

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P929248

Luminaire Tested: DFN2DIP-HX4F0-070D040US940-FLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P929248
REPORT IS A COMBINATION OF REPORTS P900825 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-070D040US940-FLLONL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9713.9 lumens
Efficiency: N/A
Efficacy: 100.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 96.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P929248

CATALOG NUMBER: DFN2DIP-HX4F0-070D040US940-FLLONL

Luminous Intensity Polar Plot

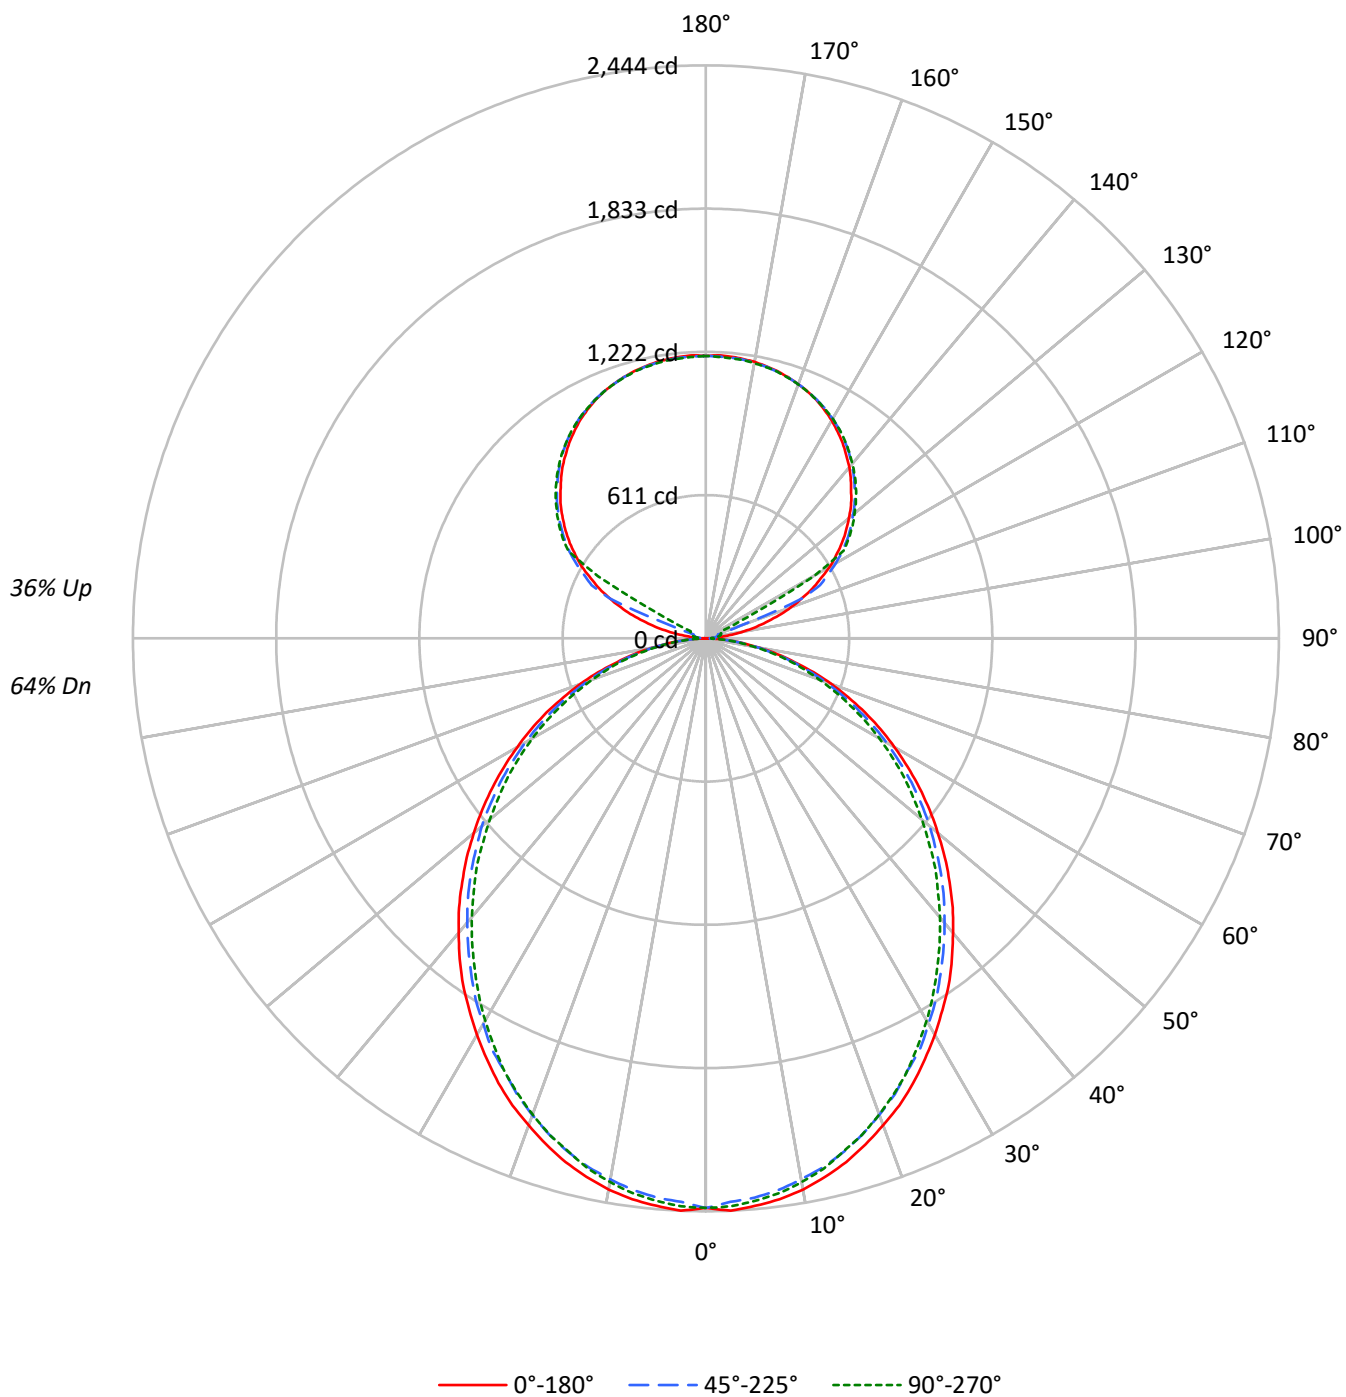

TEST NUMBER: P929248

CATALOG NUMBER: DFN2DIP-HX4F0-070D040US940-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	110	110	110	110	104	104	104	104	91	91	91		79	79	79		69
1	101	96	92	89	94	91	87	84	80	77	75		70	68	66		61
2	92	84	78	73	86	79	74	69	70	66	62		61	58	55		53
3	84	74	67	61	78	70	63	58	62	57	52		54	50	47		47
4	77	66	58	51	72	62	55	49	55	49	45		48	44	40		42
5	71	59	50	44	66	55	48	42	49	43	39		44	39	35		38
6	65	53	44	38	61	50	42	37	44	38	34		39	34	31		35
7	60	48	39	34	56	45	38	32	40	34	30		36	31	27		32
8	56	43	35	30	52	41	34	29	37	31	27		33	28	24		29
9	52	40	32	27	49	38	31	26	34	28	24		30	25	22		27
10	49	36	29	24	46	35	28	23	31	26	22		28	23	20		25

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1806	1806	1806
5°	1810	1782	1794
10°	1795	1758	1769
15°	1769	1729	1731
20°	1733	1689	1693
25°	1698	1641	1648
30°	1654	1596	1591
35°	1612	1544	1530
40°	1560	1491	1473
45°	1508	1438	1414
50°	1452	1382	1346
55°	1393	1317	1284
60°	1326	1240	1212
65°	1254	1161	1128
70°	1161	1064	1037
75°	1033	948	954
80°	879	801	793
85°	638	546	528

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1508 cd/sqm

TEST NUMBER: P929248

CATALOG NUMBER: DFN2DIP-HX4F0-070D040US940-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	228.7	2.4
10°-20°	643.4	6.6
20°-30°	945.5	9.7
30°-40°	1098.2	11.3
40°-50°	1096.8	11.3
50°-60°	956.4	9.8
60°-70°	707.0	7.3
70°-80°	400.0	4.1
80°-90°	107.7	1.1
90°-100°	39.7	0.4
100°-110°	148.0	1.5
110°-120°	392.6	4.0
120°-130°	651.1	6.7
130°-140°	691.6	7.1
140°-150°	642.8	6.6
150°-160°	516.8	5.3
160°-170°	333.0	3.4
170°-180°	114.6	1.2
0°-30°	1817.6	18.7
0°-40°	2915.8	30.0
0°-60°	4969.0	51.2
0°-90°	6183.7	63.7
90°-120°	580.3	6.0
90°-150°	2565.8	26.4
90°-180°	3530.0	36.3
0°-180°	9713.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2430	2430	2430	2430	2430	
5°	2430	2420	2395	2413	2409	231
15°	2313	2299	2268	2278	2266	651
25°	2093	2075	2035	2040	2035	963
35°	1806	1783	1745	1731	1719	1128
45°	1470	1453	1418	1392	1383	1134
55°	1112	1098	1070	1042	1030	994
65°	750	736	713	692	680	742
75°	392	388	376	362	367	419
85°	96	94	91	84	82	107
90°	1	10	17	22	24	9
95°	57	28	34	38	38	67
105°	265	291	53	63	66	283
115°	501	516	538	134	72	493
125°	708	720	736	742	745	632
135°	877	891	898	907	905	677
145°	1017	1016	1031	1037	1032	636
155°	1120	1112	1122	1128	1120	516
165°	1180	1175	1177	1183	1177	333
175°	1207	1201	1202	1208	1200	115
180°	1204	1204	1204	1204	1204	

TEST NUMBER: P929248

CATALOG NUMBER: DFN2DIP-HX4F0-070D040US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2429.5	2429.5	2429.5	2429.5	2429.5
2.5°	2443.7	2432.0	2406.3	2429.5	2425.1
5°	2429.5	2420.4	2394.7	2413.2	2408.8
7.5°	2413.2	2399.3	2373.5	2392.4	2387.7
10°	2387.7	2371.3	2343.3	2361.9	2355.0
12.5°	2352.5	2338.6	2310.6	2322.2	2317.5
15°	2312.9	2299.0	2268.4	2277.9	2266.2
17.5°	2263.7	2249.9	2219.4	2231.1	2219.4
20°	2209.9	2196.1	2163.4	2170.3	2161.1
22.5°	2156.4	2135.4	2104.9	2104.9	2100.1
25°	2093.3	2074.6	2035.0	2039.5	2035.0
27.5°	2023.1	2006.7	1976.5	1969.5	1957.9
30°	1953.2	1934.3	1899.4	1892.5	1883.0
32.5°	1878.3	1864.5	1827.0	1812.9	1803.4
35°	1805.9	1782.7	1745.2	1731.1	1719.4
37.5°	1724.1	1703.1	1665.6	1649.3	1637.6
40°	1640.1	1621.3	1583.8	1563.1	1553.6
42.5°	1558.3	1539.5	1502.3	1478.8	1464.8
45°	1469.6	1453.2	1418.0	1392.5	1383.0
47.5°	1383.0	1366.7	1329.3	1303.5	1289.7
50°	1291.9	1280.2	1247.5	1214.8	1203.1
52.5°	1203.1	1186.8	1156.6	1130.8	1114.4
55°	1112.1	1098.1	1070.0	1042.0	1030.3
57.5°	1021.0	1009.3	978.8	950.8	941.4
60°	929.7	920.5	887.9	862.1	855.2
62.5°	841.0	824.7	801.4	778.1	768.6
65°	750.1	735.9	712.6	691.6	679.9
67.5°	656.6	644.7	623.9	607.5	598.1
70°	570.1	560.7	539.6	523.2	514.1
72.5°	481.3	472.0	460.3	443.9	437.0
75°	392.4	387.9	376.0	362.2	366.9
77.5°	313.1	303.6	298.9	292.0	285.1
80°	233.7	231.3	226.6	219.6	214.9
82.5°	158.9	158.9	156.6	147.3	147.3
85°	95.7	93.5	91.3	84.0	81.8
87.5°	42.1	37.5	32.7	25.8	23.3
90°	0.8	10.4	17.4	21.9	23.5
92.5°	21.9	18.3	20.9	22.7	23.5
95°	56.6	27.8	33.9	38.4	37.5
97.5°	102.0	30.5	44.4	47.1	47.9
100°	154.2	34.9	49.7	56.6	58.3
102.5°	211.7	210.1	51.4	60.9	63.6
105°	264.8	291.1	53.2	62.7	66.2
107.5°	326.7	348.5	54.9	64.5	68.0
110°	386.1	404.3	152.5	65.4	68.8



TEST NUMBER: P929248

CATALOG NUMBER: DFN2DIP-HX4F0-070D040US940-FLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	441.8	457.4	442.6	67.1	69.8
115°	500.9	515.8	537.6	134.2	71.5
117.5°	552.4	569.8	584.7	460.0	231.7
120°	609.9	623.0	638.7	649.2	531.5
122.5°	658.7	672.7	690.1	695.3	696.2
125°	708.3	719.8	736.3	742.4	745.0
127.5°	753.7	765.9	779.0	787.7	788.5
130°	796.4	810.4	819.8	829.5	828.7
132.5°	839.9	851.3	860.9	868.7	867.9
135°	876.6	890.6	898.3	907.1	905.4
137.5°	914.8	925.3	934.1	942.8	940.2
140°	952.3	959.3	968.9	976.7	972.4
142.5°	983.8	989.9	1001.2	1008.0	1003.8
145°	1016.9	1016.0	1030.7	1036.9	1032.5
147.5°	1045.5	1042.9	1057.7	1062.1	1058.7
150°	1073.4	1067.4	1081.4	1086.5	1082.2
152.5°	1097.0	1090.0	1103.0	1108.3	1102.2
155°	1119.6	1111.9	1122.3	1127.5	1120.5
157.5°	1137.9	1131.0	1138.9	1145.0	1137.9
160°	1153.6	1148.4	1153.6	1158.8	1152.7
162.5°	1167.5	1162.4	1166.7	1172.8	1165.0
165°	1179.8	1174.6	1177.2	1183.2	1177.2
167.5°	1189.4	1184.0	1186.8	1192.9	1185.0
170°	1197.2	1192.0	1193.7	1199.8	1192.0
172.5°	1202.4	1197.2	1199.0	1205.1	1197.2
175°	1206.7	1200.6	1202.4	1208.5	1199.8
177.5°	1208.5	1202.4	1203.3	1209.5	1201.6
180°	1204.2	1204.2	1204.2	1204.2	1204.2

TEST NUMBER: P929248

CATALOG NUMBER: DFN2DIP-HX4F0-070D040US940-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.50	11.50	11.33	12.35	13.41	10.07	11.07	10.90	11.92	12.98
	3H	12.17	13.07	13.02	13.93	15.02	11.70	12.60	12.54	13.46	14.55
	4H	12.77	13.61	13.63	14.48	15.58	12.29	13.14	13.15	14.01	15.11
	6H	13.17	13.96	14.05	14.83	15.95	12.70	13.48	13.57	14.36	15.47
	8H	13.28	14.03	14.16	14.92	16.04	12.81	13.55	13.69	14.45	15.56
	12H	13.34	14.05	14.22	14.93	16.07	12.86	13.57	13.74	14.45	15.59
4H	2H	10.98	11.83	11.84	12.70	13.80	10.63	11.48	11.50	12.35	13.45
	3H	12.86	13.57	13.73	14.47	15.58	12.47	13.17	13.34	14.07	15.19
	4H	13.58	14.22	14.47	15.12	16.26	13.17	13.82	14.06	14.72	15.86
	6H	14.10	14.66	15.01	15.58	16.73	13.69	14.25	14.60	15.17	16.32
	8H	14.26	14.78	15.16	15.69	16.85	13.84	14.37	14.75	15.28	16.44
	12H	14.34	14.81	15.26	15.74	16.90	13.92	14.38	14.84	15.32	16.48
8H	4H	13.79	14.31	14.69	15.23	16.38	13.43	13.95	14.33	14.86	16.02
	6H	14.43	14.86	15.36	15.82	16.97	14.06	14.49	15.00	15.45	16.61
	8H	14.65	15.03	15.59	15.98	17.15	14.28	14.66	15.22	15.61	16.79
	12H	14.79	15.12	15.73	16.07	17.29	14.40	14.74	15.35	15.68	16.91
12H	4H	13.78	14.25	14.71	15.19	16.35	13.43	13.90	14.35	14.83	16.00
	6H	14.46	14.84	15.40	15.79	16.96	14.11	14.49	15.05	15.44	16.61
	8H	14.71	15.04	15.65	15.99	17.21	14.35	14.69	15.30	15.63	16.85

END OF REPORT