

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921876

Luminaire Tested: DFN2DIP-HX4F0-090D060US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921876
REPORT IS A COMBINATION OF REPORTS P899345 AND P896188
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-090D060US940-FLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 12680.1 lumens
Efficiency: N/A
Efficacy: 103.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 122.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921876
CATALOG NUMBER: DFN2DIP-HX4F0-090D060US940-FLLFLL

Luminous Intensity Polar Plot

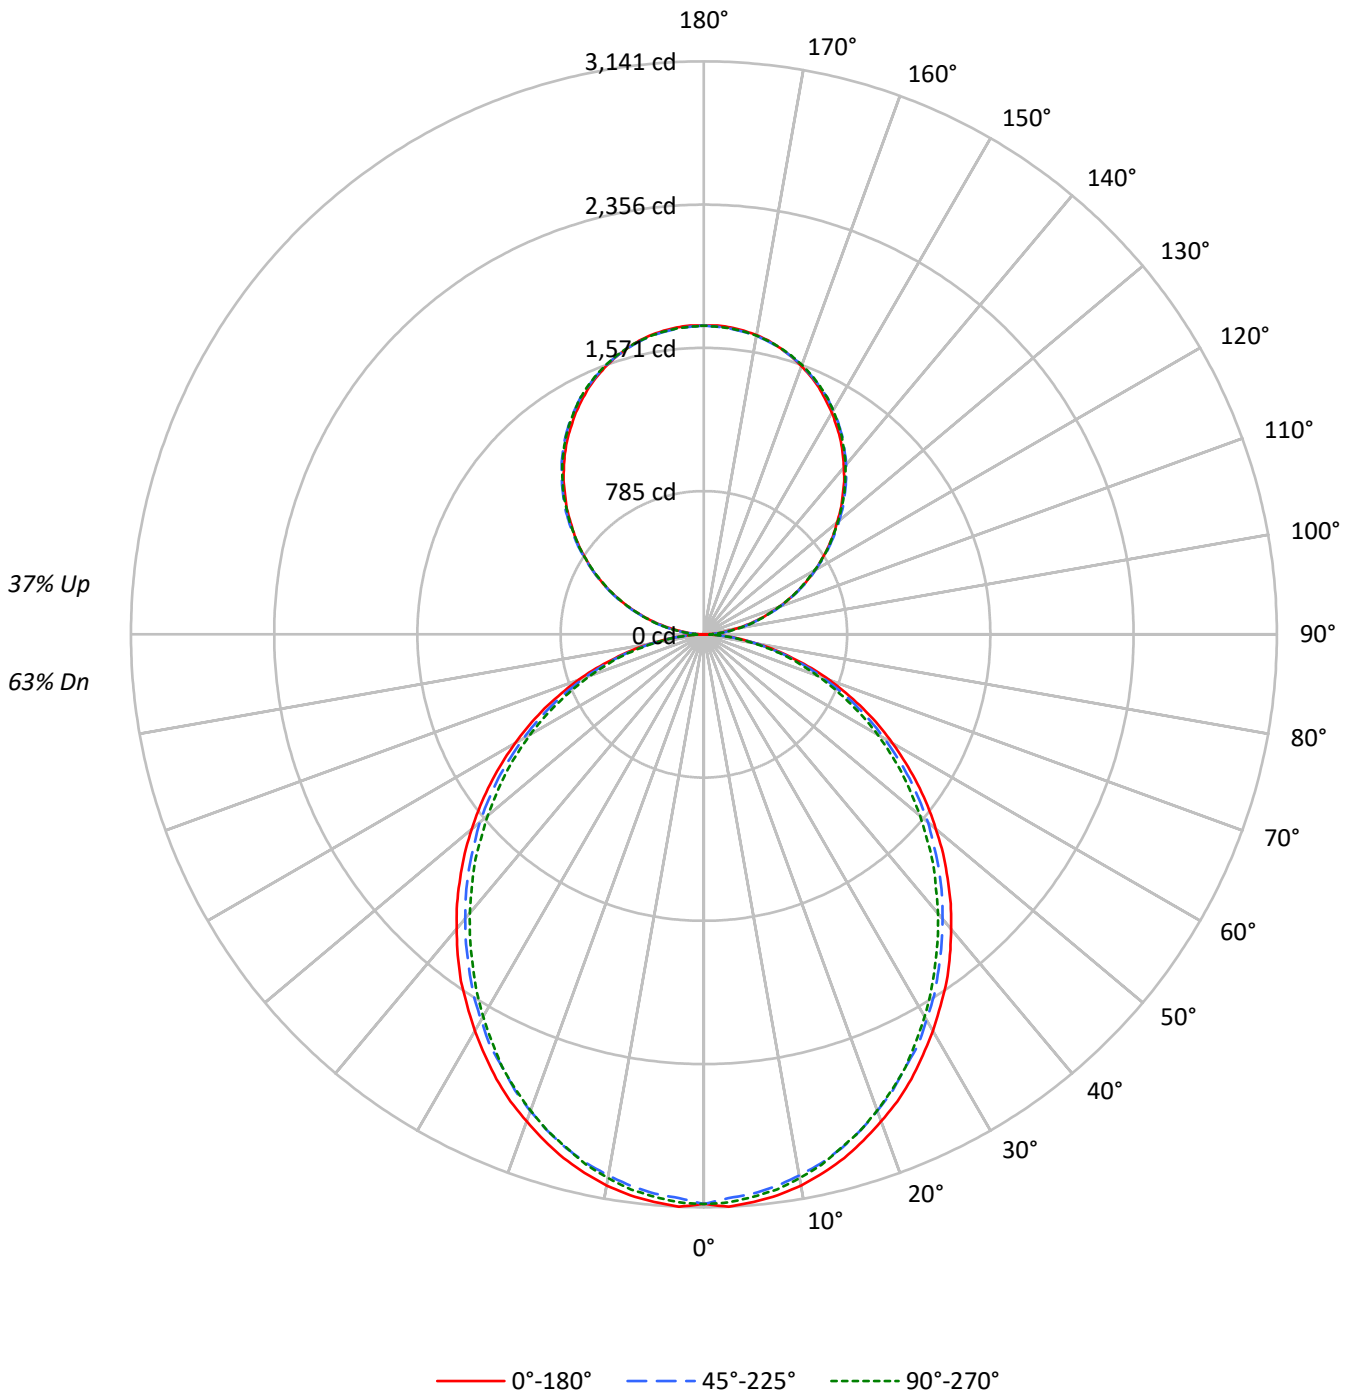



TEST NUMBER: P921876

CATALOG NUMBER: DFN2DIP-HX4F0-090D060US940-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	110	110	110	110	103	103	103	103	90	90	90	79	79	79	68	68	68	68	68	68	63
1	101	96	92	89	94	90	87	84	79	77	74	69	67	66	60	59	57	60	59	57	53
2	92	84	78	72	86	79	73	69	70	65	62	61	58	55	53	50	48	53	50	48	44
3	84	74	66	60	78	70	63	58	61	56	52	54	50	46	47	44	41	47	44	41	37
4	77	66	57	51	71	62	54	49	55	49	44	48	43	40	42	38	35	42	38	35	32
5	70	58	50	44	66	55	48	42	49	43	38	43	38	35	38	34	31	38	34	31	28
6	65	53	44	38	61	50	42	37	44	38	33	39	34	30	34	30	27	34	30	27	25
7	60	48	39	34	56	45	38	32	40	34	30	36	31	27	31	27	24	31	27	24	22
8	56	43	35	30	52	41	34	29	37	31	26	33	28	24	29	25	22	29	25	22	20
9	52	40	32	27	49	38	30	26	34	28	24	30	25	22	27	23	20	27	23	20	18
10	49	36	29	24	46	35	28	23	31	25	21	28	23	20	25	21	18	25	21	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2322	2322	2322
5°	2326	2290	2305
10°	2307	2259	2274
15°	2273	2222	2225
20°	2228	2171	2176
25°	2182	2109	2118
30°	2125	2052	2045
35°	2072	1984	1967
40°	2005	1916	1893
45°	1939	1848	1818
50°	1866	1776	1731
55°	1791	1693	1650
60°	1705	1594	1558
65°	1612	1492	1450
70°	1493	1368	1333
75°	1328	1219	1225
80°	1130	1029	1020
85°	820	702	678

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 1939 cd/sqm



TEST NUMBER: P921876

CATALOG NUMBER: DFN2DIP-HX4F0-090D060US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	293.9	2.3
10°-20°	827.0	6.5
20°-30°	1215.3	9.6
30°-40°	1411.5	11.1
40°-50°	1409.7	11.1
50°-60°	1229.3	9.7
60°-70°	908.7	7.2
70°-80°	514.1	4.1
80°-90°	140.5	1.1
90°-100°	104.7	0.8
100°-110°	332.7	2.6
110°-120°	569.3	4.5
120°-130°	748.8	5.9
130°-140°	840.5	6.6
140°-150°	824.2	6.5
150°-160°	691.4	5.5
160°-170°	458.5	3.6
170°-180°	160.3	1.3
0°-30°	2336.2	18.4
0°-40°	3747.7	29.6
0°-60°	6386.7	50.4
0°-90°	7950.0	62.7
90°-120°	1006.7	7.9
90°-150°	3420.1	27.0
90°-180°	4730.0	37.3
0°-180°	12680.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3123	3123	3123	3123	3123	
5°	3123	3111	3078	3102	3096	296
15°	2973	2955	2916	2928	2913	837
25°	2690	2666	2616	2621	2616	1238
35°	2321	2291	2243	2225	2210	1449
45°	1889	1868	1823	1790	1778	1458
55°	1430	1411	1375	1339	1324	1278
65°	964	946	916	889	874	953
75°	504	499	483	466	472	538
85°	123	120	117	108	105	137
90°	2	18	50	47	48	12
95°	74	89	91	91	89	83
105°	307	311	314	317	317	324
115°	571	580	577	575	571	565
125°	831	844	840	835	834	743
135°	1075	1091	1094	1092	1088	831
145°	1305	1315	1323	1325	1319	815
155°	1492	1496	1501	1508	1503	687
165°	1623	1622	1622	1632	1625	458
175°	1689	1685	1682	1692	1683	160
180°	1692	1692	1692	1692	1692	



TEST NUMBER: P921876

CATALOG NUMBER: DFN2DIP-HX4F0-090D060US940-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3122.7	3122.7	3122.7	3122.7	3122.7
2.5°	3140.9	3125.9	3092.8	3122.7	3117.0
5°	3122.7	3110.9	3077.8	3101.7	3095.9
7.5°	3101.7	3083.9	3050.7	3075.0	3068.9
10°	3068.9	3047.9	3011.8	3035.7	3026.8
12.5°	3023.6	3005.8	2969.8	2984.7	2978.8
15°	2972.7	2954.9	2915.6	2927.8	2912.8
17.5°	2909.6	2891.7	2852.6	2867.6	2852.6
20°	2840.5	2822.6	2780.5	2789.4	2777.7
22.5°	2771.6	2744.6	2705.4	2705.4	2699.3
25°	2690.4	2666.5	2615.6	2621.3	2615.6
27.5°	2600.2	2579.2	2540.4	2531.5	2516.5
30°	2510.4	2486.2	2441.2	2432.3	2420.3
32.5°	2414.2	2396.4	2348.2	2330.1	2318.0
35°	2321.2	2291.2	2243.1	2225.0	2210.0
37.5°	2216.1	2189.0	2140.8	2119.9	2104.9
40°	2108.0	2083.8	2035.7	2008.9	1996.9
42.5°	2002.9	1978.7	1930.9	1900.7	1882.8
45°	1888.8	1867.9	1822.6	1789.8	1777.7
47.5°	1777.7	1756.7	1708.5	1675.4	1657.6
50°	1660.5	1645.5	1603.4	1561.4	1546.4
52.5°	1546.4	1525.4	1486.5	1453.4	1432.4
55°	1429.5	1411.3	1375.3	1339.3	1324.4
57.5°	1312.2	1297.3	1258.1	1222.1	1210.0
60°	1195.0	1183.2	1141.1	1108.0	1099.1
62.5°	1080.9	1059.9	1029.9	1000.1	987.9
65°	964.0	945.8	915.9	888.9	873.9
67.5°	843.9	828.7	801.8	780.9	768.7
70°	732.7	720.6	693.6	672.5	660.8
72.5°	618.7	606.5	591.6	570.6	561.7
75°	504.4	498.6	483.3	465.5	471.5
77.5°	402.3	390.3	384.2	375.3	366.4
80°	300.4	297.2	291.1	282.2	276.3
82.5°	204.2	204.2	201.3	189.2	189.2
85°	123.0	120.1	117.3	108.0	105.1
87.5°	54.1	48.1	42.1	33.2	30.0
90°	1.5	18.4	50.0	46.9	48.4
92.5°	31.7	42.9	44.4	45.9	45.9
95°	74.5	88.7	91.3	91.3	88.7
97.5°	123.9	137.2	142.9	142.9	142.9
100°	181.1	192.8	196.9	196.9	195.4
102.5°	241.3	249.9	255.6	257.1	255.6
105°	307.1	311.2	314.2	316.8	316.8
107.5°	372.4	378.5	378.5	379.5	372.4
110°	435.7	443.8	443.8	443.8	439.7



TEST NUMBER: P921876

CATALOG NUMBER: DFN2DIP-HX4F0-090D060US940-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	504.0	512.6	511.1	507.0	504.0
115°	571.3	579.5	576.9	575.4	571.3
117.5°	638.2	649.4	642.2	638.2	634.1
120°	705.5	716.8	705.5	705.5	700.9
122.5°	766.7	781.0	773.8	769.8	766.7
125°	831.0	843.7	839.6	835.1	833.6
127.5°	893.8	909.5	903.9	897.9	893.8
130°	952.4	970.8	968.2	965.2	959.6
132.5°	1018.2	1032.5	1033.5	1026.4	1022.3
135°	1074.9	1090.7	1093.7	1092.2	1088.1
137.5°	1138.1	1150.8	1153.4	1152.4	1146.3
140°	1193.7	1206.5	1213.6	1213.6	1208.0
142.5°	1250.8	1263.6	1267.7	1269.2	1263.6
145°	1304.9	1315.1	1323.3	1324.8	1319.2
147.5°	1353.3	1366.1	1372.3	1374.7	1369.1
150°	1403.4	1412.0	1417.6	1422.2	1417.6
152.5°	1447.7	1456.4	1463.6	1469.2	1463.6
155°	1492.1	1496.2	1500.7	1508.0	1503.3
157.5°	1530.4	1533.5	1536.0	1546.2	1539.1
160°	1564.6	1567.6	1569.1	1577.8	1571.7
162.5°	1596.2	1596.2	1597.7	1607.4	1600.3
165°	1623.2	1621.7	1621.7	1631.9	1624.8
167.5°	1647.7	1643.2	1643.2	1653.3	1646.2
170°	1666.1	1662.0	1660.5	1670.6	1662.0
172.5°	1678.8	1674.7	1673.2	1683.4	1674.7
175°	1689.0	1685.0	1681.9	1692.1	1683.4
177.5°	1694.6	1690.6	1687.5	1696.1	1687.5
180°	1692.1	1692.1	1692.1	1692.1	1692.1



TEST NUMBER: P921876
 CATALOG NUMBER: DFN2DIP-HX4F0-090D060US940-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.29	12.28	12.13	13.14	14.22	10.86	11.85	11.70	12.71	13.79
	3H	12.96	13.85	13.82	14.72	15.83	12.49	13.38	13.34	14.25	15.36
	4H	13.56	14.40	14.43	15.28	16.39	13.09	13.92	13.95	14.80	15.92
	6H	13.97	14.74	14.85	15.62	16.75	13.49	14.26	14.37	15.15	16.28
	8H	14.07	14.81	14.96	15.71	16.84	13.60	14.34	14.49	15.24	16.37
	12H	14.13	14.83	15.02	15.73	16.88	13.65	14.35	14.54	15.25	16.40
4H	2H	11.77	12.61	12.65	13.49	14.60	11.43	12.27	12.30	13.14	14.26
	3H	13.65	14.35	14.53	15.26	16.39	13.26	13.96	14.14	14.87	16.00
	4H	14.37	15.01	15.27	15.92	17.07	13.96	14.60	14.86	15.51	16.67
	6H	14.89	15.45	15.81	16.38	17.53	14.48	15.04	15.40	15.97	17.12
	8H	15.05	15.56	15.96	16.49	17.66	14.63	15.15	15.55	16.07	17.25
	12H	15.13	15.59	16.06	16.53	17.71	14.70	15.17	15.64	16.11	17.29
8H	4H	14.58	15.09	15.49	16.02	17.19	14.22	14.73	15.13	15.66	16.83
	6H	15.22	15.64	16.16	16.61	17.78	14.85	15.28	15.79	16.25	17.42
	8H	15.44	15.82	16.39	16.77	17.96	15.07	15.45	16.02	16.40	17.59
	12H	15.58	15.91	16.53	16.86	18.10	15.19	15.52	16.15	16.48	17.71
12H	4H	14.57	15.03	15.50	15.98	17.16	14.22	14.68	15.15	15.63	16.80
	6H	15.25	15.63	16.20	16.58	17.77	14.90	15.27	15.85	16.23	17.42
	8H	15.50	15.83	16.45	16.78	18.02	15.14	15.47	16.09	16.42	17.66