

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P929394

Luminaire Tested: DFN2DIP-HX4F0-110D040US940-RLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P929394
REPORT IS A COMBINATION OF REPORTS P900834 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-110D040US940-RLLONL
Description: 4 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11872.6 lumens
Efficiency: N/A
Efficacy: 83.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 142.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9967
Total Harmonic Distortion (THDi): 0.063
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P929394

CATALOG NUMBER: DFN2DIP-HX4F0-110D040US940-RLLONL

Luminous Intensity Polar Plot

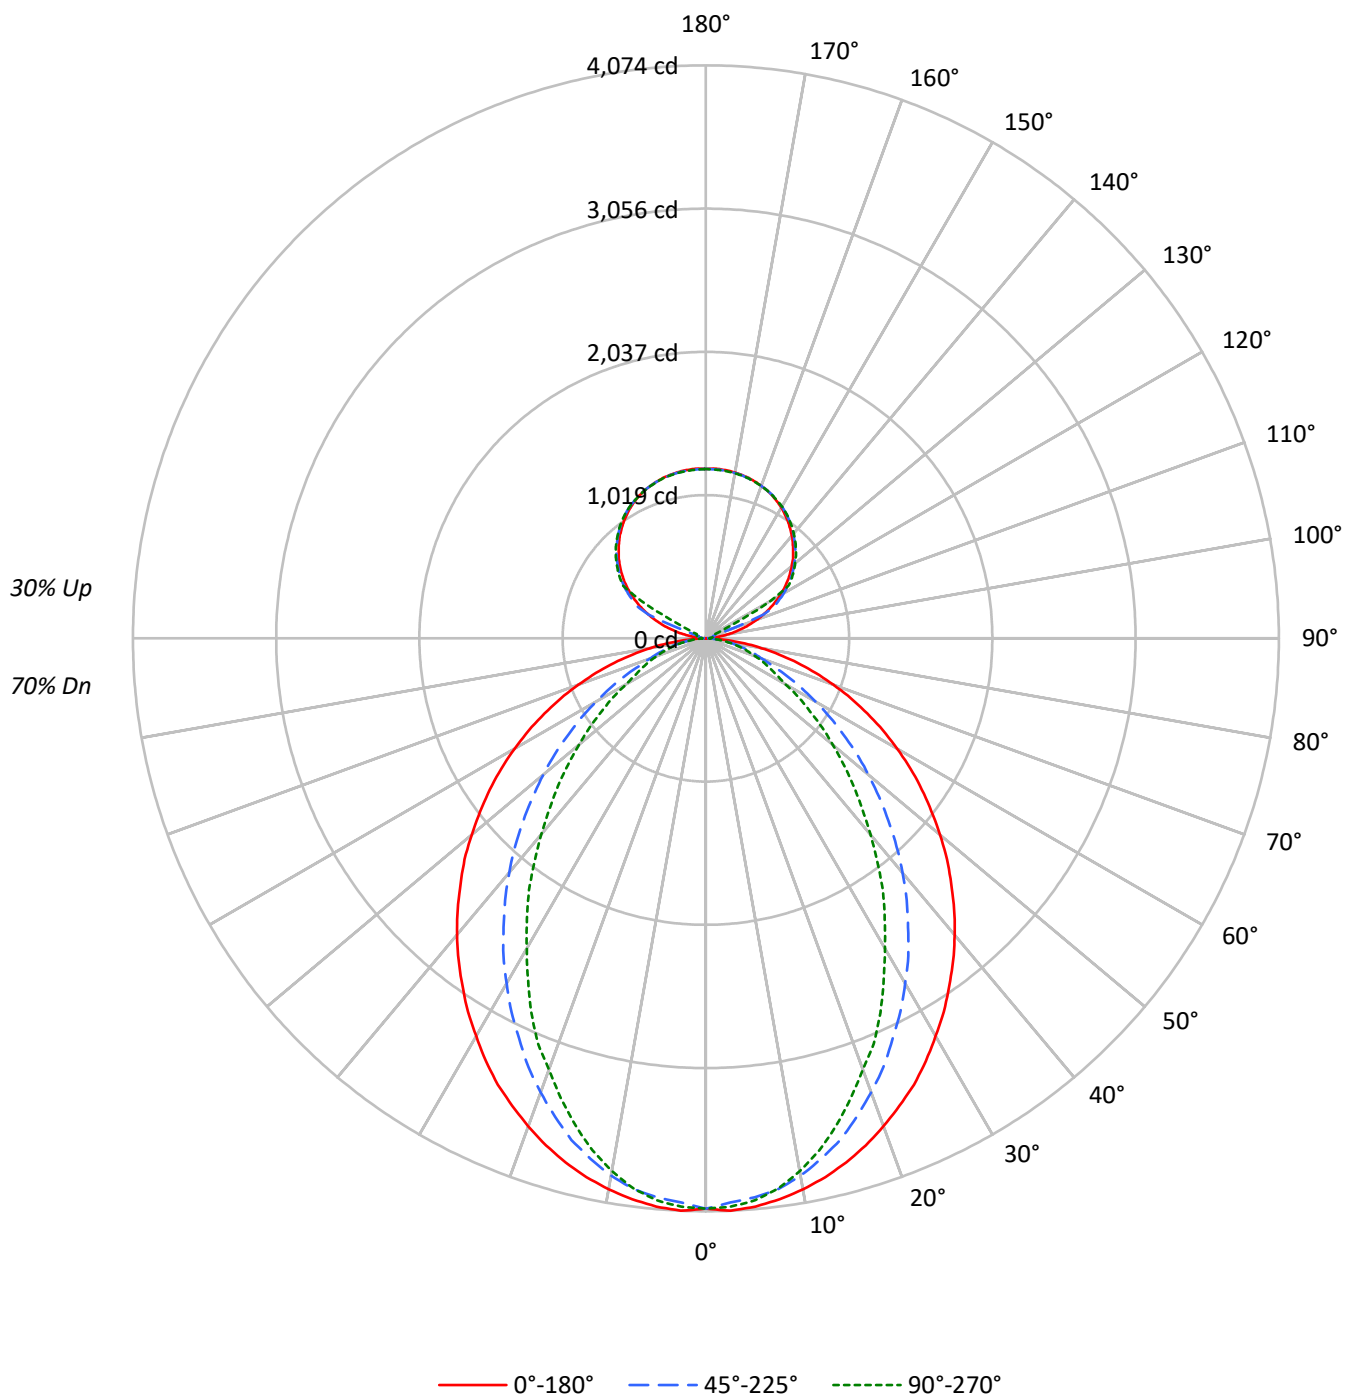

TEST NUMBER: P929394

CATALOG NUMBER: DFN2DIP-HX4F0-110D040US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	95	95	95	84	84	84	75	75	75
1	103	99	95	92	97	94	90	87	84	82	79	75	73	72	67	66	64
2	94	87	81	76	89	83	77	73	75	70	67	67	64	61	60	58	55
3	87	77	70	64	82	73	67	62	66	61	57	60	56	52	54	51	48
4	80	69	61	55	75	66	59	53	60	54	49	54	49	46	48	45	42
5	73	62	54	48	69	59	52	46	54	48	43	49	44	40	44	40	37
6	68	56	48	42	64	53	46	41	49	43	38	44	39	35	40	36	33
7	63	51	43	37	60	49	41	36	44	38	34	41	36	32	37	33	30
8	59	46	39	33	56	45	37	32	41	35	30	37	32	29	34	30	27
9	55	43	35	30	52	41	34	29	38	32	28	35	30	26	32	27	24
10	52	39	32	27	49	38	31	27	35	29	25	32	27	24	29	25	22

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3015	3015	3015
5°	3020	2968	2987
10°	2991	2910	2890
15°	2950	2814	2740
20°	2896	2682	2555
25°	2840	2533	2377
30°	2765	2381	2152
35°	2692	2218	1953
40°	2618	2048	1726
45°	2532	1860	1520
50°	2442	1671	1319
55°	2349	1468	1125
60°	2241	1256	926
65°	2117	1040	834
70°	1966	839	755
75°	1778	740	687
80°	1504	622	596
85°	1051	417	450

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2532 cd/sqm

TEST NUMBER: P929394

CATALOG NUMBER: DFN2DIP-HX4F0-110D040US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	380.1	3.2
10°-20°	1043.4	8.8
20°-30°	1464.8	12.3
30°-40°	1596.8	13.4
40°-50°	1467.6	12.4
50°-60°	1152.6	9.7
60°-70°	750.2	6.3
70°-80°	386.2	3.3
80°-90°	100.7	0.8
90°-100°	39.7	0.3
100°-110°	148.0	1.2
110°-120°	392.6	3.3
120°-130°	651.1	5.5
130°-140°	691.6	5.8
140°-150°	642.8	5.4
150°-160°	516.8	4.4
160°-170°	333.0	2.8
170°-180°	114.6	1.0
0°-30°	2888.3	24.3
0°-40°	4485.0	37.8
0°-60°	7105.2	59.8
0°-90°	8342.3	70.3
90°-120°	580.3	4.9
90°-150°	2565.8	21.6
90°-180°	3530.0	29.7
0°-180°	11872.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4055	4055	4055	4055	4055	
5°	4055	4037	3989	4022	4011	385
15°	3857	3817	3692	3622	3586	1087
25°	3501	3384	3141	2991	2936	1610
35°	3017	2830	2507	2276	2194	1888
45°	2466	2220	1835	1574	1486	1905
55°	1875	1589	1193	973	903	1676
65°	1266	969	639	514	503	1255
75°	675	418	294	268	264	714
85°	158	81	70	70	70	181
90°	1	10	17	22	24	11
95°	57	28	34	38	38	67
105°	265	291	53	63	66	283
115°	501	516	538	134	72	493
125°	708	720	736	742	745	632
135°	877	891	898	907	905	677
145°	1017	1016	1031	1037	1032	636
155°	1120	1112	1122	1128	1120	516
165°	1180	1175	1177	1183	1177	333
175°	1207	1201	1202	1208	1200	115
180°	1204	1204	1204	1204	1204	



TEST NUMBER: P929394

CATALOG NUMBER: DFN2DIP-HX4F0-110D040US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4055.3	4055.3	4055.3	4055.3	4055.3
2.5°	4073.6	4055.3	4014.8	4051.8	4044.4
5°	4055.3	4037.0	3989.1	4022.2	4011.3
7.5°	4022.2	4000.4	3949.0	3963.4	3945.0
10°	3978.2	3952.5	3879.3	3868.0	3846.2
12.5°	3923.3	3890.2	3790.9	3769.1	3728.6
15°	3857.1	3816.6	3692.0	3622.3	3585.7
17.5°	3780.0	3721.2	3567.0	3486.4	3427.6
20°	3692.0	3618.4	3435.0	3343.5	3262.5
22.5°	3596.6	3512.1	3299.2	3174.5	3119.6
25°	3501.2	3383.6	3141.4	2991.1	2935.8
27.5°	3387.5	3262.5	2994.6	2822.1	2737.6
30°	3266.4	3126.6	2833.1	2646.1	2546.8
32.5°	3148.8	2979.8	2679.2	2458.9	2367.0
35°	3016.8	2829.5	2506.8	2275.5	2194.5
37.5°	2888.4	2686.3	2345.2	2091.7	2000.2
40°	2752.4	2532.5	2176.2	1915.7	1820.3
42.5°	2613.0	2378.3	2007.6	1735.8	1644.3
45°	2466.3	2220.2	1835.1	1574.2	1486.3
47.5°	2326.9	2066.4	1670.0	1409.1	1328.5
50°	2172.6	1912.2	1508.5	1255.0	1178.2
52.5°	2022.0	1746.7	1354.2	1112.1	1042.3
55°	1875.2	1589.0	1192.6	972.6	903.0
57.5°	1724.9	1431.3	1049.7	844.2	785.3
60°	1570.7	1277.2	899.0	712.2	653.4
62.5°	1420.4	1126.9	770.6	594.6	565.3
65°	1266.2	968.7	638.6	514.0	502.6
67.5°	1119.5	822.0	514.0	451.3	440.4
70°	965.2	679.1	425.6	389.0	374.2
72.5°	818.4	546.7	355.9	326.7	319.2
75°	675.2	418.2	293.6	267.9	264.4
77.5°	532.3	297.1	231.3	216.5	209.1
80°	399.9	213.0	176.0	161.6	161.6
82.5°	278.8	143.3	121.1	113.7	113.7
85°	157.7	80.6	69.7	69.7	69.7
87.5°	58.8	29.2	29.2	25.7	25.7
90°	0.8	10.4	17.4	21.9	23.5
92.5°	21.9	18.3	20.9	22.7	23.5
95°	56.6	27.8	33.9	38.4	37.5
97.5°	102.0	30.5	44.4	47.1	47.9
100°	154.2	34.9	49.7	56.6	58.3
102.5°	211.7	210.1	51.4	60.9	63.6
105°	264.8	291.1	53.2	62.7	66.2
107.5°	326.7	348.5	54.9	64.5	68.0
110°	386.1	404.3	152.5	65.4	68.8

TEST NUMBER: P929394

CATALOG NUMBER: DFN2DIP-HX4F0-110D040US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	441.8	457.4	442.6	67.1	69.8
115°	500.9	515.8	537.6	134.2	71.5
117.5°	552.4	569.8	584.7	460.0	231.7
120°	609.9	623.0	638.7	649.2	531.5
122.5°	658.7	672.7	690.1	695.3	696.2
125°	708.3	719.8	736.3	742.4	745.0
127.5°	753.7	765.9	779.0	787.7	788.5
130°	796.4	810.4	819.8	829.5	828.7
132.5°	839.9	851.3	860.9	868.7	867.9
135°	876.6	890.6	898.3	907.1	905.4
137.5°	914.8	925.3	934.1	942.8	940.2
140°	952.3	959.3	968.9	976.7	972.4
142.5°	983.8	989.9	1001.2	1008.0	1003.8
145°	1016.9	1016.0	1030.7	1036.9	1032.5
147.5°	1045.5	1042.9	1057.7	1062.1	1058.7
150°	1073.4	1067.4	1081.4	1086.5	1082.2
152.5°	1097.0	1090.0	1103.0	1108.3	1102.2
155°	1119.6	1111.9	1122.3	1127.5	1120.5
157.5°	1137.9	1131.0	1138.9	1145.0	1137.9
160°	1153.6	1148.4	1153.6	1158.8	1152.7
162.5°	1167.5	1162.4	1166.7	1172.8	1165.0
165°	1179.8	1174.6	1177.2	1183.2	1177.2
167.5°	1189.4	1184.0	1186.8	1192.9	1185.0
170°	1197.2	1192.0	1193.7	1199.8	1192.0
172.5°	1202.4	1197.2	1199.0	1205.1	1197.2
175°	1206.7	1200.6	1202.4	1208.5	1199.8
177.5°	1208.5	1202.4	1203.3	1209.5	1201.6
180°	1204.2	1204.2	1204.2	1204.2	1204.2

TEST NUMBER: P929394

CATALOG NUMBER: DFN2DIP-HX4F0-110D040US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.70	13.72	13.46	14.51	15.46	8.67	9.70	9.44	10.48	11.44
	3H	14.39	15.31	15.17	16.10	17.09	9.87	10.80	10.66	11.59	12.57
	4H	15.01	15.87	15.81	16.68	17.67	10.34	11.20	11.14	12.01	13.00
	6H	15.44	16.24	16.25	17.05	18.06	10.67	11.47	11.48	12.28	13.29
	8H	15.57	16.33	16.39	17.16	18.17	10.77	11.52	11.59	12.36	13.36
	12H	15.64	16.37	16.47	17.19	18.22	10.82	11.54	11.64	12.36	13.40
4H	2H	12.74	13.61	13.54	14.41	15.40	9.29	10.16	10.09	10.96	11.95
	3H	14.59	15.31	15.40	16.15	17.15	10.66	11.38	11.47	12.22	13.23
	4H	15.29	15.94	16.12	16.78	17.82	11.22	11.87	12.05	12.71	13.74
	6H	15.81	16.38	16.66	17.24	18.28	11.65	12.21	12.49	13.07	14.12
	8H	15.99	16.52	16.84	17.38	18.43	11.78	12.31	12.63	13.16	14.22
	12H	16.10	16.57	16.97	17.45	18.51	11.86	12.33	12.73	13.21	14.27
8H	4H	15.27	15.80	16.12	16.65	17.71	11.51	12.04	12.36	12.89	13.95
	6H	15.84	16.28	16.72	17.18	18.23	12.04	12.47	12.92	13.37	14.43
	8H	16.06	16.45	16.95	17.34	18.41	12.23	12.62	13.12	13.51	14.58
	12H	16.21	16.55	17.10	17.44	18.56	12.36	12.70	13.25	13.59	14.71
12H	4H	15.23	15.70	16.10	16.58	17.64	11.53	12.00	12.39	12.88	13.94
	6H	15.82	16.21	16.71	17.10	18.17	12.09	12.48	12.98	13.37	14.44
	8H	16.05	16.39	16.94	17.28	18.40	12.31	12.65	13.20	13.53	14.66

END OF REPORT