

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921912

Luminaire Tested: DFN2DIP-HX4F0-110D060US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921912
REPORT IS A COMBINATION OF REPORTS P899349 AND P896188
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-110D060US940-FLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14445.7 lumens
Efficiency: N/A
Efficacy: 98.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 146.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9967
Total Harmonic Distortion (THDi): 0.063
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921912

CATALOG NUMBER: DFN2DIP-HX4F0-110D060US940-FLLFLL

Luminous Intensity Polar Plot

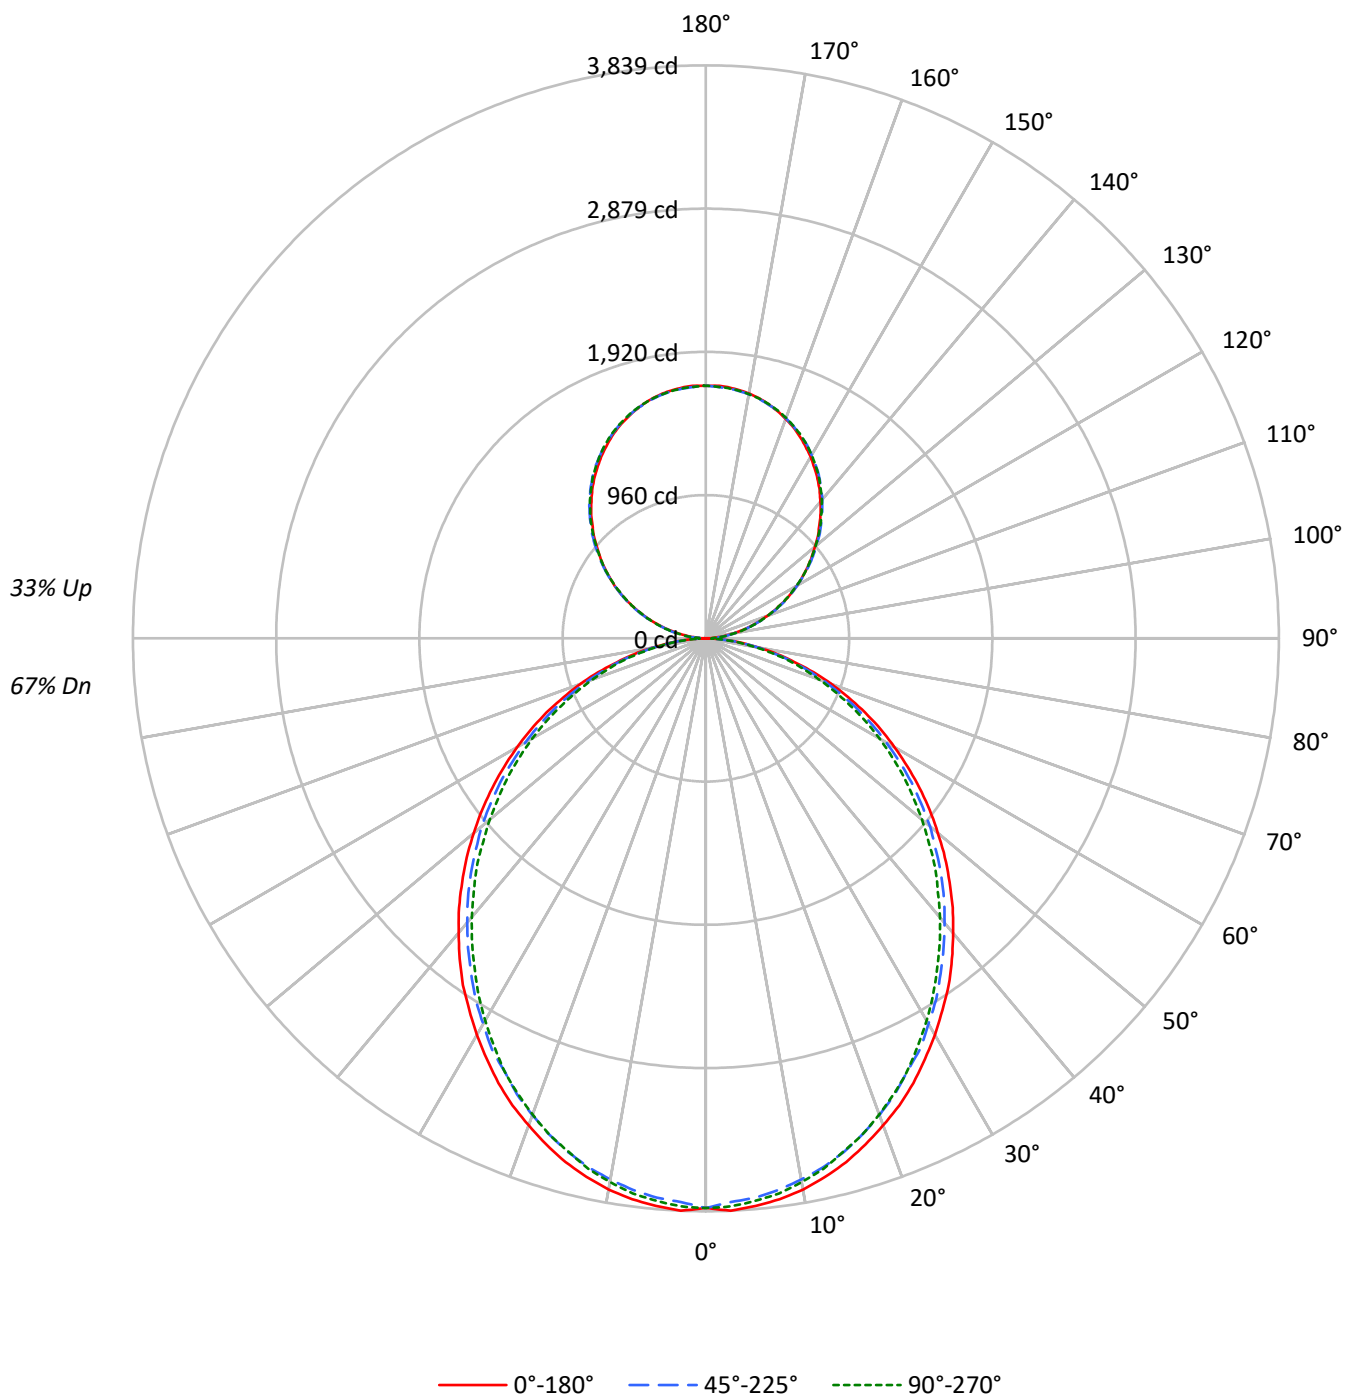

TEST NUMBER: P921912

CATALOG NUMBER: DFN2DIP-HX4F0-110D060US940-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	111	111	111	111	105	105	105	105	93	93	93		82	82	82		72
1	102	97	93	90	96	92	88	85	82	79	76		72	70	68		64
2	93	85	79	73	87	80	75	70	72	67	63		63	60	57		56
3	85	75	67	61	79	71	64	58	63	58	53		56	52	48		50
4	77	66	58	52	73	63	55	50	56	50	46		50	45	42		44
5	71	59	51	45	67	56	49	43	50	44	39		45	40	36		40
6	66	53	45	39	62	51	43	37	45	39	35		41	36	32		36
7	61	48	40	34	57	46	38	33	41	35	31		37	32	28		33
8	56	44	36	30	53	42	34	29	38	32	27		34	29	25		31
9	53	40	32	27	50	38	31	26	35	29	24		31	26	23		28
10	49	37	29	24	46	35	28	24	32	26	22		29	24	21		26

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2838	2838	2838
5°	2843	2799	2817
10°	2820	2761	2779
15°	2779	2716	2720
20°	2723	2653	2659
25°	2667	2578	2589
30°	2598	2508	2499
35°	2532	2425	2404
40°	2451	2342	2314
45°	2370	2258	2222
50°	2281	2171	2115
55°	2188	2069	2017
60°	2084	1948	1905
65°	1970	1824	1772
70°	1824	1672	1629
75°	1623	1490	1498
80°	1381	1258	1246
85°	1002	857	829

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2370 cd/sqm

TEST NUMBER: P921912

CATALOG NUMBER: DFN2DIP-HX4F0-110D060US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	359.2	2.5
10°-20°	1010.7	7.0
20°-30°	1485.4	10.3
30°-40°	1725.2	11.9
40°-50°	1723.0	11.9
50°-60°	1502.4	10.4
60°-70°	1110.6	7.7
70°-80°	628.4	4.3
80°-90°	170.7	1.2
90°-100°	104.7	0.7
100°-110°	332.7	2.3
110°-120°	569.3	3.9
120°-130°	748.8	5.2
130°-140°	840.5	5.8
140°-150°	824.2	5.7
150°-160°	691.4	4.8
160°-170°	458.5	3.2
170°-180°	160.3	1.1
0°-30°	2855.3	19.8
0°-40°	4580.5	31.7
0°-60°	7805.9	54.0
0°-90°	9715.6	67.3
90°-120°	1006.7	7.0
90°-150°	3420.1	23.7
90°-180°	4730.0	32.7
0°-180°	14445.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3817	3817	3817	3817	3817	
5°	3817	3802	3762	3791	3784	362
15°	3633	3611	3564	3578	3560	1023
25°	3288	3259	3197	3204	3197	1513
35°	2837	2800	2742	2719	2701	1772
45°	2309	2283	2228	2188	2173	1782
55°	1747	1725	1681	1637	1619	1562
65°	1178	1156	1120	1086	1068	1165
75°	616	609	591	569	576	658
85°	150	147	143	132	128	168
90°	2	18	50	47	48	14
95°	74	89	91	91	89	83
105°	307	311	314	317	317	324
115°	571	580	577	575	571	565
125°	831	844	840	835	834	743
135°	1075	1091	1094	1092	1088	831
145°	1305	1315	1323	1325	1319	815
155°	1492	1496	1501	1508	1503	687
165°	1623	1622	1622	1632	1625	458
175°	1689	1685	1682	1692	1683	160
180°	1692	1692	1692	1692	1692	

TEST NUMBER: P921912

CATALOG NUMBER: DFN2DIP-HX4F0-110D060US940-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3816.7	3816.7	3816.7	3816.7	3816.7
2.5°	3838.8	3820.5	3780.0	3816.7	3809.7
5°	3816.7	3802.3	3761.8	3790.9	3784.0
7.5°	3790.9	3769.2	3728.7	3758.3	3750.9
10°	3750.9	3725.1	3681.2	3710.3	3699.4
12.5°	3695.6	3673.8	3629.8	3648.1	3640.7
15°	3633.3	3611.4	3563.5	3578.3	3560.1
17.5°	3556.1	3534.4	3486.5	3504.8	3486.5
20°	3471.7	3449.8	3398.5	3409.4	3395.0
22.5°	3387.6	3354.4	3306.6	3306.6	3299.1
25°	3288.3	3259.1	3196.8	3203.8	3196.8
27.5°	3178.1	3152.4	3104.8	3094.0	3075.7
30°	3068.3	3038.7	2983.8	2972.9	2958.1
32.5°	2950.7	2928.9	2870.1	2847.9	2833.1
35°	2837.0	2800.4	2741.6	2719.4	2701.1
37.5°	2708.5	2675.4	2616.6	2590.9	2572.6
40°	2576.5	2546.9	2488.1	2455.4	2440.6
42.5°	2448.0	2418.4	2360.0	2323.0	2301.2
45°	2308.6	2282.9	2227.6	2187.5	2172.7
47.5°	2172.7	2147.1	2088.2	2047.7	2025.9
50°	2029.4	2011.2	1959.7	1908.3	1890.1
52.5°	1890.1	1864.3	1816.9	1776.3	1750.6
55°	1747.1	1724.9	1681.0	1636.9	1618.6
57.5°	1603.8	1585.6	1537.7	1493.6	1478.8
60°	1460.5	1446.2	1394.7	1354.2	1343.4
62.5°	1321.2	1295.5	1258.8	1222.3	1207.5
65°	1178.2	1156.0	1119.5	1086.4	1068.1
67.5°	1031.4	1012.8	980.1	954.4	939.6
70°	895.5	880.7	847.7	822.0	807.5
72.5°	756.2	741.4	723.1	697.4	686.4
75°	616.4	609.4	590.7	568.9	576.3
77.5°	491.8	477.0	469.6	458.7	447.8
80°	367.2	363.3	355.9	345.0	337.6
82.5°	249.6	249.6	246.1	231.3	231.3
85°	150.3	146.8	143.3	132.0	128.5
87.5°	66.2	58.8	51.4	40.5	36.6
90°	1.5	18.4	50.0	46.9	48.4
92.5°	31.7	42.9	44.4	45.9	45.9
95°	74.5	88.7	91.3	91.3	88.7
97.5°	123.9	137.2	142.9	142.9	142.9
100°	181.1	192.8	196.9	196.9	195.4
102.5°	241.3	249.9	255.6	257.1	255.6
105°	307.1	311.2	314.2	316.8	316.8
107.5°	372.4	378.5	378.5	379.5	372.4
110°	435.7	443.8	443.8	443.8	439.7

TEST NUMBER: P921912

CATALOG NUMBER: DFN2DIP-HX4F0-110D060US940-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	504.0	512.6	511.1	507.0	504.0
115°	571.3	579.5	576.9	575.4	571.3
117.5°	638.2	649.4	642.2	638.2	634.1
120°	705.5	716.8	705.5	705.5	700.9
122.5°	766.7	781.0	773.8	769.8	766.7
125°	831.0	843.7	839.6	835.1	833.6
127.5°	893.8	909.5	903.9	897.9	893.8
130°	952.4	970.8	968.2	965.2	959.6
132.5°	1018.2	1032.5	1033.5	1026.4	1022.3
135°	1074.9	1090.7	1093.7	1092.2	1088.1
137.5°	1138.1	1150.8	1153.4	1152.4	1146.3
140°	1193.7	1206.5	1213.6	1213.6	1208.0
142.5°	1250.8	1263.6	1267.7	1269.2	1263.6
145°	1304.9	1315.1	1323.3	1324.8	1319.2
147.5°	1353.3	1366.1	1372.3	1374.7	1369.1
150°	1403.4	1412.0	1417.6	1422.2	1417.6
152.5°	1447.7	1456.4	1463.6	1469.2	1463.6
155°	1492.1	1496.2	1500.7	1508.0	1503.3
157.5°	1530.4	1533.5	1536.0	1546.2	1539.1
160°	1564.6	1567.6	1569.1	1577.8	1571.7
162.5°	1596.2	1596.2	1597.7	1607.4	1600.3
165°	1623.2	1621.7	1621.7	1631.9	1624.8
167.5°	1647.7	1643.2	1643.2	1653.3	1646.2
170°	1666.1	1662.0	1660.5	1670.6	1662.0
172.5°	1678.8	1674.7	1673.2	1683.4	1674.7
175°	1689.0	1685.0	1681.9	1692.1	1683.4
177.5°	1694.6	1690.6	1687.5	1696.1	1687.5
180°	1692.1	1692.1	1692.1	1692.1	1692.1

TEST NUMBER: P921912

CATALOG NUMBER: DFN2DIP-HX4F0-110D060US940-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.35	13.39	13.15	14.21	15.21	11.92	12.96	12.71	13.78	14.78
	3H	14.03	14.96	14.83	15.79	16.82	13.55	14.49	14.36	15.32	16.35
	4H	14.62	15.51	15.45	16.34	17.38	14.15	15.03	14.97	15.87	16.91
	6H	15.03	15.85	15.87	16.69	17.75	14.56	15.37	15.39	16.21	17.27
	8H	15.14	15.92	15.99	16.78	17.84	14.67	15.45	15.51	16.31	17.36
	12H	15.20	15.94	16.05	16.79	17.87	14.72	15.46	15.57	16.31	17.39
4H	2H	12.84	13.72	13.66	14.55	15.60	12.49	13.38	13.32	14.21	15.25
	3H	14.72	15.46	15.56	16.32	17.38	14.33	15.06	15.17	15.93	16.99
	4H	15.44	16.11	16.30	16.98	18.06	15.04	15.71	15.89	16.57	17.66
	6H	15.97	16.55	16.84	17.44	18.53	15.56	16.14	16.43	17.03	18.12
	8H	16.12	16.67	17.00	17.55	18.65	15.71	16.25	16.58	17.14	18.24
	12H	16.21	16.70	17.10	17.60	18.71	15.78	16.27	16.68	17.18	18.28
8H	4H	15.65	16.20	16.53	17.08	18.18	15.29	15.84	16.17	16.72	17.82
	6H	16.29	16.74	17.19	17.67	18.77	15.93	16.38	16.83	17.31	18.41
	8H	16.52	16.92	17.43	17.84	18.95	16.15	16.55	17.06	17.47	18.58
	12H	16.66	17.01	17.57	17.92	19.09	16.27	16.63	17.19	17.54	18.71
12H	4H	15.65	16.14	16.54	17.04	18.15	15.30	15.79	16.19	16.69	17.80
	6H	16.33	16.73	17.24	17.64	18.76	15.97	16.37	16.88	17.29	18.41
	8H	16.58	16.93	17.49	17.84	19.01	16.22	16.57	17.13	17.48	18.65

END OF REPORT