

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924522

Luminaire Tested: DFN2DIP-HX4F0-040D100US950-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924522
REPORT IS A COMBINATION OF REPORTS P899407 AND P896188
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-040D100US950-FLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12220.8 lumens
Efficiency: N/A
Efficacy: 134.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 91
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924522

CATALOG NUMBER: DFN2DIP-HX4F0-040D100US950-FLLFLL

Luminous Intensity Polar Plot

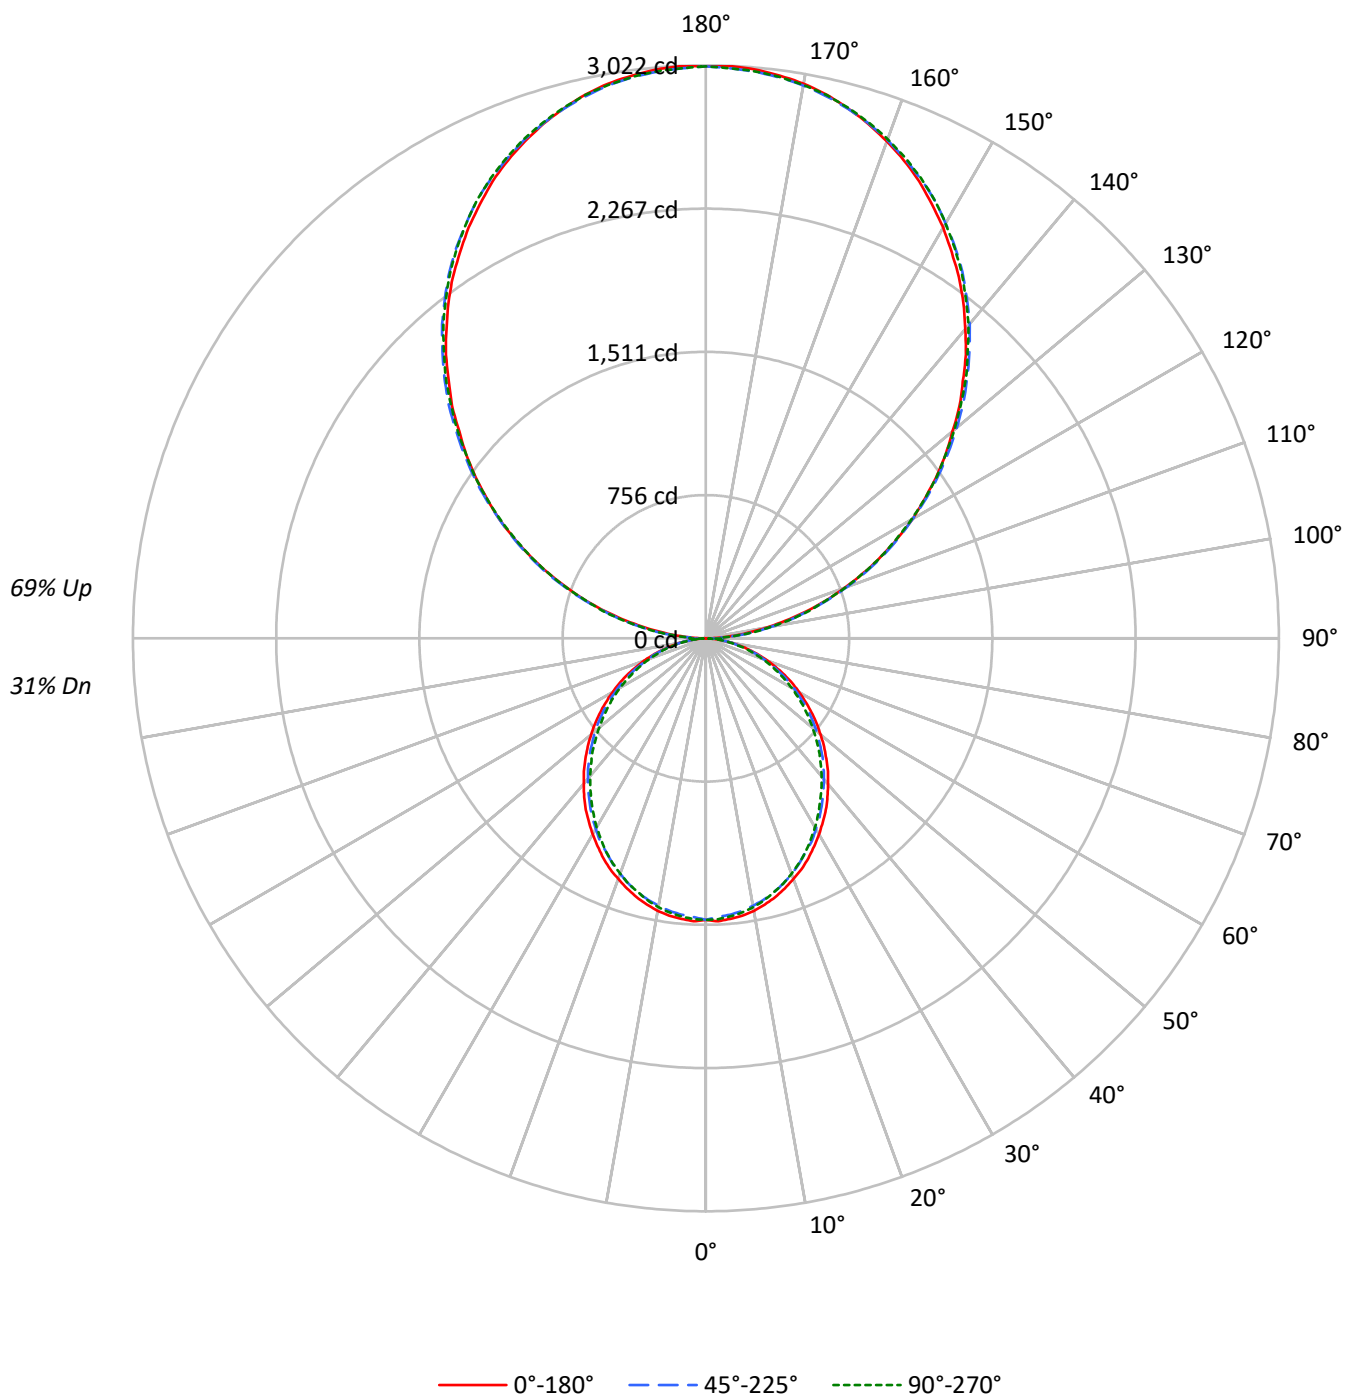

TEST NUMBER: P924522

CATALOG NUMBER: DFN2DIP-HX4F0-040D100US950-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	92	92	92	92	73	73	73	55	55	55	39	39	39
1	94	89	86	82	84	80	77	74	64	61	60	48	47	46	34	33	33
2	85	78	72	67	76	70	65	61	56	52	49	42	40	38	30	29	27
3	78	68	61	56	69	62	56	51	49	45	41	37	35	32	27	25	23
4	71	60	53	47	63	55	48	43	44	39	35	33	30	28	24	22	20
5	65	54	46	40	58	49	42	37	39	34	30	30	26	24	21	19	17
6	60	48	40	35	54	44	37	32	35	30	26	27	23	21	19	17	15
7	55	43	36	30	49	39	33	28	32	27	23	24	21	18	18	15	14
8	51	39	32	27	46	36	29	24	29	24	20	22	19	16	16	14	12
9	47	36	28	24	43	32	26	22	26	21	18	20	17	15	15	13	11
10	44	33	26	21	40	30	24	19	24	19	16	19	15	13	14	12	10

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1104	1104	1104
5°	1106	1089	1096
10°	1097	1074	1081
15°	1081	1057	1058
20°	1059	1032	1034
25°	1038	1003	1007
30°	1011	976	972
35°	985	944	935
40°	953	911	900
45°	922	879	864
50°	887	844	823
55°	851	805	785
60°	811	758	741
65°	766	710	689
70°	710	650	634
75°	631	580	583
80°	537	489	485
85°	390	333	322

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2275 cd/sqm

TEST NUMBER: P924522

CATALOG NUMBER: DFN2DIP-HX4F0-040D100US950-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	139.8	1.1
10°-20°	393.2	3.2
20°-30°	577.9	4.7
30°-40°	671.2	5.5
40°-50°	670.3	5.5
50°-60°	584.5	4.8
60°-70°	432.1	3.5
70°-80°	244.5	2.0
80°-90°	73.1	0.6
90°-100°	186.7	1.5
100°-110°	593.2	4.9
110°-120°	1015.2	8.3
120°-130°	1335.1	10.9
130°-140°	1498.6	12.3
140°-150°	1469.5	12.0
150°-160°	1232.7	10.1
160°-170°	817.5	6.7
170°-180°	285.7	2.3
0°-30°	1110.8	9.1
0°-40°	1782.0	14.6
0°-60°	3036.8	24.8
0°-90°	3786.4	31.0
90°-120°	1795.1	14.7
90°-150°	6098.3	49.9
90°-180°	8434.0	69.0
0°-180°	12220.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1485	1485	1485	1485	1485	
5°	1485	1479	1463	1475	1472	141
15°	1413	1405	1386	1392	1385	398
25°	1279	1268	1244	1246	1244	589
35°	1104	1090	1067	1058	1051	689
45°	898	888	867	851	845	693
55°	680	671	654	637	630	608
65°	458	450	436	423	416	453
75°	240	237	230	221	224	256
85°	58	57	56	51	50	65
90°	3	33	89	84	86	12
95°	133	158	163	163	158	148
105°	548	555	560	565	565	578
115°	1019	1033	1029	1026	1019	1008
125°	1482	1504	1497	1489	1486	1324
135°	1916	1945	1950	1948	1940	1481
145°	2327	2345	2360	2362	2352	1454
155°	2661	2668	2676	2689	2680	1225
165°	2894	2892	2892	2910	2897	817
175°	3012	3004	2999	3017	3002	286
180°	3017	3017	3017	3017	3017	

TEST NUMBER: P924522

CATALOG NUMBER: DFN2DIP-HX4F0-040D100US950-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1484.8	1484.8	1484.8	1484.8	1484.8
2.5°	1493.5	1486.3	1470.6	1484.8	1482.1
5°	1484.8	1479.2	1463.4	1474.8	1472.1
7.5°	1474.8	1466.3	1450.6	1462.1	1459.2
10°	1459.2	1449.2	1432.1	1443.5	1439.2
12.5°	1437.7	1429.2	1412.1	1419.3	1416.3
15°	1413.4	1405.0	1386.4	1392.1	1385.0
17.5°	1383.5	1375.0	1356.4	1363.5	1356.4
20°	1350.6	1342.1	1322.1	1326.3	1320.8
22.5°	1317.9	1305.0	1286.4	1286.4	1283.5
25°	1279.2	1267.9	1243.6	1246.4	1243.6
27.5°	1236.4	1226.4	1208.0	1203.7	1196.6
30°	1193.6	1182.2	1160.8	1156.5	1150.8
32.5°	1147.9	1139.5	1116.6	1108.0	1102.2
35°	1103.7	1089.5	1066.6	1058.0	1050.8
37.5°	1053.7	1040.8	1017.9	1008.0	1000.8
40°	1002.4	990.8	967.9	955.2	949.5
42.5°	952.4	940.8	918.1	903.7	895.2
45°	898.1	888.2	866.6	851.1	845.2
47.5°	845.2	835.2	812.4	796.7	788.2
50°	789.5	782.4	762.4	742.4	735.2
52.5°	735.2	725.3	706.8	691.1	681.1
55°	679.7	671.0	654.0	636.8	629.7
57.5°	623.9	616.9	598.2	581.1	575.4
60°	568.2	562.6	542.6	526.9	522.6
62.5°	514.0	504.0	489.8	475.5	469.7
65°	458.4	449.7	435.5	422.6	415.6
67.5°	401.3	394.0	381.3	371.3	365.6
70°	348.4	342.7	329.8	319.8	314.2
72.5°	294.2	288.4	281.3	271.3	267.0
75°	239.8	237.1	229.8	221.3	224.2
77.5°	191.3	185.6	182.7	178.4	174.2
80°	142.8	141.3	138.4	134.2	131.4
82.5°	97.1	97.1	95.8	90.0	90.0
85°	58.5	57.1	55.7	51.3	50.0
87.5°	25.8	22.9	20.0	15.7	14.2
90°	2.8	32.7	89.1	83.7	86.4
92.5°	56.4	76.4	79.2	81.9	81.9
95°	132.8	158.3	162.8	162.8	158.3
97.5°	221.0	244.7	254.7	254.7	254.7
100°	322.9	343.8	351.1	351.1	348.4
102.5°	430.3	445.7	455.7	458.4	455.7
105°	547.6	554.8	560.3	564.9	564.9
107.5°	664.0	675.0	675.0	676.8	664.0
110°	776.8	791.3	791.3	791.3	784.1

TEST NUMBER: P924522

CATALOG NUMBER: DFN2DIP-HX4F0-040D100US950-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	898.7	914.1	911.5	904.1	898.7
115°	1018.8	1033.3	1028.8	1026.0	1018.8
117.5°	1137.9	1158.0	1145.2	1137.9	1130.6
120°	1257.9	1278.0	1257.9	1257.9	1249.8
122.5°	1367.1	1392.6	1379.9	1372.6	1367.1
125°	1481.8	1504.5	1497.2	1489.0	1486.3
127.5°	1593.7	1621.8	1611.8	1600.9	1593.7
130°	1698.2	1730.9	1726.5	1720.9	1711.0
132.5°	1815.6	1841.0	1842.8	1830.2	1822.8
135°	1916.5	1944.7	1950.2	1947.5	1940.1
137.5°	2029.3	2052.1	2056.6	2054.8	2043.8
140°	2128.5	2151.2	2164.0	2164.0	2153.9
142.5°	2230.4	2253.1	2260.3	2263.1	2253.1
145°	2326.7	2344.9	2359.5	2362.2	2352.2
147.5°	2413.1	2435.9	2446.8	2451.4	2441.4
150°	2502.3	2517.8	2527.8	2535.9	2527.8
152.5°	2581.4	2596.9	2609.7	2619.7	2609.7
155°	2660.6	2667.9	2676.1	2688.8	2680.5
157.5°	2728.8	2734.3	2738.8	2757.0	2744.3
160°	2789.8	2795.2	2797.9	2813.3	2802.5
162.5°	2846.2	2846.2	2848.8	2866.1	2853.4
165°	2894.3	2891.6	2891.6	2909.8	2897.1
167.5°	2938.0	2929.8	2929.8	2948.1	2935.3
170°	2970.8	2963.5	2960.7	2979.0	2963.5
172.5°	2993.5	2986.2	2983.4	3001.7	2986.2
175°	3011.7	3004.4	2999.0	3017.1	3001.7
177.5°	3021.7	3014.4	3008.9	3024.4	3008.9
180°	3017.1	3017.1	3017.1	3017.1	3017.1

TEST NUMBER: P924522

CATALOG NUMBER: DFN2DIP-HX4F0-040D100US950-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	5.53	6.25	6.64	7.35	8.87	5.10	5.81	6.21	6.91	8.43
	3H	7.18	7.82	8.30	8.93	10.47	6.71	7.35	7.82	8.46	9.99
	4H	7.76	8.37	8.89	9.48	11.02	7.29	7.90	8.41	9.01	10.55
	6H	8.16	8.71	9.29	9.83	11.38	7.68	8.24	8.81	9.35	10.91
	8H	8.26	8.79	9.39	9.92	11.46	7.78	8.31	8.92	9.44	10.99
	12H	8.30	8.80	9.44	9.93	11.50	7.82	8.32	8.96	9.45	11.02
4H	2H	5.98	6.58	7.11	7.69	9.23	5.63	6.24	6.76	7.35	8.89
	3H	7.83	8.34	8.97	9.47	11.03	7.44	7.94	8.57	9.08	10.63
	4H	8.54	9.00	9.68	10.13	11.70	8.13	8.60	9.27	9.72	11.30
	6H	9.05	9.45	10.19	10.59	12.16	8.64	9.04	9.78	10.18	11.75
	8H	9.19	9.57	10.34	10.71	12.29	8.78	9.15	9.93	10.29	11.87
	12H	9.26	9.60	10.42	10.75	12.34	8.84	9.17	10.00	10.33	11.91
8H	4H	8.72	9.10	9.87	10.24	11.82	8.36	8.74	9.51	9.88	11.46
	6H	9.35	9.66	10.52	10.84	12.42	8.99	9.29	10.15	10.48	12.05
	8H	9.57	9.84	10.74	11.00	12.60	9.20	9.47	10.37	10.63	12.23
	12H	9.70	9.93	10.87	11.09	12.72	9.31	9.55	10.49	10.71	12.34
12H	4H	8.70	9.04	9.86	10.19	11.78	8.35	8.69	9.51	9.84	11.43
	6H	9.38	9.65	10.55	10.81	12.41	9.03	9.30	10.20	10.46	12.06
	8H	9.62	9.85	10.79	11.01	12.64	9.26	9.49	10.43	10.65	12.28

END OF REPORT