

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924547

Luminaire Tested: DFN2DIP-HX4F0-060D040US950-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924547
REPORT IS A COMBINATION OF REPORTS P899304 AND P896188
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-060D040US950-RLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8242.5 lumens
Efficiency: N/A
Efficacy: 105.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 77.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924547

CATALOG NUMBER: DFN2DIP-HX4F0-060D040US950-RLLFLL

Luminous Intensity Polar Plot

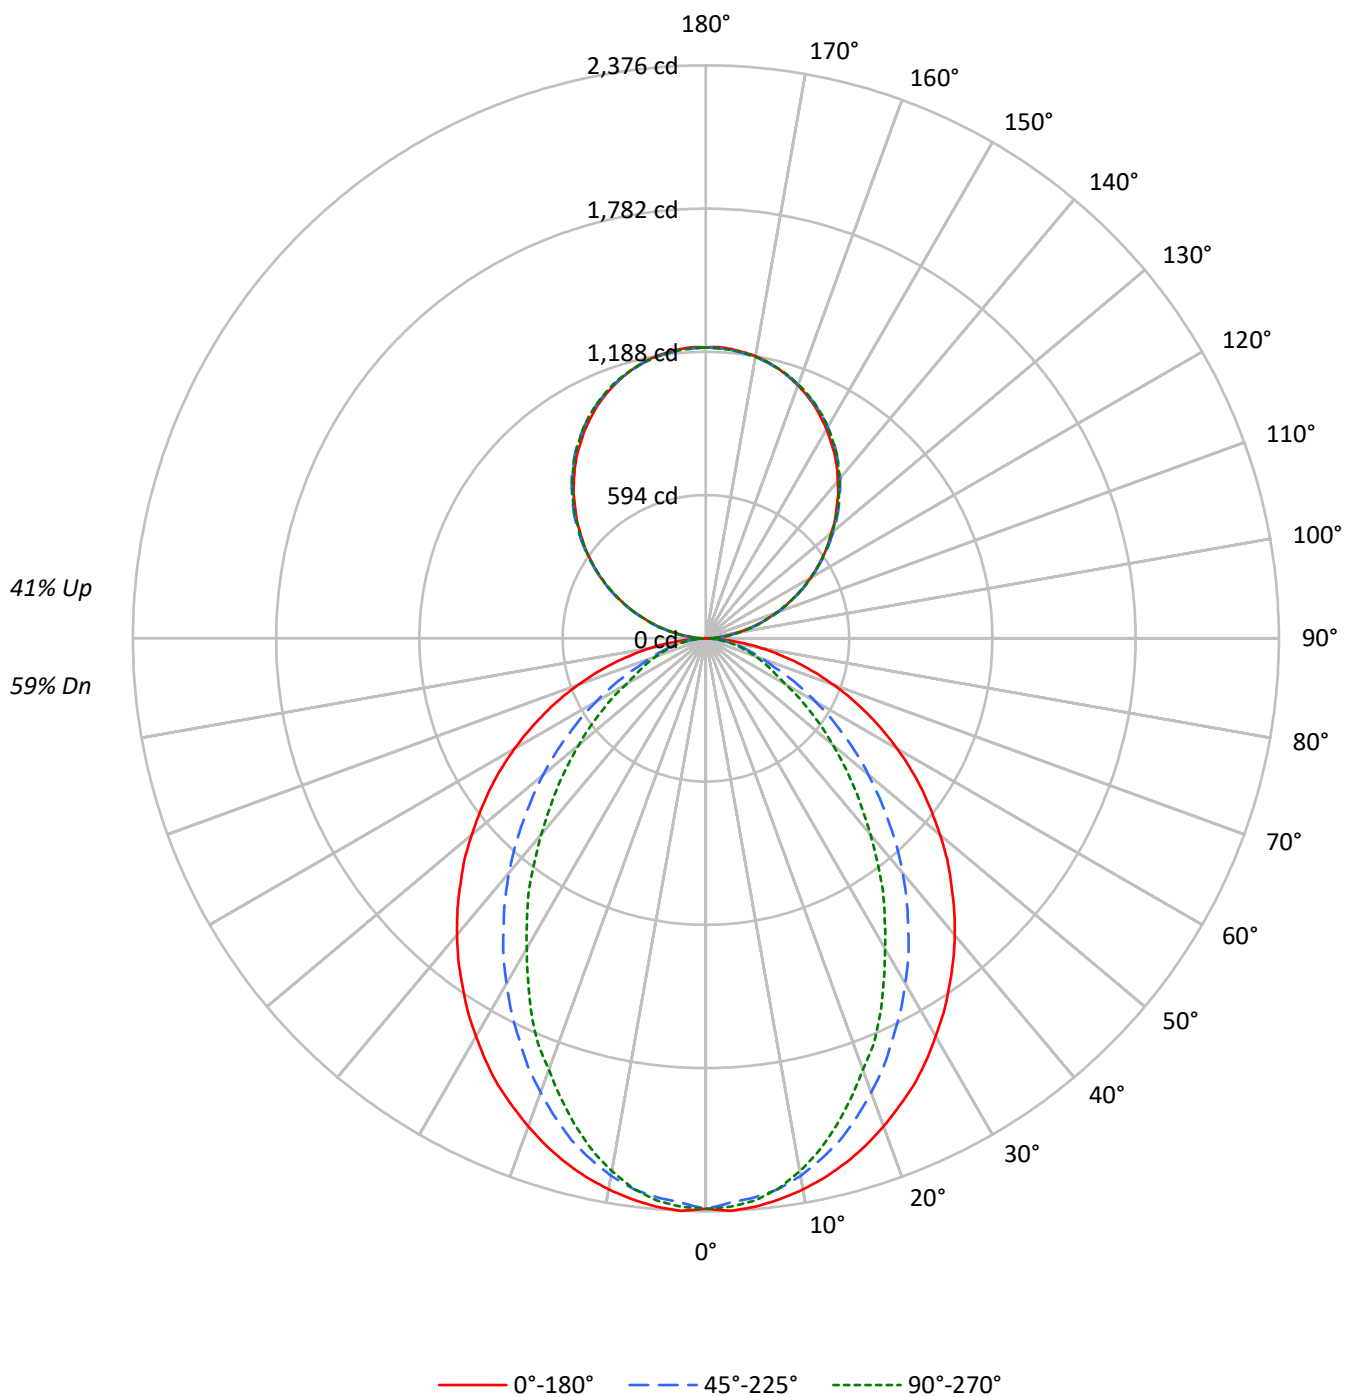

TEST NUMBER: P924547

CATALOG NUMBER: DFN2DIP-HX4F0-060D040US950-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	76	76	76	64	64	64
1	100	96	92	89	94	90	87	84	78	76	74	68	66	64	58	57	56
2	92	85	79	74	86	79	74	70	69	65	62	60	57	55	52	50	48
3	84	75	68	62	78	70	64	59	62	57	53	54	50	47	46	44	41
4	77	67	59	53	72	63	56	51	55	50	46	48	44	41	42	39	36
5	71	60	52	46	66	56	49	44	50	44	40	44	39	36	38	34	32
6	66	54	46	40	61	51	44	39	45	39	35	40	35	32	35	31	28
7	61	49	41	36	57	46	39	34	41	35	31	36	32	28	32	28	25
8	57	45	37	32	53	42	35	30	38	32	28	33	29	25	29	26	23
9	53	41	34	29	50	39	32	27	35	29	25	31	26	23	27	24	21
10	50	38	31	26	47	36	29	25	32	27	23	29	24	21	25	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1759	1759	1759
5°	1762	1731	1742
10°	1745	1698	1686
15°	1721	1642	1598
20°	1689	1564	1491
25°	1657	1478	1387
30°	1613	1389	1255
35°	1571	1294	1140
40°	1527	1195	1007
45°	1477	1085	887
50°	1425	975	769
55°	1370	856	656
60°	1307	733	540
65°	1235	607	487
70°	1147	489	440
75°	1037	432	401
80°	877	363	348
85°	613	243	262

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1477 cd/sqm

TEST NUMBER: P924547

CATALOG NUMBER: DFN2DIP-HX4F0-060D040US950-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.7	2.7
10°-20°	608.7	7.4
20°-30°	854.5	10.4
30°-40°	931.5	11.3
40°-50°	856.2	10.4
50°-60°	672.4	8.2
60°-70°	437.7	5.3
70°-80°	225.3	2.7
80°-90°	60.9	0.7
90°-100°	74.7	0.9
100°-110°	237.3	2.9
110°-120°	406.1	4.9
120°-130°	534.0	6.5
130°-140°	599.4	7.3
140°-150°	587.8	7.1
150°-160°	493.1	6.0
160°-170°	327.0	4.0
170°-180°	114.3	1.4
0°-30°	1684.9	20.4
0°-40°	2616.4	31.7
0°-60°	4144.9	50.3
0°-90°	4868.8	59.1
90°-120°	718.0	8.7
90°-150°	2439.3	29.6
90°-180°	3374.0	40.9
0°-180°	8242.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2366	2366	2366	2366	2366	
5°	2366	2355	2327	2346	2340	224
15°	2250	2226	2154	2113	2092	634
25°	2042	1974	1833	1745	1713	939
35°	1760	1651	1462	1327	1280	1102
45°	1439	1295	1071	918	867	1111
55°	1094	927	696	567	527	978
65°	739	565	372	300	293	732
75°	394	244	171	156	154	417
85°	92	47	41	41	41	106
90°	1	13	36	34	34	8
95°	53	63	65	65	63	59
105°	219	222	224	226	226	231
115°	408	413	412	410	408	403
125°	593	602	599	596	594	530
135°	767	778	780	779	776	593
145°	931	938	944	945	941	582
155°	1064	1067	1070	1076	1072	490
165°	1158	1157	1157	1164	1159	327
175°	1205	1202	1200	1207	1201	114
180°	1207	1207	1207	1207	1207	

TEST NUMBER: P924547

CATALOG NUMBER: DFN2DIP-HX4F0-060D040US950-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2365.7	2365.7	2365.7	2365.7	2365.7
2.5°	2376.4	2365.7	2342.1	2363.6	2359.3
5°	2365.7	2355.0	2327.1	2346.5	2340.1
7.5°	2346.5	2333.7	2303.7	2312.1	2301.4
10°	2320.7	2305.7	2263.1	2256.5	2243.7
12.5°	2288.7	2269.4	2211.5	2198.8	2175.1
15°	2250.1	2226.4	2153.8	2113.1	2091.7
17.5°	2205.2	2170.8	2080.9	2033.8	1999.6
20°	2153.8	2110.8	2003.9	1950.5	1903.2
22.5°	2098.1	2048.8	1924.6	1851.9	1819.9
25°	2042.5	1973.9	1832.6	1745.0	1712.7
27.5°	1976.2	1903.2	1747.0	1646.3	1597.1
30°	1905.5	1824.0	1652.7	1543.7	1485.8
32.5°	1836.9	1738.4	1563.0	1434.4	1380.8
35°	1759.9	1650.7	1462.4	1327.4	1280.2
37.5°	1685.0	1567.0	1368.1	1220.3	1166.8
40°	1605.7	1477.4	1269.5	1117.5	1061.9
42.5°	1524.4	1387.4	1171.1	1012.6	959.2
45°	1438.7	1295.2	1070.6	918.3	867.0
47.5°	1357.4	1205.5	974.2	822.1	775.0
50°	1267.5	1115.5	880.0	732.1	687.4
52.5°	1179.5	1019.0	790.0	648.7	608.1
55°	1094.0	927.0	695.8	567.4	526.7
57.5°	1006.3	834.9	612.4	492.5	458.1
60°	916.3	745.1	524.5	415.5	381.1
62.5°	828.6	657.4	449.5	346.9	329.8
65°	738.7	565.1	372.5	299.8	293.3
67.5°	653.0	479.5	299.8	263.3	256.9
70°	563.1	396.1	248.2	227.0	218.3
72.5°	477.5	318.9	207.6	190.6	186.2
75°	393.9	243.9	171.2	156.3	154.3
77.5°	310.5	173.3	134.9	126.3	122.0
80°	233.3	124.2	102.7	94.3	94.3
82.5°	162.7	83.6	70.6	66.3	66.3
85°	92.0	47.0	40.6	40.6	40.6
87.5°	34.3	17.1	17.1	15.0	15.0
90°	1.0	13.1	35.7	33.5	34.5
92.5°	22.5	30.5	31.7	32.7	32.7
95°	53.1	63.3	65.2	65.2	63.3
97.5°	88.4	97.9	101.9	101.9	101.9
100°	129.2	137.6	140.4	140.4	139.4
102.5°	172.1	178.3	182.3	183.4	182.3
105°	219.0	221.9	224.1	225.9	225.9
107.5°	265.6	270.0	270.0	270.6	265.6
110°	310.7	316.5	316.5	316.5	313.7

TEST NUMBER: P924547

CATALOG NUMBER: DFN2DIP-HX4F0-060D040US950-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	359.5	365.7	364.5	361.7	359.5
115°	407.5	413.4	411.5	410.4	407.5
117.5°	455.2	463.2	458.1	455.2	452.3
120°	503.2	511.2	503.2	503.2	499.9
122.5°	546.8	557.0	552.0	549.0	546.8
125°	592.7	601.8	598.9	595.6	594.5
127.5°	637.5	648.7	644.7	640.3	637.5
130°	679.2	692.4	690.6	688.4	684.4
132.5°	726.2	736.4	737.2	732.0	729.1
135°	766.6	777.9	780.1	778.9	776.1
137.5°	811.8	820.8	822.6	821.9	817.6
140°	851.3	860.5	865.6	865.6	861.6
142.5°	892.2	901.2	904.1	905.3	901.2
145°	930.7	938.0	943.8	944.9	940.9
147.5°	965.3	974.3	978.7	980.5	976.5
150°	1000.9	1007.1	1011.1	1014.4	1011.1
152.5°	1032.6	1038.7	1043.9	1047.9	1043.9
155°	1064.2	1067.1	1070.4	1075.5	1072.2
157.5°	1091.6	1093.7	1095.5	1102.8	1097.7
160°	1115.9	1118.1	1119.1	1125.3	1121.0
162.5°	1138.4	1138.4	1139.6	1146.4	1141.4
165°	1157.8	1156.6	1156.6	1163.9	1158.8
167.5°	1175.2	1171.9	1171.9	1179.2	1174.1
170°	1188.3	1185.3	1184.3	1191.5	1185.3
172.5°	1197.4	1194.5	1193.4	1200.7	1194.5
175°	1204.7	1201.8	1199.6	1206.8	1200.7
177.5°	1208.7	1205.8	1203.6	1209.8	1203.6
180°	1206.8	1206.8	1206.8	1206.8	1206.8

TEST NUMBER: P924547

CATALOG NUMBER: DFN2DIP-HX4F0-060D040US950-RLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.92	10.83	10.80	11.72	12.86	5.89	6.80	6.77	7.70	8.84
	3H	11.60	12.41	12.50	13.32	14.49	7.09	7.90	7.98	8.81	9.97
	4H	12.21	12.98	13.12	13.89	15.07	7.54	8.31	8.45	9.22	10.40
	6H	12.64	13.35	13.56	14.27	15.45	7.87	8.58	8.79	9.50	10.68
	8H	12.77	13.44	13.70	14.38	15.56	7.96	8.64	8.89	9.57	10.76
	12H	12.83	13.47	13.77	14.40	15.61	8.01	8.65	8.94	9.58	10.79
4H	2H	9.94	10.71	10.86	11.63	12.80	6.50	7.26	7.41	8.18	9.35
	3H	11.78	12.42	12.71	13.36	14.55	7.85	8.49	8.78	9.44	10.63
	4H	12.48	13.06	13.41	14.00	15.21	8.41	8.99	9.34	9.93	11.14
	6H	13.00	13.50	13.95	14.46	15.68	8.83	9.33	9.78	10.30	11.51
	8H	13.18	13.64	14.13	14.60	15.83	8.96	9.43	9.92	10.39	11.62
	12H	13.28	13.70	14.25	14.67	15.90	9.03	9.46	10.00	10.43	11.66
8H	4H	12.45	12.92	13.40	13.88	15.10	8.69	9.16	9.65	10.12	11.35
	6H	13.02	13.41	14.00	14.41	15.63	9.22	9.60	10.19	10.60	11.83
	8H	13.24	13.58	14.23	14.57	15.81	9.41	9.75	10.40	10.74	11.98
	12H	13.38	13.68	14.37	14.66	15.96	9.53	9.83	10.52	10.82	12.11
12H	4H	12.41	12.83	13.38	13.80	15.04	8.70	9.12	9.67	10.10	11.33
	6H	13.00	13.34	13.98	14.33	15.57	9.27	9.61	10.25	10.60	11.84
	8H	13.22	13.52	14.21	14.50	15.80	9.48	9.78	10.47	10.76	12.06

END OF REPORT