

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P902880

Luminaire Tested: DFN2DIP-PN2F0-030D050US830-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P902880
REPORT IS A COMBINATION OF REPORTS P899493 AND P896349
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-030D050US830-FLLFLL
Description: 2 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6970.1 lumens
Efficiency: N/A
Efficacy: 101.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 69
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P902880

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US830-FLLFLL

Luminous Intensity Polar Plot

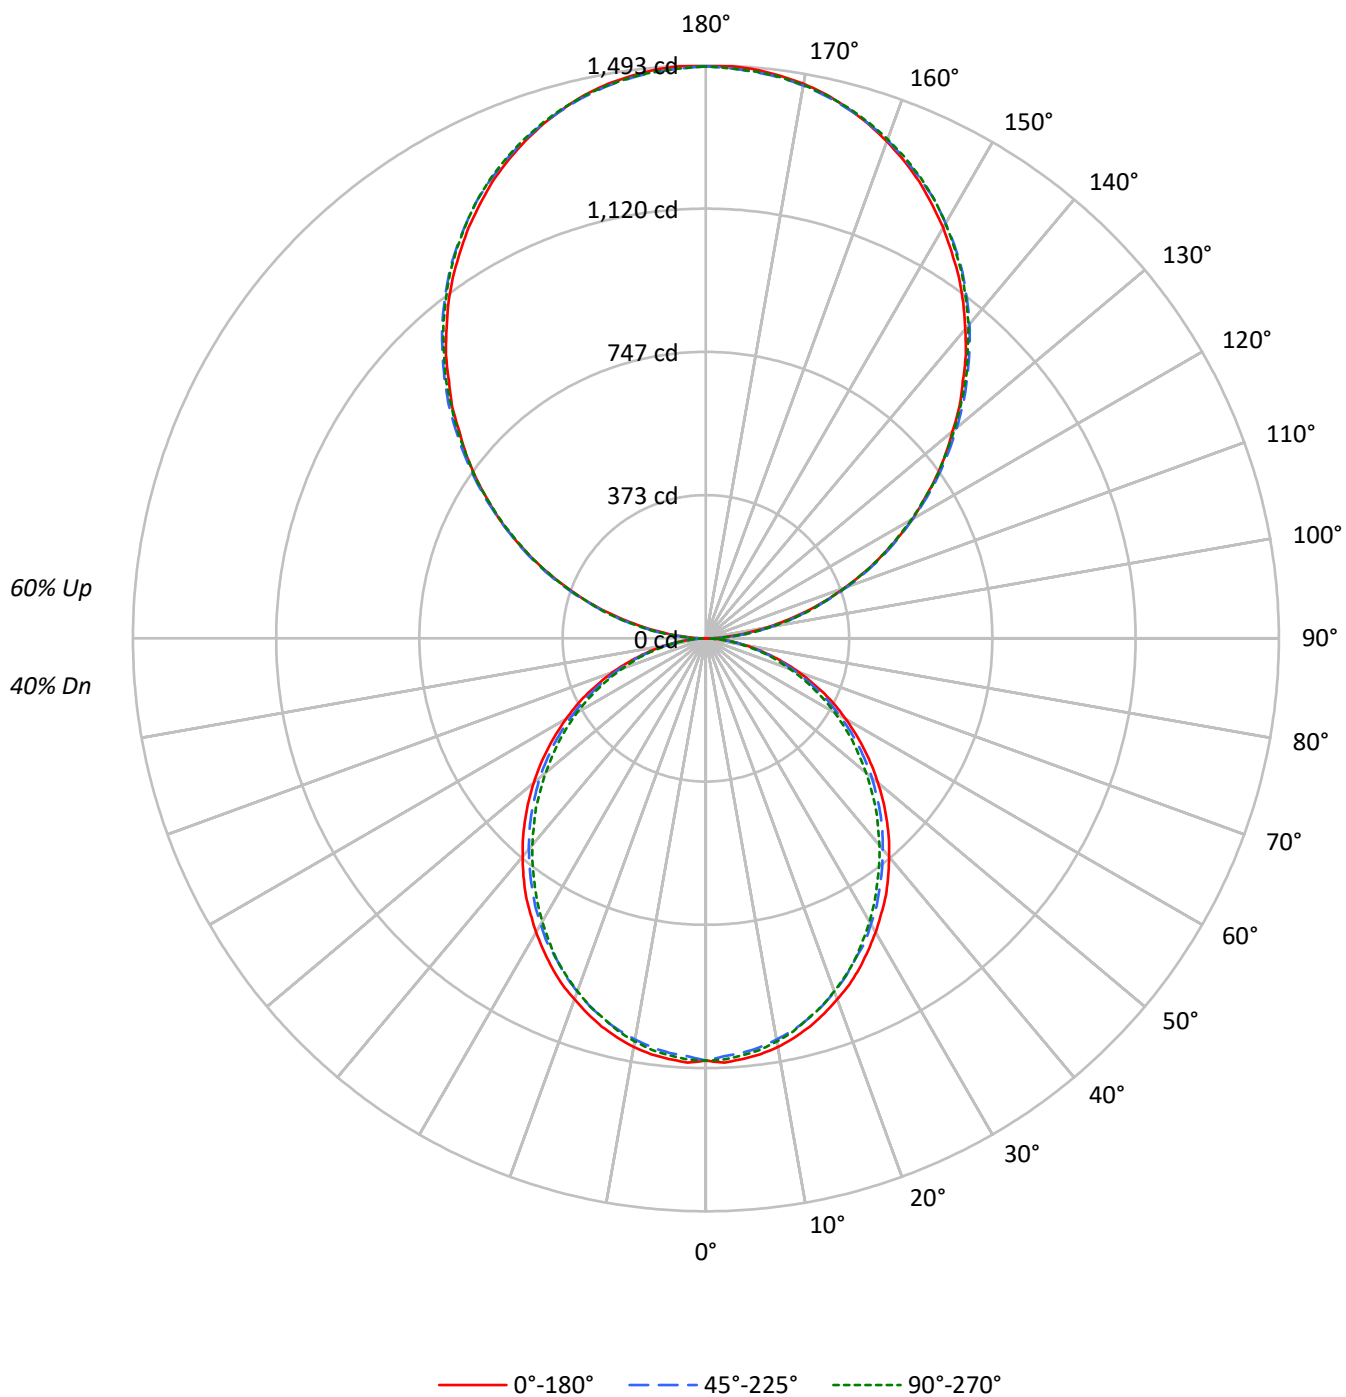

TEST NUMBER: P902880

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US830-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	78	78	78	62	62	62	47	47	47
1	96	91	87	84	87	83	80	77	68	66	64	54	53	51	42	41	40
2	87	80	74	69	79	73	68	63	60	56	53	48	45	43	37	35	33
3	79	70	63	57	72	64	58	53	53	48	44	42	39	36	32	30	28
4	73	62	54	48	66	57	50	45	47	42	38	38	34	31	29	27	25
5	67	55	47	41	60	51	44	38	42	37	33	34	30	27	26	23	21
6	61	49	41	36	56	45	38	33	38	32	28	30	27	24	24	21	19
7	57	45	37	31	51	41	34	29	34	29	25	28	24	21	22	19	17
8	52	40	33	28	48	37	30	26	31	26	22	25	21	18	20	17	15
9	49	37	29	24	44	34	27	23	28	23	20	23	19	17	18	16	14
10	46	34	27	22	41	31	25	20	26	21	18	21	18	15	17	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2383	2383	2383
5°	2383	2345	2362
10°	2360	2308	2327
15°	2321	2265	2273
20°	2271	2207	2218
25°	2220	2139	2156
30°	2158	2075	2077
35°	2098	2001	1994
40°	2026	1926	1915
45°	1953	1850	1834
50°	1873	1770	1741
55°	1790	1678	1654
60°	1695	1569	1554
65°	1592	1456	1436
70°	1460	1318	1309
75°	1278	1152	1187
80°	1057	940	964
85°	719	595	603

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2011 cd/sqm

TEST NUMBER: P902880

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US830-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	103.6	1.5
10°-20°	291.4	4.2
20°-30°	428.2	6.1
30°-40°	497.3	7.1
40°-50°	496.7	7.1
50°-60°	433.1	6.2
60°-70°	320.2	4.6
70°-80°	181.1	2.6
80°-90°	52.0	0.7
90°-100°	92.2	1.3
100°-110°	293.0	4.2
110°-120°	501.5	7.2
120°-130°	659.5	9.5
130°-140°	740.3	10.6
140°-150°	725.9	10.4
150°-160°	609.0	8.7
160°-170°	403.9	5.8
170°-180°	141.2	2.0
0°-30°	823.1	11.8
0°-40°	1320.4	18.9
0°-60°	2250.3	32.3
0°-90°	2803.6	40.2
90°-120°	886.7	12.7
90°-150°	3012.5	43.2
90°-180°	4167.0	59.8
0°-180°	6970.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1100	1100	1100	1100	1100	
5°	1100	1096	1084	1093	1091	104
15°	1047	1041	1027	1032	1026	295
25°	948	940	922	924	922	436
35°	818	807	790	784	779	511
45°	666	658	642	631	626	514
55°	504	497	485	472	467	450
65°	340	333	323	313	308	336
75°	178	176	170	164	166	190
85°	43	42	41	38	37	48
90°	1	16	44	41	43	7
95°	66	78	80	80	78	73
105°	270	274	277	279	279	285
115°	503	510	508	507	503	498
125°	732	743	740	736	734	654
135°	947	961	963	962	958	732
145°	1149	1158	1166	1167	1162	718
155°	1314	1318	1322	1328	1324	605
165°	1430	1428	1428	1438	1431	403
175°	1488	1484	1482	1490	1483	141
180°	1490	1490	1490	1490	1490	

TEST NUMBER: P902880

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US830-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1100.2	1100.2	1100.2	1100.2	1100.2
2.5°	1106.6	1101.4	1089.7	1100.2	1098.3
5°	1100.2	1096.1	1084.4	1092.9	1090.8
7.5°	1092.9	1086.6	1074.9	1083.5	1081.3
10°	1081.3	1073.8	1061.2	1069.6	1066.5
12.5°	1065.4	1059.0	1046.4	1051.6	1049.5
15°	1047.4	1041.1	1027.3	1031.5	1026.2
17.5°	1025.1	1018.9	1005.0	1010.3	1005.0
20°	1000.8	994.5	979.7	982.8	978.6
22.5°	976.6	967.0	953.2	953.2	951.0
25°	947.9	939.5	921.5	923.6	921.5
27.5°	916.2	908.7	895.0	891.9	886.6
30°	884.5	876.0	860.2	857.0	852.7
32.5°	850.6	844.3	827.4	821.0	816.7
35°	817.8	807.3	790.3	783.9	778.6
37.5°	780.8	771.3	754.3	746.9	741.6
40°	742.7	734.2	717.3	707.8	703.6
42.5°	705.7	697.2	680.3	669.7	663.4
45°	665.5	658.1	642.2	630.6	626.3
47.5°	626.3	619.0	602.0	590.3	584.0
50°	585.0	579.8	565.0	550.2	544.9
52.5°	544.9	537.4	523.8	512.1	504.6
55°	503.7	497.3	484.6	471.9	466.7
57.5°	462.3	457.0	443.3	430.6	426.3
60°	421.0	416.9	402.1	390.4	387.3
62.5°	380.9	373.4	362.9	352.3	348.1
65°	339.7	333.3	322.7	313.2	307.9
67.5°	297.4	292.0	282.5	275.1	270.9
70°	258.2	253.9	244.4	237.0	232.8
72.5°	218.0	213.7	208.4	201.0	197.9
75°	177.7	175.7	170.3	164.0	166.2
77.5°	141.8	137.5	135.3	132.2	129.1
80°	105.8	104.7	102.5	99.4	97.4
82.5°	71.9	71.9	71.0	66.6	66.6
85°	43.4	42.3	41.3	38.1	37.0
87.5°	19.0	17.0	14.8	11.7	10.6
90°	1.3	16.2	44.0	41.4	42.7
92.5°	27.9	37.7	39.1	40.4	40.4
95°	65.6	78.2	80.4	80.4	78.2
97.5°	109.1	120.8	125.8	125.8	125.8
100°	159.5	169.8	173.4	173.4	172.1
102.5°	212.5	220.2	225.1	226.5	225.1
105°	270.5	274.1	276.8	279.0	279.0
107.5°	328.0	333.4	333.4	334.3	328.0
110°	383.7	391.0	391.0	391.0	387.3

TEST NUMBER: P902880

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US830-FLLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	443.9	451.6	450.3	446.7	443.9
115°	503.2	510.5	508.2	506.9	503.2
117.5°	562.1	572.0	565.7	562.1	558.6
120°	621.4	631.3	621.4	621.4	617.4
122.5°	675.3	688.0	681.6	678.1	675.3
125°	732.0	743.2	739.6	735.6	734.2
127.5°	787.2	801.2	796.3	790.8	787.2
130°	839.0	855.1	852.8	850.2	845.2
132.5°	896.9	909.5	910.4	904.1	900.5
135°	946.8	960.6	963.4	962.1	958.5
137.5°	1002.5	1013.7	1016.0	1015.0	1009.7
140°	1051.4	1062.7	1068.9	1068.9	1064.0
142.5°	1101.7	1113.0	1116.6	1117.9	1113.0
145°	1149.4	1158.4	1165.5	1167.0	1162.0
147.5°	1192.1	1203.3	1208.7	1211.0	1206.0
150°	1236.1	1243.8	1248.7	1252.7	1248.7
152.5°	1275.3	1282.9	1289.1	1294.1	1289.1
155°	1314.3	1317.9	1321.9	1328.2	1324.2
157.5°	1348.0	1350.7	1352.9	1362.0	1355.7
160°	1378.1	1380.8	1382.1	1389.8	1384.4
162.5°	1406.0	1406.0	1407.3	1415.9	1409.6
165°	1429.8	1428.4	1428.4	1437.5	1431.2
167.5°	1451.3	1447.3	1447.3	1456.3	1450.0
170°	1467.5	1464.0	1462.6	1471.6	1464.0
172.5°	1478.8	1475.2	1473.9	1482.8	1475.2
175°	1487.8	1484.1	1481.5	1490.4	1482.8
177.5°	1492.7	1489.1	1486.4	1494.0	1486.4
180°	1490.4	1490.4	1490.4	1490.4	1490.4

TEST NUMBER: P902880

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.19	9.97	10.23	11.02	12.42	8.76	9.54	9.79	10.58	11.98
	3H	10.83	11.53	11.87	12.58	14.00	10.35	11.05	11.39	12.10	13.52
	4H	11.40	12.06	12.46	13.11	14.54	10.92	11.58	11.97	12.63	14.06
	6H	11.78	12.39	12.85	13.45	14.89	11.29	11.90	12.36	12.96	14.40
	8H	11.87	12.45	12.94	13.53	14.96	11.39	11.97	12.46	13.04	14.48
	12H	11.91	12.46	12.99	13.53	14.99	11.42	11.97	12.49	13.04	14.50
4H	2H	9.63	10.30	10.70	11.35	12.78	9.28	9.95	10.35	11.00	12.43
	3H	11.47	12.02	12.54	13.10	14.55	11.07	11.62	12.14	12.70	14.15
	4H	12.16	12.67	13.24	13.74	15.21	11.75	12.26	12.83	13.33	14.79
	6H	12.65	13.09	13.74	14.19	15.64	12.24	12.67	13.32	13.77	15.23
	8H	12.79	13.20	13.88	14.29	15.76	12.37	12.78	13.46	13.86	15.34
	12H	12.85	13.22	13.96	14.32	15.80	12.42	12.79	13.52	13.89	15.37
8H	4H	12.34	12.75	13.43	13.84	15.31	11.97	12.38	13.06	13.47	14.94
	6H	12.95	13.28	14.06	14.41	15.88	12.57	12.91	13.68	14.04	15.51
	8H	13.15	13.45	14.27	14.56	16.05	12.77	13.07	13.89	14.18	15.67
	12H	13.27	13.53	14.39	14.63	16.16	12.87	13.13	13.99	14.24	15.77
12H	4H	12.32	12.69	13.43	13.79	15.27	11.96	12.33	13.07	13.43	14.91
	6H	12.97	13.27	14.09	14.38	15.87	12.61	12.90	13.72	14.01	15.51
	8H	13.19	13.45	14.31	14.56	16.09	12.82	13.08	13.94	14.19	15.72

END OF REPORT