

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P902923

Luminaire Tested: DFN2DIP-PN2F0-050D050US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P902923
REPORT IS A COMBINATION OF REPORTS P901018 AND P897905
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-050D050US830-RLLONL
Description: 2 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8671.4 lumens
Efficiency: N/A
Efficacy: 94.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 92.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P902923

CATALOG NUMBER: DFN2DIP-PN2F0-050D050US830-RLLONL

Luminous Intensity Polar Plot

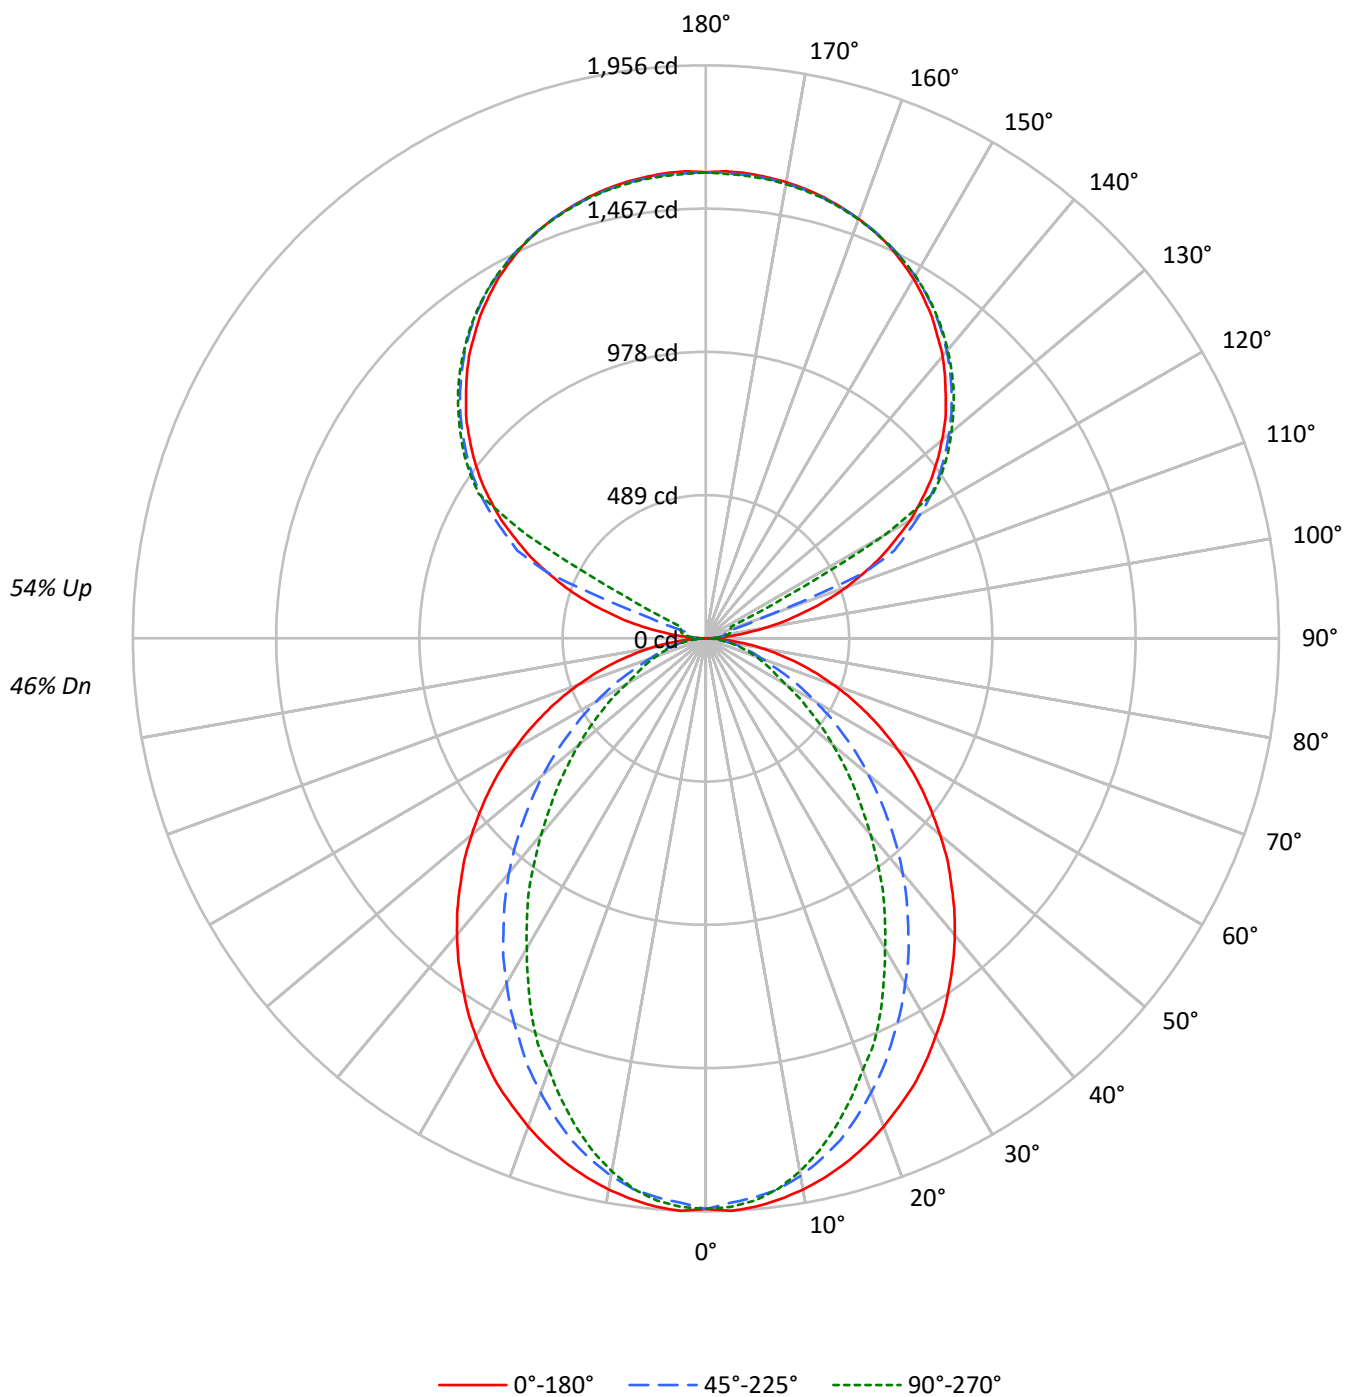

TEST NUMBER: P902923

CATALOG NUMBER: DFN2DIP-PN2F0-050D050US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4219	4219	4219
5°	4219	4143	4172
10°	4170	4052	4030
15°	4106	3910	3815
20°	4023	3717	3552
25°	3938	3502	3299
30°	3827	3283	2980
35°	3717	3048	2700
40°	3605	2806	2380
45°	3476	2539	2090
50°	3342	2270	1808
55°	3201	1983	1537
60°	3038	1685	1259
65°	2849	1384	1127
70°	2621	1102	1010
75°	2333	954	907
80°	1920	775	768
85°	1256	483	546

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3476 cd/sqm

TEST NUMBER: P902923

CATALOG NUMBER: DFN2DIP-PN2F0-050D050US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	182.5	2.1
10°-20°	501.1	5.8
20°-30°	703.6	8.1
30°-40°	766.9	8.8
40°-50°	704.9	8.1
50°-60°	553.6	6.4
60°-70°	360.3	4.2
70°-80°	185.5	2.1
80°-90°	50.2	0.6
90°-100°	52.5	0.6
100°-110°	195.5	2.3
110°-120°	518.5	6.0
120°-130°	860.0	9.9
130°-140°	913.5	10.5
140°-150°	849.0	9.8
150°-160°	682.6	7.9
160°-170°	439.8	5.1
170°-180°	151.4	1.7
0°-30°	1387.2	16.0
0°-40°	2154.2	24.8
0°-60°	3412.7	39.4
0°-90°	4008.6	46.2
90°-120°	766.5	8.8
90°-150°	3389.0	39.1
90°-180°	4663.0	53.8
0°-180°	8671.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1948	1948	1948	1948	1948	
5°	1948	1939	1916	1932	1927	185
15°	1853	1833	1773	1740	1722	522
25°	1682	1625	1509	1437	1410	773
35°	1449	1359	1204	1093	1054	907
45°	1185	1066	881	756	714	915
55°	901	763	573	467	434	805
65°	608	465	307	247	242	603
75°	324	201	141	129	127	343
85°	76	39	34	34	34	87
90°	1	14	23	29	31	8
95°	75	37	45	51	50	89
105°	350	384	70	83	88	374
115°	662	681	710	177	94	651
125°	936	951	972	980	984	834
135°	1158	1176	1186	1198	1196	894
145°	1343	1342	1361	1370	1364	840
155°	1479	1469	1482	1489	1480	681
165°	1558	1551	1555	1563	1555	440
175°	1594	1586	1588	1596	1585	152
180°	1590	1590	1590	1590	1590	

TEST NUMBER: P902923

CATALOG NUMBER: DFN2DIP-PN2F0-050D050US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1947.8	1947.8	1947.8	1947.8	1947.8
2.5°	1956.5	1947.8	1928.3	1946.1	1942.5
5°	1947.8	1939.0	1916.0	1931.8	1926.7
7.5°	1931.8	1921.4	1896.7	1903.7	1894.8
10°	1910.7	1898.4	1863.2	1857.8	1847.3
12.5°	1884.3	1868.5	1820.8	1810.3	1790.8
15°	1852.6	1833.2	1773.3	1739.8	1722.2
17.5°	1815.5	1787.3	1713.3	1674.5	1646.2
20°	1773.3	1738.0	1649.8	1605.9	1567.0
22.5°	1727.5	1686.9	1584.6	1524.8	1498.4
25°	1681.6	1625.1	1508.8	1436.6	1410.0
27.5°	1627.0	1567.0	1438.3	1355.5	1314.9
30°	1568.9	1501.8	1360.7	1270.9	1223.2
32.5°	1512.4	1431.3	1286.9	1181.0	1136.9
35°	1449.0	1359.1	1204.0	1092.9	1054.0
37.5°	1387.2	1290.2	1126.4	1004.7	960.7
40°	1322.0	1216.4	1045.2	920.1	874.3
42.5°	1255.1	1142.3	964.2	833.7	789.8
45°	1184.6	1066.4	881.4	756.1	713.8
47.5°	1117.6	992.5	802.1	676.8	638.1
50°	1043.6	918.4	724.5	602.8	565.9
52.5°	971.2	839.0	650.4	534.1	500.7
55°	900.7	763.2	572.8	467.1	433.7
57.5°	828.5	687.5	504.2	405.5	377.2
60°	754.4	613.4	431.8	342.0	313.8
62.5°	682.2	541.2	370.1	285.6	271.5
65°	608.1	465.3	306.7	246.9	241.5
67.5°	537.6	394.8	246.9	216.8	211.5
70°	463.6	326.1	204.4	186.8	179.7
72.5°	393.1	262.6	171.0	156.9	153.4
75°	324.3	200.9	141.0	128.7	127.0
77.5°	255.6	142.7	111.1	104.0	100.4
80°	192.1	102.3	84.5	77.6	77.6
82.5°	133.9	68.8	58.2	54.6	54.6
85°	75.8	38.7	33.5	33.5	33.5
87.5°	28.3	14.0	14.0	12.3	12.3
90°	1.1	13.8	23.0	28.8	31.0
92.5°	28.8	24.2	27.6	30.0	31.0
95°	74.7	36.8	44.9	50.7	49.5
97.5°	134.6	40.3	58.6	62.2	63.2
100°	203.8	46.1	65.6	74.7	77.1
102.5°	279.7	277.4	68.0	80.5	84.1
105°	349.9	384.5	70.2	82.8	87.5
107.5°	431.6	460.2	72.6	85.1	89.8
110°	509.9	534.0	201.4	86.3	90.9



TEST NUMBER: P902923

CATALOG NUMBER: DFN2DIP-PN2F0-050D050US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	583.5	604.2	584.7	88.6	92.1
115°	661.8	681.3	710.1	177.3	94.4
117.5°	729.6	752.6	772.3	607.6	306.1
120°	805.6	822.8	843.6	857.4	702.0
122.5°	870.0	888.4	911.5	918.4	919.6
125°	935.6	950.6	972.5	980.5	984.0
127.5°	995.4	1011.5	1029.0	1040.4	1041.5
130°	1051.9	1070.4	1082.9	1095.6	1094.6
132.5°	1109.5	1124.5	1137.0	1147.5	1146.3
135°	1157.8	1176.3	1186.5	1198.2	1195.8
137.5°	1208.3	1222.2	1233.8	1245.3	1241.9
140°	1257.8	1267.2	1279.7	1290.1	1284.4
142.5°	1299.4	1307.5	1322.4	1331.5	1325.8
145°	1343.1	1341.9	1361.4	1369.5	1363.8
147.5°	1381.0	1377.5	1397.1	1402.9	1398.4
150°	1417.9	1409.9	1428.2	1435.1	1429.4
152.5°	1448.9	1439.7	1457.0	1464.0	1455.9
155°	1478.8	1468.6	1482.3	1489.2	1480.1
157.5°	1503.0	1493.8	1504.2	1512.3	1503.0
160°	1523.8	1516.8	1523.8	1530.6	1522.6
162.5°	1542.1	1535.3	1541.0	1549.1	1538.7
165°	1558.2	1551.4	1554.8	1562.8	1554.8
167.5°	1570.9	1564.0	1567.5	1575.6	1565.2
170°	1581.3	1574.3	1576.7	1584.7	1574.3
172.5°	1588.2	1581.3	1583.7	1591.7	1581.3
175°	1593.9	1585.8	1588.2	1596.2	1584.7
177.5°	1596.2	1588.2	1589.4	1597.4	1587.1
180°	1590.4	1590.4	1590.4	1590.4	1590.4

TEST NUMBER: P902923

CATALOG NUMBER: DFN2DIP-PN2F0-050D050US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.67	12.47	12.66	13.47	14.80	7.64	8.44	8.63	9.44	10.77
	3H	13.32	14.04	14.33	15.05	16.40	8.81	9.52	9.81	10.53	11.88
	4H	13.92	14.59	14.94	15.61	16.96	9.24	9.92	10.26	10.94	12.29
	6H	14.32	14.94	15.35	15.96	17.33	9.55	10.17	10.58	11.19	12.56
	8H	14.44	15.03	15.47	16.06	17.43	9.63	10.22	10.66	11.26	12.62
	12H	14.49	15.05	15.53	16.08	17.47	9.66	10.23	10.70	11.26	12.64
4H	2H	11.68	12.36	12.70	13.37	14.73	8.22	8.89	9.24	9.91	11.26
	3H	13.48	14.04	14.52	15.09	16.46	9.55	10.11	10.58	11.15	12.52
	4H	14.16	14.67	15.20	15.71	17.10	10.08	10.59	11.12	11.63	13.02
	6H	14.65	15.09	15.70	16.15	17.54	10.48	10.92	11.53	11.98	13.36
	8H	14.81	15.23	15.87	16.28	17.68	10.60	11.01	11.65	12.06	13.46
	12H	14.90	15.27	15.97	16.33	17.74	10.65	11.02	11.72	12.09	13.49
8H	4H	14.12	14.53	15.17	15.58	16.98	10.34	10.76	11.39	11.81	13.21
	6H	14.66	15.00	15.74	16.09	17.49	10.84	11.18	11.91	12.27	13.67
	8H	14.86	15.16	15.95	16.24	17.66	11.02	11.31	12.10	12.39	13.81
	12H	14.99	15.25	16.07	16.32	17.78	11.12	11.38	12.20	12.45	13.91
12H	4H	14.07	14.44	15.14	15.51	16.91	10.34	10.72	11.41	11.78	13.19
	6H	14.63	14.93	15.72	16.01	17.43	10.88	11.18	11.96	12.26	13.68
	8H	14.84	15.10	15.92	16.17	17.63	11.08	11.34	12.16	12.41	13.87

END OF REPORT