

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P905669

Luminaire Tested: DFN2DIP-PN2F0-060D050US835-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P905669
REPORT IS A COMBINATION OF REPORTS P901019 AND P897905
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-060D050US835-FLLONL
Description: 2 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10890.0 lumens
Efficiency: N/A
Efficacy: 102.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 105.8
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P905669

CATALOG NUMBER: DFN2DIP-PN2F0-060D050US835-FLLONL

Luminous Intensity Polar Plot

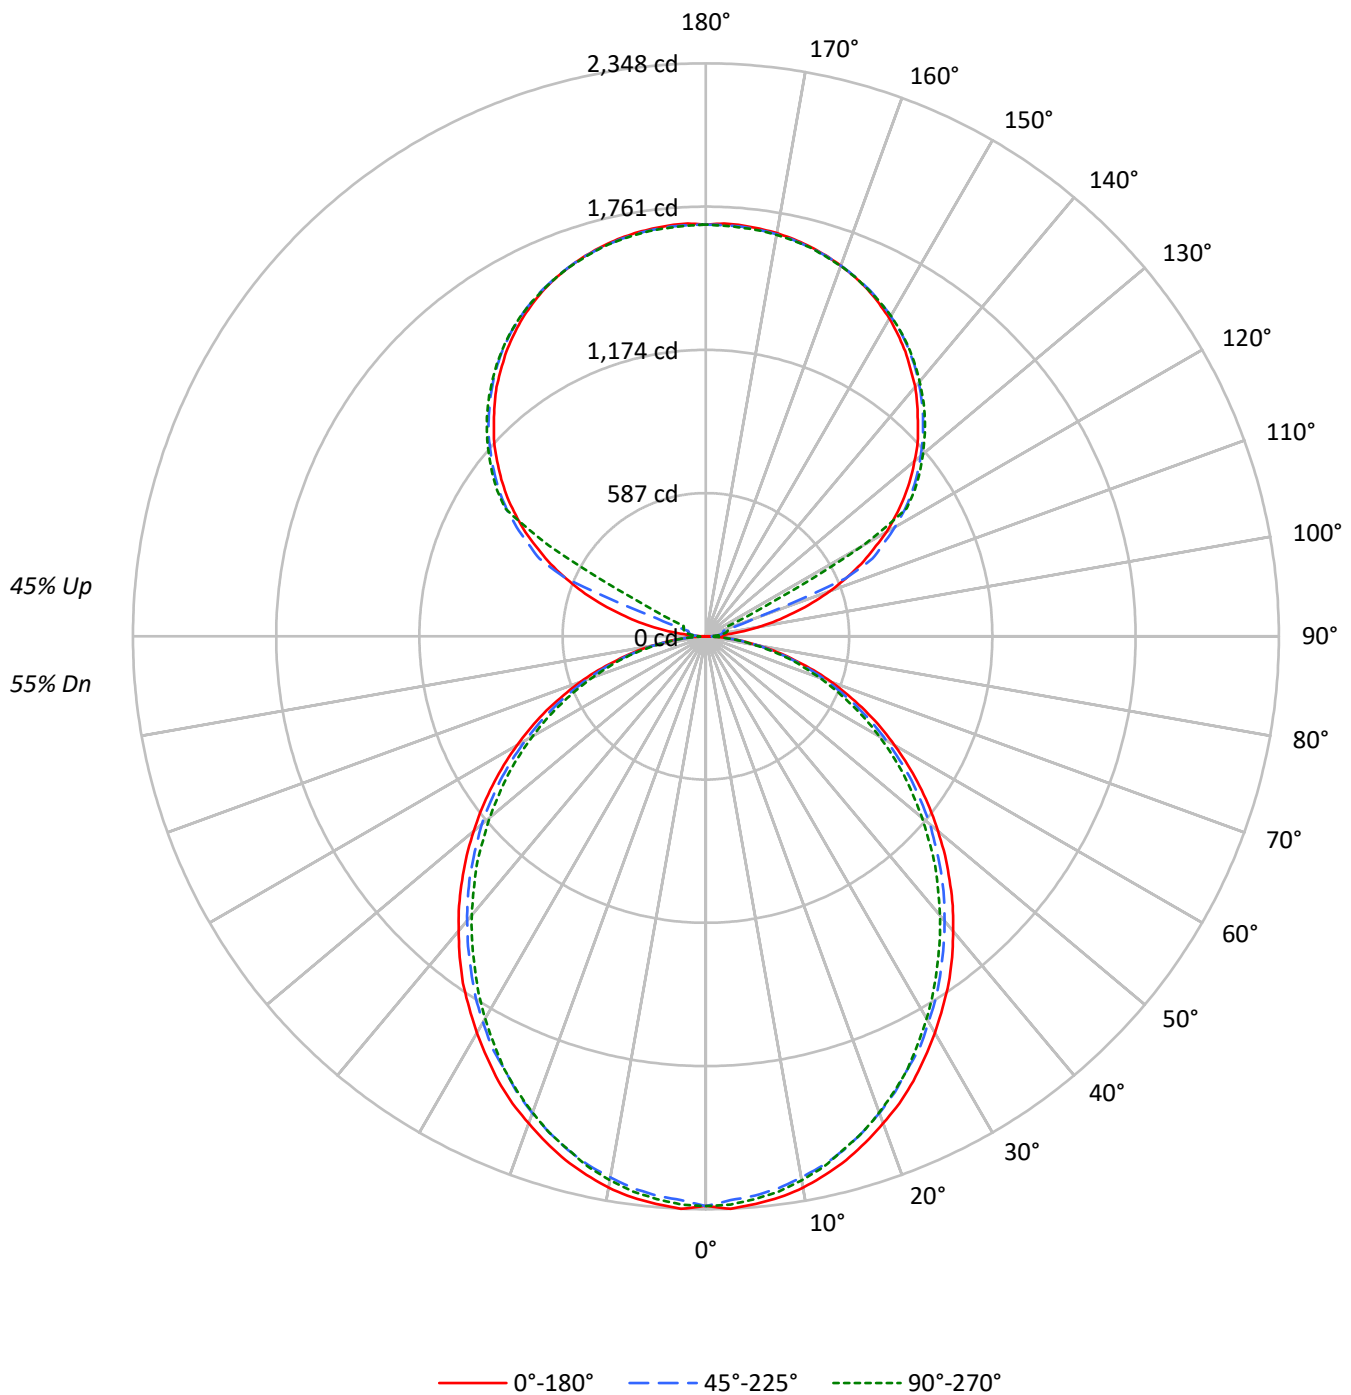

TEST NUMBER: P905669

CATALOG NUMBER: DFN2DIP-PN2F0-060D050US835-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	86	86	86	73	73	73	60	60	60
1	99	94	91	87	92	88	84	81	75	73	71	64	62	60	53	52	51
2	90	82	76	71	83	77	71	67	66	62	58	56	53	51	47	45	43
3	82	73	65	59	76	68	61	56	58	53	49	50	46	43	42	39	37
4	75	64	56	50	69	60	53	47	52	46	42	44	40	37	37	34	32
5	69	57	49	43	64	53	46	41	46	41	36	40	35	32	34	30	27
6	64	51	43	37	59	48	41	35	42	36	32	36	31	28	30	27	24
7	59	46	38	33	54	43	36	31	38	32	28	33	28	25	28	24	22
8	55	42	34	29	51	40	33	28	35	29	25	30	25	22	26	22	19
9	51	39	31	26	47	36	29	25	32	26	22	28	23	20	24	20	17
10	48	35	28	23	44	33	27	22	29	24	20	25	21	18	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5056	5056	5056
5°	5056	4975	5012
10°	5007	4897	4937
15°	4925	4806	4824
20°	4818	4683	4708
25°	4711	4539	4575
30°	4578	4403	4408
35°	4452	4245	4232
40°	4298	4086	4064
45°	4144	3925	3892
50°	3976	3755	3693
55°	3798	3560	3508
60°	3597	3330	3297
65°	3377	3089	3047
70°	3097	2796	2777
75°	2712	2445	2518
80°	2245	1997	2043
85°	1522	1262	1280

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4144 cd/sqm

TEST NUMBER: P905669

CATALOG NUMBER: DFN2DIP-PN2F0-060D050US835-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	219.7	2.0
10°-20°	618.3	5.7
20°-30°	908.6	8.3
30°-40°	1055.3	9.7
40°-50°	1054.0	9.7
50°-60°	919.0	8.4
60°-70°	679.4	6.2
70°-80°	384.4	3.5
80°-90°	104.4	1.0
90°-100°	55.7	0.5
100°-110°	207.4	1.9
110°-120°	550.1	5.1
120°-130°	912.4	8.4
130°-140°	969.2	8.9
140°-150°	900.8	8.3
150°-160°	724.2	6.7
160°-170°	466.6	4.3
170°-180°	160.6	1.5
0°-30°	1746.6	16.0
0°-40°	2801.8	25.7
0°-60°	4774.8	43.8
0°-90°	5943.0	54.6
90°-120°	813.2	7.5
90°-150°	3595.6	33.0
90°-180°	4947.0	45.4
0°-180°	10890.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2335	2335	2335	2335	2335	
5°	2335	2326	2301	2319	2315	222
15°	2222	2209	2180	2189	2178	626
25°	2011	1994	1955	1960	1955	926
35°	1735	1713	1677	1663	1652	1084
45°	1412	1396	1363	1338	1329	1090
55°	1069	1055	1028	1001	990	955
65°	721	707	685	664	653	713
75°	377	373	361	348	352	402
85°	92	90	88	81	79	103
90°	1	15	24	31	33	10
95°	79	39	48	54	52	94
105°	371	408	74	88	93	397
115°	702	723	753	188	100	691
125°	993	1009	1032	1040	1044	885
135°	1228	1248	1259	1271	1269	949
145°	1425	1424	1444	1453	1447	891
155°	1569	1558	1573	1580	1570	723
165°	1653	1646	1650	1658	1650	467
175°	1691	1682	1685	1694	1681	161
180°	1687	1687	1687	1687	1687	

TEST NUMBER: P905669

CATALOG NUMBER: DFN2DIP-PN2F0-060D050US835-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2334.6	2334.6	2334.6	2334.6	2334.6
2.5°	2348.2	2337.0	2312.2	2334.6	2330.3
5°	2334.6	2325.8	2301.0	2318.9	2314.6
7.5°	2318.9	2305.6	2280.8	2298.9	2294.4
10°	2294.4	2278.7	2251.7	2269.6	2262.9
12.5°	2260.6	2247.2	2220.3	2231.5	2227.0
15°	2222.4	2209.1	2179.8	2188.9	2177.7
17.5°	2175.3	2162.0	2132.7	2143.8	2132.7
20°	2123.6	2110.3	2078.8	2085.5	2076.7
22.5°	2072.2	2051.9	2022.6	2022.6	2018.1
25°	2011.4	1993.6	1955.4	1959.7	1955.4
27.5°	1944.0	1928.3	1899.2	1892.6	1881.4
30°	1876.9	1858.7	1825.2	1818.5	1809.4
32.5°	1804.9	1791.6	1755.6	1742.0	1733.0
35°	1735.4	1713.0	1677.0	1663.4	1652.2
37.5°	1656.8	1636.5	1600.6	1584.8	1573.6
40°	1576.0	1557.9	1522.0	1502.0	1492.9
42.5°	1497.4	1479.3	1443.6	1421.0	1407.6
45°	1412.2	1396.4	1362.6	1338.1	1329.0
47.5°	1329.0	1313.3	1277.4	1252.6	1239.2
50°	1241.4	1230.2	1198.8	1167.3	1156.1
52.5°	1156.1	1140.4	1111.3	1086.6	1070.9
55°	1068.7	1055.1	1028.2	1001.3	990.1
57.5°	981.1	969.9	940.6	913.7	904.6
60°	893.4	884.6	853.2	828.4	821.7
62.5°	808.1	792.4	770.0	747.6	738.6
65°	720.7	707.2	684.8	664.5	653.3
67.5°	630.9	619.5	599.5	583.8	574.7
70°	547.8	538.8	518.5	502.8	494.0
72.5°	462.5	453.5	442.3	426.6	419.9
75°	377.0	372.8	361.3	348.0	352.5
77.5°	300.8	291.8	287.2	280.6	273.9
80°	224.6	222.2	217.7	211.0	206.5
82.5°	152.7	152.7	150.5	141.5	141.5
85°	91.9	89.8	87.6	80.7	78.6
87.5°	40.5	36.0	31.4	24.8	22.4
90°	1.2	14.6	24.4	30.6	32.9
92.5°	30.6	25.7	29.3	31.8	32.9
95°	79.3	39.0	47.6	53.8	52.5
97.5°	142.8	42.8	62.2	66.0	67.1
100°	216.2	48.9	69.6	79.3	81.8
102.5°	296.7	294.3	72.1	85.4	89.2
105°	371.2	407.9	74.5	87.9	92.8
107.5°	457.9	488.3	77.0	90.3	95.3
110°	541.0	566.5	213.7	91.6	96.4

TEST NUMBER: P905669

CATALOG NUMBER: DFN2DIP-PN2F0-060D050US835-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	619.1	641.0	620.3	94.0	97.7
115°	702.1	722.8	753.4	188.1	100.2
117.5°	774.1	798.5	819.4	644.6	324.8
120°	854.7	873.0	895.0	909.7	744.8
122.5°	923.0	942.6	967.1	974.4	975.7
125°	992.6	1008.6	1031.8	1040.3	1044.0
127.5°	1056.1	1073.2	1091.7	1103.8	1105.0
130°	1116.0	1135.6	1148.9	1162.4	1161.3
132.5°	1177.1	1193.0	1206.3	1217.4	1216.2
135°	1228.4	1248.0	1258.8	1271.2	1268.7
137.5°	1282.0	1296.7	1309.0	1321.2	1317.6
140°	1334.5	1344.4	1357.7	1368.7	1362.7
142.5°	1378.6	1387.2	1403.0	1412.7	1406.6
145°	1425.0	1423.7	1444.4	1453.0	1446.9
147.5°	1465.2	1461.5	1482.3	1488.4	1483.6
150°	1504.3	1495.8	1515.3	1522.6	1516.5
152.5°	1537.2	1527.5	1545.8	1553.2	1544.6
155°	1569.0	1558.1	1572.7	1580.0	1570.3
157.5°	1594.6	1584.9	1595.9	1604.5	1594.6
160°	1616.7	1609.3	1616.7	1623.9	1615.4
162.5°	1636.1	1628.9	1634.9	1643.5	1632.5
165°	1653.2	1646.0	1649.6	1658.1	1649.6
167.5°	1666.7	1659.3	1663.1	1671.6	1660.6
170°	1677.7	1670.3	1672.8	1681.3	1670.3
172.5°	1685.0	1677.7	1680.2	1688.7	1677.7
175°	1691.1	1682.5	1685.0	1693.5	1681.3
177.5°	1693.5	1685.0	1686.3	1694.8	1683.8
180°	1687.4	1687.4	1687.4	1687.4	1687.4

TEST NUMBER: P905669

CATALOG NUMBER: DFN2DIP-PN2F0-060D050US835-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.20	14.10	14.12	15.04	16.24	12.76	13.67	13.68	14.60	15.81
	3H	14.84	15.65	15.77	16.60	17.83	14.36	15.17	15.29	16.12	17.35
	4H	15.42	16.19	16.36	17.13	18.37	14.94	15.70	15.88	16.65	17.89
	6H	15.80	16.51	16.76	17.47	18.72	15.32	16.03	16.27	16.98	18.23
	8H	15.90	16.58	16.86	17.55	18.80	15.42	16.09	16.38	17.06	18.31
	12H	15.94	16.59	16.91	17.55	18.83	15.45	16.09	16.42	17.06	18.33
4H	2H	13.66	14.42	14.60	15.37	16.61	13.31	14.07	14.25	15.02	16.26
	3H	15.50	16.14	16.46	17.12	18.37	15.10	15.74	16.06	16.72	17.97
	4H	16.20	16.79	17.17	17.76	19.04	15.79	16.37	16.76	17.35	18.62
	6H	16.70	17.20	17.68	18.20	19.48	16.28	16.78	17.26	17.78	19.06
	8H	16.84	17.31	17.82	18.30	19.59	16.42	16.89	17.40	17.88	19.17
	12H	16.91	17.33	17.91	18.34	19.63	16.47	16.90	17.47	17.90	19.20
8H	4H	16.39	16.86	17.37	17.85	19.14	16.02	16.49	17.00	17.48	18.77
	6H	17.00	17.39	18.01	18.42	19.71	16.63	17.02	17.63	18.05	19.33
	8H	17.21	17.55	18.22	18.57	19.88	16.83	17.17	17.84	18.19	19.49
	12H	17.33	17.63	18.35	18.64	19.99	16.93	17.23	17.95	18.25	19.60
12H	4H	16.38	16.80	17.38	17.81	19.10	16.01	16.44	17.02	17.45	18.74
	6H	17.02	17.37	18.04	18.39	19.69	16.66	17.01	17.68	18.03	19.33
	8H	17.25	17.56	18.27	18.57	19.92	16.88	17.19	17.90	18.20	19.55

END OF REPORT