

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P905671

Luminaire Tested: DFN2DIP-PN2F0-060D050US835-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P905671
REPORT IS A COMBINATION OF REPORTS P901020 AND P897905
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-060D050US835-RLLONL
Description: 2 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10050.0 lumens
Efficiency: N/A
Efficacy: 95.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 105.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P905671

CATALOG NUMBER: DFN2DIP-PN2F0-060D050US835-RLLONL

Luminous Intensity Polar Plot

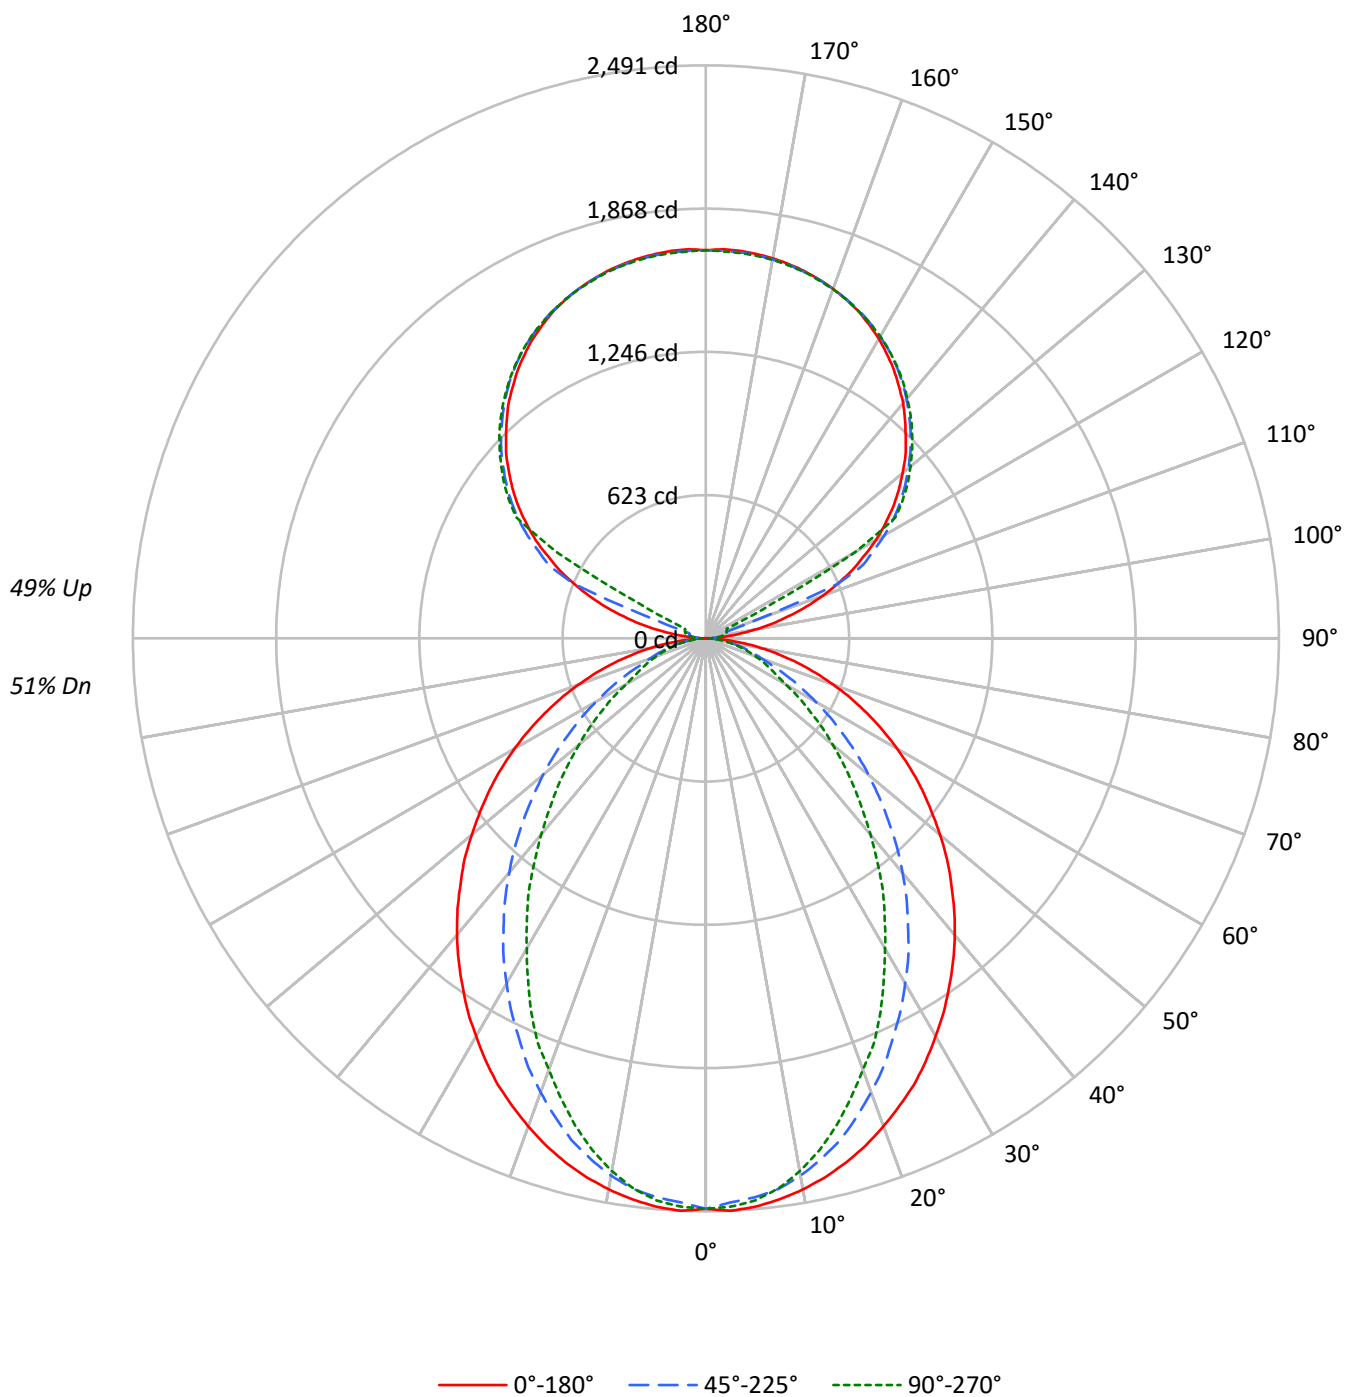

TEST NUMBER: P905671

CATALOG NUMBER: DFN2DIP-PN2F0-060D050US835-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	107	107	107	107	99	99	99	99	84	84	84		70	70	70		57
1	98	94	91	87	91	87	84	81	74	72	70		62	61	59		51
2	90	83	77	72	83	77	72	67	66	62	59		55	52	50		45
3	82	73	66	61	76	68	62	57	58	54	50		49	46	43		41
4	76	65	58	52	70	61	54	49	52	47	43		44	40	37		37
5	70	58	50	45	64	54	47	42	47	41	37		40	36	33		33
6	64	53	45	39	59	49	42	37	42	37	33		36	32	29		30
7	60	48	40	34	55	45	38	33	39	33	29		33	29	26		28
8	55	43	36	31	51	41	34	29	35	30	26		30	26	23		26
9	52	40	32	27	48	37	31	26	32	27	23		28	24	21		24
10	48	36	29	25	45	34	28	24	30	25	21		26	22	19		22

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5371	5371	5371
5°	5371	5274	5312
10°	5309	5159	5131
15°	5227	4978	4857
20°	5122	4732	4523
25°	5014	4459	4200
30°	4872	4179	3794
35°	4733	3881	3437
40°	4590	3572	3030
45°	4426	3232	2661
50°	4255	2890	2302
55°	4075	2525	1956
60°	3868	2146	1603
65°	3628	1762	1434
70°	3336	1403	1286
75°	2970	1214	1155
80°	2443	987	977
85°	1597	614	694

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4426 cd/sqm

TEST NUMBER: P905671

CATALOG NUMBER: DFN2DIP-PN2F0-060D050US835-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	232.4	2.3
10°-20°	638.0	6.3
20°-30°	895.7	8.9
30°-40°	976.4	9.7
40°-50°	897.4	8.9
50°-60°	704.8	7.0
60°-70°	458.8	4.6
70°-80°	236.1	2.3
80°-90°	63.3	0.6
90°-100°	55.7	0.6
100°-110°	207.4	2.1
110°-120°	550.1	5.5
120°-130°	912.4	9.1
130°-140°	969.2	9.6
140°-150°	900.8	9.0
150°-160°	724.2	7.2
160°-170°	466.6	4.6
170°-180°	160.6	1.6
0°-30°	1766.2	17.6
0°-40°	2742.6	27.3
0°-60°	4344.8	43.2
0°-90°	5103.0	50.8
90°-120°	813.2	8.1
90°-150°	3595.6	35.8
90°-180°	4947.0	49.2
0°-180°	10050.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2480	2480	2480	2480	2480	
5°	2480	2469	2439	2460	2453	235
15°	2359	2334	2258	2215	2193	665
25°	2141	2069	1921	1829	1795	985
35°	1845	1730	1533	1391	1342	1155
45°	1508	1358	1122	963	909	1165
55°	1147	972	729	595	552	1025
65°	774	592	390	314	307	768
75°	413	256	180	164	162	437
85°	96	49	43	43	43	111
90°	1	15	24	31	33	9
95°	79	39	48	54	52	94
105°	371	408	74	88	93	397
115°	702	723	753	188	100	691
125°	993	1009	1032	1040	1044	885
135°	1228	1248	1259	1271	1269	949
145°	1425	1424	1444	1453	1447	891
155°	1569	1558	1573	1580	1570	723
165°	1653	1646	1650	1658	1650	467
175°	1691	1682	1685	1694	1681	161
180°	1687	1687	1687	1687	1687	

TEST NUMBER: P905671

CATALOG NUMBER: DFN2DIP-PN2F0-060D050US835-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2479.8	2479.8	2479.8	2479.8	2479.8
2.5°	2491.0	2479.8	2455.0	2477.6	2473.1
5°	2479.8	2468.6	2439.3	2459.6	2452.9
7.5°	2459.6	2446.2	2414.8	2423.6	2412.4
10°	2432.6	2416.9	2372.2	2365.3	2351.9
12.5°	2399.1	2378.8	2318.1	2304.8	2280.0
15°	2358.6	2333.8	2257.6	2215.0	2192.6
17.5°	2311.5	2275.5	2181.2	2131.9	2096.0
20°	2257.6	2212.6	2100.5	2044.5	1995.0
22.5°	2199.3	2147.6	2017.4	1941.2	1907.6
25°	2141.0	2069.1	1921.0	1829.1	1795.3
27.5°	2071.5	1995.0	1831.2	1725.7	1674.1
30°	1997.4	1911.9	1732.4	1618.1	1557.4
32.5°	1925.5	1822.2	1638.4	1503.6	1447.4
35°	1844.8	1730.3	1532.9	1391.4	1341.9
37.5°	1766.2	1642.6	1434.1	1279.1	1223.1
40°	1683.1	1548.6	1330.7	1171.4	1113.1
42.5°	1597.9	1454.3	1227.6	1061.4	1005.5
45°	1508.1	1357.6	1122.2	962.6	908.8
47.5°	1422.9	1263.6	1021.2	861.7	812.4
50°	1328.6	1169.3	922.4	767.4	720.5
52.5°	1236.4	1068.1	828.1	680.0	637.4
55°	1146.7	971.7	729.3	594.8	552.1
57.5°	1054.8	875.2	641.9	516.2	480.2
60°	960.5	781.0	549.8	435.5	399.5
62.5°	868.6	689.1	471.2	363.6	345.7
65°	774.3	592.4	390.5	314.3	307.4
67.5°	684.5	502.6	314.3	276.0	269.3
70°	590.2	415.2	260.2	237.9	228.8
72.5°	500.5	334.3	217.6	199.8	195.2
75°	412.9	255.7	179.5	163.8	161.7
77.5°	325.5	181.7	141.4	132.4	127.9
80°	244.5	130.2	107.6	98.8	98.8
82.5°	170.5	87.6	74.0	69.5	69.5
85°	96.4	49.3	42.6	42.6	42.6
87.5°	36.0	17.9	17.9	15.7	15.7
90°	1.2	14.6	24.4	30.6	32.9
92.5°	30.6	25.7	29.3	31.8	32.9
95°	79.3	39.0	47.6	53.8	52.5
97.5°	142.8	42.8	62.2	66.0	67.1
100°	216.2	48.9	69.6	79.3	81.8
102.5°	296.7	294.3	72.1	85.4	89.2
105°	371.2	407.9	74.5	87.9	92.8
107.5°	457.9	488.3	77.0	90.3	95.3
110°	541.0	566.5	213.7	91.6	96.4



TEST NUMBER: P905671

CATALOG NUMBER: DFN2DIP-PN2F0-060D050US835-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	619.1	641.0	620.3	94.0	97.7
115°	702.1	722.8	753.4	188.1	100.2
117.5°	774.1	798.5	819.4	644.6	324.8
120°	854.7	873.0	895.0	909.7	744.8
122.5°	923.0	942.6	967.1	974.4	975.7
125°	992.6	1008.6	1031.8	1040.3	1044.0
127.5°	1056.1	1073.2	1091.7	1103.8	1105.0
130°	1116.0	1135.6	1148.9	1162.4	1161.3
132.5°	1177.1	1193.0	1206.3	1217.4	1216.2
135°	1228.4	1248.0	1258.8	1271.2	1268.7
137.5°	1282.0	1296.7	1309.0	1321.2	1317.6
140°	1334.5	1344.4	1357.7	1368.7	1362.7
142.5°	1378.6	1387.2	1403.0	1412.7	1406.6
145°	1425.0	1423.7	1444.4	1453.0	1446.9
147.5°	1465.2	1461.5	1482.3	1488.4	1483.6
150°	1504.3	1495.8	1515.3	1522.6	1516.5
152.5°	1537.2	1527.5	1545.8	1553.2	1544.6
155°	1569.0	1558.1	1572.7	1580.0	1570.3
157.5°	1594.6	1584.9	1595.9	1604.5	1594.6
160°	1616.7	1609.3	1616.7	1623.9	1615.4
162.5°	1636.1	1628.9	1634.9	1643.5	1632.5
165°	1653.2	1646.0	1649.6	1658.1	1649.6
167.5°	1666.7	1659.3	1663.1	1671.6	1660.6
170°	1677.7	1670.3	1672.8	1681.3	1670.3
172.5°	1685.0	1677.7	1680.2	1688.7	1677.7
175°	1691.1	1682.5	1685.0	1693.5	1681.3
177.5°	1693.5	1685.0	1686.3	1694.8	1683.8
180°	1687.4	1687.4	1687.4	1687.4	1687.4

TEST NUMBER: P905671

CATALOG NUMBER: DFN2DIP-PN2F0-060D050US835-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.94	13.78	13.90	14.75	16.01	8.91	9.75	9.87	10.72	11.98
	3H	14.60	15.35	15.57	16.33	17.61	10.08	10.83	11.05	11.81	13.09
	4H	15.20	15.90	16.18	16.88	18.18	10.52	11.23	11.50	12.21	13.50
	6H	15.60	16.25	16.59	17.24	18.54	10.83	11.48	11.82	12.47	13.77
	8H	15.72	16.34	16.72	17.34	18.64	10.91	11.53	11.91	12.53	13.84
	12H	15.77	16.36	16.78	17.36	18.68	10.95	11.54	11.95	12.53	13.86
4H	2H	12.96	13.66	13.95	14.65	15.94	9.50	10.20	10.48	11.18	12.48
	3H	14.76	15.35	15.76	16.36	17.67	10.83	11.42	11.82	12.43	13.73
	4H	15.44	15.98	16.45	16.98	18.31	11.36	11.90	12.37	12.90	14.23
	6H	15.94	16.40	16.95	17.42	18.75	11.76	12.22	12.78	13.25	14.58
	8H	16.10	16.53	17.12	17.55	18.89	11.88	12.31	12.90	13.33	14.68
	12H	16.18	16.57	17.22	17.61	18.96	11.94	12.33	12.97	13.36	14.71
8H	4H	15.40	15.84	16.42	16.86	18.20	11.63	12.06	12.65	13.08	14.42
	6H	15.95	16.30	16.99	17.37	18.71	12.13	12.48	13.17	13.54	14.88
	8H	16.15	16.46	17.20	17.51	18.87	12.30	12.62	13.35	13.66	15.02
	12H	16.28	16.55	17.33	17.59	19.00	12.41	12.68	13.46	13.73	15.13
12H	4H	15.36	15.74	16.39	16.78	18.13	11.63	12.02	12.67	13.05	14.40
	6H	15.92	16.24	16.97	17.28	18.64	12.17	12.48	13.22	13.53	14.89
	8H	16.13	16.40	17.18	17.45	18.85	12.36	12.64	13.42	13.68	15.08

END OF REPORT