

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908306

Luminaire Tested: DFN2DIP-PN2F0-020D020US840-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908306
REPORT IS A COMBINATION OF REPORTS P899462 AND P896349
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-020D020US840-RLLFLL
Description: 2 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3504.2 lumens
Efficiency: N/A
Efficacy: 108.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 32.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908306

CATALOG NUMBER: DFN2DIP-PN2F0-020D020US840-RLLFLL

Luminous Intensity Polar Plot

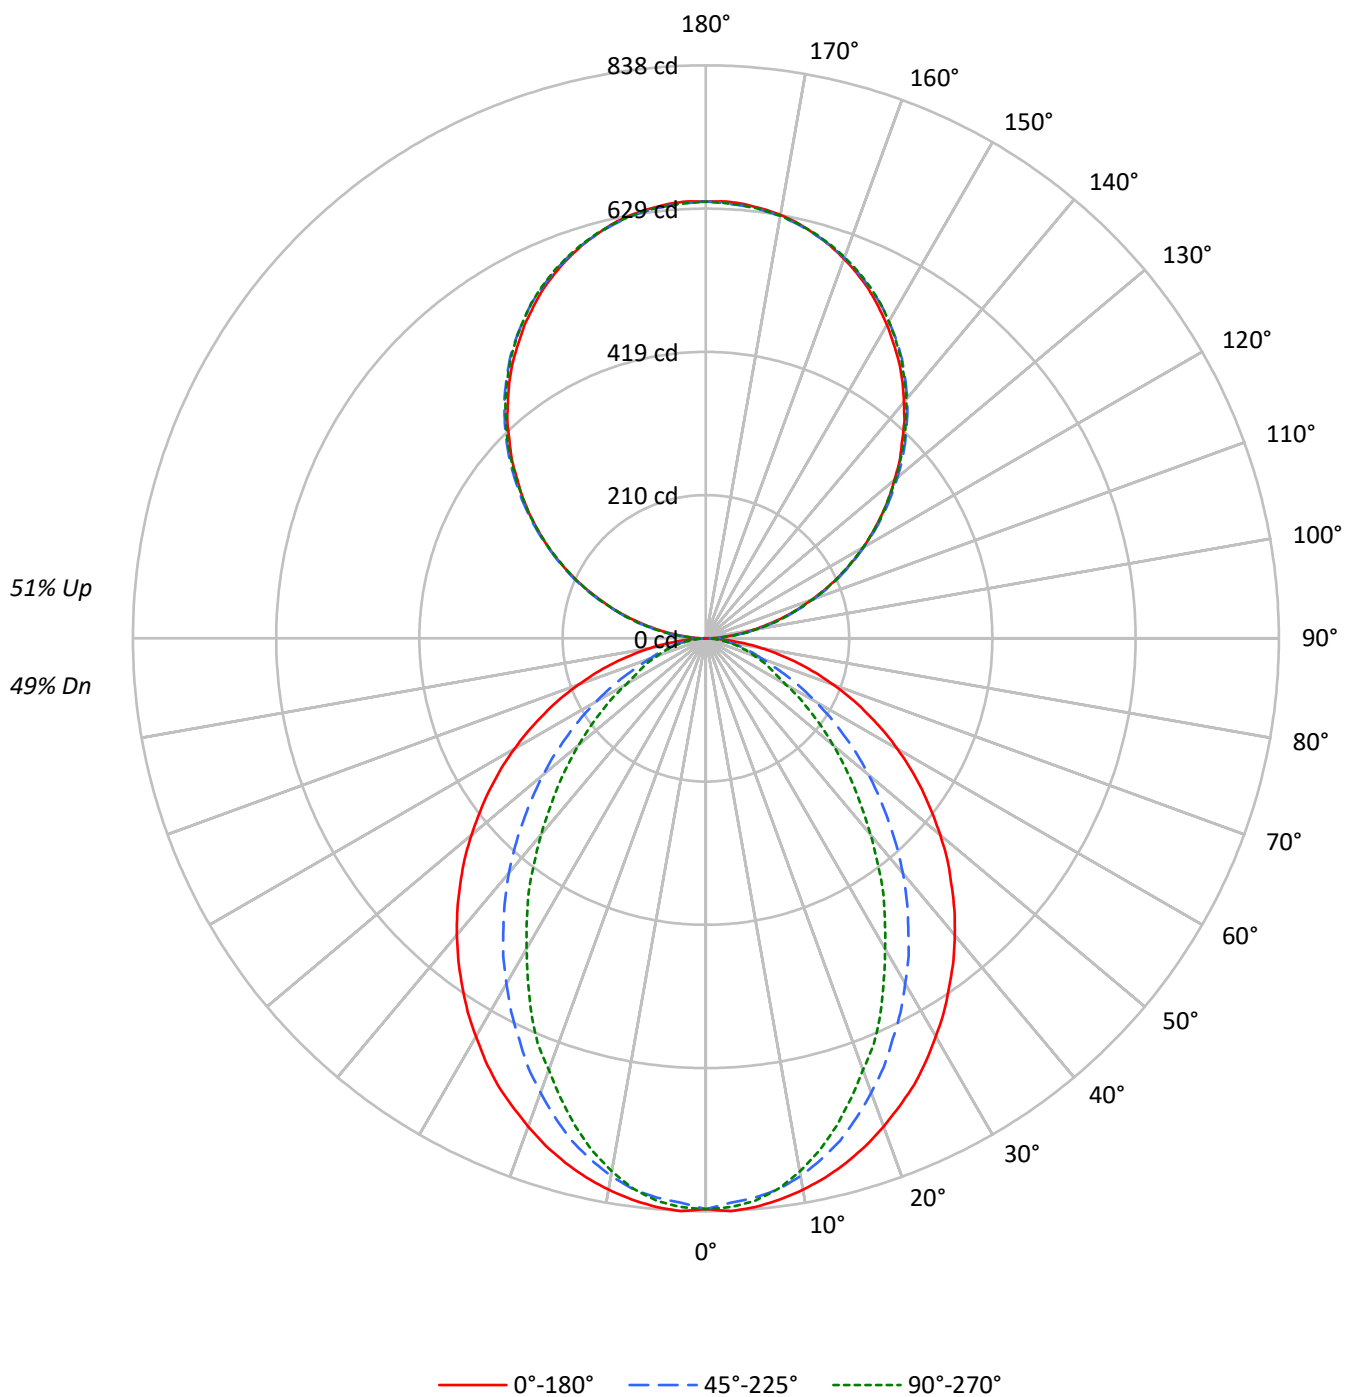

TEST NUMBER: P908306

CATALOG NUMBER: DFN2DIP-PN2F0-020D020US840-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1808	1808	1808
5°	1808	1775	1788
10°	1787	1737	1727
15°	1760	1675	1635
20°	1724	1593	1522
25°	1688	1501	1414
30°	1640	1407	1277
35°	1593	1306	1157
40°	1545	1203	1020
45°	1490	1088	896
50°	1432	973	775
55°	1372	850	658
60°	1302	722	540
65°	1221	593	483
70°	1123	472	433
75°	1000	409	389
80°	822	333	328
85°	537	206	233

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1490 cd/sqm

TEST NUMBER: P908306

CATALOG NUMBER: DFN2DIP-PN2F0-020D020US840-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	78.2	2.2
10°-20°	214.8	6.1
20°-30°	301.5	8.6
30°-40°	328.7	9.4
40°-50°	302.1	8.6
50°-60°	237.3	6.8
60°-70°	154.4	4.4
70°-80°	79.5	2.3
80°-90°	22.1	0.6
90°-100°	39.5	1.1
100°-110°	125.6	3.6
110°-120°	214.9	6.1
120°-130°	282.7	8.1
130°-140°	317.3	9.1
140°-150°	311.1	8.9
150°-160°	261.0	7.4
160°-170°	173.1	4.9
170°-180°	60.5	1.7
0°-30°	594.5	17.0
0°-40°	923.2	26.3
0°-60°	1462.6	41.7
0°-90°	1718.6	49.0
90°-120°	380.0	10.8
90°-150°	1291.1	36.8
90°-180°	1786.0	51.0
0°-180°	3504.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	835	835	835	835	835	
5°	835	831	821	828	826	79
15°	794	786	760	746	738	224
25°	721	696	647	616	604	331
35°	621	582	516	468	452	389
45°	508	457	378	324	306	392
55°	386	327	246	200	186	345
65°	261	199	132	106	104	258
75°	139	86	60	55	54	147
85°	32	17	14	14	14	37
90°	1	7	19	18	18	3
95°	28	34	34	34	34	31
105°	116	117	119	120	120	122
115°	216	219	218	217	216	213
125°	314	318	317	315	315	280
135°	406	412	413	412	411	314
145°	493	496	500	500	498	308
155°	563	565	566	569	568	259
165°	613	612	612	616	613	173
175°	638	636	635	639	636	61
180°	639	639	639	639	639	

TEST NUMBER: P908306

CATALOG NUMBER: DFN2DIP-PN2F0-020D020US840-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	834.8	834.8	834.8	834.8	834.8
2.5°	838.5	834.8	826.4	834.0	832.5
5°	834.8	831.0	821.1	828.0	825.7
7.5°	828.0	823.4	812.8	815.9	812.0
10°	818.9	813.5	798.5	796.2	791.7
12.5°	807.6	800.7	780.3	775.9	767.5
15°	794.0	785.6	759.9	745.6	738.1
17.5°	778.1	766.0	734.3	717.6	705.6
20°	759.9	744.8	707.1	688.2	671.6
22.5°	740.3	723.0	679.1	653.5	642.2
25°	720.7	696.5	646.6	615.7	604.3
27.5°	697.3	671.6	616.4	580.9	563.5
30°	672.4	643.6	583.2	544.7	524.2
32.5°	648.1	613.4	551.5	506.1	487.3
35°	621.0	582.5	516.0	468.4	451.7
37.5°	594.5	552.9	482.7	430.6	411.7
40°	566.5	521.3	448.0	394.4	374.7
42.5°	537.9	489.6	413.2	357.3	338.5
45°	507.7	457.0	377.8	324.1	305.9
47.5°	479.0	425.4	343.8	290.0	273.5
50°	447.3	393.6	310.5	258.3	242.6
52.5°	416.2	359.5	278.7	228.9	214.6
55°	386.0	327.1	245.5	200.3	185.8
57.5°	355.1	294.6	216.1	173.8	161.7
60°	323.4	262.9	185.1	146.6	134.5
62.5°	292.4	232.0	158.6	122.4	116.3
65°	260.6	199.4	131.5	105.8	103.5
67.5°	230.5	169.2	105.8	92.9	90.7
70°	198.6	139.8	87.6	80.1	77.1
72.5°	168.4	112.5	73.2	67.3	65.7
75°	139.0	86.0	60.4	55.1	54.4
77.5°	109.6	61.2	47.6	44.5	43.0
80°	82.3	43.8	36.3	33.2	33.2
82.5°	57.4	29.5	24.9	23.4	23.4
85°	32.4	16.6	14.3	14.3	14.3
87.5°	12.1	6.1	6.1	5.3	5.3
90°	0.6	7.0	18.9	17.7	18.3
92.5°	11.9	16.2	16.8	17.4	17.4
95°	28.1	33.5	34.4	34.4	33.5
97.5°	46.8	51.8	53.9	53.9	53.9
100°	68.4	72.8	74.3	74.3	73.7
102.5°	91.1	94.3	96.4	97.0	96.4
105°	115.9	117.4	118.7	119.6	119.6
107.5°	140.6	142.9	142.9	143.3	140.6
110°	164.5	167.5	167.5	167.5	166.0

TEST NUMBER: P908306

CATALOG NUMBER: DFN2DIP-PN2F0-020D020US840-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	190.3	193.5	193.0	191.4	190.3
115°	215.7	218.7	217.8	217.2	215.7
117.5°	241.0	245.2	242.5	241.0	239.3
120°	266.3	270.5	266.3	266.3	264.6
122.5°	289.4	294.8	292.2	290.6	289.4
125°	313.7	318.5	317.0	315.3	314.7
127.5°	337.4	343.4	341.2	338.9	337.4
130°	359.5	366.5	365.5	364.4	362.2
132.5°	384.4	389.8	390.1	387.5	385.9
135°	405.8	411.7	412.8	412.3	410.7
137.5°	429.6	434.4	435.5	435.1	432.7
140°	450.6	455.4	458.2	458.2	456.1
142.5°	472.2	477.0	478.6	479.1	477.0
145°	492.6	496.4	499.6	500.1	498.0
147.5°	510.9	515.7	518.1	519.0	516.8
150°	529.8	533.0	535.1	536.8	535.1
152.5°	546.5	549.8	552.5	554.6	552.5
155°	563.3	564.8	566.5	569.3	567.5
157.5°	577.7	578.9	579.9	583.7	581.0
160°	590.7	591.8	592.4	595.6	593.3
162.5°	602.6	602.6	603.1	606.8	604.1
165°	612.8	612.2	612.2	616.0	613.4
167.5°	622.0	620.3	620.3	624.1	621.5
170°	628.9	627.4	626.8	630.7	627.4
172.5°	633.8	632.2	631.7	635.5	632.2
175°	637.6	636.1	634.9	638.7	635.5
177.5°	639.7	638.2	637.0	640.3	637.0
180°	638.7	638.7	638.7	638.7	638.7

TEST NUMBER: P908306

CATALOG NUMBER: DFN2DIP-PN2F0-020D020US840-RLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.00	9.82	9.97	10.80	12.09	4.97	5.79	5.94	6.77	8.06
	3H	10.65	11.39	11.64	12.38	13.69	6.14	6.87	7.12	7.86	9.17
	4H	11.25	11.94	12.24	12.94	14.25	6.57	7.27	7.57	8.26	9.58
	6H	11.65	12.29	12.66	13.29	14.62	6.88	7.52	7.89	8.52	9.85
	8H	11.77	12.38	12.78	13.39	14.72	6.96	7.57	7.97	8.59	9.91
	12H	11.82	12.40	12.84	13.41	14.76	7.00	7.58	8.01	8.58	9.93
4H	2H	9.01	9.70	10.01	10.70	12.02	5.55	6.24	6.55	7.24	8.56
	3H	10.81	11.39	11.83	12.42	13.75	6.88	7.46	7.89	8.48	9.81
	4H	11.49	12.02	12.51	13.03	14.39	7.41	7.94	8.43	8.96	10.31
	6H	11.98	12.44	13.01	13.48	14.83	7.81	8.26	8.84	9.30	10.65
	8H	12.15	12.57	13.18	13.60	14.97	7.93	8.35	8.96	9.38	10.75
	12H	12.23	12.61	13.28	13.66	15.03	7.98	8.37	9.03	9.41	10.78
8H	4H	11.45	11.88	12.48	12.91	14.27	7.68	8.10	8.71	9.13	10.50
	6H	12.00	12.35	13.05	13.42	14.78	8.17	8.52	9.23	9.60	10.96
	8H	12.20	12.51	13.26	13.57	14.95	8.35	8.66	9.41	9.72	11.10
	12H	12.32	12.59	13.39	13.65	15.07	8.45	8.72	9.52	9.78	11.20
12H	4H	11.40	11.79	12.45	12.83	14.20	7.68	8.06	8.73	9.11	10.48
	6H	11.97	12.28	13.03	13.34	14.72	8.22	8.52	9.28	9.58	10.96
	8H	12.18	12.45	13.24	13.50	14.92	8.41	8.68	9.48	9.73	11.16

END OF REPORT