

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908337

Luminaire Tested: DFN2DIP-PN2F0-030D050US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908337
REPORT IS A COMBINATION OF REPORTS P901013 AND P897905
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-030D050US840-FLLONL
Description: 2 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7998.2 lumens
Efficiency: N/A
Efficacy: 115.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 69
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908337

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US840-FLLONL

Luminous Intensity Polar Plot

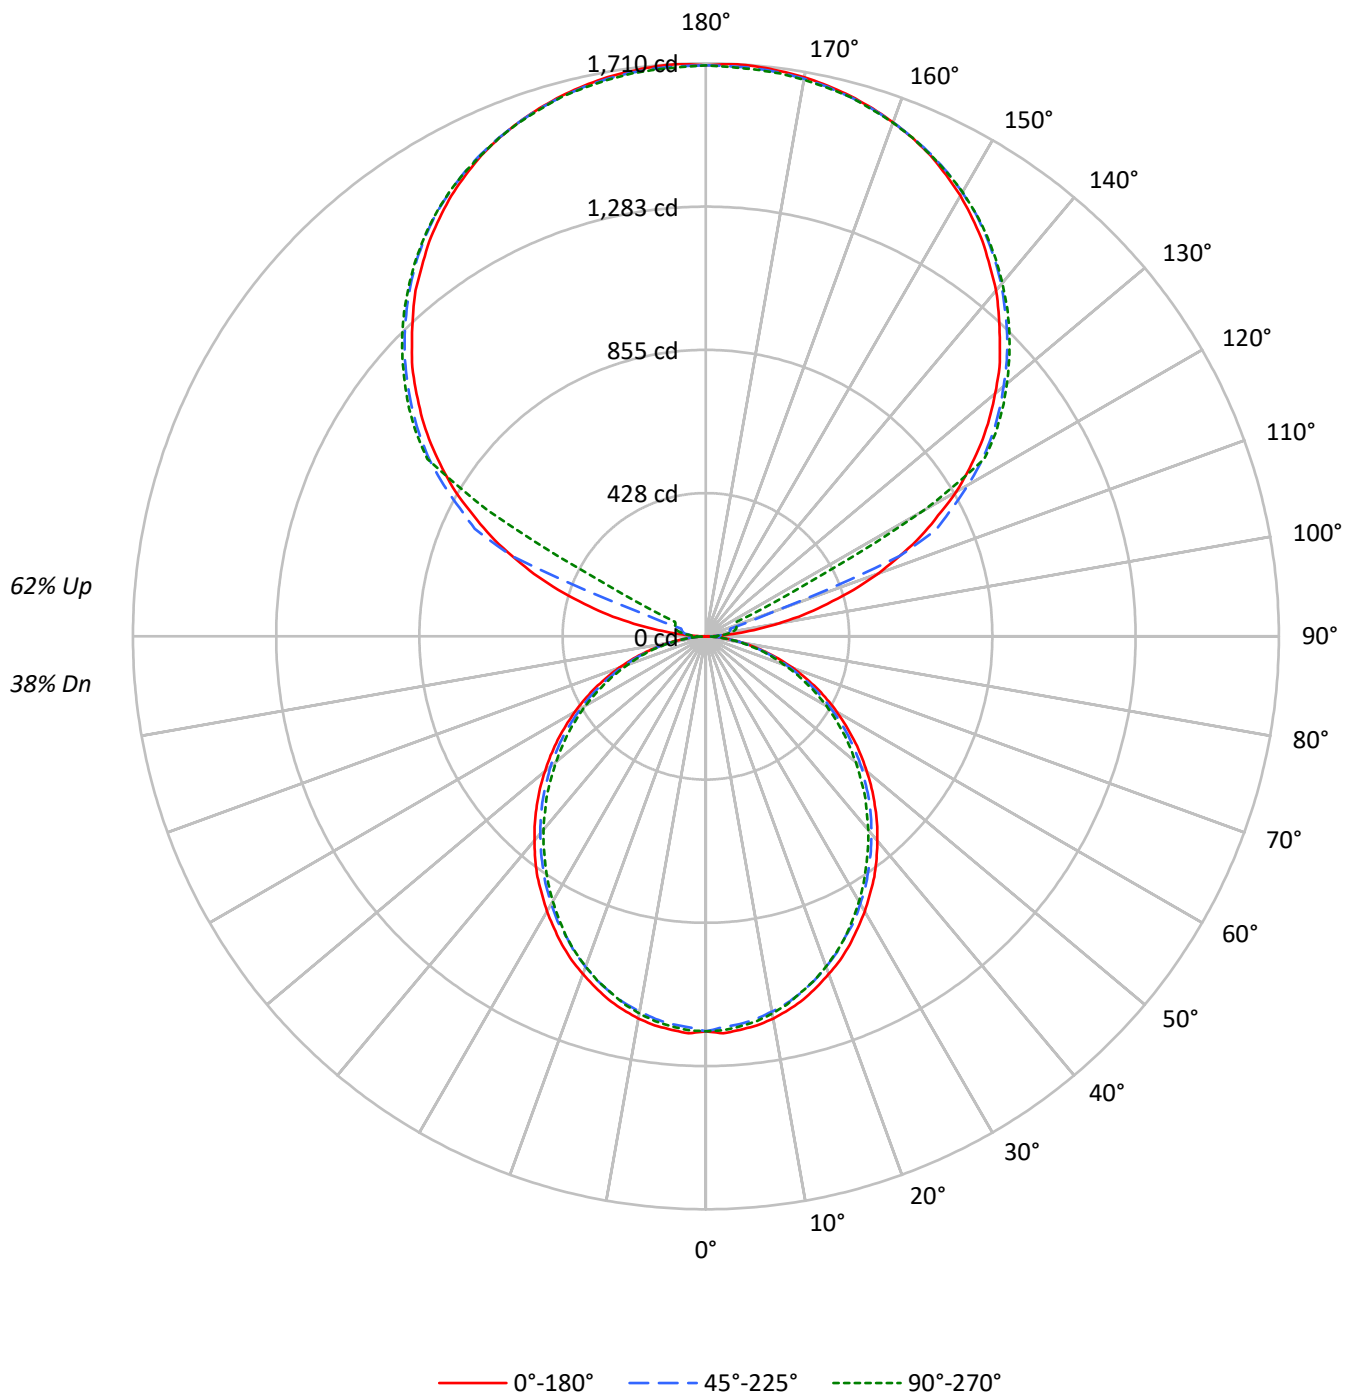

TEST NUMBER: P908337

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US840-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	60	60	60	45	45	45
1	95	91	87	83	86	82	79	76	67	65	63	53	51	50	39	39	38
2	86	79	73	68	78	72	67	63	59	55	52	46	44	42	35	33	32
3	79	70	62	57	71	63	57	52	52	47	44	41	38	35	31	29	27
4	72	62	54	48	65	56	49	44	46	41	37	36	33	30	27	25	23
5	66	55	47	41	60	50	43	38	41	36	32	33	29	26	25	22	20
6	61	49	41	35	55	45	38	33	37	32	28	29	26	23	22	20	18
7	56	44	36	31	51	40	34	29	33	28	24	27	23	20	20	18	16
8	52	40	32	27	47	37	30	25	30	25	22	24	21	18	19	16	14
9	48	36	29	24	44	33	27	23	28	23	19	22	19	16	17	15	13
10	45	33	26	22	41	31	24	20	26	21	17	21	17	14	16	13	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2553	2553	2553
5°	2553	2512	2531
10°	2528	2473	2493
15°	2487	2427	2435
20°	2433	2365	2377
25°	2379	2292	2310
30°	2312	2223	2226
35°	2248	2144	2137
40°	2170	2063	2052
45°	2093	1982	1965
50°	2007	1896	1865
55°	1918	1798	1772
60°	1816	1681	1665
65°	1705	1560	1539
70°	1564	1412	1402
75°	1370	1235	1271
80°	1133	1008	1032
85°	770	637	647

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2093 cd/sqm

TEST NUMBER: P908337

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US840-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	111.0	1.4
10°-20°	312.2	3.9
20°-30°	458.8	5.7
30°-40°	532.8	6.7
40°-50°	532.2	6.7
50°-60°	464.1	5.8
60°-70°	343.1	4.3
70°-80°	194.1	2.4
80°-90°	54.2	0.7
90°-100°	56.2	0.7
100°-110°	209.5	2.6
110°-120°	555.6	6.9
120°-130°	921.4	11.5
130°-140°	978.8	12.2
140°-150°	909.7	11.4
150°-160°	731.3	9.1
160°-170°	471.2	5.9
170°-180°	162.2	2.0
0°-30°	881.9	11.0
0°-40°	1414.7	17.7
0°-60°	2411.0	30.1
0°-90°	3002.3	37.5
90°-120°	821.2	10.3
90°-150°	3631.1	45.4
90°-180°	4996.0	62.5
0°-180°	7998.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1179	1179	1179	1179	1179	
5°	1179	1174	1162	1171	1169	112
15°	1122	1116	1101	1105	1100	316
25°	1016	1007	987	990	987	467
35°	876	865	847	840	834	547
45°	713	705	688	676	671	550
55°	540	533	519	506	500	482
65°	364	357	346	336	330	360
75°	190	188	182	176	178	203
85°	46	45	44	41	40	52
90°	1	15	25	31	33	7
95°	80	39	48	54	53	95
105°	375	412	75	89	94	401
115°	709	730	761	190	101	698
125°	1002	1019	1042	1051	1054	894
135°	1240	1260	1271	1284	1281	958
145°	1439	1438	1459	1467	1461	900
155°	1584	1574	1588	1596	1586	730
165°	1670	1662	1666	1674	1666	472
175°	1708	1699	1702	1710	1698	163
180°	1704	1704	1704	1704	1704	

TEST NUMBER: P908337

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1178.8	1178.8	1178.8	1178.8	1178.8
2.5°	1185.7	1180.0	1167.5	1178.8	1176.7
5°	1178.8	1174.4	1161.9	1170.9	1168.7
7.5°	1170.9	1164.2	1151.7	1160.8	1158.5
10°	1158.5	1150.5	1137.0	1146.0	1142.7
12.5°	1141.5	1134.7	1121.2	1126.7	1124.5
15°	1122.2	1115.5	1100.7	1105.2	1099.5
17.5°	1098.3	1091.7	1076.8	1082.5	1076.8
20°	1072.3	1065.5	1049.7	1053.0	1048.5
22.5°	1046.3	1036.1	1021.3	1021.3	1019.0
25°	1015.6	1006.6	987.3	989.6	987.3
27.5°	981.6	973.6	959.0	955.6	950.0
30°	947.7	938.6	921.6	918.2	913.6
32.5°	911.4	904.6	886.5	879.6	875.0
35°	876.3	864.9	846.8	839.9	834.2
37.5°	836.6	826.4	808.2	800.2	794.6
40°	795.8	786.7	768.5	758.4	753.9
42.5°	756.1	747.0	728.9	717.5	710.7
45°	713.1	705.1	688.0	675.6	671.1
47.5°	671.1	663.2	645.0	632.5	625.7
50°	626.8	621.2	605.3	589.5	583.8
52.5°	583.8	575.8	561.2	548.7	540.7
55°	539.7	532.8	519.2	505.6	500.0
57.5°	495.3	489.7	474.9	461.3	456.8
60°	451.1	446.7	430.8	418.3	415.0
62.5°	408.1	400.1	388.8	377.5	372.9
65°	364.0	357.1	345.8	335.6	329.9
67.5°	318.6	312.9	302.7	294.8	290.2
70°	276.6	272.1	261.9	253.9	249.4
72.5°	233.6	228.9	223.3	215.4	212.1
75°	190.4	188.2	182.5	175.7	178.0
77.5°	151.9	147.3	145.0	141.7	138.4
80°	113.4	112.2	109.9	106.5	104.3
82.5°	77.1	77.1	76.0	71.4	71.4
85°	46.5	45.3	44.2	40.8	39.7
87.5°	20.4	18.2	15.9	12.5	11.3
90°	1.2	14.7	24.6	30.9	33.2
92.5°	30.9	26.0	29.6	32.1	33.2
95°	80.1	39.4	48.1	54.3	53.0
97.5°	144.2	43.2	62.8	66.7	67.8
100°	218.3	49.4	70.3	80.1	82.6
102.5°	299.6	297.2	72.8	86.2	90.1
105°	374.9	411.9	75.2	88.8	93.7
107.5°	462.4	493.1	77.8	91.2	96.2
110°	546.3	572.1	215.8	92.5	97.4

TEST NUMBER: P908337

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	625.2	647.3	626.4	94.9	98.7
115°	709.0	729.9	760.8	190.0	101.2
117.5°	781.7	806.4	827.5	651.0	328.0
120°	863.1	881.6	903.8	918.7	752.1
122.5°	932.1	951.9	976.6	984.0	985.3
125°	1002.4	1018.6	1042.0	1050.6	1054.3
127.5°	1066.5	1083.8	1102.5	1114.7	1115.9
130°	1127.0	1146.8	1160.2	1173.9	1172.8
132.5°	1188.7	1204.8	1218.2	1229.4	1228.2
135°	1240.5	1260.3	1271.2	1283.7	1281.2
137.5°	1294.6	1309.5	1321.9	1334.2	1330.6
140°	1347.7	1357.7	1371.1	1382.2	1376.1
142.5°	1392.2	1400.9	1416.8	1426.6	1420.5
145°	1439.1	1437.7	1458.6	1467.3	1461.2
147.5°	1479.7	1475.9	1496.9	1503.1	1498.2
150°	1519.1	1510.6	1530.2	1537.6	1531.5
152.5°	1552.4	1542.6	1561.1	1568.5	1559.8
155°	1584.5	1573.5	1588.2	1595.6	1585.8
157.5°	1610.3	1600.5	1611.6	1620.3	1610.3
160°	1632.6	1625.2	1632.6	1639.9	1631.3
162.5°	1652.2	1645.0	1651.0	1659.7	1648.6
165°	1669.5	1662.2	1665.9	1674.5	1665.9
167.5°	1683.1	1675.7	1679.5	1688.1	1677.0
170°	1694.3	1686.8	1689.3	1697.9	1686.8
172.5°	1701.6	1694.3	1696.8	1705.4	1694.3
175°	1707.8	1699.1	1701.6	1710.2	1697.9
177.5°	1710.2	1701.6	1702.9	1711.5	1700.4
180°	1704.0	1704.0	1704.0	1704.0	1704.0

TEST NUMBER: P908337

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US840-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.14	9.90	10.19	10.96	12.40	8.70	9.46	9.76	10.52	11.96
	3H	10.77	11.45	11.84	12.52	13.98	10.29	10.97	11.36	12.04	13.50
	4H	11.34	11.98	12.42	13.06	14.52	10.86	11.50	11.93	12.57	14.04
	6H	11.72	12.31	12.80	13.39	14.86	11.23	11.83	12.32	12.90	14.38
	8H	11.81	12.38	12.90	13.47	14.94	11.32	11.89	12.42	12.98	14.45
	12H	11.85	12.39	12.95	13.47	14.96	11.36	11.89	12.45	12.98	14.47
4H	2H	9.58	10.22	10.66	11.29	12.76	9.23	9.87	10.31	10.94	12.41
	3H	11.41	11.95	12.50	13.05	14.52	11.01	11.55	12.10	12.65	14.12
	4H	12.10	12.60	13.20	13.68	15.18	11.69	12.18	12.79	13.27	14.77
	6H	12.59	13.02	13.70	14.13	15.62	12.17	12.60	13.28	13.71	15.20
	8H	12.73	13.13	13.83	14.23	15.74	12.31	12.70	13.41	13.81	15.31
	12H	12.79	13.15	13.91	14.26	15.78	12.35	12.71	13.48	13.83	15.34
8H	4H	12.28	12.68	13.38	13.78	15.29	11.91	12.31	13.02	13.41	14.92
	6H	12.88	13.21	14.01	14.35	15.86	12.51	12.84	13.64	13.98	15.49
	8H	13.09	13.37	14.22	14.50	16.02	12.71	12.99	13.84	14.12	15.64
	12H	13.20	13.45	14.34	14.58	16.14	12.80	13.06	13.94	14.18	15.74
12H	4H	12.26	12.62	13.38	13.73	15.24	11.90	12.26	13.02	13.37	14.88
	6H	12.91	13.19	14.04	14.32	15.84	12.54	12.83	13.68	13.96	15.48
	8H	13.13	13.38	14.26	14.50	16.06	12.76	13.01	13.90	14.13	15.69

END OF REPORT