

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908353

Luminaire Tested: DFN2DIP-PN2F0-040D040US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908353
REPORT IS A COMBINATION OF REPORTS P901005 AND P897905
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-040D040US840-FLLONL
Description: 2 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7998.1 lumens
Efficiency: N/A
Efficacy: 113.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 70.2
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908353

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US840-FLLONL

Luminous Intensity Polar Plot

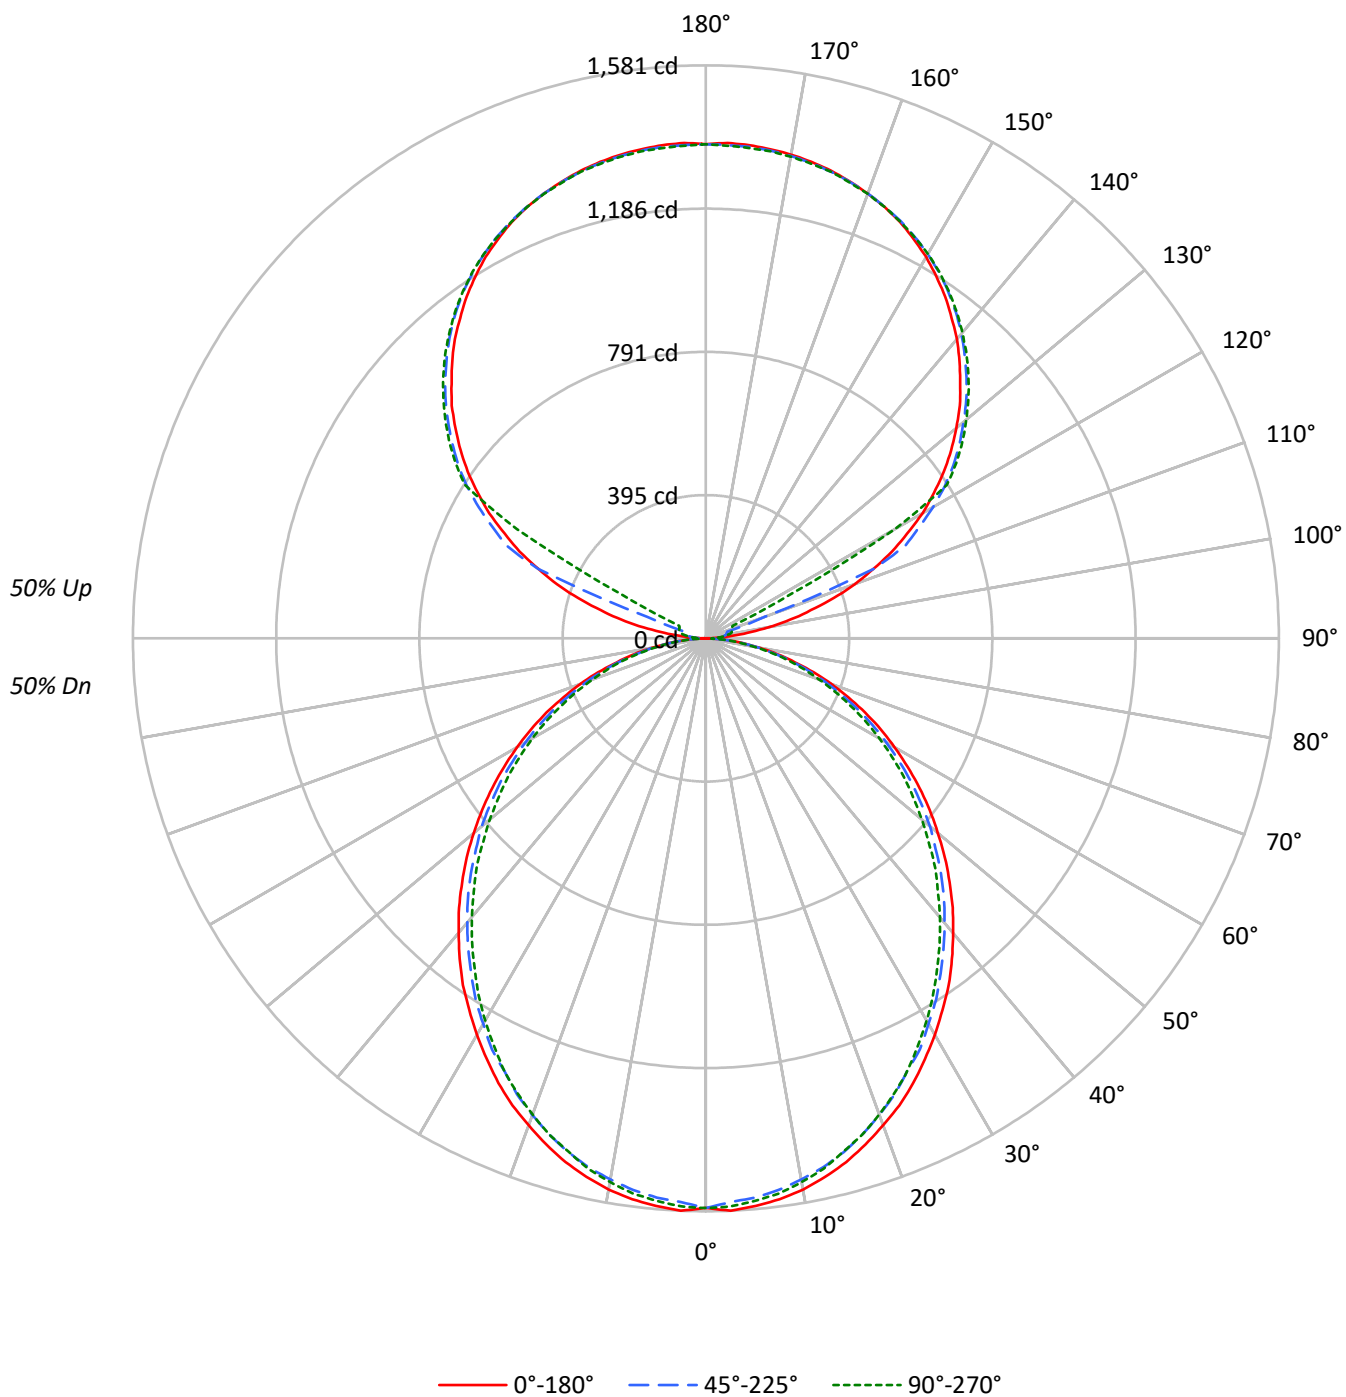

TEST NUMBER: P908353

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US840-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3404	3404	3404
5°	3404	3349	3374
10°	3371	3297	3324
15°	3316	3236	3247
20°	3244	3153	3170
25°	3171	3056	3080
30°	3082	2965	2968
35°	2997	2858	2849
40°	2894	2750	2736
45°	2790	2642	2620
50°	2677	2528	2486
55°	2557	2397	2362
60°	2422	2242	2220
65°	2273	2080	2052
70°	2085	1882	1869
75°	1826	1646	1695
80°	1511	1344	1376
85°	1025	850	862

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2790 cd/sqm

TEST NUMBER: P908353

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US840-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	147.9	1.8
10°-20°	416.2	5.2
20°-30°	611.7	7.6
30°-40°	710.5	8.9
40°-50°	709.6	8.9
50°-60°	618.7	7.7
60°-70°	457.4	5.7
70°-80°	258.8	3.2
80°-90°	70.7	0.9
90°-100°	44.9	0.6
100°-110°	167.6	2.1
110°-120°	444.4	5.6
120°-130°	737.1	9.2
130°-140°	783.0	9.8
140°-150°	727.7	9.1
150°-160°	585.1	7.3
160°-170°	377.0	4.7
170°-180°	129.8	1.6
0°-30°	1175.9	14.7
0°-40°	1886.3	23.6
0°-60°	3214.6	40.2
0°-90°	4001.4	50.0
90°-120°	656.9	8.2
90°-150°	2904.8	36.3
90°-180°	3997.0	50.0
0°-180°	7998.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1572	1572	1572	1572	1572	
5°	1572	1566	1549	1561	1558	149
15°	1496	1487	1468	1474	1466	421
25°	1354	1342	1316	1319	1316	623
35°	1168	1153	1129	1120	1112	730
45°	951	940	917	901	895	734
55°	720	710	692	674	667	643
65°	485	476	461	447	440	480
75°	254	251	243	234	237	271
85°	62	60	59	54	53	69
90°	1	12	20	25	27	7
95°	64	32	38	43	42	76
105°	300	330	60	71	75	320
115°	567	584	609	152	81	558
125°	802	815	834	840	843	715
135°	992	1008	1017	1027	1025	767
145°	1151	1150	1167	1174	1169	720
155°	1268	1259	1271	1276	1269	584
165°	1336	1330	1333	1340	1333	377
175°	1366	1359	1361	1368	1358	130
180°	1363	1363	1363	1363	1363	

TEST NUMBER: P908353

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1571.8	1571.8	1571.8	1571.8	1571.8
2.5°	1580.9	1573.4	1556.7	1571.8	1568.9
5°	1571.8	1565.8	1549.1	1561.2	1558.3
7.5°	1561.2	1552.2	1535.5	1547.7	1544.7
10°	1544.7	1534.1	1516.0	1528.0	1523.5
12.5°	1521.9	1512.9	1494.8	1502.4	1499.2
15°	1496.2	1487.2	1467.5	1473.6	1466.1
17.5°	1464.5	1455.5	1435.8	1443.3	1435.8
20°	1429.7	1420.7	1399.6	1404.0	1398.2
22.5°	1395.0	1381.4	1361.7	1361.7	1358.7
25°	1354.1	1342.1	1316.5	1319.4	1316.5
27.5°	1308.8	1298.2	1278.7	1274.1	1266.7
30°	1263.5	1251.4	1228.8	1224.3	1218.2
32.5°	1215.2	1206.2	1181.9	1172.9	1166.7
35°	1168.3	1153.3	1129.0	1119.9	1112.4
37.5°	1115.4	1101.8	1077.5	1067.0	1059.4
40°	1061.1	1048.8	1024.6	1011.2	1005.1
42.5°	1008.1	995.9	971.9	956.6	947.7
45°	950.7	940.2	917.4	900.9	894.7
47.5°	894.7	884.1	860.0	843.3	834.4
50°	835.8	828.2	807.1	785.9	778.3
52.5°	778.3	767.8	748.2	731.5	720.9
55°	719.5	710.3	692.3	674.1	666.6
57.5°	660.5	653.0	633.2	615.1	609.0
60°	601.5	595.5	574.4	557.7	553.2
62.5°	544.1	533.5	518.5	503.3	497.3
65°	485.2	476.1	461.0	447.4	439.9
67.5°	424.7	417.1	403.6	393.0	387.0
70°	368.8	362.7	349.1	338.5	332.5
72.5°	311.4	305.3	297.8	287.2	282.7
75°	253.9	251.0	243.3	234.3	237.3
77.5°	202.5	196.4	193.4	188.8	184.4
80°	151.2	149.6	146.5	142.1	139.1
82.5°	102.8	102.8	101.4	95.2	95.2
85°	61.9	60.5	59.0	54.3	52.9
87.5°	27.3	24.2	21.2	16.7	15.0
90°	0.9	11.8	19.7	24.7	26.6
92.5°	24.7	20.7	23.6	25.7	26.6
95°	64.0	31.5	38.4	43.4	42.4
97.5°	115.4	34.5	50.3	53.3	54.2
100°	174.6	39.5	56.2	64.0	66.0
102.5°	239.6	237.8	58.2	69.0	72.0
105°	299.8	329.5	60.2	71.0	74.9
107.5°	369.9	394.6	62.2	73.0	77.0
110°	437.1	457.7	172.7	74.0	77.9

TEST NUMBER: P908353

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	500.2	517.9	501.1	75.9	79.0
115°	567.1	583.9	608.6	151.9	81.0
117.5°	625.4	645.1	662.0	520.8	262.4
120°	690.5	705.3	723.1	735.0	601.8
122.5°	745.7	761.5	781.3	787.2	788.2
125°	801.9	814.9	833.5	840.5	843.4
127.5°	853.2	867.1	881.9	891.8	892.7
130°	901.6	917.5	928.2	939.1	938.2
132.5°	950.9	963.8	974.6	983.5	982.6
135°	992.4	1008.2	1017.0	1026.9	1025.0
137.5°	1035.7	1047.5	1057.5	1067.3	1064.4
140°	1078.1	1086.1	1096.9	1105.8	1100.9
142.5°	1113.8	1120.6	1133.5	1141.2	1136.4
145°	1151.2	1150.2	1166.9	1173.9	1168.9
147.5°	1183.7	1180.7	1197.5	1202.4	1198.6
150°	1215.3	1208.4	1224.3	1230.1	1225.2
152.5°	1241.9	1234.1	1248.8	1254.8	1247.9
155°	1267.6	1258.8	1270.6	1276.5	1268.6
157.5°	1288.3	1280.4	1289.4	1296.3	1288.3
160°	1306.1	1300.1	1306.1	1311.9	1305.0
162.5°	1321.8	1316.0	1320.9	1327.8	1318.9
165°	1335.6	1329.8	1332.7	1339.6	1332.7
167.5°	1346.6	1340.5	1343.6	1350.5	1341.6
170°	1355.4	1349.5	1351.4	1358.4	1349.5
172.5°	1361.3	1355.4	1357.5	1364.3	1355.4
175°	1366.1	1359.3	1361.3	1368.2	1358.4
177.5°	1368.2	1361.3	1362.3	1369.3	1360.4
180°	1363.3	1363.3	1363.3	1363.3	1363.3

TEST NUMBER: P908353

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US840-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.41	12.28	12.37	13.25	14.52	10.98	11.84	11.93	12.81	14.08
	3H	13.05	13.83	14.02	14.81	16.10	12.57	13.35	13.54	14.33	15.62
	4H	13.63	14.36	14.61	15.35	16.65	13.15	13.88	14.13	14.86	16.16
	6H	14.01	14.69	15.01	15.68	16.99	13.53	14.20	14.52	15.19	16.51
	8H	14.11	14.75	15.11	15.76	17.07	13.62	14.26	14.62	15.27	16.58
	12H	14.15	14.76	15.16	15.76	17.10	13.66	14.27	14.66	15.27	16.60
4H	2H	11.87	12.60	12.85	13.58	14.88	11.52	12.25	12.50	13.23	14.53
	3H	13.71	14.32	14.70	15.33	16.65	13.31	13.92	14.31	14.93	16.25
	4H	14.41	14.96	15.41	15.97	17.31	13.99	14.55	15.00	15.56	16.90
	6H	14.90	15.38	15.92	16.41	17.75	14.48	14.96	15.50	15.99	17.33
	8H	15.04	15.49	16.06	16.51	17.87	14.62	15.07	15.64	16.09	17.44
	12H	15.11	15.51	16.14	16.55	17.91	14.67	15.08	15.71	16.12	17.47
8H	4H	14.59	15.04	15.61	16.06	17.42	14.22	14.67	15.24	15.70	17.05
	6H	15.20	15.57	16.24	16.64	17.98	14.82	15.20	15.87	16.26	17.61
	8H	15.41	15.73	16.46	16.78	18.15	15.02	15.35	16.07	16.40	17.77
	12H	15.52	15.81	16.58	16.86	18.27	15.13	15.41	16.18	16.46	17.87
12H	4H	14.58	14.98	15.61	16.02	17.38	14.21	14.62	15.25	15.66	17.02
	6H	15.22	15.55	16.27	16.60	17.97	14.86	15.19	15.91	16.24	17.61
	8H	15.45	15.74	16.50	16.78	18.19	15.08	15.37	16.13	16.41	17.82

END OF REPORT