

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908355

Luminaire Tested: DFN2DIP-PN2F0-040D040US840-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908355
REPORT IS A COMBINATION OF REPORTS P901006 AND P897905
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-040D040US840-RLLONL
Description: 2 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7432.6 lumens
Efficiency: N/A
Efficacy: 105.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 70.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908355

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US840-RLLONL

Luminous Intensity Polar Plot

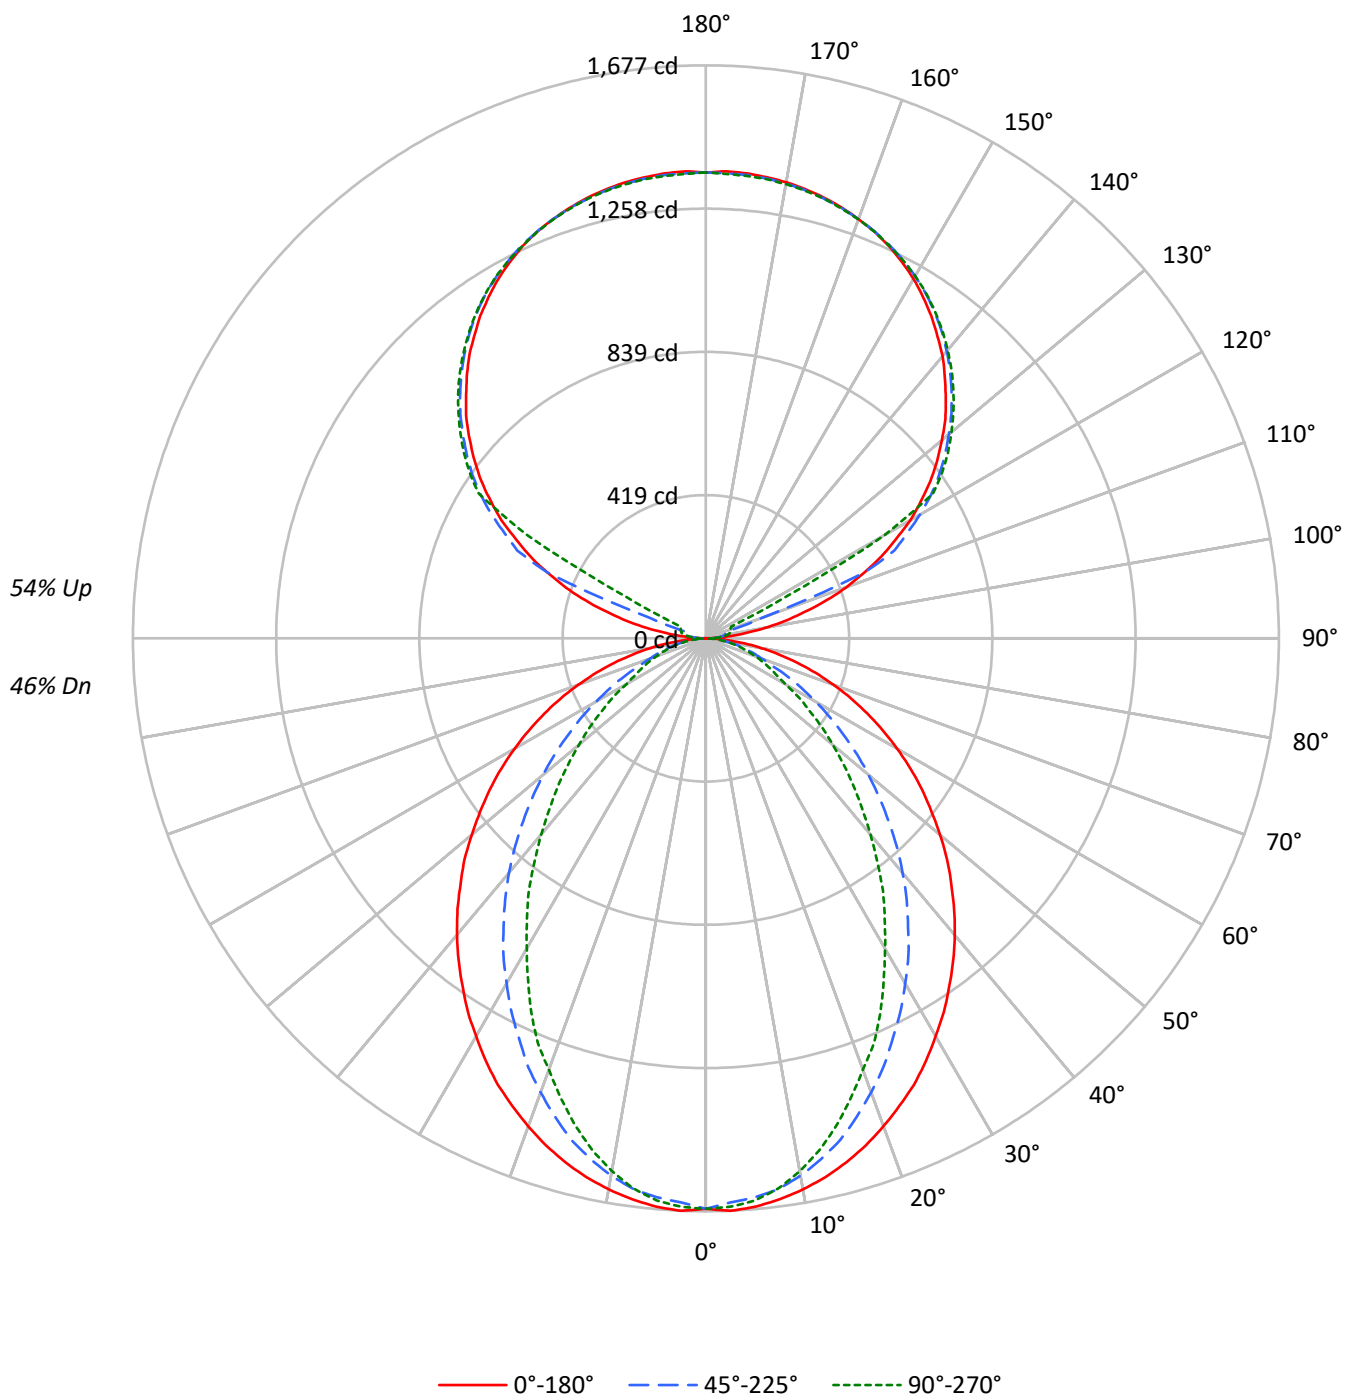

TEST NUMBER: P908355

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53			46
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45			40
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39			34
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34			29
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29			26
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26			23
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23			20
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21			18
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19			16
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17			15
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15			13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3616	3616	3616
5°	3616	3551	3576
10°	3574	3473	3455
15°	3519	3351	3270
20°	3448	3186	3045
25°	3376	3002	2828
30°	3280	2814	2554
35°	3186	2613	2314
40°	3090	2405	2040
45°	2980	2176	1792
50°	2864	1945	1549
55°	2744	1700	1317
60°	2604	1444	1079
65°	2442	1186	965
70°	2247	945	866
75°	1999	818	778
80°	1645	664	659
85°	1075	413	467

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2980 cd/sqm

TEST NUMBER: P908355

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US840-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	156.5	2.1
10°-20°	429.5	5.8
20°-30°	603.0	8.1
30°-40°	657.4	8.8
40°-50°	604.2	8.1
50°-60°	474.5	6.4
60°-70°	308.9	4.2
70°-80°	159.0	2.1
80°-90°	43.0	0.6
90°-100°	44.9	0.6
100°-110°	167.6	2.3
110°-120°	444.4	6.0
120°-130°	737.1	9.9
130°-140°	783.0	10.5
140°-150°	727.7	9.8
150°-160°	585.1	7.9
160°-170°	377.0	5.1
170°-180°	129.8	1.7
0°-30°	1189.0	16.0
0°-40°	1846.4	24.8
0°-60°	2925.1	39.4
0°-90°	3435.9	46.2
90°-120°	656.9	8.8
90°-150°	2904.8	39.1
90°-180°	3997.0	53.8
0°-180°	7432.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1670	1670	1670	1670	1670	
5°	1670	1662	1642	1656	1651	158
15°	1588	1571	1520	1491	1476	447
25°	1441	1393	1293	1231	1209	663
35°	1242	1165	1032	937	903	777
45°	1015	914	756	648	612	784
55°	772	654	491	400	372	690
65°	521	399	263	212	207	517
75°	278	172	121	110	109	294
85°	65	33	29	29	29	75
90°	1	12	20	25	27	7
95°	64	32	38	43	42	76
105°	300	330	60	71	75	320
115°	567	584	609	152	81	558
125°	802	815	834	840	843	715
135°	992	1008	1017	1027	1025	767
145°	1151	1150	1167	1174	1169	720
155°	1268	1259	1271	1276	1269	584
165°	1336	1330	1333	1340	1333	377
175°	1366	1359	1361	1368	1358	130
180°	1363	1363	1363	1363	1363	

TEST NUMBER: P908355

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US840-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1669.5	1669.5	1669.5	1669.5	1669.5
2.5°	1677.1	1669.5	1652.8	1668.1	1665.0
5°	1669.5	1661.9	1642.2	1655.9	1651.4
7.5°	1655.9	1646.9	1625.8	1631.6	1624.2
10°	1637.8	1627.2	1597.0	1592.4	1583.5
12.5°	1615.2	1601.5	1560.6	1551.7	1535.0
15°	1587.9	1571.2	1519.9	1491.3	1476.2
17.5°	1556.2	1532.0	1468.4	1435.3	1411.1
20°	1519.9	1489.7	1414.1	1376.4	1343.1
22.5°	1480.7	1445.9	1358.2	1306.9	1284.3
25°	1441.4	1393.0	1293.2	1231.4	1208.6
27.5°	1394.6	1343.1	1232.8	1161.9	1127.0
30°	1344.7	1287.2	1166.3	1089.3	1048.5
32.5°	1296.4	1226.8	1103.0	1012.3	974.4
35°	1242.0	1164.9	1032.0	936.8	903.4
37.5°	1189.1	1105.9	965.4	861.1	823.4
40°	1133.2	1042.6	896.0	788.7	749.4
42.5°	1075.7	979.1	826.5	714.6	676.9
45°	1015.3	914.0	755.5	648.1	611.9
47.5°	958.0	850.7	687.5	580.2	546.9
50°	894.4	787.2	621.0	516.6	485.0
52.5°	832.4	719.1	557.5	457.8	429.1
55°	772.0	654.2	491.0	400.4	371.7
57.5°	710.1	589.3	432.1	347.5	323.4
60°	646.6	525.7	370.1	293.2	269.0
62.5°	584.8	463.9	317.2	244.8	232.8
65°	521.3	398.8	262.9	211.6	206.9
67.5°	460.9	338.4	211.6	185.8	181.3
70°	397.4	279.5	175.2	160.2	154.0
72.5°	337.0	225.1	146.5	134.5	131.5
75°	277.9	172.2	120.9	110.3	108.9
77.5°	219.1	122.3	95.2	89.2	86.0
80°	164.6	87.7	72.4	66.6	66.6
82.5°	114.8	59.0	49.9	46.8	46.8
85°	64.9	33.2	28.7	28.7	28.7
87.5°	24.2	12.0	12.0	10.6	10.6
90°	0.9	11.8	19.7	24.7	26.6
92.5°	24.7	20.7	23.6	25.7	26.6
95°	64.0	31.5	38.4	43.4	42.4
97.5°	115.4	34.5	50.3	53.3	54.2
100°	174.6	39.5	56.2	64.0	66.0
102.5°	239.6	237.8	58.2	69.0	72.0
105°	299.8	329.5	60.2	71.0	74.9
107.5°	369.9	394.6	62.2	73.0	77.0
110°	437.1	457.7	172.7	74.0	77.9

TEST NUMBER: P908355

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	500.2	517.9	501.1	75.9	79.0
115°	567.1	583.9	608.6	151.9	81.0
117.5°	625.4	645.1	662.0	520.8	262.4
120°	690.5	705.3	723.1	735.0	601.8
122.5°	745.7	761.5	781.3	787.2	788.2
125°	801.9	814.9	833.5	840.5	843.4
127.5°	853.2	867.1	881.9	891.8	892.7
130°	901.6	917.5	928.2	939.1	938.2
132.5°	950.9	963.8	974.6	983.5	982.6
135°	992.4	1008.2	1017.0	1026.9	1025.0
137.5°	1035.7	1047.5	1057.5	1067.3	1064.4
140°	1078.1	1086.1	1096.9	1105.8	1100.9
142.5°	1113.8	1120.6	1133.5	1141.2	1136.4
145°	1151.2	1150.2	1166.9	1173.9	1168.9
147.5°	1183.7	1180.7	1197.5	1202.4	1198.6
150°	1215.3	1208.4	1224.3	1230.1	1225.2
152.5°	1241.9	1234.1	1248.8	1254.8	1247.9
155°	1267.6	1258.8	1270.6	1276.5	1268.6
157.5°	1288.3	1280.4	1289.4	1296.3	1288.3
160°	1306.1	1300.1	1306.1	1311.9	1305.0
162.5°	1321.8	1316.0	1320.9	1327.8	1318.9
165°	1335.6	1329.8	1332.7	1339.6	1332.7
167.5°	1346.6	1340.5	1343.6	1350.5	1341.6
170°	1355.4	1349.5	1351.4	1358.4	1349.5
172.5°	1361.3	1355.4	1357.5	1364.3	1355.4
175°	1366.1	1359.3	1361.3	1368.2	1358.4
177.5°	1368.2	1361.3	1362.3	1369.3	1360.4
180°	1363.3	1363.3	1363.3	1363.3	1363.3

TEST NUMBER: P908355

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.13	11.93	12.13	12.94	14.26	7.10	7.90	8.10	8.90	10.23
	3H	12.79	13.50	13.79	14.52	15.86	8.27	8.99	9.28	10.00	11.35
	4H	13.38	14.06	14.40	15.07	16.43	8.71	9.38	9.73	10.40	11.76
	6H	13.79	14.41	14.81	15.43	16.79	9.01	9.64	10.04	10.65	12.02
	8H	13.90	14.49	14.94	15.53	16.89	9.09	9.69	10.13	10.72	12.09
	12H	13.95	14.52	14.99	15.55	16.93	9.13	9.69	10.17	10.72	12.11
4H	2H	11.14	11.82	12.17	12.84	14.19	7.68	8.36	8.71	9.37	10.73
	3H	12.95	13.51	13.98	14.55	15.92	9.01	9.57	10.04	10.62	11.98
	4H	13.62	14.14	14.66	15.17	16.56	9.54	10.06	10.58	11.09	12.48
	6H	14.12	14.56	15.17	15.62	17.00	9.94	10.38	10.99	11.44	12.83
	8H	14.28	14.69	15.33	15.74	17.14	10.06	10.47	11.11	11.52	12.93
	12H	14.36	14.73	15.43	15.80	17.21	10.11	10.49	11.18	11.55	12.96
8H	4H	13.58	14.00	14.63	15.05	16.45	9.81	10.22	10.86	11.27	12.67
	6H	14.13	14.47	15.20	15.56	16.96	10.30	10.64	11.38	11.74	13.14
	8H	14.33	14.63	15.41	15.70	17.12	10.48	10.78	11.56	11.86	13.28
	12H	14.45	14.71	15.54	15.79	17.25	10.58	10.85	11.67	11.92	13.38
12H	4H	13.53	13.91	14.60	14.97	16.38	9.81	10.18	10.88	11.25	12.65
	6H	14.10	14.40	15.18	15.48	16.89	10.35	10.65	11.43	11.72	13.14
	8H	14.30	14.57	15.39	15.64	17.10	10.54	10.80	11.62	11.87	13.34