

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908401

Luminaire Tested: DFN2DIP-PN2F0-060D060US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908401
REPORT IS A COMBINATION OF REPORTS P901029 AND P897905
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-060D060US840-FLLONL
Description: 2 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11997.2 lumens
Efficiency: N/A
Efficacy: 102.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 117.3
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908401

CATALOG NUMBER: DFN2DIP-PN2F0-060D060US840-FLLONL

Luminous Intensity Polar Plot

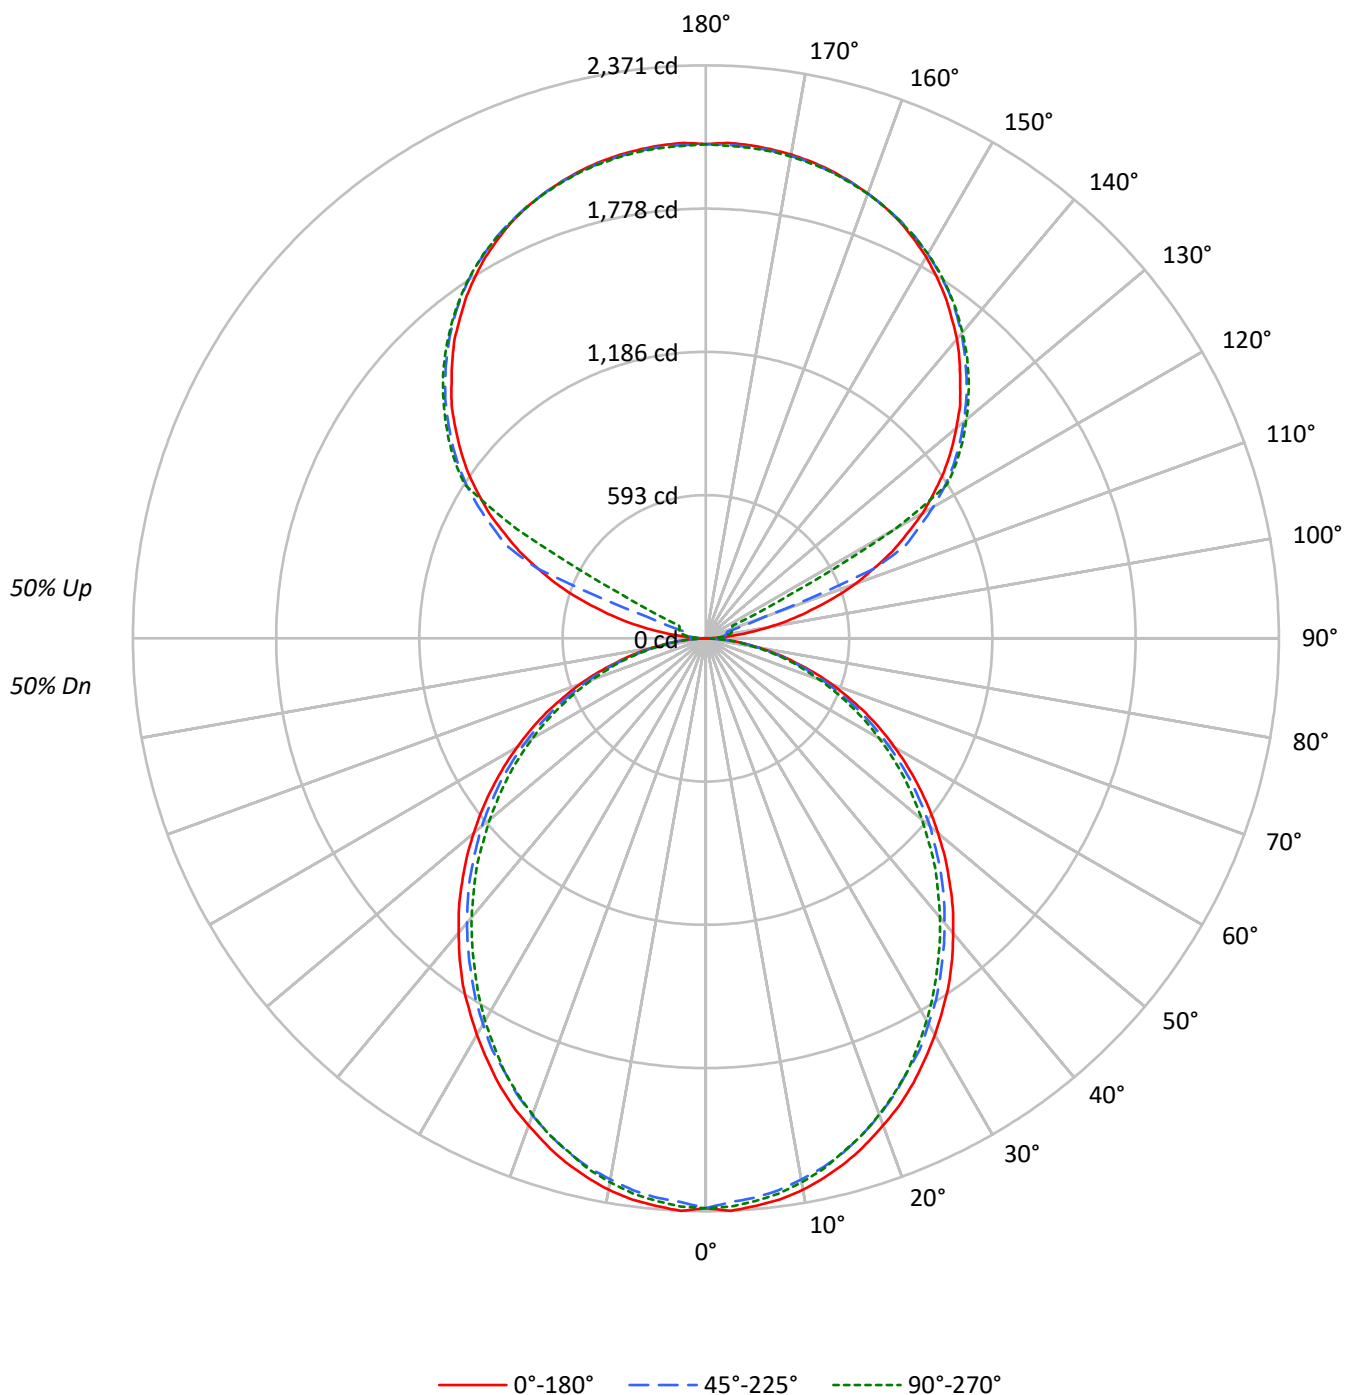

TEST NUMBER: P908401

CATALOG NUMBER: DFN2DIP-PN2F0-060D060US840-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5106	5106	5106
5°	5106	5024	5061
10°	5057	4946	4985
15°	4974	4853	4871
20°	4866	4729	4754
25°	4757	4583	4620
30°	4623	4447	4452
35°	4496	4287	4274
40°	4340	4126	4104
45°	4185	3963	3930
50°	4015	3792	3729
55°	3836	3595	3543
60°	3633	3363	3329
65°	3410	3120	3077
70°	3127	2823	2805
75°	2739	2469	2543
80°	2266	2016	2063
85°	1537	1275	1293

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4185 cd/sqm

TEST NUMBER: P908401

CATALOG NUMBER: DFN2DIP-PN2F0-060D060US840-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.9	1.8
10°-20°	624.4	5.2
20°-30°	917.5	7.6
30°-40°	1065.7	8.9
40°-50°	1064.4	8.9
50°-60°	928.1	7.7
60°-70°	686.1	5.7
70°-80°	388.2	3.2
80°-90°	106.0	0.9
90°-100°	67.4	0.6
100°-110°	251.4	2.1
110°-120°	666.7	5.6
120°-130°	1105.7	9.2
130°-140°	1174.5	9.8
140°-150°	1091.6	9.1
150°-160°	877.6	7.3
160°-170°	565.5	4.7
170°-180°	194.6	1.6
0°-30°	1763.8	14.7
0°-40°	2829.5	23.6
0°-60°	4821.9	40.2
0°-90°	6002.2	50.0
90°-120°	985.5	8.2
90°-150°	4357.2	36.3
90°-180°	5995.0	50.0
0°-180°	11997.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2358	2358	2358	2358	2358	
5°	2358	2349	2324	2342	2337	224
15°	2244	2231	2201	2210	2199	632
25°	2031	2013	1975	1979	1975	935
35°	1752	1730	1694	1680	1668	1094
45°	1426	1410	1376	1351	1342	1101
55°	1079	1066	1038	1011	1000	965
65°	728	714	692	671	660	720
75°	381	376	365	351	356	406
85°	93	91	88	82	79	104
90°	1	18	30	37	40	11
95°	96	47	58	65	64	114
105°	450	494	90	106	112	481
115°	851	876	913	228	121	838
125°	1203	1222	1250	1261	1265	1073
135°	1489	1512	1526	1540	1537	1150
145°	1727	1725	1750	1761	1753	1080
155°	1901	1888	1906	1915	1903	876
165°	2004	1995	1999	2009	1999	566
175°	2049	2039	2042	2052	2038	195
180°	2045	2045	2045	2045	2045	

TEST NUMBER: P908401

CATALOG NUMBER: DFN2DIP-PN2F0-060D060US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2357.6	2357.6	2357.6	2357.6	2357.6
2.5°	2371.4	2360.1	2335.0	2357.6	2353.3
5°	2357.6	2348.7	2323.7	2341.8	2337.4
7.5°	2341.8	2328.3	2303.3	2321.6	2317.0
10°	2317.0	2301.2	2273.9	2292.0	2285.2
12.5°	2282.9	2269.4	2242.2	2253.5	2249.0
15°	2244.3	2230.9	2201.3	2210.5	2199.2
17.5°	2196.8	2183.3	2153.7	2164.9	2153.7
20°	2144.6	2131.1	2099.3	2106.1	2097.2
22.5°	2092.6	2072.1	2042.6	2042.6	2038.0
25°	2031.2	2013.3	1974.7	1979.0	1974.7
27.5°	1963.2	1947.3	1917.9	1911.3	1900.0
30°	1895.4	1877.0	1843.2	1836.4	1827.3
32.5°	1822.7	1809.3	1772.9	1759.2	1750.1
35°	1752.5	1729.9	1693.5	1679.8	1668.5
37.5°	1673.1	1652.6	1616.4	1600.4	1589.1
40°	1591.5	1573.3	1537.0	1516.8	1507.6
42.5°	1512.2	1493.9	1457.8	1435.0	1421.5
45°	1426.1	1410.2	1376.0	1351.3	1342.1
47.5°	1342.1	1326.3	1290.0	1265.0	1251.4
50°	1253.6	1242.3	1210.6	1178.8	1167.5
52.5°	1167.5	1151.7	1122.3	1097.3	1081.5
55°	1079.2	1065.5	1038.3	1011.2	999.9
57.5°	990.8	979.5	949.9	922.7	913.5
60°	902.2	893.3	861.6	836.6	829.8
62.5°	816.1	800.2	777.6	755.0	745.9
65°	727.8	714.2	691.6	671.1	659.7
67.5°	637.1	625.6	605.4	589.6	580.4
70°	553.2	544.1	523.6	507.8	498.9
72.5°	467.1	458.0	446.7	430.8	424.0
75°	380.7	376.5	364.9	351.4	356.0
77.5°	303.8	294.7	290.0	283.4	276.6
80°	226.8	224.4	219.8	213.1	208.5
82.5°	154.2	154.2	152.0	142.9	142.9
85°	92.8	90.7	88.5	81.5	79.4
87.5°	40.9	36.4	31.7	25.0	22.6
90°	1.4	17.8	29.5	37.1	39.9
92.5°	37.1	31.1	35.4	38.5	39.9
95°	96.1	47.3	57.7	65.2	63.6
97.5°	173.1	51.8	75.3	80.0	81.4
100°	262.0	59.2	84.3	96.1	99.1
102.5°	359.5	356.7	87.4	103.5	108.1
105°	449.8	494.2	90.3	106.4	112.5
107.5°	554.9	591.8	93.3	109.5	115.4
110°	655.6	686.5	259.0	111.1	116.8



TEST NUMBER: P908401

CATALOG NUMBER: DFN2DIP-PN2F0-060D060US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	750.2	776.8	751.6	113.8	118.5
115°	850.8	876.0	913.0	227.9	121.4
117.5°	938.1	967.7	992.9	781.2	393.5
120°	1035.8	1057.9	1084.7	1102.4	902.6
122.5°	1118.5	1142.3	1171.9	1180.7	1182.4
125°	1203.0	1222.2	1250.3	1260.7	1265.1
127.5°	1279.9	1300.6	1322.9	1337.7	1339.1
130°	1352.4	1376.1	1392.3	1408.7	1407.2
132.5°	1426.4	1445.7	1461.9	1475.2	1473.8
135°	1488.6	1512.4	1525.5	1540.4	1537.4
137.5°	1553.6	1571.4	1586.3	1601.0	1596.7
140°	1617.2	1629.2	1645.4	1658.7	1651.3
142.5°	1670.6	1681.0	1700.2	1711.9	1704.6
145°	1726.9	1725.3	1750.4	1760.8	1753.4
147.5°	1775.5	1771.1	1796.2	1803.6	1797.9
150°	1823.0	1812.6	1836.3	1845.1	1837.8
152.5°	1862.9	1851.1	1873.2	1882.2	1871.8
155°	1901.4	1888.1	1905.9	1914.7	1902.9
157.5°	1932.5	1920.7	1934.0	1944.4	1932.5
160°	1959.1	1950.2	1959.1	1967.9	1957.6
162.5°	1982.7	1973.9	1981.3	1991.7	1978.3
165°	2003.5	1994.7	1999.0	2009.4	1999.0
167.5°	2019.7	2010.8	2015.4	2025.8	2012.4
170°	2033.2	2024.2	2027.2	2037.5	2024.2
172.5°	2041.9	2033.2	2036.1	2046.5	2033.2
175°	2049.3	2038.9	2041.9	2052.2	2037.5
177.5°	2052.2	2041.9	2043.5	2053.9	2040.5
180°	2044.9	2044.9	2044.9	2044.9	2044.9

TEST NUMBER: P908401

CATALOG NUMBER: DFN2DIP-PN2F0-060D060US840-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.82	13.69	13.78	14.66	15.93	12.39	13.25	13.34	14.22	15.49
	3H	14.46	15.24	15.43	16.22	17.51	13.98	14.76	14.95	15.74	17.03
	4H	15.04	15.77	16.02	16.75	18.06	14.56	15.29	15.54	16.27	17.57
	6H	15.42	16.10	16.41	17.09	18.40	14.94	15.61	15.93	16.60	17.91
	8H	15.52	16.16	16.52	17.17	18.48	15.03	15.67	16.03	16.68	17.99
	12H	15.56	16.17	16.56	17.17	18.51	15.07	15.68	16.07	16.68	18.01
4H	2H	13.28	14.01	14.26	14.99	16.29	12.92	13.66	13.91	14.64	15.94
	3H	15.12	15.73	16.11	16.74	18.06	14.72	15.33	15.71	16.34	17.66
	4H	15.81	16.37	16.82	17.38	18.72	15.40	15.96	16.41	16.97	18.31
	6H	16.31	16.79	17.33	17.82	19.16	15.89	16.37	16.91	17.40	18.74
	8H	16.45	16.90	17.47	17.92	19.27	16.03	16.48	17.05	17.50	18.85
	12H	16.51	16.92	17.55	17.96	19.32	16.08	16.49	17.12	17.53	18.88
8H	4H	16.00	16.45	17.02	17.47	18.82	15.63	16.08	16.65	17.10	18.46
	6H	16.61	16.98	17.65	18.04	19.39	16.23	16.61	17.28	17.67	19.02
	8H	16.81	17.14	17.86	18.19	19.56	16.43	16.76	17.48	17.81	19.18
	12H	16.93	17.22	17.99	18.27	19.68	16.54	16.82	17.59	17.87	19.28
12H	4H	15.98	16.39	17.02	17.43	18.79	15.62	16.03	16.66	17.07	18.42
	6H	16.63	16.96	17.68	18.01	19.38	16.27	16.60	17.32	17.65	19.02
	8H	16.86	17.15	17.91	18.19	19.60	16.49	16.78	17.54	17.82	19.23

END OF REPORT