

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911034

Luminaire Tested: DFN2DIP-PN2F0-020D020US850-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911034
REPORT IS A COMBINATION OF REPORTS P899462 AND P896349
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-020D020US850-RLLFLL
Description: 2 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3848.2 lumens
Efficiency: N/A
Efficacy: 119.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 32.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911034

CATALOG NUMBER: DFN2DIP-PN2F0-020D020US850-RLLFLL

Luminous Intensity Polar Plot

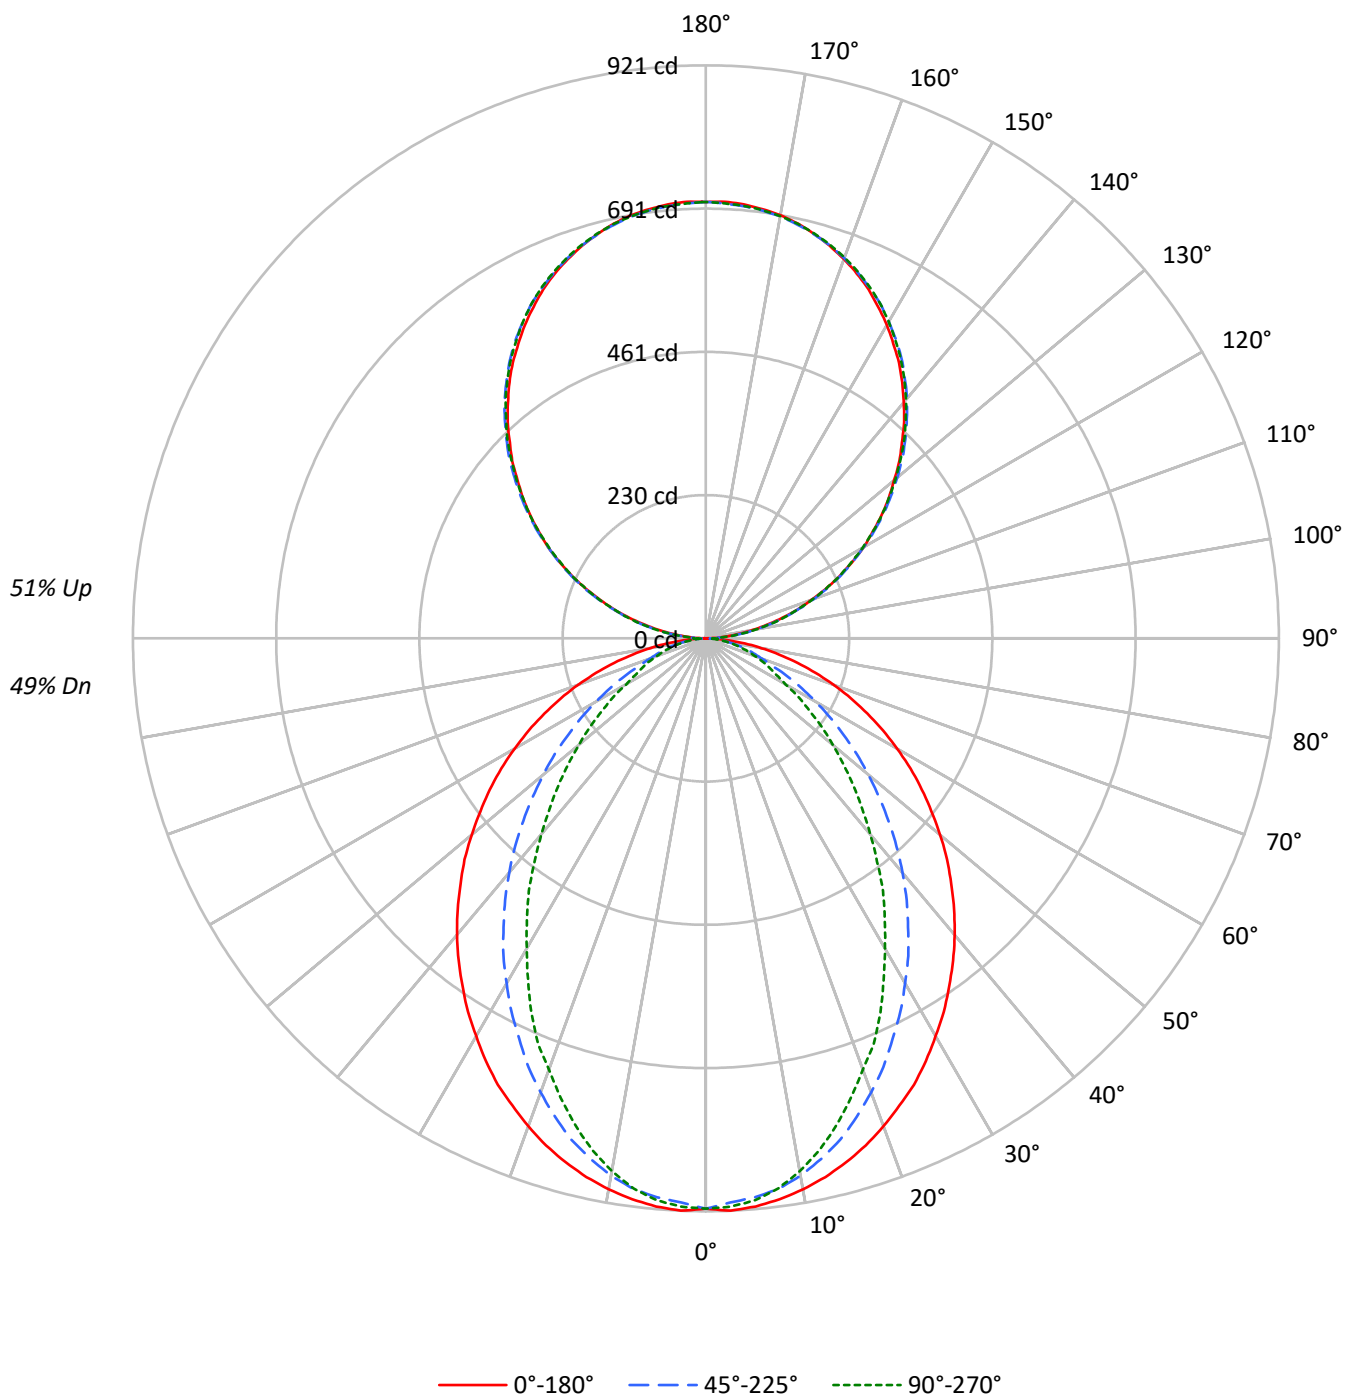

TEST NUMBER: P911034

CATALOG NUMBER: DFN2DIP-PN2F0-020D020US850-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1985	1985	1985
5°	1985	1950	1963
10°	1963	1907	1897
15°	1932	1840	1795
20°	1893	1749	1672
25°	1854	1648	1553
30°	1801	1545	1403
35°	1749	1435	1271
40°	1697	1321	1120
45°	1636	1195	984
50°	1573	1068	851
55°	1507	933	723
60°	1430	793	593
65°	1341	651	530
70°	1233	519	476
75°	1098	449	427
80°	903	365	361
85°	590	226	256

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1636 cd/sqm

TEST NUMBER: P911034

CATALOG NUMBER: DFN2DIP-PN2F0-020D020US850-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	85.9	2.2
10°-20°	235.8	6.1
20°-30°	331.1	8.6
30°-40°	361.0	9.4
40°-50°	331.8	8.6
50°-60°	260.6	6.8
60°-70°	169.6	4.4
70°-80°	87.3	2.3
80°-90°	24.3	0.6
90°-100°	43.4	1.1
100°-110°	137.9	3.6
110°-120°	236.0	6.1
120°-130°	310.4	8.1
130°-140°	348.4	9.1
140°-150°	341.7	8.9
150°-160°	286.6	7.4
160°-170°	190.1	4.9
170°-180°	66.4	1.7
0°-30°	652.9	17.0
0°-40°	1013.8	26.3
0°-60°	1606.2	41.7
0°-90°	1887.3	49.0
90°-120°	417.3	10.8
90°-150°	1417.8	36.8
90°-180°	1961.0	51.0
0°-180°	3848.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	917	917	917	917	917	
5°	917	913	902	909	907	87
15°	872	863	834	819	811	246
25°	792	765	710	676	664	364
35°	682	640	567	514	496	427
45°	558	502	415	356	336	431
55°	424	359	270	220	204	379
65°	286	219	144	116	114	284
75°	153	94	66	61	60	161
85°	36	18	16	16	16	41
90°	1	8	21	19	20	4
95°	31	37	38	38	37	34
105°	127	129	130	131	131	134
115°	237	240	239	238	237	234
125°	344	350	348	346	346	308
135°	446	452	453	453	451	344
145°	541	545	549	549	547	338
155°	619	620	622	625	623	285
165°	673	672	672	676	674	190
175°	700	699	697	701	698	67
180°	701	701	701	701	701	

TEST NUMBER: P911034

CATALOG NUMBER: DFN2DIP-PN2F0-020D020US850-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	916.7	916.7	916.7	916.7	916.7
2.5°	920.8	916.7	907.5	915.9	914.3
5°	916.7	912.6	901.7	909.3	906.7
7.5°	909.3	904.3	892.6	896.0	891.7
10°	899.3	893.4	876.9	874.3	869.5
12.5°	886.9	879.3	856.9	852.0	842.8
15°	871.9	862.7	834.5	818.8	810.6
17.5°	854.5	841.2	806.4	788.1	774.9
20°	834.5	817.9	776.5	755.8	737.5
22.5°	813.0	793.9	745.8	717.6	705.2
25°	791.5	764.9	710.1	676.2	663.6
27.5°	765.8	737.5	676.9	637.9	618.8
30°	738.4	706.8	640.4	598.2	575.7
32.5°	711.8	673.6	605.6	555.8	535.1
35°	681.9	639.7	566.7	514.4	496.1
37.5°	652.9	607.2	530.1	472.9	452.1
40°	622.1	572.5	492.0	433.1	411.4
42.5°	590.7	537.6	453.8	392.4	371.7
45°	557.5	501.8	414.9	355.9	335.9
47.5°	526.0	467.1	377.5	318.5	300.3
50°	491.2	432.3	341.0	283.7	266.4
52.5°	457.0	394.8	306.1	251.4	235.7
55°	423.9	359.2	269.6	219.9	204.1
57.5°	389.9	323.5	237.3	190.9	177.6
60°	355.1	288.7	203.3	161.0	147.7
62.5°	321.1	254.7	174.2	134.4	127.8
65°	286.2	219.0	144.4	116.2	113.7
67.5°	253.1	185.8	116.2	102.0	99.6
70°	218.1	153.5	96.2	87.9	84.6
72.5°	185.0	123.5	80.4	73.9	72.2
75°	152.6	94.5	66.3	60.6	59.8
77.5°	120.3	67.2	52.2	48.9	47.2
80°	90.4	48.1	39.8	36.5	36.5
82.5°	63.0	32.4	27.4	25.7	25.7
85°	35.6	18.2	15.7	15.7	15.7
87.5°	13.3	6.7	6.7	5.8	5.8
90°	0.7	7.7	20.7	19.4	20.1
92.5°	13.1	17.7	18.4	19.1	19.1
95°	30.8	36.8	37.8	37.8	36.8
97.5°	51.3	56.9	59.2	59.2	59.2
100°	75.1	80.0	81.6	81.6	81.0
102.5°	100.0	103.6	105.9	106.6	105.9
105°	127.3	129.0	130.3	131.3	131.3
107.5°	154.4	156.9	156.9	157.4	154.4
110°	180.7	184.0	184.0	184.0	182.3



TEST NUMBER: P911034

CATALOG NUMBER: DFN2DIP-PN2F0-020D020US850-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	208.9	212.5	211.9	210.2	208.9
115°	236.9	240.2	239.2	238.5	236.9
117.5°	264.6	269.3	266.3	264.6	262.8
120°	292.4	297.1	292.4	292.4	290.6
122.5°	317.8	323.7	320.8	319.2	317.8
125°	344.5	349.8	348.1	346.2	345.6
127.5°	370.5	377.1	374.7	372.2	370.5
130°	394.8	402.5	401.3	400.1	397.8
132.5°	422.1	428.1	428.4	425.5	423.7
135°	445.6	452.1	453.4	452.8	451.0
137.5°	471.8	477.1	478.2	477.8	475.2
140°	494.8	500.2	503.2	503.2	500.8
142.5°	518.6	523.8	525.6	526.1	523.8
145°	541.0	545.2	548.6	549.2	546.8
147.5°	561.0	566.4	568.9	569.9	567.6
150°	581.8	585.3	587.7	589.5	587.7
152.5°	600.2	603.7	606.7	609.1	606.7
155°	618.6	620.3	622.1	625.1	623.3
157.5°	634.5	635.7	636.8	641.0	638.0
160°	648.7	649.9	650.5	654.1	651.5
162.5°	661.7	661.7	662.3	666.4	663.4
165°	672.9	672.3	672.3	676.5	673.6
167.5°	683.0	681.1	681.1	685.4	682.5
170°	690.7	689.0	688.4	692.6	689.0
172.5°	696.0	694.2	693.7	697.9	694.2
175°	700.2	698.6	697.2	701.4	697.9
177.5°	702.6	700.9	699.6	703.1	699.6
180°	701.4	701.4	701.4	701.4	701.4

TEST NUMBER: P911034

CATALOG NUMBER: DFN2DIP-PN2F0-020D020US850-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.32	10.14	10.29	11.12	12.41	5.29	6.11	6.26	7.10	8.38
	3H	10.98	11.71	11.96	12.70	14.01	6.46	7.20	7.45	8.19	9.50
	4H	11.57	12.27	12.57	13.26	14.58	6.90	7.60	7.90	8.59	9.91
	6H	11.98	12.62	12.98	13.62	14.95	7.21	7.85	8.21	8.84	10.17
	8H	12.09	12.70	13.11	13.72	15.04	7.29	7.90	8.30	8.91	10.24
	12H	12.15	12.73	13.16	13.73	15.08	7.32	7.90	8.34	8.91	10.26
4H	2H	9.33	10.03	10.34	11.02	12.34	5.88	6.57	6.88	7.56	8.88
	3H	11.14	11.72	12.15	12.74	14.07	7.20	7.78	8.22	8.81	10.14
	4H	11.81	12.34	12.83	13.36	14.71	7.74	8.27	8.76	9.28	10.64
	6H	12.31	12.76	13.34	13.80	15.15	8.14	8.59	9.17	9.63	10.98
	8H	12.47	12.90	13.50	13.93	15.29	8.26	8.68	9.29	9.71	11.08
	12H	12.56	12.94	13.60	13.99	15.36	8.31	8.69	9.36	9.74	11.11
8H	4H	11.78	12.20	12.81	13.23	14.60	8.00	8.43	9.03	9.46	10.83
	6H	12.32	12.67	13.38	13.74	15.11	8.50	8.85	9.55	9.92	11.29
	8H	12.52	12.83	13.59	13.89	15.27	8.68	8.98	9.74	10.04	11.42
	12H	12.65	12.92	13.71	13.97	15.40	8.78	9.05	9.84	10.10	11.53
12H	4H	11.73	12.11	12.78	13.16	14.53	8.01	8.39	9.05	9.43	10.81
	6H	12.29	12.60	13.36	13.66	15.04	8.54	8.85	9.60	9.91	11.29
	8H	12.50	12.77	13.57	13.82	15.25	8.74	9.01	9.80	10.06	11.49

END OF REPORT