

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911081

Luminaire Tested: DFN2DIP-PN2F0-040D040US850-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911081
REPORT IS A COMBINATION OF REPORTS P901005 AND P897905
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-040D040US850-FLLONL
Description: 2 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8783.3 lumens
Efficiency: N/A
Efficacy: 125.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 70.2
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911081

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US850-FLLONL

Luminous Intensity Polar Plot

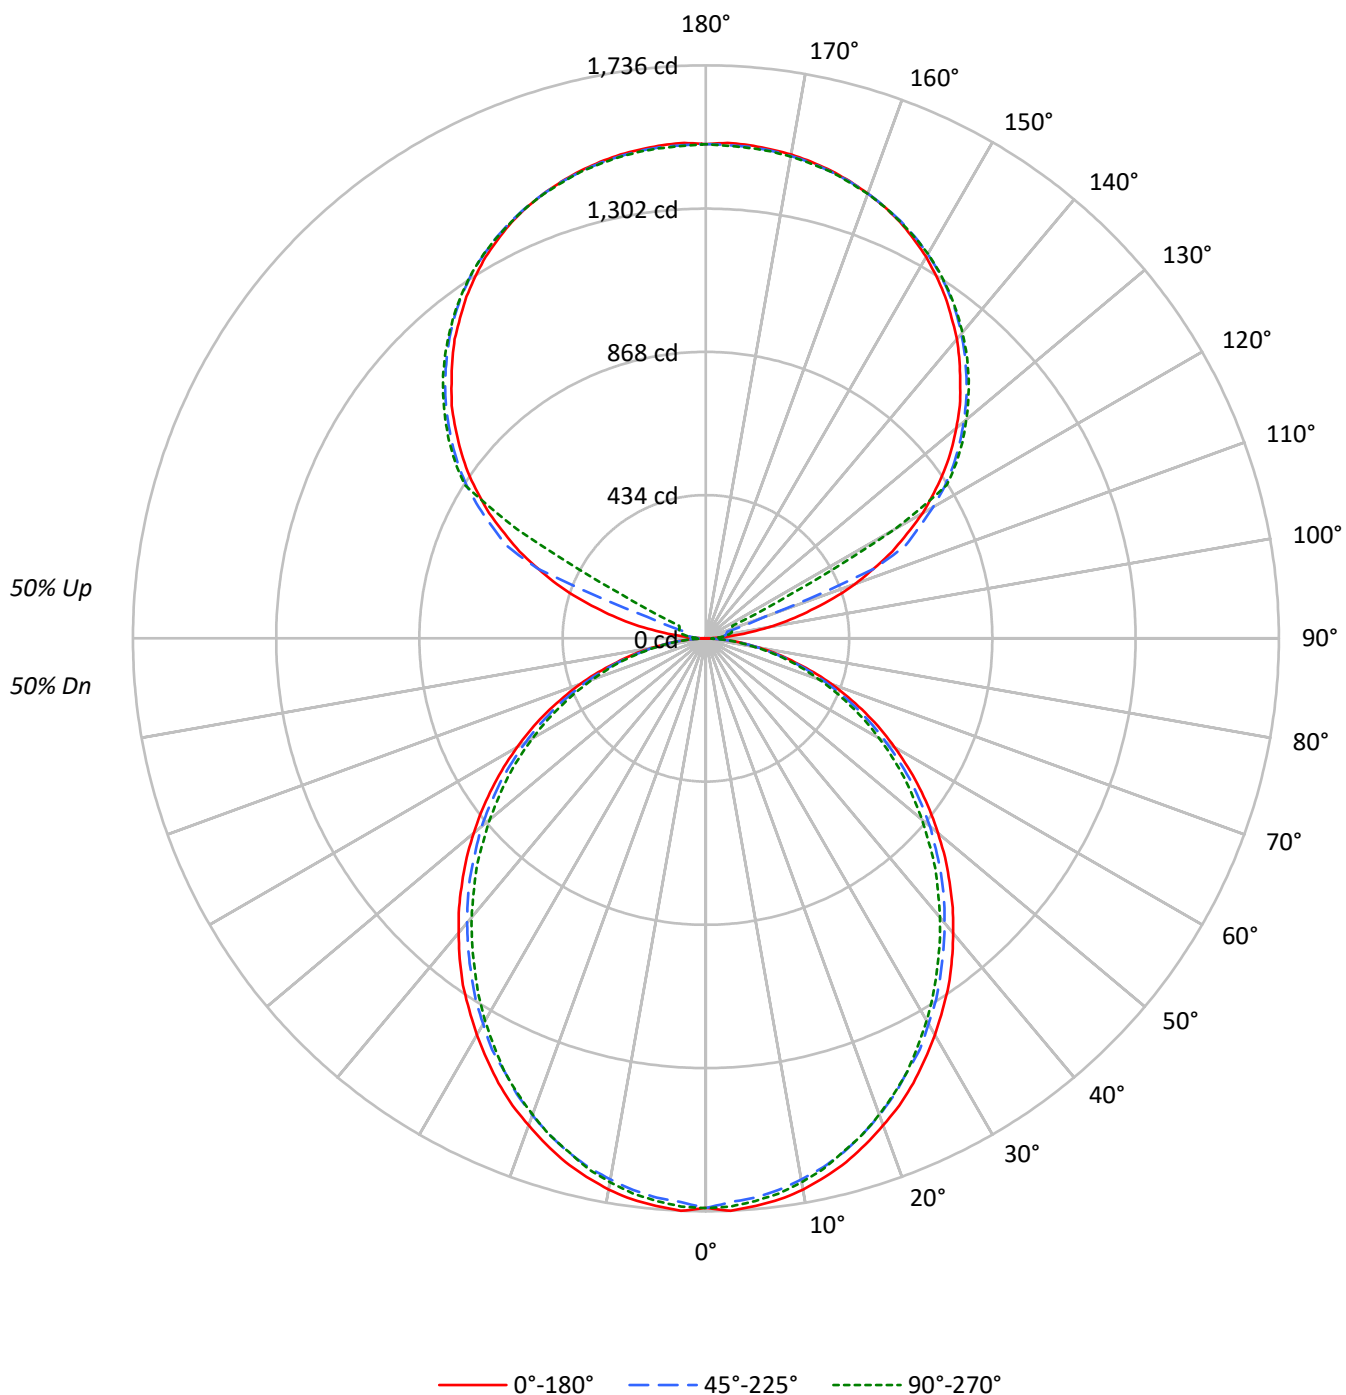

TEST NUMBER: P911081

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US850-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3738	3738	3738
5°	3738	3678	3706
10°	3702	3621	3650
15°	3642	3553	3566
20°	3562	3463	3481
25°	3483	3356	3382
30°	3385	3255	3259
35°	3291	3139	3129
40°	3178	3020	3005
45°	3064	2902	2877
50°	2939	2776	2730
55°	2808	2632	2594
60°	2660	2462	2437
65°	2497	2284	2254
70°	2290	2067	2053
75°	2006	1808	1861
80°	1659	1476	1511
85°	1127	933	946

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3064 cd/sqm

TEST NUMBER: P911081

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US850-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	162.5	1.8
10°-20°	457.1	5.2
20°-30°	671.7	7.6
30°-40°	780.2	8.9
40°-50°	779.2	8.9
50°-60°	679.5	7.7
60°-70°	502.3	5.7
70°-80°	284.2	3.2
80°-90°	77.6	0.9
90°-100°	49.4	0.6
100°-110°	184.0	2.1
110°-120°	488.1	5.6
120°-130°	809.5	9.2
130°-140°	859.9	9.8
140°-150°	799.2	9.1
150°-160°	642.5	7.3
160°-170°	414.0	4.7
170°-180°	142.5	1.6
0°-30°	1291.3	14.7
0°-40°	2071.5	23.6
0°-60°	3530.2	40.2
0°-90°	4394.3	50.0
90°-120°	721.5	8.2
90°-150°	3190.0	36.3
90°-180°	4389.0	50.0
0°-180°	8783.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1726	1726	1726	1726	1726	
5°	1726	1720	1701	1714	1711	164
15°	1643	1633	1612	1618	1610	463
25°	1487	1474	1446	1449	1446	684
35°	1283	1266	1240	1230	1222	801
45°	1044	1032	1007	989	983	806
55°	790	780	760	740	732	706
65°	533	523	506	491	483	527
75°	279	276	267	257	261	298
85°	68	66	65	60	58	76
90°	1	13	22	27	29	8
95°	70	35	42	48	47	83
105°	329	362	66	78	82	352
115°	623	641	668	167	89	613
125°	881	895	915	923	926	785
135°	1090	1107	1117	1128	1126	842
145°	1264	1263	1281	1289	1284	791
155°	1392	1382	1395	1402	1393	641
165°	1467	1460	1464	1471	1464	414
175°	1500	1493	1495	1502	1492	143
180°	1497	1497	1497	1497	1497	

TEST NUMBER: P911081

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US850-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1726.0	1726.0	1726.0	1726.0	1726.0
2.5°	1736.1	1727.8	1709.5	1726.0	1722.9
5°	1726.0	1719.5	1701.2	1714.4	1711.3
7.5°	1714.4	1704.5	1686.2	1699.7	1696.3
10°	1696.3	1684.7	1664.8	1678.0	1673.0
12.5°	1671.3	1661.4	1641.5	1649.9	1646.4
15°	1643.1	1633.2	1611.6	1618.3	1610.0
17.5°	1608.3	1598.4	1576.8	1585.0	1576.8
20°	1570.0	1560.1	1537.0	1541.8	1535.4
22.5°	1532.0	1517.0	1495.4	1495.4	1492.0
25°	1487.1	1473.9	1445.7	1448.9	1445.7
27.5°	1437.3	1425.6	1404.2	1399.2	1391.0
30°	1387.6	1374.3	1349.4	1344.4	1337.8
32.5°	1334.5	1324.6	1298.0	1288.0	1281.2
35°	1283.0	1266.5	1239.9	1229.9	1221.6
37.5°	1224.9	1209.9	1183.3	1171.8	1163.5
40°	1165.2	1151.8	1125.2	1110.4	1103.8
42.5°	1107.1	1093.7	1067.3	1050.6	1040.7
45°	1044.0	1032.5	1007.4	989.3	982.6
47.5°	982.6	970.9	944.4	926.1	916.3
50°	917.8	909.5	886.3	863.0	854.7
52.5°	854.7	843.2	821.7	803.4	791.7
55°	790.2	780.1	760.2	740.3	732.1
57.5°	725.3	717.1	695.3	675.5	668.8
60°	660.5	654.0	630.8	612.5	607.5
62.5°	597.5	585.9	569.4	552.7	546.1
65°	532.9	522.8	506.3	491.3	483.1
67.5°	466.4	458.0	443.3	431.6	425.0
70°	405.0	398.4	383.4	371.7	365.2
72.5°	342.0	335.3	327.0	315.4	310.4
75°	278.8	275.6	267.2	257.3	260.6
77.5°	222.4	215.7	212.4	207.4	202.5
80°	166.0	164.2	160.9	156.0	152.7
82.5°	112.9	112.9	111.3	104.6	104.6
85°	68.0	66.4	64.8	59.7	58.1
87.5°	29.9	26.6	23.3	18.3	16.5
90°	1.0	13.0	21.6	27.2	29.2
92.5°	27.2	22.7	26.0	28.2	29.2
95°	70.3	34.6	42.1	47.7	46.6
97.5°	126.8	37.9	55.2	58.6	59.6
100°	191.7	43.4	61.8	70.3	72.5
102.5°	263.2	261.2	63.9	75.7	79.1
105°	329.3	361.9	66.1	78.0	82.3
107.5°	406.2	433.3	68.3	80.2	84.5
110°	480.0	502.6	189.6	81.3	85.5

TEST NUMBER: P911081

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US850-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	549.3	568.7	550.3	83.4	86.7
115°	622.8	641.2	668.4	166.8	88.9
117.5°	686.8	708.4	726.9	571.9	288.1
120°	758.3	774.5	794.0	807.1	660.9
122.5°	818.9	836.3	858.0	864.5	865.6
125°	880.7	894.9	915.4	923.0	926.2
127.5°	937.0	952.2	968.5	979.4	980.4
130°	990.1	1007.5	1019.3	1031.3	1030.3
132.5°	1044.2	1058.4	1070.3	1080.1	1079.1
135°	1089.8	1107.2	1116.9	1127.7	1125.6
137.5°	1137.4	1150.4	1161.3	1172.1	1168.9
140°	1184.0	1192.7	1204.6	1214.4	1208.9
142.5°	1223.1	1230.7	1244.7	1253.3	1248.0
145°	1264.3	1263.2	1281.4	1289.1	1283.7
147.5°	1299.9	1296.6	1315.1	1320.5	1316.3
150°	1334.6	1327.0	1344.4	1350.9	1345.4
152.5°	1363.8	1355.2	1371.4	1377.9	1370.4
155°	1392.0	1382.4	1395.3	1401.8	1393.1
157.5°	1414.8	1406.1	1416.0	1423.5	1414.8
160°	1434.3	1427.7	1434.3	1440.7	1433.2
162.5°	1451.6	1445.1	1450.6	1458.1	1448.4
165°	1466.8	1460.3	1463.5	1471.1	1463.5
167.5°	1478.7	1472.1	1475.5	1483.1	1473.3
170°	1488.5	1482.0	1484.1	1491.7	1482.0
172.5°	1494.9	1488.5	1490.7	1498.3	1488.5
175°	1500.3	1492.7	1494.9	1502.5	1491.7
177.5°	1502.5	1494.9	1496.0	1503.7	1493.9
180°	1497.2	1497.2	1497.2	1497.2	1497.2

TEST NUMBER: P911081

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US850-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.74	12.60	12.70	13.57	14.84	11.30	12.16	12.26	13.14	14.41
	3H	13.38	14.15	14.35	15.13	16.43	12.90	13.67	13.87	14.65	15.95
	4H	13.95	14.69	14.94	15.67	16.97	13.47	14.20	14.45	15.19	16.49
	6H	14.34	15.01	15.33	16.00	17.32	13.85	14.53	14.84	15.52	16.83
	8H	14.44	15.08	15.43	16.08	17.39	13.95	14.59	14.95	15.60	16.91
	12H	14.48	15.09	15.48	16.09	17.42	13.98	14.59	14.99	15.59	16.93
4H	2H	12.19	12.92	13.18	13.91	15.21	11.84	12.57	12.83	13.56	14.86
	3H	14.03	14.64	15.03	15.66	16.97	13.63	14.24	14.63	15.26	16.57
	4H	14.73	15.29	15.74	16.30	17.64	14.32	14.88	15.32	15.88	17.22
	6H	15.23	15.71	16.24	16.74	18.07	14.81	15.29	15.82	16.32	17.65
	8H	15.37	15.82	16.38	16.84	18.19	14.94	15.39	15.96	16.42	17.77
	12H	15.43	15.84	16.47	16.88	18.23	15.00	15.40	16.03	16.44	17.80
8H	4H	14.92	15.37	15.94	16.39	17.74	14.55	15.00	15.57	16.02	17.37
	6H	15.52	15.90	16.57	16.96	18.31	15.15	15.52	16.19	16.59	17.94
	8H	15.73	16.06	16.78	17.11	18.48	15.35	15.68	16.40	16.73	18.10
	12H	15.85	16.14	16.90	17.18	18.59	15.45	15.74	16.51	16.79	18.20
12H	4H	14.90	15.31	15.94	16.35	17.70	14.54	14.95	15.58	15.98	17.34
	6H	15.55	15.88	16.60	16.93	18.29	15.19	15.51	16.24	16.56	17.93
	8H	15.78	16.06	16.83	17.11	18.52	15.41	15.69	16.46	16.74	18.15

END OF REPORT