

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911092

Luminaire Tested: DFN2DIP-PN2F0-050D020US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911092
REPORT IS A COMBINATION OF REPORTS P899467 AND P896349
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-050D020US850-FLLFLL
Description: 2 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7452.5 lumens
Efficiency: N/A
Efficacy: 111.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 67
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911092

CATALOG NUMBER: DFN2DIP-PN2F0-050D020US850-FLLFLL

Luminous Intensity Polar Plot

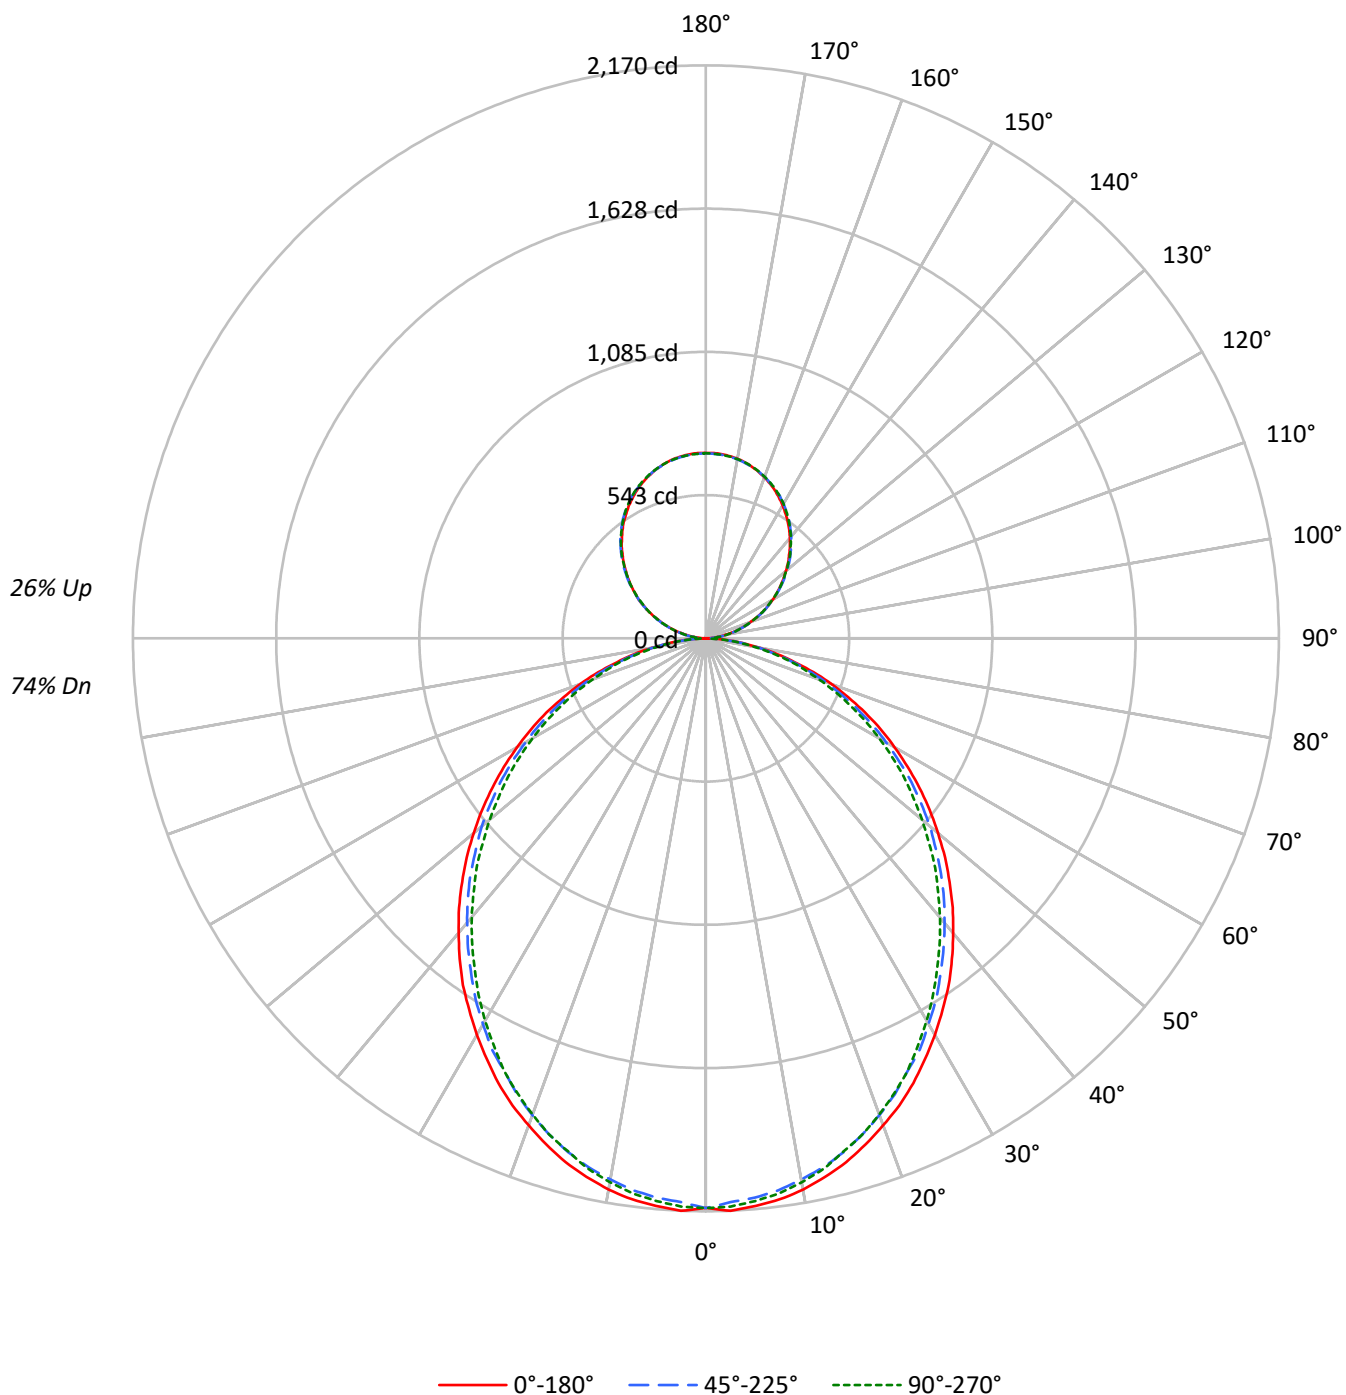

TEST NUMBER: P911092

CATALOG NUMBER: DFN2DIP-PN2F0-050D020US850-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	113	113	113	113	107	107	107	107	96	96	96	87	87	87	78	78	78
1	103	99	95	91	98	94	90	87	85	82	80	77	74	72	69	67	66
2	94	86	80	74	89	82	76	71	74	70	66	67	64	61	61	58	55
3	86	76	68	62	81	72	65	60	66	60	55	59	55	51	54	50	47
4	79	67	59	53	74	64	57	51	58	52	47	53	48	44	48	44	41
5	72	60	52	45	68	57	50	44	52	46	41	48	42	38	43	39	36
6	67	54	46	40	63	52	44	38	47	41	36	43	38	34	39	35	31
7	62	49	41	35	58	47	39	34	43	37	32	39	34	30	36	31	28
8	57	45	37	31	54	43	35	30	39	33	28	36	31	27	33	29	25
9	54	41	33	28	51	39	32	27	36	30	26	33	28	24	31	26	23
10	50	38	30	25	48	36	29	24	33	27	23	31	26	22	28	24	21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4673	4673	4673
5°	4673	4598	4632
10°	4628	4526	4563
15°	4552	4442	4458
20°	4453	4328	4351
25°	4354	4194	4228
30°	4231	4069	4074
35°	4114	3923	3911
40°	3972	3776	3756
45°	3830	3627	3597
50°	3674	3471	3413
55°	3510	3290	3242
60°	3325	3077	3047
65°	3121	2855	2816
70°	2862	2584	2567
75°	2506	2259	2327
80°	2075	1845	1888
85°	1407	1167	1182

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3830 cd/sqm

TEST NUMBER: P911092

CATALOG NUMBER: DFN2DIP-PN2F0-050D020US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	203.1	2.7
10°-20°	571.4	7.7
20°-30°	839.7	11.3
30°-40°	975.2	13.1
40°-50°	974.0	13.1
50°-60°	849.3	11.4
60°-70°	627.9	8.4
70°-80°	355.2	4.8
80°-90°	95.8	1.3
90°-100°	43.4	0.6
100°-110°	137.9	1.9
110°-120°	236.0	3.2
120°-130°	310.4	4.2
130°-140°	348.4	4.7
140°-150°	341.7	4.6
150°-160°	286.6	3.8
160°-170°	190.1	2.6
170°-180°	66.4	0.9
0°-30°	1614.1	21.7
0°-40°	2589.4	34.7
0°-60°	4412.7	59.2
0°-90°	5491.6	73.7
90°-120°	417.3	5.6
90°-150°	1417.8	19.0
90°-180°	1961.0	26.3
0°-180°	7452.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2158	2158	2158	2158	2158	
5°	2158	2150	2126	2143	2139	205
15°	2054	2042	2014	2023	2012	578
25°	1859	1842	1807	1811	1807	855
35°	1604	1583	1550	1537	1527	1001
45°	1305	1290	1259	1237	1228	1007
55°	988	975	950	925	915	883
65°	666	654	633	614	604	659
75°	348	344	334	322	326	372
85°	85	83	81	75	73	95
90°	1	8	21	19	20	7
95°	31	37	38	38	37	34
105°	127	129	130	131	131	134
115°	237	240	239	238	237	234
125°	344	350	348	346	346	308
135°	446	452	453	453	451	344
145°	541	545	549	549	547	338
155°	619	620	622	625	623	285
165°	673	672	672	676	674	190
175°	700	699	697	701	698	67
180°	701	701	701	701	701	

TEST NUMBER: P911092

CATALOG NUMBER: DFN2DIP-PN2F0-050D020US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2157.6	2157.6	2157.6	2157.6	2157.6
2.5°	2170.1	2159.8	2136.9	2157.6	2153.7
5°	2157.6	2149.5	2126.5	2143.0	2139.2
7.5°	2143.0	2130.7	2107.9	2124.6	2120.4
10°	2120.4	2105.9	2081.0	2097.5	2091.4
12.5°	2089.1	2076.8	2052.0	2062.3	2058.1
15°	2053.9	2041.6	2014.5	2022.9	2012.5
17.5°	2010.3	1998.0	1970.9	1981.2	1970.9
20°	1962.6	1950.3	1921.2	1927.3	1919.2
22.5°	1915.0	1896.3	1869.2	1869.2	1865.0
25°	1858.9	1842.4	1807.1	1811.1	1807.1
27.5°	1796.6	1782.1	1755.2	1749.0	1738.7
30°	1734.5	1717.8	1686.8	1680.6	1672.3
32.5°	1668.0	1655.7	1622.5	1609.9	1601.6
35°	1603.7	1583.1	1549.8	1537.3	1527.0
37.5°	1531.1	1512.5	1479.2	1464.7	1454.3
40°	1456.6	1439.8	1406.5	1388.0	1379.7
42.5°	1383.9	1367.2	1334.1	1313.2	1300.9
45°	1305.1	1290.5	1259.3	1236.6	1228.2
47.5°	1228.2	1213.7	1180.5	1157.6	1145.3
50°	1147.3	1136.9	1107.9	1078.8	1068.4
52.5°	1068.4	1053.9	1027.0	1004.2	989.7
55°	987.7	975.1	950.2	925.3	915.0
57.5°	906.6	896.3	869.2	844.4	836.0
60°	825.7	817.6	788.5	765.5	759.4
62.5°	746.9	732.4	711.6	690.9	682.6
65°	666.1	653.5	632.8	614.2	603.7
67.5°	583.1	572.6	554.1	539.5	531.1
70°	506.3	497.9	479.2	464.7	456.6
72.5°	427.5	419.1	408.8	394.2	388.0
75°	348.4	344.5	333.9	321.6	325.8
77.5°	278.0	269.6	265.5	259.3	253.2
80°	207.6	205.4	201.2	195.1	190.9
82.5°	141.1	141.1	139.1	130.8	130.8
85°	84.9	83.0	81.0	74.6	72.6
87.5°	37.4	33.3	29.1	22.8	20.7
90°	0.7	7.7	20.7	19.4	20.1
92.5°	13.1	17.7	18.4	19.1	19.1
95°	30.8	36.8	37.8	37.8	36.8
97.5°	51.3	56.9	59.2	59.2	59.2
100°	75.1	80.0	81.6	81.6	81.0
102.5°	100.0	103.6	105.9	106.6	105.9
105°	127.3	129.0	130.3	131.3	131.3
107.5°	154.4	156.9	156.9	157.4	154.4
110°	180.7	184.0	184.0	184.0	182.3

TEST NUMBER: P911092

CATALOG NUMBER: DFN2DIP-PN2F0-050D020US850-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	208.9	212.5	211.9	210.2	208.9
115°	236.9	240.2	239.2	238.5	236.9
117.5°	264.6	269.3	266.3	264.6	262.8
120°	292.4	297.1	292.4	292.4	290.6
122.5°	317.8	323.7	320.8	319.2	317.8
125°	344.5	349.8	348.1	346.2	345.6
127.5°	370.5	377.1	374.7	372.2	370.5
130°	394.8	402.5	401.3	400.1	397.8
132.5°	422.1	428.1	428.4	425.5	423.7
135°	445.6	452.1	453.4	452.8	451.0
137.5°	471.8	477.1	478.2	477.8	475.2
140°	494.8	500.2	503.2	503.2	500.8
142.5°	518.6	523.8	525.6	526.1	523.8
145°	541.0	545.2	548.6	549.2	546.8
147.5°	561.0	566.4	568.9	569.9	567.6
150°	581.8	585.3	587.7	589.5	587.7
152.5°	600.2	603.7	606.7	609.1	606.7
155°	618.6	620.3	622.1	625.1	623.3
157.5°	634.5	635.7	636.8	641.0	638.0
160°	648.7	649.9	650.5	654.1	651.5
162.5°	661.7	661.7	662.3	666.4	663.4
165°	672.9	672.3	672.3	676.5	673.6
167.5°	683.0	681.1	681.1	685.4	682.5
170°	690.7	689.0	688.4	692.6	689.0
172.5°	696.0	694.2	693.7	697.9	694.2
175°	700.2	698.6	697.2	701.4	697.9
177.5°	702.6	700.9	699.6	703.1	699.6
180°	701.4	701.4	701.4	701.4	701.4

TEST NUMBER: P911092

CATALOG NUMBER: DFN2DIP-PN2F0-050D020US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.46	15.58	15.18	16.33	17.21	14.02	15.15	14.75	15.89	16.78
	3H	16.12	17.13	16.86	17.88	18.80	15.64	16.65	16.38	17.40	18.32
	4H	16.70	17.66	17.46	18.42	19.35	16.22	17.18	16.98	17.94	18.87
	6H	17.10	17.98	17.87	18.76	19.70	16.62	17.50	17.38	18.27	19.21
	8H	17.21	18.05	17.98	18.84	19.78	16.72	17.56	17.50	18.35	19.30
	12H	17.26	18.06	18.04	18.84	19.82	16.76	17.56	17.55	18.35	19.32
4H	2H	14.94	15.90	15.70	16.66	17.59	14.59	15.55	15.35	16.31	17.24
	3H	16.81	17.60	17.58	18.40	19.35	16.41	17.20	17.18	18.00	18.95
	4H	17.52	18.24	18.30	19.04	20.02	17.10	17.83	17.89	18.63	19.60
	6H	18.03	18.65	18.83	19.48	20.46	17.61	18.23	18.41	19.06	20.04
	8H	18.17	18.76	18.98	19.58	20.57	17.75	18.34	18.56	19.16	20.15
	12H	18.25	18.78	19.08	19.62	20.62	17.82	18.34	18.64	19.18	20.19
8H	4H	17.72	18.31	18.53	19.13	20.12	17.35	17.94	18.16	18.76	19.75
	6H	18.34	18.83	19.18	19.69	20.68	17.97	18.45	18.80	19.31	20.31
	8H	18.55	18.98	19.40	19.84	20.85	18.17	18.60	19.02	19.46	20.47
	12H	18.68	19.06	19.53	19.91	20.98	18.28	18.67	19.13	19.51	20.58
12H	4H	17.72	18.25	18.55	19.09	20.09	17.36	17.89	18.19	18.73	19.73
	6H	18.37	18.80	19.22	19.66	20.67	18.00	18.44	18.85	19.30	20.31
	8H	18.61	18.99	19.46	19.84	20.91	18.24	18.62	19.09	19.47	20.54

END OF REPORT