

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911109

Luminaire Tested: DFN2DIP-PN2F0-050D060US850-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911109
REPORT IS A COMBINATION OF REPORTS P901027 AND P897905
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-050D060US850-FLLONL
Description: 2 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12077.0 lumens
Efficiency: N/A
Efficacy: 116.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 103.7
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911109

CATALOG NUMBER: DFN2DIP-PN2F0-050D060US850-FLLONL

Luminous Intensity Polar Plot

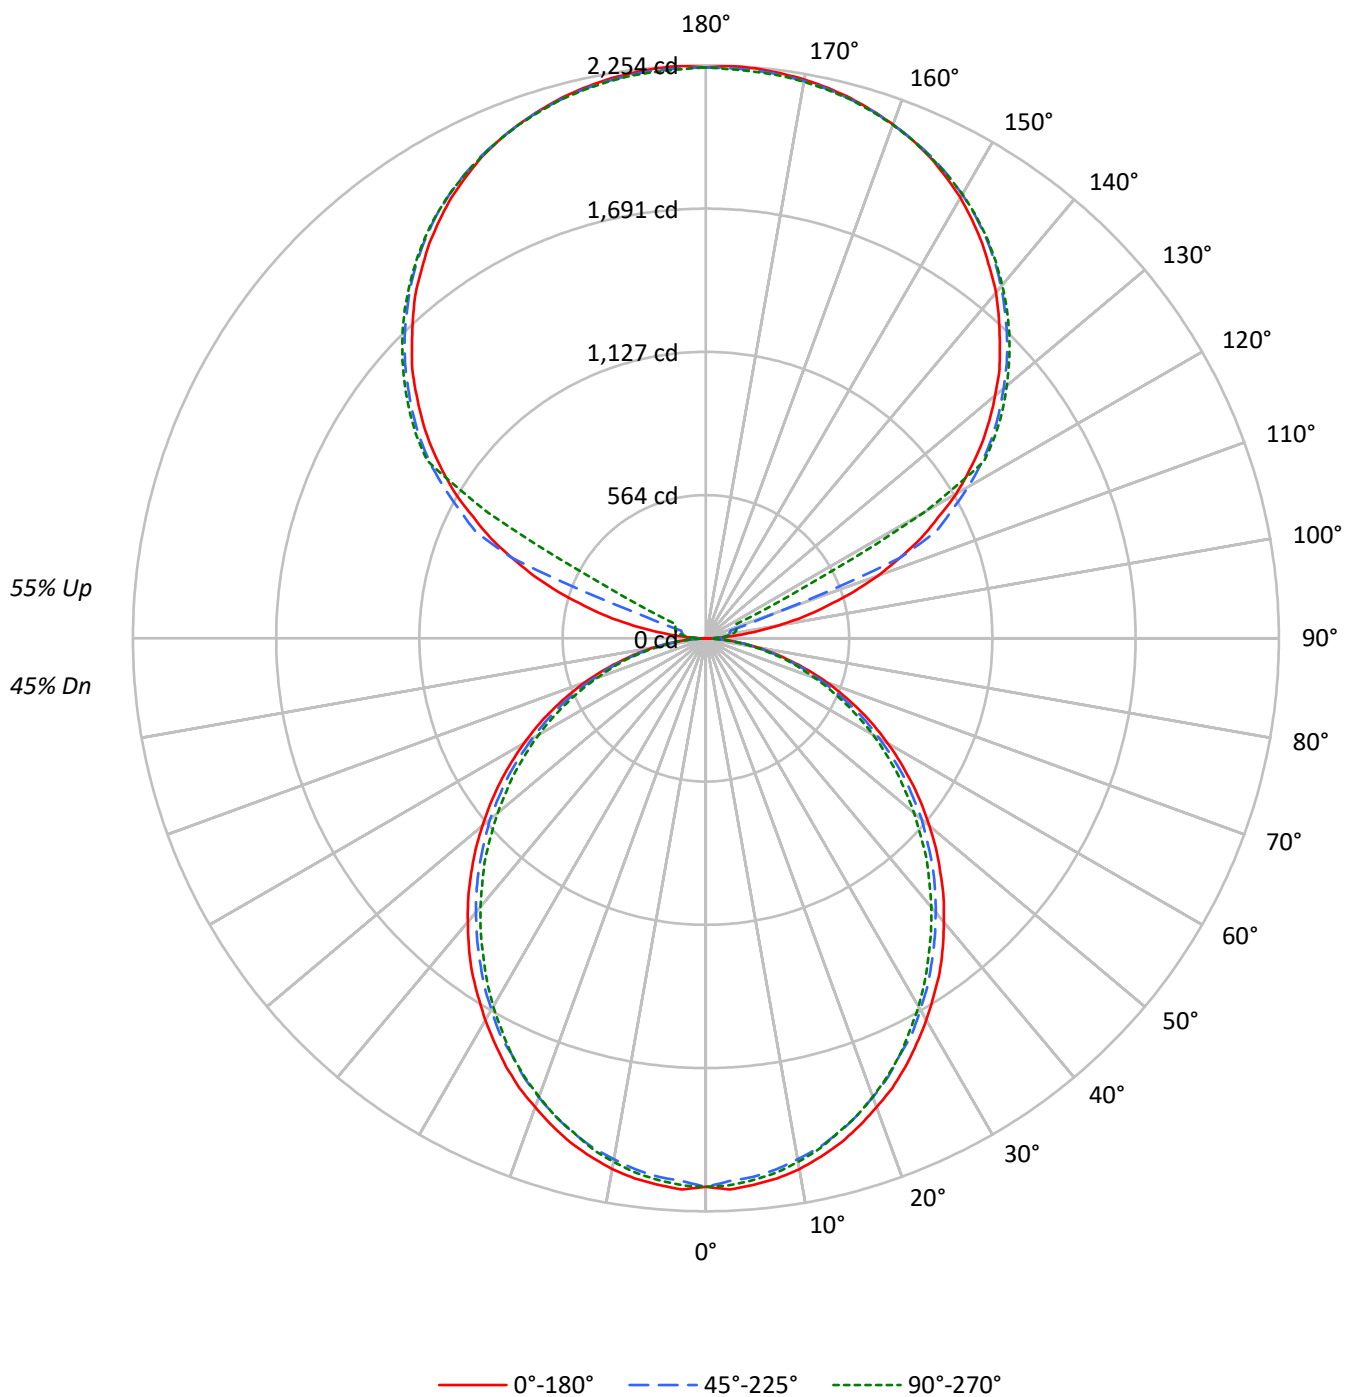

TEST NUMBER: P911109

CATALOG NUMBER: DFN2DIP-PN2F0-050D060US850-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52
1	97	92	89	85	89	85	82	79	71	68	66	58	56	55	46	45	44
2	88	81	75	70	81	74	69	65	62	58	55	51	48	46	40	39	37
3	80	71	64	58	73	65	59	54	55	50	46	45	42	39	36	33	31
4	74	63	55	49	67	58	51	46	49	43	39	40	36	33	32	29	27
5	67	56	48	42	62	52	45	39	43	38	34	36	32	29	29	26	24
6	62	50	42	36	57	46	39	34	39	34	30	32	28	25	26	23	21
7	57	45	37	32	53	42	35	30	35	30	26	30	25	22	24	21	18
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	17
9	50	37	30	25	45	35	28	24	30	24	21	25	21	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4673	4673	4673
5°	4673	4598	4632
10°	4628	4526	4563
15°	4552	4442	4458
20°	4453	4328	4351
25°	4354	4194	4228
30°	4231	4069	4074
35°	4114	3923	3911
40°	3972	3776	3756
45°	3830	3627	3597
50°	3674	3471	3413
55°	3510	3290	3242
60°	3325	3077	3047
65°	3121	2855	2816
70°	2862	2584	2567
75°	2506	2259	2327
80°	2075	1845	1888
85°	1407	1167	1182

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3830 cd/sqm

TEST NUMBER: P911109

CATALOG NUMBER: DFN2DIP-PN2F0-050D060US850-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	203.1	1.7
10°-20°	571.4	4.7
20°-30°	839.7	7.0
30°-40°	975.2	8.1
40°-50°	974.0	8.1
50°-60°	849.3	7.0
60°-70°	627.9	5.2
70°-80°	355.2	2.9
80°-90°	97.7	0.8
90°-100°	74.1	0.6
100°-110°	276.0	2.3
110°-120°	732.1	6.1
120°-130°	1214.2	10.1
130°-140°	1289.8	10.7
140°-150°	1198.7	9.9
150°-160°	963.8	8.0
160°-170°	621.0	5.1
170°-180°	213.7	1.8
0°-30°	1614.1	13.4
0°-40°	2589.4	21.4
0°-60°	4412.7	36.5
0°-90°	5493.5	45.5
90°-120°	1082.2	9.0
90°-150°	4785.0	39.6
90°-180°	6583.0	54.5
0°-180°	12077.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2158	2158	2158	2158	2158	
5°	2158	2150	2126	2143	2139	205
15°	2054	2042	2014	2023	2012	578
25°	1859	1842	1807	1811	1807	855
35°	1604	1583	1550	1537	1527	1001
45°	1305	1290	1259	1237	1228	1007
55°	988	975	950	925	915	883
65°	666	654	633	614	604	659
75°	348	344	334	322	326	372
85°	85	83	81	75	73	95
90°	2	20	32	41	44	11
95°	106	52	63	72	70	125
105°	494	543	99	117	124	528
115°	934	962	1003	250	133	920
125°	1321	1342	1373	1384	1389	1178
135°	1635	1661	1675	1692	1688	1263
145°	1896	1895	1922	1934	1926	1186
155°	2088	2074	2093	2103	2090	962
165°	2200	2190	2195	2207	2195	622
175°	2250	2239	2242	2254	2238	214
180°	2246	2246	2246	2246	2246	

TEST NUMBER: P911109

CATALOG NUMBER: DFN2DIP-PN2F0-050D060US850-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2157.6	2157.6	2157.6	2157.6	2157.6
2.5°	2170.1	2159.8	2136.9	2157.6	2153.7
5°	2157.6	2149.5	2126.5	2143.0	2139.2
7.5°	2143.0	2130.7	2107.9	2124.6	2120.4
10°	2120.4	2105.9	2081.0	2097.5	2091.4
12.5°	2089.1	2076.8	2052.0	2062.3	2058.1
15°	2053.9	2041.6	2014.5	2022.9	2012.5
17.5°	2010.3	1998.0	1970.9	1981.2	1970.9
20°	1962.6	1950.3	1921.2	1927.3	1919.2
22.5°	1915.0	1896.3	1869.2	1869.2	1865.0
25°	1858.9	1842.4	1807.1	1811.1	1807.1
27.5°	1796.6	1782.1	1755.2	1749.0	1738.7
30°	1734.5	1717.8	1686.8	1680.6	1672.3
32.5°	1668.0	1655.7	1622.5	1609.9	1601.6
35°	1603.7	1583.1	1549.8	1537.3	1527.0
37.5°	1531.1	1512.5	1479.2	1464.7	1454.3
40°	1456.6	1439.8	1406.5	1388.0	1379.7
42.5°	1383.9	1367.2	1334.1	1313.2	1300.9
45°	1305.1	1290.5	1259.3	1236.6	1228.2
47.5°	1228.2	1213.7	1180.5	1157.6	1145.3
50°	1147.3	1136.9	1107.9	1078.8	1068.4
52.5°	1068.4	1053.9	1027.0	1004.2	989.7
55°	987.7	975.1	950.2	925.3	915.0
57.5°	906.6	896.3	869.2	844.4	836.0
60°	825.7	817.6	788.5	765.5	759.4
62.5°	746.9	732.4	711.6	690.9	682.6
65°	666.1	653.5	632.8	614.2	603.7
67.5°	583.1	572.6	554.1	539.5	531.1
70°	506.3	497.9	479.2	464.7	456.6
72.5°	427.5	419.1	408.8	394.2	388.0
75°	348.4	344.5	333.9	321.6	325.8
77.5°	278.0	269.6	265.5	259.3	253.2
80°	207.6	205.4	201.2	195.1	190.9
82.5°	141.1	141.1	139.1	130.8	130.8
85°	84.9	83.0	81.0	74.6	72.6
87.5°	37.4	33.3	29.1	22.8	20.7
90°	1.6	19.5	32.4	40.7	43.8
92.5°	40.7	34.2	38.9	42.3	43.8
95°	105.6	51.9	63.3	71.6	69.9
97.5°	190.1	56.9	82.7	87.8	89.4
100°	287.7	65.0	92.6	105.6	108.8
102.5°	394.8	391.7	95.9	113.7	118.7
105°	493.9	542.7	99.1	116.9	123.5
107.5°	609.4	649.9	102.5	120.2	126.8
110°	720.0	753.9	284.5	122.0	128.3

TEST NUMBER: P911109

CATALOG NUMBER: DFN2DIP-PN2F0-050D060US850-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	823.9	853.0	825.4	125.0	130.1
115°	934.3	961.9	1002.6	250.3	133.3
117.5°	1030.2	1062.6	1090.4	857.9	432.2
120°	1137.5	1161.8	1191.2	1210.6	991.2
122.5°	1228.3	1254.4	1287.0	1296.6	1298.4
125°	1321.0	1342.2	1373.1	1384.5	1389.2
127.5°	1405.5	1428.3	1452.8	1469.0	1470.5
130°	1485.2	1511.2	1529.0	1546.9	1545.4
132.5°	1566.5	1587.6	1605.4	1620.0	1618.5
135°	1634.8	1660.8	1675.3	1691.7	1688.3
137.5°	1706.1	1725.6	1742.0	1758.2	1753.4
140°	1776.0	1789.1	1806.9	1821.5	1813.4
142.5°	1834.6	1846.0	1867.1	1880.0	1871.9
145°	1896.4	1894.6	1922.2	1933.7	1925.6
147.5°	1949.8	1945.0	1972.6	1980.7	1974.4
150°	2002.0	1990.5	2016.6	2026.3	2018.2
152.5°	2045.8	2032.8	2057.1	2067.0	2055.5
155°	2088.0	2073.5	2093.0	2102.7	2089.7
157.5°	2122.2	2109.2	2123.8	2135.3	2122.2
160°	2151.5	2141.6	2151.5	2161.1	2149.8
162.5°	2177.3	2167.7	2175.7	2187.2	2172.5
165°	2200.1	2190.5	2195.3	2206.7	2195.3
167.5°	2218.0	2208.2	2213.2	2224.7	2209.9
170°	2232.7	2222.9	2226.2	2237.5	2222.9
172.5°	2242.4	2232.7	2236.0	2247.4	2232.7
175°	2250.5	2239.1	2242.4	2253.7	2237.5
177.5°	2253.7	2242.4	2244.1	2255.5	2240.8
180°	2245.6	2245.6	2245.6	2245.6	2245.6

TEST NUMBER: P911109

CATALOG NUMBER: DFN2DIP-PN2F0-050D060US850-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.08	12.90	13.07	13.91	15.24	11.64	12.46	12.64	13.47	14.81
	3H	13.72	14.45	14.72	15.47	16.82	13.24	13.97	14.24	14.99	16.34
	4H	14.29	14.99	15.31	16.01	17.37	13.81	14.51	14.83	15.52	16.89
	6H	14.67	15.31	15.70	16.34	17.71	14.19	14.83	15.21	15.85	17.23
	8H	14.77	15.38	15.80	16.42	17.79	14.28	14.89	15.32	15.93	17.30
	12H	14.81	15.39	15.85	16.42	17.82	14.31	14.90	15.35	15.93	17.33
4H	2H	12.53	13.22	13.55	14.24	15.61	12.18	12.87	13.20	13.89	15.26
	3H	14.37	14.95	15.40	15.99	17.37	13.97	14.55	15.00	15.59	16.97
	4H	15.06	15.60	16.10	16.63	18.03	14.65	15.18	15.69	16.22	17.62
	6H	15.56	16.01	16.61	17.08	18.47	15.14	15.59	16.19	16.66	18.05
	8H	15.69	16.12	16.75	17.18	18.59	15.27	15.70	16.32	16.75	18.16
	12H	15.76	16.14	16.82	17.21	18.63	15.32	15.71	16.39	16.78	18.19
8H	4H	15.24	15.67	16.30	16.73	18.14	14.88	15.30	15.93	16.36	17.77
	6H	15.85	16.20	16.92	17.30	18.71	15.48	15.83	16.55	16.93	18.33
	8H	16.06	16.37	17.14	17.45	18.87	15.68	15.99	16.76	17.07	18.49
	12H	16.17	16.45	17.26	17.52	18.99	15.78	16.05	16.86	17.13	18.59
12H	4H	15.23	15.61	16.29	16.68	18.10	14.86	15.25	15.93	16.32	17.74
	6H	15.87	16.19	16.96	17.27	18.69	15.51	15.82	16.59	16.90	18.33
	8H	16.10	16.37	17.18	17.45	18.91	15.73	16.00	16.82	17.08	18.55