

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913776

Luminaire Tested: DFN2DIP-PN2F0-020D060US927-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913776
REPORT IS A COMBINATION OF REPORTS P899501 AND P896349
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-020D060US927-FLLFLL
Description: 2 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5775.0 lumens
Efficiency: N/A
Efficacy: 83.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 69
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913776

CATALOG NUMBER: DFN2DIP-PN2F0-020D060US927-FLLFLL

Luminous Intensity Polar Plot

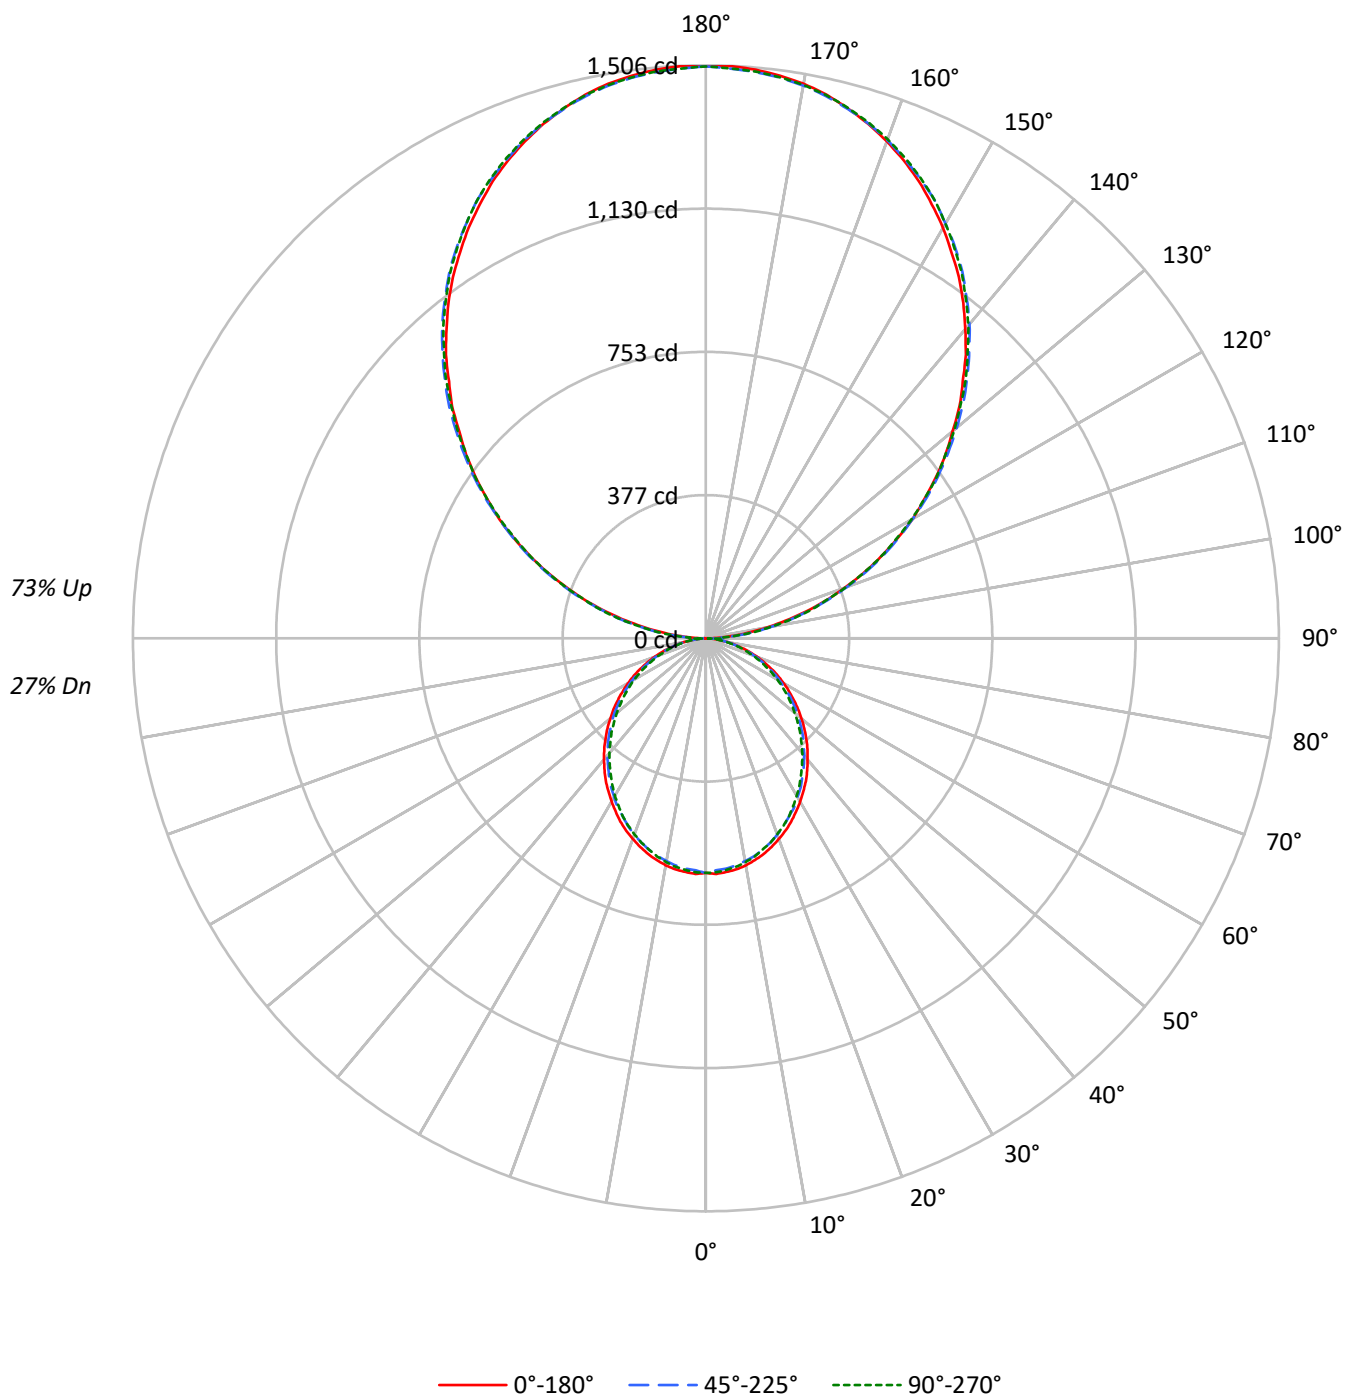

TEST NUMBER: P913776

CATALOG NUMBER: DFN2DIP-PN2F0-020D060US927-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	102	102	102	102	91	91	91	91	71	71	71	52	52	52	35	35	35
1	93	88	85	81	83	79	76	73	62	60	58	46	44	43	31	30	30
2	84	77	71	66	75	69	64	60	54	51	48	40	38	36	27	26	25
3	77	68	61	55	68	61	55	50	48	44	40	35	33	30	24	23	21
4	70	60	52	47	62	54	47	42	42	38	34	32	29	26	22	20	18
5	64	53	45	40	57	48	41	36	38	33	29	28	25	22	19	17	16
6	59	48	40	34	53	43	36	31	34	29	25	25	22	20	18	16	14
7	55	43	35	30	49	39	32	27	31	26	22	23	20	17	16	14	12
8	51	39	31	26	45	35	28	24	28	23	20	21	18	15	15	13	11
9	47	35	28	23	42	32	26	21	25	21	17	19	16	14	14	11	10
10	44	32	25	21	39	29	23	19	23	19	16	18	15	12	13	10	9

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1335	1335	1335
5°	1335	1314	1324
10°	1322	1293	1304
15°	1301	1269	1274
20°	1272	1237	1243
25°	1244	1198	1208
30°	1209	1163	1164
35°	1176	1121	1118
40°	1135	1079	1073
45°	1094	1036	1028
50°	1050	992	975
55°	1003	940	926
60°	950	879	871
65°	892	816	805
70°	818	738	734
75°	716	645	665
80°	593	527	539
85°	401	333	339

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2025 cd/sqm

TEST NUMBER: P913776

CATALOG NUMBER: DFN2DIP-PN2F0-020D060US927-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	58.0	1.0
10°-20°	163.3	2.8
20°-30°	239.9	4.2
30°-40°	278.7	4.8
40°-50°	278.3	4.8
50°-60°	242.7	4.2
60°-70°	179.4	3.1
70°-80°	101.5	1.8
80°-90°	31.1	0.5
90°-100°	93.0	1.6
100°-110°	295.6	5.1
110°-120°	505.8	8.8
120°-130°	665.2	11.5
130°-140°	746.6	12.9
140°-150°	732.2	12.7
150°-160°	614.2	10.6
160°-170°	407.3	7.1
170°-180°	142.4	2.5
0°-30°	461.2	8.0
0°-40°	739.9	12.8
0°-60°	1260.8	21.8
0°-90°	1572.8	27.2
90°-120°	894.4	15.5
90°-150°	3038.4	52.6
90°-180°	4202.0	72.8
0°-180°	5775.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	616	616	616	616	616	
5°	616	614	608	612	611	59
15°	587	583	576	578	575	165
25°	531	526	516	518	516	244
35°	458	452	443	439	436	286
45°	373	369	360	353	351	288
55°	282	279	272	264	261	252
65°	190	187	181	176	172	188
75°	100	98	95	92	93	106
85°	24	24	23	21	21	27
90°	1	16	44	42	43	6
95°	66	79	81	81	79	74
105°	273	276	279	282	282	288
115°	508	515	512	511	508	502
125°	738	750	746	742	740	660
135°	955	969	972	970	967	738
145°	1159	1168	1176	1177	1172	724
155°	1326	1329	1333	1340	1336	610
165°	1442	1441	1441	1450	1443	407
175°	1500	1497	1494	1503	1496	143
180°	1503	1503	1503	1503	1503	

TEST NUMBER: P913776

CATALOG NUMBER: DFN2DIP-PN2F0-020D060US927-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	616.5	616.5	616.5	616.5	616.5
2.5°	620.0	617.1	610.5	616.5	615.4
5°	616.5	614.2	607.6	612.4	611.2
7.5°	612.4	608.8	602.3	607.0	605.9
10°	605.9	601.7	594.6	599.3	597.5
12.5°	596.9	593.4	586.3	589.2	588.0
15°	586.8	583.4	575.6	578.0	575.0
17.5°	574.4	570.9	563.2	566.1	563.2
20°	560.8	557.2	548.9	550.7	548.3
22.5°	547.2	541.9	534.1	534.1	532.9
25°	531.2	526.4	516.3	517.5	516.3
27.5°	513.3	509.2	501.5	499.8	496.8
30°	495.6	490.8	482.0	480.2	477.8
32.5°	476.6	473.1	463.6	460.0	457.6
35°	458.3	452.3	442.8	439.3	436.3
37.5°	437.5	432.1	422.6	418.5	415.5
40°	416.1	411.4	401.9	396.6	394.2
42.5°	395.4	390.6	381.2	375.3	371.7
45°	372.9	368.8	359.8	353.3	350.9
47.5°	350.9	346.8	337.3	330.7	327.3
50°	327.8	324.9	316.6	308.2	305.3
52.5°	305.3	301.1	293.4	286.9	282.8
55°	282.2	278.6	271.5	264.4	261.4
57.5°	259.0	256.1	248.3	241.3	238.8
60°	235.9	233.6	225.3	218.7	217.0
62.5°	213.4	209.2	203.4	197.4	195.0
65°	190.3	186.7	180.9	175.5	172.5
67.5°	166.6	163.6	158.3	154.2	151.8
70°	144.7	142.3	136.9	132.8	130.5
72.5°	122.2	119.8	116.8	112.6	110.9
75°	99.6	98.5	95.4	91.9	93.1
77.5°	79.5	77.1	75.8	74.1	72.3
80°	59.3	58.7	57.5	55.7	54.5
82.5°	40.3	40.3	39.8	37.4	37.4
85°	24.2	23.7	23.1	21.3	20.8
87.5°	10.7	9.5	8.3	6.6	5.9
90°	1.3	16.3	44.4	41.7	43.0
92.5°	28.1	38.1	39.5	40.8	40.8
95°	66.1	78.8	81.1	81.1	78.8
97.5°	110.1	121.9	126.9	126.9	126.9
100°	160.9	171.3	174.9	174.9	173.6
102.5°	214.4	222.0	227.0	228.4	227.0
105°	272.8	276.5	279.2	281.5	281.5
107.5°	330.8	336.3	336.3	337.2	330.8
110°	387.1	394.3	394.3	394.3	390.6

TEST NUMBER: P913776

CATALOG NUMBER: DFN2DIP-PN2F0-020D060US927-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	447.7	455.4	454.1	450.4	447.7
115°	507.6	514.8	512.5	511.2	507.6
117.5°	567.0	576.9	570.5	567.0	563.3
120°	626.8	636.8	626.8	626.8	622.7
122.5°	681.1	693.8	687.5	683.9	681.1
125°	738.2	749.6	745.9	741.9	740.5
127.5°	794.0	808.0	803.0	797.6	794.0
130°	846.1	862.4	860.2	857.5	852.5
132.5°	904.6	917.3	918.1	911.8	908.2
135°	954.9	968.9	971.6	970.3	966.6
137.5°	1011.1	1022.4	1024.7	1023.7	1018.3
140°	1060.5	1071.8	1078.2	1078.2	1073.2
142.5°	1111.2	1122.5	1126.2	1127.5	1122.5
145°	1159.3	1168.3	1175.6	1176.9	1172.0
147.5°	1202.3	1213.6	1219.1	1221.3	1216.3
150°	1246.7	1254.4	1259.4	1263.4	1259.4
152.5°	1286.1	1293.9	1300.2	1305.2	1300.2
155°	1325.6	1329.2	1333.2	1339.7	1335.5
157.5°	1359.5	1362.3	1364.5	1373.6	1367.3
160°	1390.0	1392.7	1394.0	1401.7	1396.3
162.5°	1418.0	1418.0	1419.4	1428.0	1421.6
165°	1442.0	1440.7	1440.7	1449.8	1443.4
167.5°	1463.8	1459.8	1459.8	1468.8	1462.4
170°	1480.1	1476.5	1475.1	1484.2	1476.5
172.5°	1491.4	1487.8	1486.4	1495.5	1487.8
175°	1500.5	1496.9	1494.1	1503.2	1495.5
177.5°	1505.5	1501.9	1499.1	1506.8	1499.1
180°	1503.2	1503.2	1503.2	1503.2	1503.2

TEST NUMBER: P913776

CATALOG NUMBER: DFN2DIP-PN2F0-020D060US927-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	5.55	6.24	6.68	7.36	8.92	5.11	5.80	6.24	6.92	8.49
	3H	7.18	7.79	8.31	8.92	10.50	6.70	7.31	7.84	8.44	10.02
	4H	7.74	8.33	8.89	9.46	11.04	7.26	7.85	8.41	8.98	10.56
	6H	8.12	8.66	9.27	9.79	11.39	7.63	8.17	8.79	9.30	10.90
	8H	8.21	8.72	9.37	9.87	11.46	7.72	8.24	8.88	9.38	10.97
	12H	8.24	8.73	9.41	9.87	11.48	7.75	8.24	8.91	9.38	10.99
4H	2H	5.98	6.57	7.14	7.70	9.28	5.63	6.22	6.79	7.35	8.93
	3H	7.81	8.29	8.97	9.45	11.05	7.41	7.90	8.57	9.05	10.65
	4H	8.50	8.95	9.66	10.09	11.71	8.08	8.53	9.25	9.68	11.29
	6H	8.98	9.37	10.15	10.54	12.14	8.56	8.95	9.73	10.12	11.72
	8H	9.12	9.48	10.29	10.64	12.26	8.69	9.05	9.86	10.21	11.84
	12H	9.17	9.50	10.36	10.67	12.30	8.74	9.07	9.92	10.24	11.86
8H	4H	8.67	9.03	9.84	10.19	11.81	8.30	8.66	9.47	9.82	11.44
	6H	9.27	9.56	10.46	10.77	12.39	8.89	9.19	10.08	10.39	12.01
	8H	9.47	9.73	10.67	10.91	12.55	9.09	9.35	10.28	10.53	12.17
	12H	9.58	9.81	10.78	10.99	12.66	9.19	9.41	10.38	10.59	12.26
12H	4H	8.64	8.97	9.83	10.14	11.77	8.28	8.61	9.47	9.78	11.41
	6H	9.29	9.55	10.48	10.73	12.37	8.93	9.19	10.12	10.37	12.01
	8H	9.51	9.74	10.71	10.91	12.59	9.14	9.37	10.34	10.54	12.22

END OF REPORT