

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913786

Luminaire Tested: DFN2DIP-PN2F0-030D030US927-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913786
REPORT IS A COMBINATION OF REPORTS P899474 AND P896349
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-030D030US927-RLLFLL
Description: 2 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4123.3 lumens
Efficiency: N/A
Efficacy: 88.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 46.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913786

CATALOG NUMBER: DFN2DIP-PN2F0-030D030US927-RLLFLL

Luminous Intensity Polar Plot

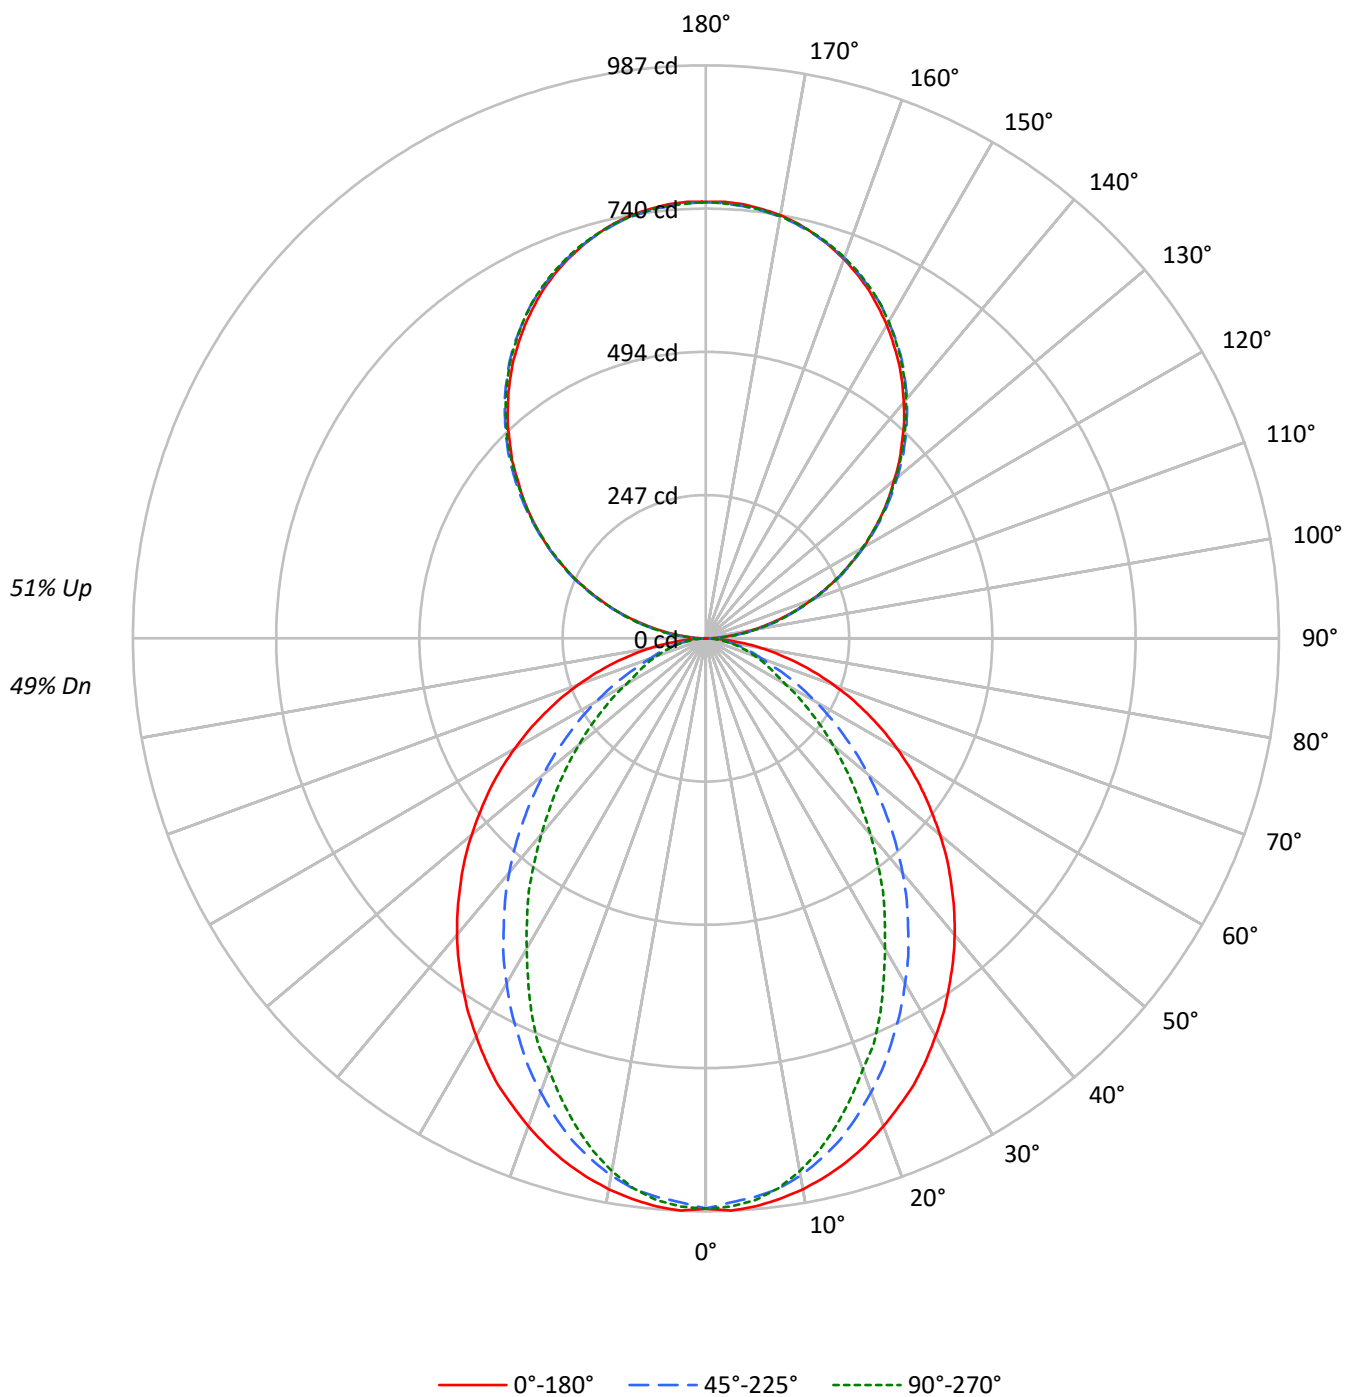

TEST NUMBER: P913786

CATALOG NUMBER: DFN2DIP-PN2F0-030D030US927-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2127	2127	2127
5°	2127	2089	2104
10°	2103	2044	2032
15°	2070	1972	1924
20°	2029	1874	1791
25°	1986	1766	1664
30°	1930	1655	1503
35°	1875	1537	1362
40°	1818	1415	1200
45°	1753	1280	1054
50°	1685	1145	911
55°	1614	1000	775
60°	1532	850	635
65°	1437	697	568
70°	1322	556	509
75°	1176	481	457
80°	968	391	387
85°	633	243	275

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1753 cd/sqm

TEST NUMBER: P913786

CATALOG NUMBER: DFN2DIP-PN2F0-030D030US927-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	92.1	2.2
10°-20°	252.7	6.1
20°-30°	354.8	8.6
30°-40°	386.8	9.4
40°-50°	355.5	8.6
50°-60°	279.2	6.8
60°-70°	181.7	4.4
70°-80°	93.5	2.3
80°-90°	26.0	0.6
90°-100°	46.5	1.1
100°-110°	147.8	3.6
110°-120°	252.9	6.1
120°-130°	332.6	8.1
130°-140°	373.3	9.1
140°-150°	366.1	8.9
150°-160°	307.1	7.4
160°-170°	203.7	4.9
170°-180°	71.2	1.7
0°-30°	699.6	17.0
0°-40°	1086.3	26.3
0°-60°	1720.9	41.7
0°-90°	2022.2	49.0
90°-120°	447.2	10.8
90°-150°	1519.2	36.8
90°-180°	2101.0	51.0
0°-180°	4123.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	982	982	982	982	982	
5°	982	978	966	974	972	93
15°	934	924	894	877	868	263
25°	848	820	761	724	711	390
35°	731	685	607	551	532	457
45°	597	538	444	381	360	461
55°	454	385	289	236	219	406
65°	307	235	155	124	122	304
75°	164	101	71	65	64	173
85°	38	20	17	17	17	44
90°	1	8	22	21	22	4
95°	33	40	41	41	40	37
105°	136	138	140	141	141	144
115°	254	257	256	256	254	251
125°	369	375	373	371	370	330
135°	477	484	486	485	483	369
145°	580	584	588	588	586	362
155°	663	665	667	670	668	305
165°	721	720	720	725	722	203
175°	750	748	747	752	748	71
180°	752	752	752	752	752	

TEST NUMBER: P913786

CATALOG NUMBER: DFN2DIP-PN2F0-030D030US927-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	982.2	982.2	982.2	982.2	982.2
2.5°	986.7	982.2	972.4	981.4	979.6
5°	982.2	977.8	966.2	974.2	971.5
7.5°	974.2	968.9	956.5	960.0	955.5
10°	963.5	957.4	939.6	936.8	931.6
12.5°	950.2	942.2	918.2	912.9	903.1
15°	934.2	924.4	894.2	877.3	868.5
17.5°	915.5	901.3	864.0	844.5	830.2
20°	894.2	876.4	831.9	809.8	790.2
22.5°	871.2	850.6	799.1	768.9	755.6
25°	848.0	819.5	760.9	724.4	711.1
27.5°	820.5	790.2	725.3	683.6	663.1
30°	791.2	757.3	686.2	641.0	616.9
32.5°	762.6	721.8	649.0	595.6	573.3
35°	730.7	685.3	607.1	551.1	531.6
37.5°	699.6	650.6	568.0	506.6	484.5
40°	666.7	613.4	527.1	464.0	440.9
42.5°	632.9	576.1	486.2	420.4	398.2
45°	597.4	537.7	444.5	381.3	360.0
47.5°	563.6	500.5	404.5	341.3	321.8
50°	526.2	463.1	365.4	304.0	285.3
52.5°	489.7	423.1	328.0	269.3	252.5
55°	454.2	384.8	288.8	235.6	218.7
57.5°	417.8	346.7	254.3	204.5	190.2
60°	380.4	309.3	217.8	172.5	158.3
62.5°	344.0	272.9	186.6	144.0	137.0
65°	306.7	234.6	154.6	124.5	121.8
67.5°	271.2	199.1	124.5	109.3	106.6
70°	233.8	164.5	103.1	94.2	90.6
72.5°	198.2	132.4	86.2	79.1	77.3
75°	163.5	101.3	71.1	64.9	64.0
77.5°	128.9	71.9	56.0	52.4	50.6
80°	96.9	51.6	42.6	39.1	39.1
82.5°	67.5	34.7	29.3	27.6	27.6
85°	38.2	19.5	16.9	16.9	16.9
87.5°	14.3	7.1	7.1	6.3	6.3
90°	0.7	8.2	22.2	20.8	21.5
92.5°	14.0	19.0	19.7	20.4	20.4
95°	33.1	39.5	40.6	40.6	39.5
97.5°	55.1	60.9	63.5	63.5	63.5
100°	80.4	85.6	87.5	87.5	86.8
102.5°	107.2	111.1	113.5	114.2	113.5
105°	136.4	138.2	139.6	140.7	140.7
107.5°	165.4	168.1	168.1	168.6	165.4
110°	193.5	197.2	197.2	197.2	195.4



TEST NUMBER: P913786

CATALOG NUMBER: DFN2DIP-PN2F0-030D030US927-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	223.9	227.8	227.0	225.2	223.9
115°	253.8	257.4	256.3	255.6	253.8
117.5°	283.4	288.4	285.3	283.4	281.6
120°	313.4	318.4	313.4	313.4	311.3
122.5°	340.6	346.9	343.7	341.9	340.6
125°	369.2	374.8	373.0	370.9	370.3
127.5°	397.0	404.0	401.6	398.8	397.0
130°	423.0	431.2	430.1	428.7	426.2
132.5°	452.3	458.6	459.1	455.9	454.1
135°	477.4	484.4	485.8	485.1	483.3
137.5°	505.5	511.2	512.3	511.9	509.1
140°	530.2	535.9	539.1	539.1	536.5
142.5°	555.6	561.3	563.1	563.8	561.3
145°	579.6	584.2	587.8	588.4	586.0
147.5°	601.2	606.8	609.5	610.7	608.2
150°	623.4	627.2	629.7	631.8	629.7
152.5°	643.1	646.9	650.1	652.6	650.1
155°	662.8	664.6	666.6	669.8	667.8
157.5°	679.8	681.1	682.3	686.8	683.7
160°	695.0	696.3	697.0	700.8	698.1
162.5°	709.0	709.0	709.7	714.0	710.8
165°	721.0	720.3	720.3	724.8	721.7
167.5°	731.9	729.8	729.8	734.4	731.2
170°	740.1	738.2	737.6	742.1	738.2
172.5°	745.7	743.9	743.2	747.7	743.9
175°	750.3	748.5	747.1	751.6	747.7
177.5°	752.7	750.9	749.6	753.4	749.6
180°	751.6	751.6	751.6	751.6	751.6

TEST NUMBER: P913786

CATALOG NUMBER: DFN2DIP-PN2F0-030D030US927-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.56	10.38	10.53	11.37	12.65	5.53	6.35	6.50	7.33	8.62
	3H	11.22	11.95	12.20	12.94	14.25	6.70	7.44	7.68	8.43	9.74
	4H	11.81	12.51	12.81	13.50	14.82	7.14	7.83	8.13	8.83	10.15
	6H	12.22	12.86	13.22	13.86	15.19	7.44	8.08	8.45	9.08	10.41
	8H	12.33	12.94	13.35	13.96	15.29	7.53	8.13	8.54	9.15	10.48
	12H	12.39	12.97	13.41	13.98	15.33	7.56	8.14	8.58	9.15	10.50
4H	2H	9.57	10.27	10.58	11.26	12.58	6.11	6.81	7.12	7.80	9.12
	3H	11.38	11.96	12.39	12.98	14.31	7.44	8.02	8.45	9.04	10.37
	4H	12.06	12.58	13.07	13.60	14.95	7.97	8.50	8.99	9.52	10.87
	6H	12.55	13.00	13.58	14.04	15.39	8.37	8.83	9.40	9.87	11.22
	8H	12.71	13.14	13.74	14.17	15.54	8.49	8.92	9.52	9.95	11.32
	12H	12.80	13.18	13.85	14.23	15.60	8.55	8.93	9.60	9.98	11.35
8H	4H	12.02	12.44	13.05	13.47	14.84	8.24	8.67	9.27	9.70	11.06
	6H	12.56	12.91	13.62	13.99	15.35	8.74	9.09	9.79	10.16	11.52
	8H	12.76	13.07	13.83	14.13	15.51	8.91	9.22	9.98	10.28	11.66
	12H	12.89	13.16	13.95	14.21	15.64	9.02	9.29	10.09	10.34	11.77
12H	4H	11.97	12.35	13.02	13.40	14.77	8.24	8.63	9.29	9.67	11.04
	6H	12.54	12.84	13.60	13.90	15.28	8.78	9.09	9.84	10.15	11.53
	8H	12.74	13.01	13.81	14.06	15.49	8.98	9.25	10.04	10.30	11.73

END OF REPORT