

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913793

Luminaire Tested: DFN2DIP-PN2F0-030D050US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913793
REPORT IS A COMBINATION OF REPORTS P901013 AND P897905
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-030D050US927-FLLONL
Description: 2 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6274.1 lumens
Efficiency: N/A
Efficacy: 90.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 69
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913793

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US927-FLLONL

Luminous Intensity Polar Plot

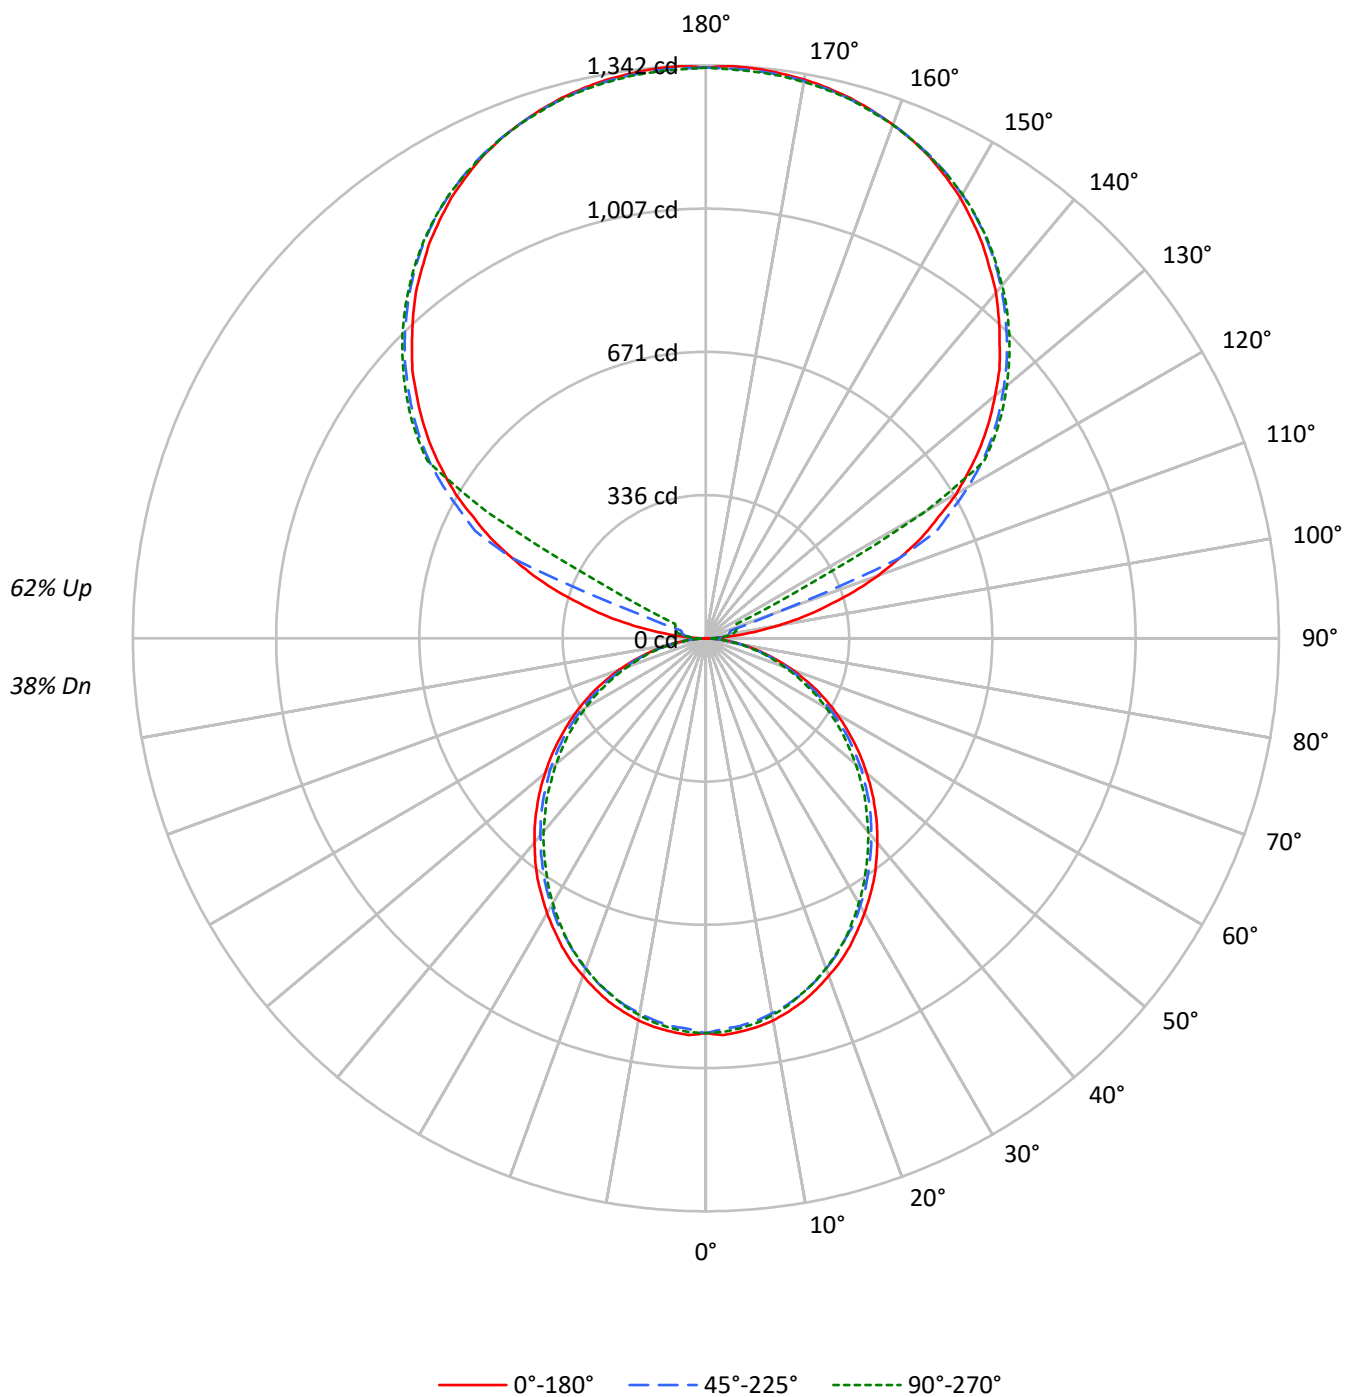

TEST NUMBER: P913793

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	60	60	60	45	45	45
1	95	91	87	83	86	82	79	76	67	65	63	53	51	50	39	39	38
2	86	79	73	68	78	72	67	63	59	55	52	46	44	42	35	33	32
3	79	70	62	57	71	63	57	52	52	47	44	41	38	35	31	29	27
4	72	62	54	48	65	56	49	44	46	41	37	36	33	30	27	25	23
5	66	55	47	41	60	50	43	38	41	36	32	33	29	26	25	22	20
6	61	49	41	35	55	45	38	33	37	32	28	29	26	23	22	20	18
7	56	44	36	31	51	40	34	29	33	28	24	27	23	20	20	18	16
8	52	40	32	27	47	37	30	25	30	25	22	24	21	18	19	16	14
9	48	36	29	24	44	33	27	23	28	23	19	22	19	16	17	15	13
10	45	33	26	22	41	31	24	20	26	21	17	21	17	14	16	13	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2003	2003	2003
5°	2003	1971	1985
10°	1983	1940	1956
15°	1951	1904	1910
20°	1908	1855	1865
25°	1866	1798	1812
30°	1813	1744	1746
35°	1763	1681	1676
40°	1702	1618	1610
45°	1642	1554	1541
50°	1575	1487	1463
55°	1504	1410	1390
60°	1425	1319	1306
65°	1338	1223	1207
70°	1227	1108	1100
75°	1074	968	998
80°	889	791	809
85°	603	500	507

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1642 cd/sqm

TEST NUMBER: P913793

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	87.0	1.4
10°-20°	244.9	3.9
20°-30°	359.9	5.7
30°-40°	418.0	6.7
40°-50°	417.5	6.7
50°-60°	364.0	5.8
60°-70°	269.1	4.3
70°-80°	152.3	2.4
80°-90°	42.5	0.7
90°-100°	44.1	0.7
100°-110°	164.3	2.6
110°-120°	435.8	6.9
120°-130°	722.8	11.5
130°-140°	767.8	12.2
140°-150°	713.6	11.4
150°-160°	573.7	9.1
160°-170°	369.7	5.9
170°-180°	127.2	2.0
0°-30°	691.8	11.0
0°-40°	1109.8	17.7
0°-60°	1891.3	30.1
0°-90°	2355.1	37.5
90°-120°	644.2	10.3
90°-150°	2848.4	45.4
90°-180°	3919.0	62.5
0°-180°	6274.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	925	925	925	925	925	
5°	925	921	911	918	917	88
15°	880	875	863	867	862	248
25°	797	790	774	776	774	367
35°	687	678	664	659	654	429
45°	559	553	540	530	526	432
55°	423	418	407	397	392	378
65°	286	280	271	263	259	282
75°	149	148	143	138	140	159
85°	36	36	35	32	31	41
90°	1	12	19	24	26	6
95°	63	31	38	43	42	74
105°	294	323	59	70	74	314
115°	556	573	597	149	79	548
125°	786	799	817	824	827	701
135°	973	989	997	1007	1005	752
145°	1129	1128	1144	1151	1146	706
155°	1243	1234	1246	1252	1244	573
165°	1310	1304	1307	1314	1307	370
175°	1340	1333	1335	1342	1332	127
180°	1337	1337	1337	1337	1337	

TEST NUMBER: P913793

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	924.7	924.7	924.7	924.7	924.7
2.5°	930.1	925.7	915.8	924.7	923.0
5°	924.7	921.2	911.4	918.5	916.8
7.5°	918.5	913.2	903.4	910.6	908.8
10°	908.8	902.5	891.9	899.0	896.4
12.5°	895.4	890.1	879.5	883.8	882.1
15°	880.3	875.0	863.4	867.0	862.5
17.5°	861.6	856.3	844.7	849.1	844.7
20°	841.1	835.8	823.4	826.0	822.5
22.5°	820.8	812.8	801.1	801.1	799.3
25°	796.7	789.6	774.5	776.3	774.5
27.5°	770.0	763.7	752.3	749.6	745.2
30°	743.4	736.3	722.9	720.3	716.7
32.5°	714.9	709.6	695.4	690.0	686.4
35°	687.4	678.5	664.2	658.9	654.4
37.5°	656.2	648.2	634.0	627.7	623.3
40°	624.2	617.1	602.8	594.9	591.4
42.5°	593.1	586.0	571.8	562.8	557.5
45°	559.4	553.1	539.7	530.0	526.4
47.5°	526.4	520.2	506.0	496.1	490.8
50°	491.7	487.3	474.8	462.4	458.0
52.5°	458.0	451.7	440.2	430.4	424.1
55°	423.3	418.0	407.3	396.6	392.2
57.5°	388.6	384.1	372.6	361.9	358.3
60°	353.9	350.4	337.9	328.1	325.5
62.5°	320.1	313.9	305.0	296.1	292.6
65°	285.5	280.1	271.2	263.2	258.8
67.5°	249.9	245.4	237.4	231.2	227.7
70°	217.0	213.4	205.4	199.2	195.7
72.5°	183.2	179.6	175.2	169.0	166.4
75°	149.3	147.7	143.1	137.8	139.7
77.5°	119.1	115.6	113.8	111.1	108.5
80°	89.0	88.0	86.2	83.6	81.8
82.5°	60.4	60.4	59.7	56.0	56.0
85°	36.4	35.6	34.7	32.0	31.1
87.5°	16.0	14.3	12.4	9.8	8.9
90°	1.0	11.6	19.3	24.2	26.1
92.5°	24.2	20.4	23.2	25.2	26.1
95°	62.8	30.9	37.7	42.6	41.6
97.5°	113.1	33.9	49.3	52.3	53.2
100°	171.3	38.7	55.1	62.8	64.8
102.5°	235.0	233.1	57.1	67.7	70.7
105°	294.1	323.1	59.0	69.6	73.5
107.5°	362.7	386.8	61.0	71.5	75.5
110°	428.6	448.8	169.3	72.6	76.4

TEST NUMBER: P913793

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	490.4	507.8	491.4	74.5	77.4
115°	556.2	572.6	596.8	149.0	79.4
117.5°	613.2	632.6	649.1	510.6	257.3
120°	677.1	691.6	709.0	720.6	590.0
122.5°	731.2	746.7	766.1	771.9	772.9
125°	786.3	799.0	817.4	824.1	827.0
127.5°	836.6	850.2	864.8	874.4	875.4
130°	884.1	899.6	910.1	920.8	920.0
132.5°	932.5	945.1	955.6	964.4	963.5
135°	973.1	988.6	997.2	1007.0	1005.0
137.5°	1015.6	1027.2	1037.0	1046.6	1043.8
140°	1057.2	1065.0	1075.5	1084.3	1079.5
142.5°	1092.1	1098.9	1111.4	1119.1	1114.3
145°	1128.9	1127.8	1144.2	1151.0	1146.2
147.5°	1160.7	1157.8	1174.3	1179.1	1175.3
150°	1191.7	1184.9	1200.4	1206.2	1201.3
152.5°	1217.7	1210.1	1224.6	1230.4	1223.6
155°	1242.9	1234.3	1245.9	1251.6	1244.0
157.5°	1263.2	1255.5	1264.2	1271.1	1263.2
160°	1280.7	1274.9	1280.7	1286.4	1279.7
162.5°	1296.1	1290.4	1295.1	1301.9	1293.2
165°	1309.6	1303.9	1306.8	1313.5	1306.8
167.5°	1320.3	1314.5	1317.5	1324.2	1315.5
170°	1329.0	1323.2	1325.2	1331.9	1323.2
172.5°	1334.8	1329.0	1331.0	1337.8	1329.0
175°	1339.7	1332.8	1334.8	1341.6	1331.9
177.5°	1341.6	1334.8	1335.9	1342.6	1333.9
180°	1336.7	1336.7	1336.7	1336.7	1336.7

TEST NUMBER: P913793

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.29	9.05	9.35	10.11	11.55	7.86	8.62	8.91	9.68	11.11
	3H	9.93	10.61	10.99	11.68	13.13	9.45	10.13	10.51	11.20	12.65
	4H	10.49	11.14	11.57	12.21	13.67	10.01	10.66	11.09	11.73	13.19
	6H	10.87	11.47	11.96	12.54	14.02	10.39	10.98	11.48	12.06	13.53
	8H	10.97	11.53	12.06	12.62	14.09	10.48	11.05	11.57	12.14	13.61
	12H	11.00	11.54	12.10	12.63	14.12	10.51	11.05	11.61	12.13	13.63
4H	2H	8.73	9.38	9.82	10.45	11.91	8.38	9.03	9.47	10.10	11.56
	3H	10.56	11.10	11.66	12.20	13.68	10.17	10.70	11.26	11.80	13.28
	4H	11.26	11.75	12.36	12.84	14.34	10.84	11.34	11.94	12.43	13.93
	6H	11.75	12.17	12.85	13.28	14.77	11.33	11.75	12.43	12.87	14.36
	8H	11.89	12.28	12.99	13.39	14.89	11.46	11.86	12.57	12.96	14.47
	12H	11.94	12.30	13.07	13.42	14.93	11.51	11.87	12.63	12.99	14.50
8H	4H	11.44	11.83	12.54	12.94	14.44	11.07	11.46	12.17	12.57	14.07
	6H	12.04	12.37	13.16	13.51	15.01	11.67	11.99	12.79	13.14	14.64
	8H	12.24	12.53	13.38	13.66	15.18	11.86	12.15	13.00	13.28	14.80
	12H	12.36	12.61	13.49	13.73	15.29	11.96	12.21	13.10	13.34	14.90
12H	4H	11.41	11.77	12.54	12.89	14.40	11.05	11.41	12.18	12.53	14.04
	6H	12.06	12.35	13.20	13.48	15.00	11.70	11.99	12.83	13.11	14.64
	8H	12.28	12.54	13.42	13.66	15.22	11.91	12.17	13.05	13.29	14.85

END OF REPORT