

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913858

Luminaire Tested: DFN2DIP-PN2F0-060D060US927-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913858
REPORT IS A COMBINATION OF REPORTS P899510 AND P896349
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-060D060US927-RLLFLL
Description: 2 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8246.6 lumens
Efficiency: N/A
Efficacy: 70.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 117.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913858

CATALOG NUMBER: DFN2DIP-PN2F0-060D060US927-RLLFLL

Luminous Intensity Polar Plot

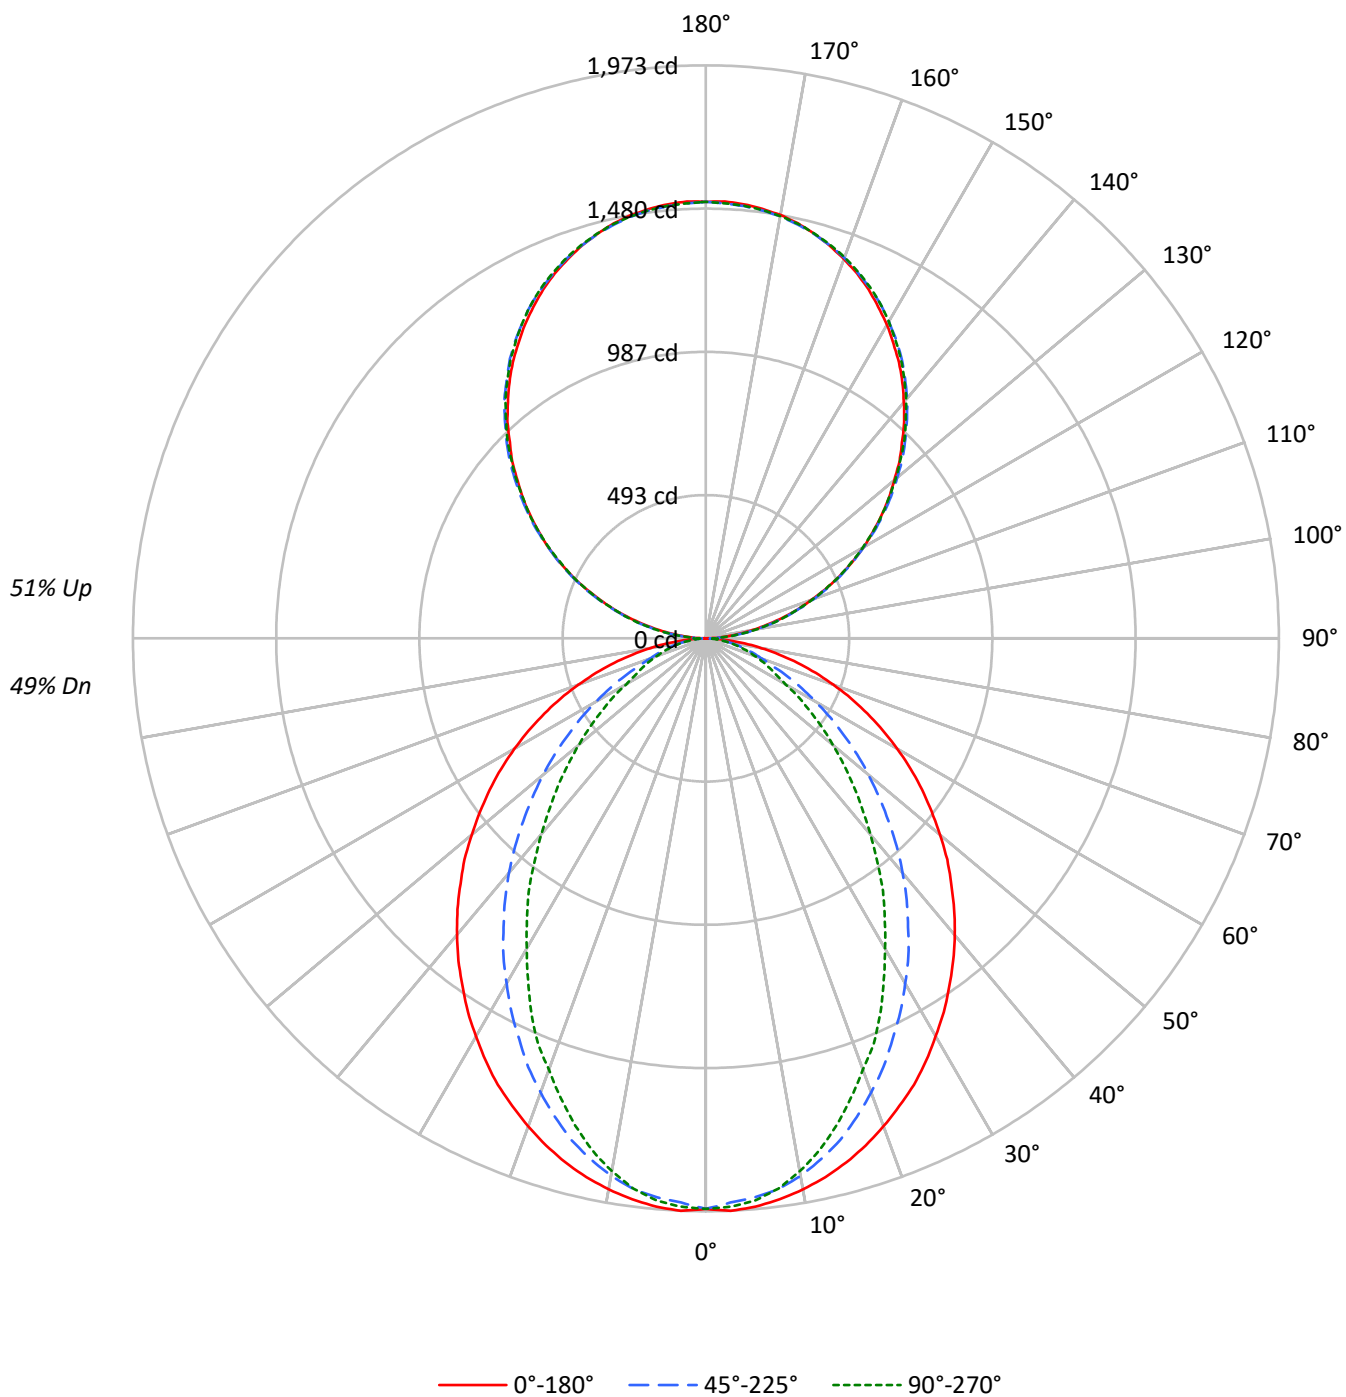

TEST NUMBER: P913858

CATALOG NUMBER: DFN2DIP-PN2F0-060D060US927-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4255	4255	4255
5°	4255	4178	4208
10°	4206	4087	4065
15°	4141	3943	3847
20°	4057	3749	3583
25°	3972	3532	3327
30°	3860	3311	3006
35°	3749	3074	2723
40°	3636	2830	2401
45°	3506	2561	2108
50°	3371	2289	1823
55°	3228	2000	1550
60°	3064	1700	1270
65°	2874	1395	1136
70°	2643	1111	1019
75°	2353	962	915
80°	1936	781	775
85°	1266	485	549

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3506 cd/sqm

TEST NUMBER: P913858

CATALOG NUMBER: DFN2DIP-PN2F0-060D060US927-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.1	2.2
10°-20°	505.4	6.1
20°-30°	709.6	8.6
30°-40°	773.5	9.4
40°-50°	710.9	8.6
50°-60°	558.3	6.8
60°-70°	363.4	4.4
70°-80°	187.1	2.3
80°-90°	52.0	0.6
90°-100°	93.0	1.1
100°-110°	295.6	3.6
110°-120°	505.8	6.1
120°-130°	665.2	8.1
130°-140°	746.6	9.1
140°-150°	732.2	8.9
150°-160°	614.2	7.4
160°-170°	407.3	4.9
170°-180°	142.4	1.7
0°-30°	1399.1	17.0
0°-40°	2172.6	26.3
0°-60°	3441.9	41.7
0°-90°	4044.4	49.0
90°-120°	894.4	10.8
90°-150°	3038.4	36.8
90°-180°	4202.0	51.0
0°-180°	8246.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1964	1964	1964	1964	1964	
5°	1964	1956	1932	1948	1943	186
15°	1868	1849	1788	1755	1737	527
25°	1696	1639	1522	1449	1422	780
35°	1461	1371	1214	1102	1063	915
45°	1195	1076	889	763	720	923
55°	908	770	578	471	437	812
65°	613	469	309	249	244	608
75°	327	203	142	130	128	346
85°	76	39	34	34	34	88
90°	1	16	44	42	43	8
95°	66	79	81	81	79	74
105°	273	276	279	282	282	288
115°	508	515	512	511	508	502
125°	738	750	746	742	740	660
135°	955	969	972	970	967	738
145°	1159	1168	1176	1177	1172	724
155°	1326	1329	1333	1340	1336	610
165°	1442	1441	1441	1450	1443	407
175°	1500	1497	1494	1503	1496	143
180°	1503	1503	1503	1503	1503	

TEST NUMBER: P913858

CATALOG NUMBER: DFN2DIP-PN2F0-060D060US927-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1964.5	1964.5	1964.5	1964.5	1964.5
2.5°	1973.3	1964.5	1944.8	1962.7	1959.1
5°	1964.5	1955.6	1932.4	1948.4	1943.1
7.5°	1948.4	1937.8	1913.0	1919.9	1911.1
10°	1927.1	1914.6	1879.2	1873.7	1863.1
12.5°	1900.5	1884.4	1836.4	1825.8	1806.2
15°	1868.4	1848.8	1788.4	1754.7	1736.9
17.5°	1831.1	1802.6	1727.9	1688.9	1660.4
20°	1788.4	1752.8	1664.0	1619.6	1580.4
22.5°	1742.2	1701.3	1598.1	1537.8	1511.2
25°	1696.1	1639.1	1521.8	1449.0	1422.2
27.5°	1641.0	1580.4	1450.6	1367.1	1326.2
30°	1582.3	1514.6	1372.4	1281.8	1233.7
32.5°	1525.3	1443.5	1297.9	1191.1	1146.6
35°	1461.4	1370.7	1214.3	1102.2	1063.0
37.5°	1399.2	1301.2	1136.1	1013.3	968.9
40°	1333.3	1226.8	1054.2	928.0	881.8
42.5°	1265.8	1152.1	972.5	840.8	796.5
45°	1194.7	1075.5	889.0	762.6	719.9
47.5°	1127.2	1001.0	809.0	682.6	643.6
50°	1052.5	926.3	730.7	607.9	570.8
52.5°	979.5	846.1	656.0	538.7	504.9
55°	908.4	769.8	577.7	471.2	437.4
57.5°	835.6	693.3	508.5	408.9	380.4
60°	760.9	618.7	435.5	345.0	316.5
62.5°	688.1	545.9	373.3	288.0	273.9
65°	613.4	469.3	309.3	249.0	243.5
67.5°	542.2	398.2	249.0	218.6	213.3
70°	467.5	328.9	206.1	188.5	181.3
72.5°	396.5	264.8	172.4	158.3	154.6
75°	327.1	202.6	142.2	129.8	128.1
77.5°	257.9	143.9	112.0	104.9	101.3
80°	193.7	103.1	85.2	78.3	78.3
82.5°	135.1	69.4	58.6	55.1	55.1
85°	76.4	39.1	33.7	33.7	33.7
87.5°	28.5	14.2	14.2	12.4	12.4
90°	1.3	16.3	44.4	41.7	43.0
92.5°	28.1	38.1	39.5	40.8	40.8
95°	66.1	78.8	81.1	81.1	78.8
97.5°	110.1	121.9	126.9	126.9	126.9
100°	160.9	171.3	174.9	174.9	173.6
102.5°	214.4	222.0	227.0	228.4	227.0
105°	272.8	276.5	279.2	281.5	281.5
107.5°	330.8	336.3	336.3	337.2	330.8
110°	387.1	394.3	394.3	394.3	390.6

TEST NUMBER: P913858

CATALOG NUMBER: DFN2DIP-PN2F0-060D060US927-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	447.7	455.4	454.1	450.4	447.7
115°	507.6	514.8	512.5	511.2	507.6
117.5°	567.0	576.9	570.5	567.0	563.3
120°	626.8	636.8	626.8	626.8	622.7
122.5°	681.1	693.8	687.5	683.9	681.1
125°	738.2	749.6	745.9	741.9	740.5
127.5°	794.0	808.0	803.0	797.6	794.0
130°	846.1	862.4	860.2	857.5	852.5
132.5°	904.6	917.3	918.1	911.8	908.2
135°	954.9	968.9	971.6	970.3	966.6
137.5°	1011.1	1022.4	1024.7	1023.7	1018.3
140°	1060.5	1071.8	1078.2	1078.2	1073.2
142.5°	1111.2	1122.5	1126.2	1127.5	1122.5
145°	1159.3	1168.3	1175.6	1176.9	1172.0
147.5°	1202.3	1213.6	1219.1	1221.3	1216.3
150°	1246.7	1254.4	1259.4	1263.4	1259.4
152.5°	1286.1	1293.9	1300.2	1305.2	1300.2
155°	1325.6	1329.2	1333.2	1339.7	1335.5
157.5°	1359.5	1362.3	1364.5	1373.6	1367.3
160°	1390.0	1392.7	1394.0	1401.7	1396.3
162.5°	1418.0	1418.0	1419.4	1428.0	1421.6
165°	1442.0	1440.7	1440.7	1449.8	1443.4
167.5°	1463.8	1459.8	1459.8	1468.8	1462.4
170°	1480.1	1476.5	1475.1	1484.2	1476.5
172.5°	1491.4	1487.8	1486.4	1495.5	1487.8
175°	1500.5	1496.9	1494.1	1503.2	1495.5
177.5°	1505.5	1501.9	1499.1	1506.8	1499.1
180°	1503.2	1503.2	1503.2	1503.2	1503.2

TEST NUMBER: P913858

CATALOG NUMBER: DFN2DIP-PN2F0-060D060US927-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.97	12.79	12.94	13.77	15.06	7.94	8.76	8.91	9.74	11.03
	3H	13.63	14.36	14.61	15.35	16.66	9.11	9.84	10.09	10.83	12.14
	4H	14.22	14.92	15.22	15.91	17.23	9.55	10.24	10.54	11.24	12.55
	6H	14.63	15.26	15.63	16.26	17.59	9.85	10.49	10.86	11.49	12.82
	8H	14.74	15.35	15.76	16.37	17.69	9.93	10.54	10.95	11.56	12.89
	12H	14.80	15.37	15.81	16.38	17.73	9.97	10.55	10.99	11.56	12.91
4H	2H	11.98	12.68	12.98	13.67	14.99	8.52	9.22	9.52	10.21	11.53
	3H	13.79	14.37	14.80	15.39	16.72	9.85	10.43	10.86	11.45	12.78
	4H	14.46	14.99	15.48	16.01	17.36	10.38	10.91	11.40	11.93	13.28
	6H	14.96	15.41	15.99	16.45	17.80	10.78	11.24	11.81	12.28	13.63
	8H	15.12	15.55	16.15	16.58	17.94	10.90	11.33	11.93	12.36	13.72
	12H	15.21	15.59	16.25	16.63	18.01	10.96	11.34	12.01	12.39	13.76
8H	4H	14.43	14.85	15.46	15.88	17.25	10.65	11.07	11.68	12.11	13.47
	6H	14.97	15.32	16.02	16.39	17.76	11.15	11.50	12.20	12.57	13.93
	8H	15.17	15.48	16.23	16.54	17.92	11.32	11.63	12.39	12.69	14.07
	12H	15.30	15.57	16.36	16.62	18.05	11.43	11.70	12.49	12.75	14.18
12H	4H	14.38	14.76	15.43	15.81	17.18	10.65	11.03	11.70	12.08	13.45
	6H	14.94	15.25	16.01	16.31	17.69	11.19	11.50	12.25	12.56	13.94
	8H	15.15	15.42	16.21	16.47	17.90	11.38	11.66	12.45	12.71	14.13