

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P916497

Luminaire Tested: DFN2DIP-PN2F0-020D040US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P916497
REPORT IS A COMBINATION OF REPORTS P901001 AND P897905
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-020D040US930-FLLONL
Description: 2 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4842.9 lumens
Efficiency: N/A
Efficacy: 102.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 47.3
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P916497

CATALOG NUMBER: DFN2DIP-PN2F0-020D040US930-FLLONL

Luminous Intensity Polar Plot

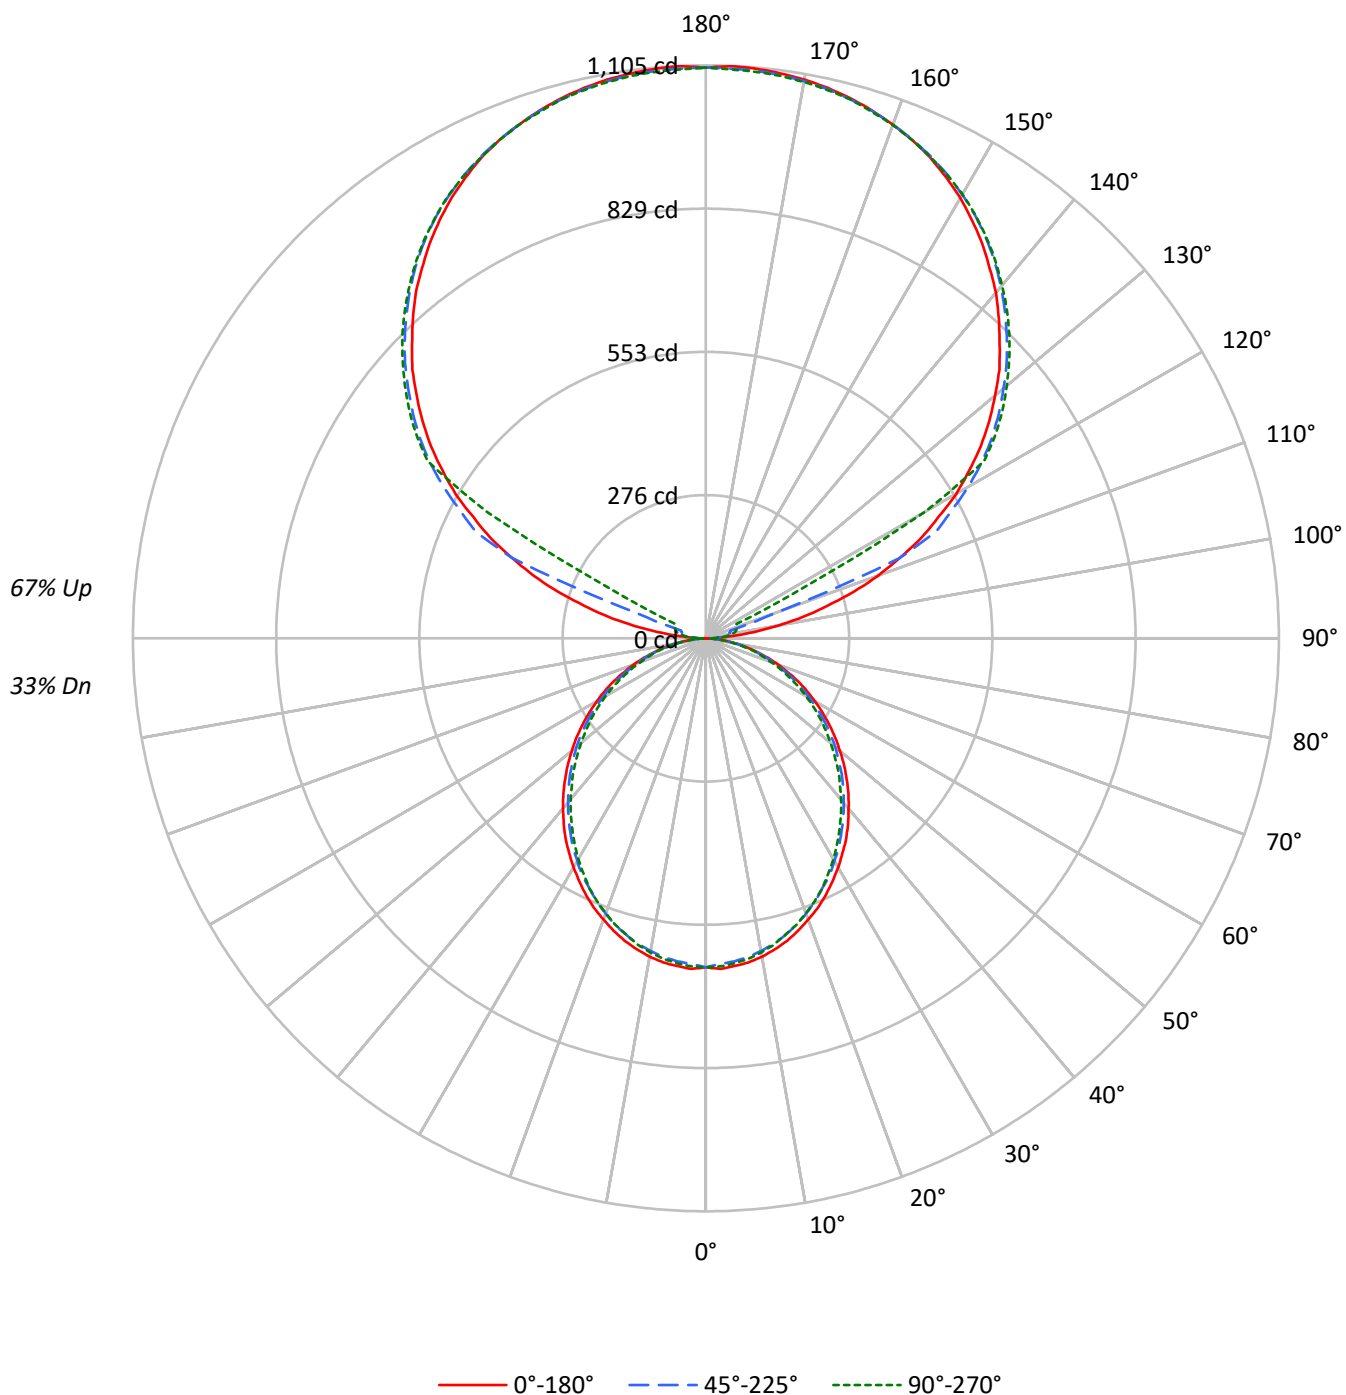

TEST NUMBER: P916497

CATALOG NUMBER: DFN2DIP-PN2F0-020D040US930-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	57	57	57	41	41	41
1	94	90	86	83	85	81	78	75	65	63	61	50	48	47	36	35	34
2	86	78	72	67	77	71	66	62	57	53	50	44	41	39	32	30	29
3	78	69	62	56	70	62	56	51	50	46	42	39	36	33	28	26	25
4	71	61	53	47	64	55	49	43	44	40	36	34	31	28	25	23	21
5	65	54	46	40	59	49	42	37	40	35	31	31	27	25	23	20	18
6	60	48	41	35	54	44	37	32	36	31	27	28	24	21	20	18	16
7	56	44	36	30	50	40	33	28	32	27	23	25	22	19	19	16	14
8	51	39	32	27	46	36	29	25	29	24	21	23	19	17	17	15	13
9	48	36	29	24	43	33	26	22	27	22	19	21	18	15	16	13	12
10	45	33	26	21	40	30	24	20	25	20	17	19	16	14	15	12	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1374	1374	1374
5°	1374	1352	1362
10°	1361	1331	1342
15°	1339	1306	1311
20°	1309	1273	1279
25°	1280	1233	1243
30°	1244	1197	1198
35°	1210	1154	1150
40°	1168	1110	1104
45°	1126	1067	1058
50°	1081	1021	1004
55°	1032	967	953
60°	978	905	896
65°	917	839	828
70°	842	760	755
75°	737	664	684
80°	611	543	555
85°	413	343	349

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1126 cd/sqm

TEST NUMBER: P916497

CATALOG NUMBER: DFN2DIP-PN2F0-020D040US930-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	59.7	1.2
10°-20°	168.0	3.5
20°-30°	246.9	5.1
30°-40°	286.8	5.9
40°-50°	286.4	5.9
50°-60°	249.7	5.2
60°-70°	184.6	3.8
70°-80°	104.5	2.2
80°-90°	29.5	0.6
90°-100°	36.3	0.7
100°-110°	135.3	2.8
110°-120°	358.8	7.4
120°-130°	595.1	12.3
130°-140°	632.1	13.1
140°-150°	587.5	12.1
150°-160°	472.3	9.8
160°-170°	304.4	6.3
170°-180°	104.8	2.2
0°-30°	474.7	9.8
0°-40°	761.5	15.7
0°-60°	1297.6	26.8
0°-90°	1616.2	33.4
90°-120°	530.4	11.0
90°-150°	2345.2	48.4
90°-180°	3227.0	66.6
0°-180°	4842.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	634	634	634	634	634	
5°	634	632	625	630	629	60
15°	604	600	592	595	592	170
25°	547	542	531	533	531	252
35°	472	466	456	452	449	295
45°	384	380	370	364	361	296
55°	290	287	279	272	269	260
65°	196	192	186	181	178	194
75°	102	101	98	95	96	109
85°	25	24	24	22	21	28
90°	1	10	16	20	21	4
95°	52	25	31	35	34	61
105°	242	266	49	57	60	259
115°	458	471	491	123	65	451
125°	647	658	673	679	681	577
135°	801	814	821	829	828	619
145°	929	929	942	948	944	581
155°	1023	1016	1026	1030	1024	472
165°	1078	1074	1076	1082	1076	305
175°	1103	1097	1099	1105	1097	105
180°	1101	1101	1101	1101	1101	

TEST NUMBER: P916497

CATALOG NUMBER: DFN2DIP-PN2F0-020D040US930-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	634.5	634.5	634.5	634.5	634.5
2.5°	638.1	635.1	628.4	634.5	633.3
5°	634.5	632.1	625.3	630.2	629.0
7.5°	630.2	626.6	619.9	624.8	623.5
10°	623.5	619.3	612.0	616.8	615.0
12.5°	614.3	610.7	603.4	606.4	605.2
15°	604.0	600.4	592.4	594.8	591.8
17.5°	591.2	587.6	579.6	582.6	579.6
20°	577.1	573.5	564.9	566.8	564.3
22.5°	563.1	557.7	549.7	549.7	548.5
25°	546.7	541.8	531.4	532.6	531.4
27.5°	528.3	524.1	516.2	514.4	511.3
30°	510.1	505.2	496.0	494.2	491.7
32.5°	490.5	486.9	477.1	473.4	471.0
35°	471.7	465.5	455.8	452.1	449.0
37.5°	450.3	444.7	435.0	430.7	427.6
40°	428.3	423.4	413.6	408.2	405.7
42.5°	406.9	402.0	392.3	386.2	382.5
45°	383.8	379.5	370.3	363.6	361.2
47.5°	361.2	356.9	347.2	340.4	336.8
50°	337.4	334.4	325.8	317.2	314.2
52.5°	314.2	309.9	302.0	295.3	291.1
55°	290.4	286.7	279.4	272.1	269.0
57.5°	266.6	263.6	255.6	248.3	245.8
60°	242.8	240.4	231.9	225.1	223.3
62.5°	219.6	215.3	209.3	203.2	200.7
65°	195.8	192.2	186.1	180.6	177.6
67.5°	171.5	168.4	162.9	158.7	156.2
70°	148.9	146.4	140.9	136.6	134.3
72.5°	125.7	123.3	120.2	115.9	114.1
75°	102.5	101.3	98.2	94.6	95.8
77.5°	81.8	79.3	78.0	76.2	74.4
80°	61.1	60.4	59.2	57.3	56.1
82.5°	41.5	41.5	40.9	38.5	38.5
85°	24.9	24.4	23.8	21.9	21.4
87.5°	11.0	9.8	8.6	6.8	6.1
90°	0.7	9.5	15.9	20.0	21.4
92.5°	20.0	16.7	19.1	20.7	21.4
95°	51.7	25.4	31.0	35.1	34.2
97.5°	93.2	27.9	40.6	43.0	43.8
100°	141.0	31.9	45.4	51.7	53.3
102.5°	193.5	192.0	47.0	55.7	58.1
105°	242.1	266.0	48.6	57.3	60.5
107.5°	298.6	318.5	50.2	58.9	62.1
110°	352.9	369.5	139.4	59.8	62.9

TEST NUMBER: P916497

CATALOG NUMBER: DFN2DIP-PN2F0-020D040US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	403.8	418.1	404.6	61.3	63.8
115°	457.9	471.4	491.4	122.6	65.4
117.5°	504.9	520.8	534.4	420.4	211.8
120°	557.5	569.4	583.8	593.4	485.8
122.5°	602.0	614.8	630.8	635.5	636.3
125°	647.4	657.9	672.9	678.6	680.9
127.5°	688.8	700.0	712.0	720.0	720.7
130°	727.9	740.7	749.3	758.1	757.4
132.5°	767.7	778.1	786.8	794.0	793.3
135°	801.2	814.0	821.1	829.1	827.5
137.5°	836.2	845.7	853.8	861.7	859.3
140°	870.4	876.9	885.6	892.8	888.8
142.5°	899.2	904.7	915.1	921.4	917.5
145°	929.4	928.6	942.1	947.7	943.7
147.5°	955.6	953.2	966.8	970.8	967.7
150°	981.1	975.6	988.4	993.1	989.1
152.5°	1002.7	996.3	1008.2	1013.0	1007.5
155°	1023.4	1016.3	1025.8	1030.5	1024.2
157.5°	1040.1	1033.7	1041.0	1046.5	1040.1
160°	1054.4	1049.6	1054.4	1059.2	1053.6
162.5°	1067.1	1062.4	1066.4	1072.0	1064.8
165°	1078.3	1073.6	1075.9	1081.5	1075.9
167.5°	1087.1	1082.2	1084.8	1090.3	1083.1
170°	1094.3	1089.5	1091.0	1096.7	1089.5
172.5°	1099.0	1094.3	1095.9	1101.5	1094.3
175°	1102.9	1097.4	1099.0	1104.6	1096.7
177.5°	1104.6	1099.0	1099.8	1105.5	1098.3
180°	1100.7	1100.7	1100.7	1100.7	1100.7

TEST NUMBER: P916497

CATALOG NUMBER: DFN2DIP-PN2F0-020D040US930-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.49	7.22	7.58	8.30	9.79	6.05	6.78	7.14	7.87	9.36
	3H	8.12	8.77	9.21	9.87	11.37	7.64	8.29	8.73	9.39	10.89
	4H	8.69	9.31	9.79	10.40	11.92	8.20	8.82	9.31	9.92	11.43
	6H	9.06	9.63	10.18	10.73	12.26	8.58	9.15	9.69	10.25	11.77
	8H	9.16	9.70	10.28	10.81	12.33	8.67	9.21	9.79	10.33	11.85
	12H	9.19	9.71	10.32	10.82	12.36	8.70	9.21	9.82	10.32	11.87
4H	2H	6.92	7.54	8.04	8.64	10.15	6.57	7.19	7.69	8.29	9.80
	3H	8.75	9.27	9.87	10.39	11.92	8.35	8.87	9.47	9.99	11.52
	4H	9.44	9.92	10.57	11.03	12.58	9.03	9.51	10.16	10.62	12.17
	6H	9.93	10.34	11.07	11.48	13.02	9.51	9.92	10.64	11.06	12.59
	8H	10.07	10.45	11.20	11.58	13.13	9.65	10.03	10.78	11.15	12.71
	12H	10.13	10.47	11.28	11.61	13.17	9.69	10.04	10.84	11.18	12.74
8H	4H	9.62	10.00	10.75	11.13	12.68	9.25	9.63	10.38	10.76	12.31
	6H	10.22	10.54	11.37	11.71	13.26	9.85	10.16	11.00	11.33	12.88
	8H	10.43	10.70	11.59	11.85	13.42	10.05	10.32	11.20	11.47	13.04
	12H	10.54	10.78	11.70	11.93	13.53	10.14	10.38	11.30	11.53	13.14
12H	4H	9.60	9.94	10.74	11.08	12.64	9.24	9.58	10.38	10.72	12.28
	6H	10.25	10.52	11.40	11.67	13.24	9.88	10.16	11.04	11.31	12.88
	8H	10.47	10.71	11.63	11.85	13.46	10.09	10.34	11.26	11.48	13.09

END OF REPORT