

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P916509

Luminaire Tested: DFN2DIP-PN2F0-030D020US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P916509
REPORT IS A COMBINATION OF REPORTS P900983 AND P897905
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-030D020US930-FLLONL
Description: 2 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4035.7 lumens
Efficiency: N/A
Efficacy: 92.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 43.8
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P916509

CATALOG NUMBER: DFN2DIP-PN2F0-030D020US930-FLLONL

Luminous Intensity Polar Plot

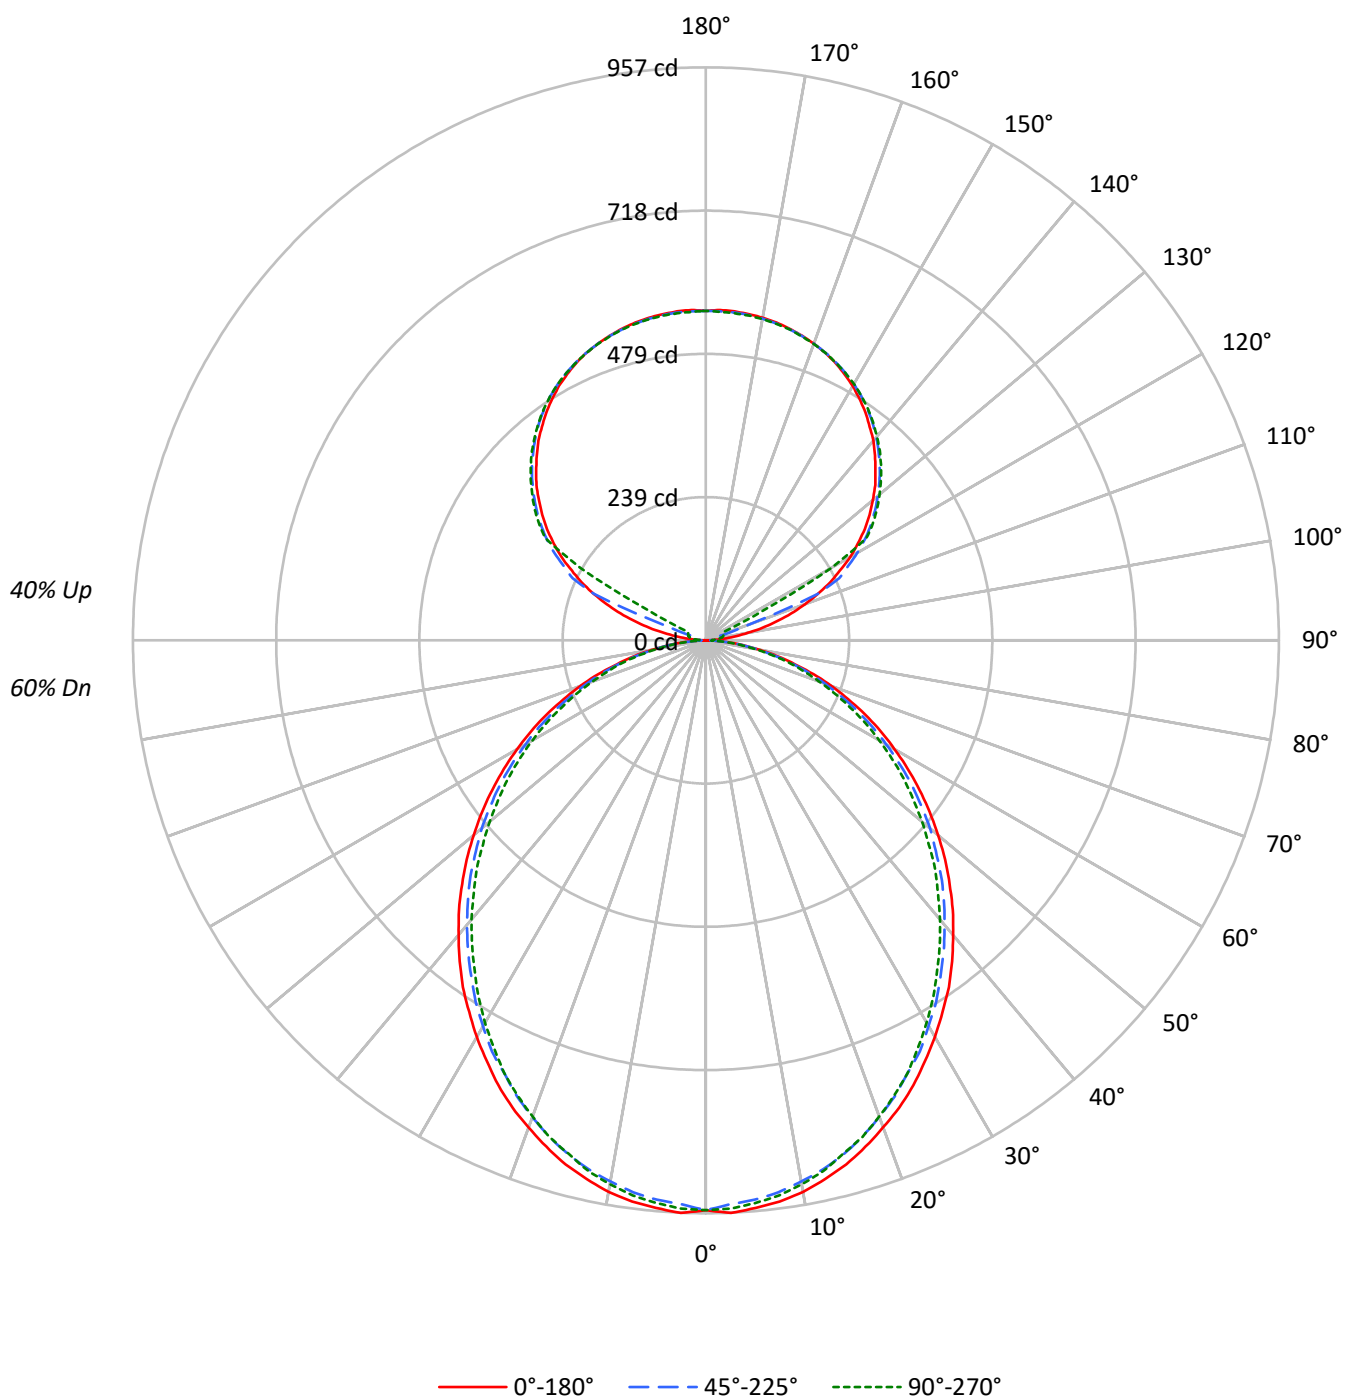

TEST NUMBER: P916509

CATALOG NUMBER: DFN2DIP-PN2F0-030D020US930-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	102	102	102	102	89	89	89	77	77	77	65	65	65
1	100	96	92	88	93	90	86	83	78	75	73	67	66	64	58	56	55
2	91	84	77	72	85	78	73	68	68	64	61	59	56	53	51	49	47
3	83	73	66	60	77	69	62	57	60	55	51	52	48	45	45	42	40
4	76	65	57	51	71	61	54	48	54	48	44	47	42	39	40	37	34
5	70	58	50	44	65	55	47	42	48	42	38	42	37	34	36	33	30
6	64	52	44	38	60	49	42	36	43	37	33	38	33	30	33	29	26
7	60	47	39	33	56	44	37	32	39	33	29	35	30	26	30	26	23
8	55	43	35	30	52	40	33	28	36	30	26	32	27	23	28	24	21
9	52	39	32	26	48	37	30	25	33	27	23	29	24	21	26	22	19
10	48	36	29	24	45	34	27	23	30	25	21	27	22	19	24	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2061	2061	2061
5°	2061	2028	2043
10°	2041	1996	2013
15°	2008	1959	1966
20°	1964	1909	1919
25°	1920	1850	1865
30°	1866	1795	1797
35°	1815	1731	1725
40°	1752	1665	1657
45°	1689	1600	1587
50°	1621	1531	1506
55°	1548	1451	1430
60°	1466	1357	1344
65°	1377	1259	1243
70°	1262	1140	1132
75°	1106	997	1026
80°	915	814	833
85°	621	514	521

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1689 cd/sqm

TEST NUMBER: P916509

CATALOG NUMBER: DFN2DIP-PN2F0-030D020US930-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	89.6	2.2
10°-20°	252.0	6.2
20°-30°	370.4	9.2
30°-40°	430.2	10.7
40°-50°	429.7	10.6
50°-60°	374.6	9.3
60°-70°	277.0	6.9
70°-80°	156.7	3.9
80°-90°	42.3	1.0
90°-100°	18.1	0.4
100°-110°	67.6	1.7
110°-120°	179.4	4.4
120°-130°	297.6	7.4
130°-140°	316.1	7.8
140°-150°	293.8	7.3
150°-160°	236.2	5.9
160°-170°	152.2	3.8
170°-180°	52.4	1.3
0°-30°	712.0	17.6
0°-40°	1142.2	28.3
0°-60°	1946.5	48.2
0°-90°	2422.4	60.0
90°-120°	265.2	6.6
90°-150°	1172.6	29.1
90°-180°	1613.0	40.0
0°-180°	4035.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	952	952	952	952	952	
5°	952	948	938	945	944	90
15°	906	901	889	892	888	255
25°	820	813	797	799	797	377
35°	707	698	684	678	674	442
45°	576	569	556	545	542	444
55°	436	430	419	408	404	390
65°	294	288	279	271	266	290
75°	154	152	147	142	144	164
85°	38	37	36	33	32	42
90°	0	5	8	10	11	4
95°	26	13	16	18	17	31
105°	121	133	24	29	30	129
115°	229	236	246	61	33	225
125°	324	329	336	339	340	289
135°	401	407	410	415	414	309
145°	465	464	471	474	472	291
155°	512	508	513	515	512	236
165°	539	537	538	541	538	152
175°	552	549	550	552	548	52
180°	550	550	550	550	550	

TEST NUMBER: P916509

CATALOG NUMBER: DFN2DIP-PN2F0-030D020US930-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	951.7	951.7	951.7	951.7	951.7
2.5°	957.2	952.7	942.6	951.7	950.0
5°	951.7	948.1	938.0	945.3	943.5
7.5°	945.3	939.9	929.8	937.2	935.3
10°	935.3	928.9	917.9	925.2	922.5
12.5°	921.5	916.1	905.1	909.6	907.8
15°	906.0	900.6	888.6	892.3	887.7
17.5°	886.7	881.3	869.4	873.9	869.4
20°	865.7	860.2	847.4	850.1	846.5
22.5°	844.7	836.5	824.5	824.5	822.6
25°	819.9	812.7	797.1	798.9	797.1
27.5°	792.5	786.0	774.2	771.5	767.0
30°	765.1	757.7	744.0	741.3	737.6
32.5°	735.8	730.3	715.7	710.1	706.5
35°	707.4	698.3	683.6	678.1	673.5
37.5°	675.4	667.2	652.5	646.0	641.5
40°	642.5	635.1	620.4	612.3	608.6
42.5°	610.4	603.1	588.5	579.3	573.8
45°	575.7	569.2	555.5	545.4	541.8
47.5°	541.8	535.4	520.7	510.6	505.2
50°	506.1	501.5	488.7	475.9	471.3
52.5°	471.3	464.9	453.1	443.0	436.5
55°	435.7	430.2	419.1	408.2	403.7
57.5°	399.9	395.3	383.4	372.4	368.8
60°	364.2	360.6	347.8	337.7	335.0
62.5°	329.5	323.0	313.9	304.8	301.1
65°	293.8	288.3	279.2	270.9	266.4
67.5°	257.2	252.6	244.3	238.0	234.3
70°	223.3	219.6	211.4	205.0	201.4
72.5°	188.6	184.8	180.3	173.9	171.2
75°	153.7	152.0	147.3	141.9	143.7
77.5°	122.6	119.0	117.1	114.4	111.7
80°	91.6	90.6	88.7	86.0	84.2
82.5°	62.2	62.2	61.4	57.6	57.6
85°	37.5	36.6	35.7	32.9	32.0
87.5°	16.5	14.7	12.8	10.1	9.1
90°	0.4	4.8	7.9	9.9	10.8
92.5°	9.9	8.4	9.5	10.4	10.8
95°	25.8	12.7	15.5	17.5	17.1
97.5°	46.6	13.9	20.3	21.5	21.9
100°	70.5	15.9	22.7	25.8	26.7
102.5°	96.8	96.0	23.5	27.9	29.1
105°	121.1	133.0	24.3	28.6	30.2
107.5°	149.4	159.2	25.1	29.4	31.1
110°	176.4	184.7	69.7	29.9	31.5

TEST NUMBER: P916509

CATALOG NUMBER: DFN2DIP-PN2F0-030D020US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	201.9	209.0	202.3	30.7	31.9
115°	228.9	235.7	245.7	61.3	32.7
117.5°	252.4	260.4	267.2	210.3	105.9
120°	278.8	284.7	291.9	296.7	242.9
122.5°	301.0	307.4	315.4	317.7	318.2
125°	323.8	328.9	336.5	339.2	340.5
127.5°	344.5	350.0	356.0	360.0	360.4
130°	363.9	370.3	374.7	379.1	378.7
132.5°	383.8	389.1	393.4	397.0	396.6
135°	400.6	407.0	410.5	414.6	413.8
137.5°	418.1	422.9	426.9	430.9	429.7
140°	435.2	438.5	442.8	446.4	444.4
142.5°	449.6	452.4	457.5	460.7	458.7
145°	464.7	464.3	471.1	473.9	471.9
147.5°	477.8	476.6	483.4	485.3	483.8
150°	490.6	487.8	494.2	496.5	494.6
152.5°	501.3	498.1	504.1	506.5	503.7
155°	511.7	508.1	512.9	515.3	512.1
157.5°	520.1	516.9	520.5	523.3	520.1
160°	527.3	524.8	527.3	529.6	526.8
162.5°	533.5	531.2	533.2	536.0	532.4
165°	539.2	536.8	537.9	540.8	537.9
167.5°	543.6	541.1	542.3	545.2	541.5
170°	547.1	544.7	545.5	548.3	544.7
172.5°	549.5	547.1	548.0	550.7	547.1
175°	551.5	548.7	549.5	552.3	548.3
177.5°	552.3	549.5	549.9	552.7	549.1
180°	550.3	550.3	550.3	550.3	550.3

TEST NUMBER: P916509

CATALOG NUMBER: DFN2DIP-PN2F0-030D020US930-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.54	11.50	11.41	12.39	13.51	10.11	11.07	10.97	11.95	13.07
	3H	12.19	13.05	13.07	13.95	15.10	11.71	12.57	12.59	13.47	14.62
	4H	12.77	13.58	13.67	14.49	15.64	12.29	13.10	13.18	14.01	15.16
	6H	13.16	13.91	14.07	14.82	15.99	12.67	13.42	13.58	14.33	15.50
	8H	13.26	13.97	14.17	14.90	16.07	12.77	13.49	13.69	14.42	15.58
	12H	13.30	13.98	14.22	14.91	16.10	12.81	13.49	13.73	14.41	15.61
4H	2H	11.01	11.82	11.91	12.72	13.88	10.66	11.47	11.56	12.37	13.53
	3H	12.86	13.54	13.77	14.47	15.64	12.46	13.14	13.37	14.07	15.24
	4H	13.56	14.18	14.48	15.11	16.31	13.15	13.77	14.07	14.70	15.89
	6H	14.06	14.60	15.00	15.55	16.75	13.64	14.18	14.58	15.13	16.33
	8H	14.20	14.70	15.14	15.65	16.86	13.78	14.28	14.72	15.23	16.44
	12H	14.27	14.72	15.23	15.69	16.91	13.84	14.29	14.80	15.26	16.47
8H	4H	13.75	14.25	14.69	15.20	16.41	13.39	13.89	14.32	14.83	16.05
	6H	14.37	14.78	15.33	15.77	16.98	13.99	14.41	14.96	15.40	16.61
	8H	14.57	14.94	15.55	15.92	17.15	14.19	14.56	15.17	15.54	16.77
	12H	14.70	15.02	15.67	15.99	17.27	14.30	14.62	15.28	15.59	16.87
12H	4H	13.74	14.19	14.70	15.16	16.38	13.38	13.83	14.34	14.80	16.02
	6H	14.39	14.76	15.36	15.74	16.97	14.03	14.40	15.00	15.37	16.60
	8H	14.62	14.94	15.60	15.92	17.19	14.25	14.58	15.23	15.55	16.82

END OF REPORT