

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P916521

Luminaire Tested: DFN2DIP-PN2F0-030D050US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P916521
REPORT IS A COMBINATION OF REPORTS P901013 AND P897905
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-030D050US930-FLLONL
Description: 2 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6457.2 lumens
Efficiency: N/A
Efficacy: 93.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 69
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P916521

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US930-FLLONL

Luminous Intensity Polar Plot

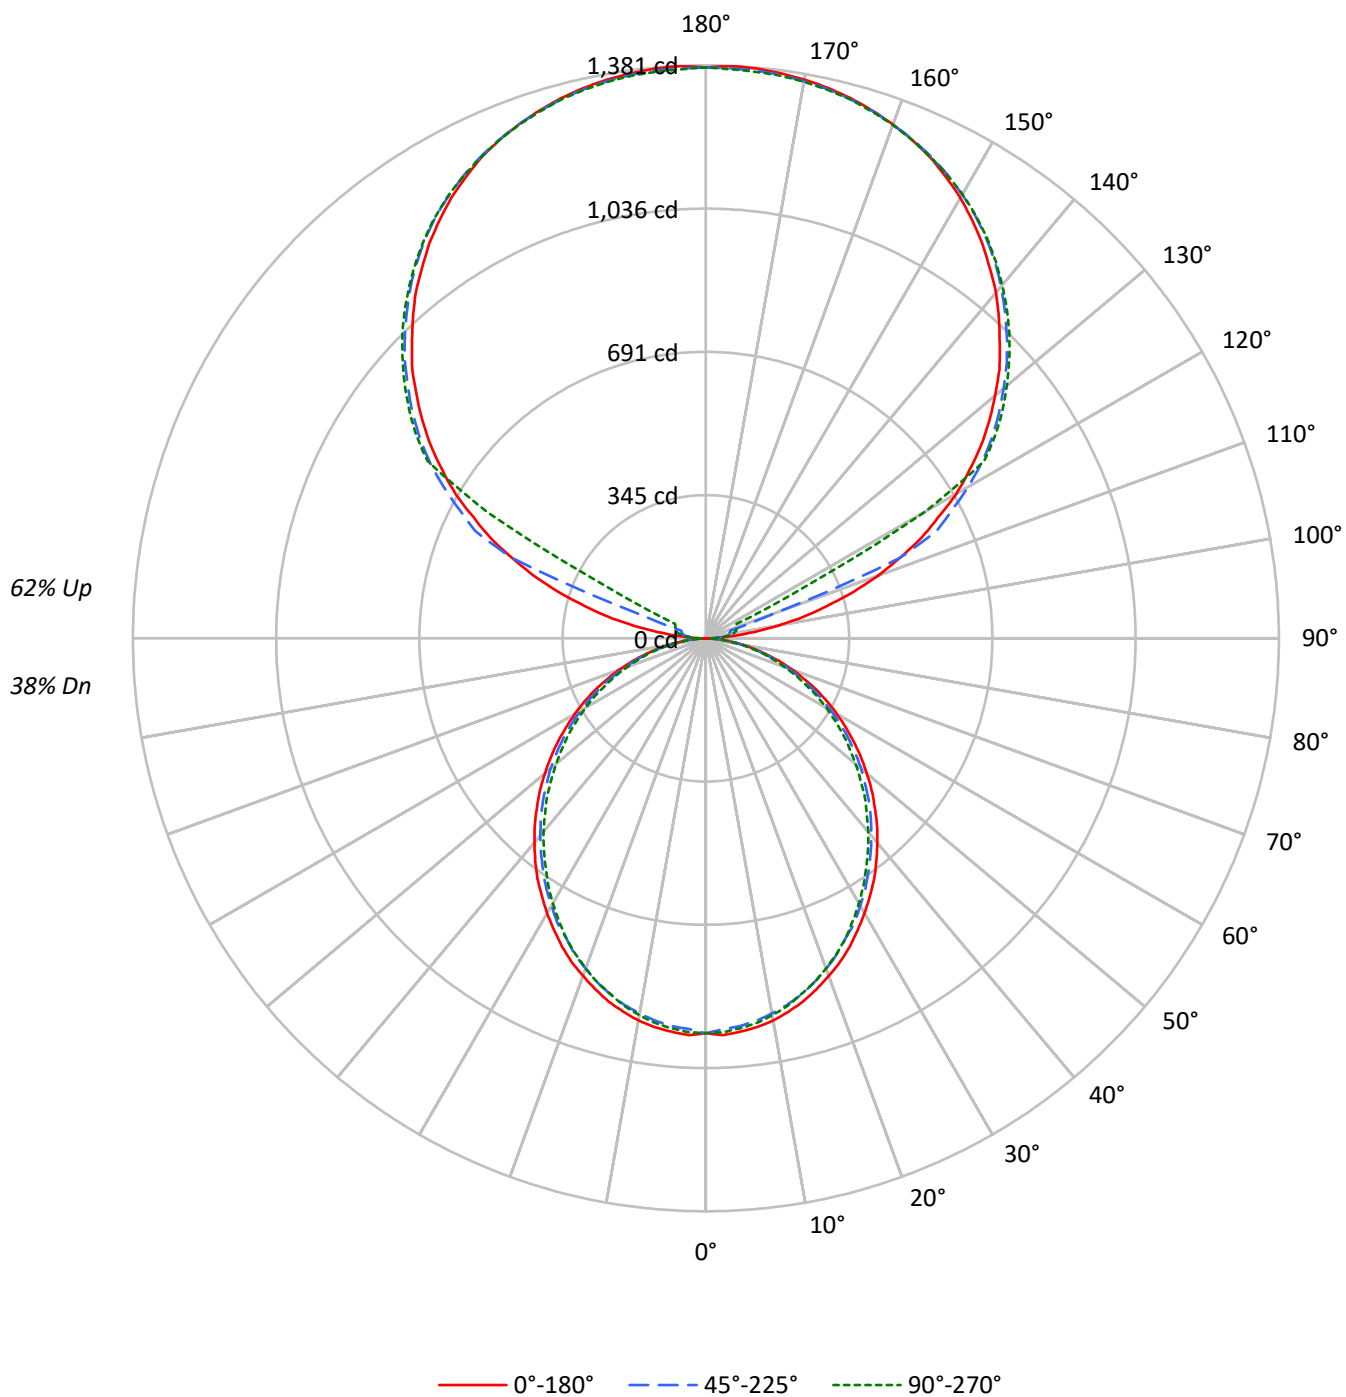

TEST NUMBER: P916521

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US930-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	60	60	60	45	45	45
1	95	91	87	83	86	82	79	76	67	65	63	53	51	50	39	39	38
2	86	79	73	68	78	72	67	63	59	55	52	46	44	42	35	33	32
3	79	70	62	57	71	63	57	52	52	47	44	41	38	35	31	29	27
4	72	62	54	48	65	56	49	44	46	41	37	36	33	30	27	25	23
5	66	55	47	41	60	50	43	38	41	36	32	33	29	26	25	22	20
6	61	49	41	35	55	45	38	33	37	32	28	29	26	23	22	20	18
7	56	44	36	31	51	40	34	29	33	28	24	27	23	20	20	18	16
8	52	40	32	27	47	37	30	25	30	25	22	24	21	18	19	16	14
9	48	36	29	24	44	33	27	23	28	23	19	22	19	16	17	15	13
10	45	33	26	22	41	31	24	20	26	21	17	21	17	14	16	13	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2061	2061	2061
5°	2061	2028	2043
10°	2041	1996	2013
15°	2008	1959	1966
20°	1964	1909	1919
25°	1920	1850	1865
30°	1866	1795	1797
35°	1815	1731	1725
40°	1752	1665	1657
45°	1689	1600	1587
50°	1621	1531	1506
55°	1548	1451	1430
60°	1466	1357	1344
65°	1377	1259	1243
70°	1262	1140	1132
75°	1106	997	1026
80°	915	814	833
85°	621	514	521

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1689 cd/sqm

TEST NUMBER: P916521

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US930-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	89.6	1.4
10°-20°	252.0	3.9
20°-30°	370.4	5.7
30°-40°	430.2	6.7
40°-50°	429.7	6.7
50°-60°	374.6	5.8
60°-70°	277.0	4.3
70°-80°	156.7	2.4
80°-90°	43.8	0.7
90°-100°	45.4	0.7
100°-110°	169.1	2.6
110°-120°	448.5	6.9
120°-130°	743.9	11.5
130°-140°	790.2	12.2
140°-150°	734.4	11.4
150°-160°	590.4	9.1
160°-170°	380.5	5.9
170°-180°	130.9	2.0
0°-30°	712.0	11.0
0°-40°	1142.2	17.7
0°-60°	1946.5	30.1
0°-90°	2423.9	37.5
90°-120°	663.0	10.3
90°-150°	2931.5	45.4
90°-180°	4033.0	62.5
0°-180°	6457.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	952	952	952	952	952	
5°	952	948	938	945	944	90
15°	906	901	889	892	888	255
25°	820	813	797	799	797	377
35°	707	698	684	678	674	442
45°	576	569	556	545	542	444
55°	436	430	419	408	404	390
65°	294	288	279	271	266	290
75°	154	152	147	142	144	164
85°	38	37	36	33	32	42
90°	1	12	20	25	27	6
95°	65	32	39	44	43	77
105°	303	333	61	72	76	323
115°	572	589	614	153	82	564
125°	809	822	841	848	851	722
135°	1002	1018	1026	1036	1034	774
145°	1162	1161	1178	1185	1180	727
155°	1279	1270	1282	1288	1280	589
165°	1348	1342	1345	1352	1345	381
175°	1379	1372	1374	1381	1371	131
180°	1376	1376	1376	1376	1376	

TEST NUMBER: P916521

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US930-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	951.7	951.7	951.7	951.7	951.7
2.5°	957.2	952.7	942.6	951.7	950.0
5°	951.7	948.1	938.0	945.3	943.5
7.5°	945.3	939.9	929.8	937.2	935.3
10°	935.3	928.9	917.9	925.2	922.5
12.5°	921.5	916.1	905.1	909.6	907.8
15°	906.0	900.6	888.6	892.3	887.7
17.5°	886.7	881.3	869.4	873.9	869.4
20°	865.7	860.2	847.4	850.1	846.5
22.5°	844.7	836.5	824.5	824.5	822.6
25°	819.9	812.7	797.1	798.9	797.1
27.5°	792.5	786.0	774.2	771.5	767.0
30°	765.1	757.7	744.0	741.3	737.6
32.5°	735.8	730.3	715.7	710.1	706.5
35°	707.4	698.3	683.6	678.1	673.5
37.5°	675.4	667.2	652.5	646.0	641.5
40°	642.5	635.1	620.4	612.3	608.6
42.5°	610.4	603.1	588.5	579.3	573.8
45°	575.7	569.2	555.5	545.4	541.8
47.5°	541.8	535.4	520.7	510.6	505.2
50°	506.1	501.5	488.7	475.9	471.3
52.5°	471.3	464.9	453.1	443.0	436.5
55°	435.7	430.2	419.1	408.2	403.7
57.5°	399.9	395.3	383.4	372.4	368.8
60°	364.2	360.6	347.8	337.7	335.0
62.5°	329.5	323.0	313.9	304.8	301.1
65°	293.8	288.3	279.2	270.9	266.4
67.5°	257.2	252.6	244.3	238.0	234.3
70°	223.3	219.6	211.4	205.0	201.4
72.5°	188.6	184.8	180.3	173.9	171.2
75°	153.7	152.0	147.3	141.9	143.7
77.5°	122.6	119.0	117.1	114.4	111.7
80°	91.6	90.6	88.7	86.0	84.2
82.5°	62.2	62.2	61.4	57.6	57.6
85°	37.5	36.6	35.7	32.9	32.0
87.5°	16.5	14.7	12.8	10.1	9.1
90°	1.0	11.9	19.9	24.9	26.8
92.5°	24.9	21.0	23.9	25.9	26.8
95°	64.7	31.8	38.8	43.9	42.8
97.5°	116.4	34.9	50.7	53.8	54.7
100°	176.3	39.9	56.7	64.7	66.7
102.5°	241.9	239.9	58.8	69.6	72.7
105°	302.6	332.6	60.7	71.7	75.7
107.5°	373.3	398.1	62.8	73.6	77.7
110°	441.1	461.9	174.2	74.7	78.6

TEST NUMBER: P916521

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	504.8	522.6	505.7	76.6	79.7
115°	572.4	589.3	614.2	153.4	81.7
117.5°	631.1	651.0	668.1	525.5	264.8
120°	696.8	711.8	729.7	741.7	607.2
122.5°	752.5	768.5	788.5	794.4	795.5
125°	809.3	822.3	841.2	848.2	851.2
127.5°	861.0	875.0	890.1	899.9	900.9
130°	909.9	925.9	936.7	947.7	946.8
132.5°	959.7	972.7	983.5	992.5	991.6
135°	1001.5	1017.5	1026.3	1036.4	1034.4
137.5°	1045.2	1057.2	1067.2	1077.2	1074.2
140°	1088.0	1096.1	1106.9	1115.9	1111.0
142.5°	1124.0	1131.0	1143.9	1151.8	1146.8
145°	1161.8	1160.7	1177.6	1184.6	1179.7
147.5°	1194.6	1191.6	1208.5	1213.5	1209.6
150°	1226.5	1219.5	1235.4	1241.4	1236.4
152.5°	1253.3	1245.4	1260.3	1266.3	1259.3
155°	1279.2	1270.3	1282.2	1288.2	1280.3
157.5°	1300.1	1292.2	1301.1	1308.1	1300.1
160°	1318.1	1312.1	1318.1	1324.0	1317.0
162.5°	1333.9	1328.0	1332.9	1339.9	1331.0
165°	1347.9	1342.0	1344.9	1351.8	1344.9
167.5°	1358.9	1352.8	1355.9	1362.9	1353.9
170°	1367.8	1361.8	1363.8	1370.8	1361.8
172.5°	1373.8	1367.8	1369.9	1376.8	1367.8
175°	1378.8	1371.7	1373.8	1380.7	1370.8
177.5°	1380.7	1373.8	1374.8	1381.8	1372.8
180°	1375.7	1375.7	1375.7	1375.7	1375.7

TEST NUMBER: P916521

CATALOG NUMBER: DFN2DIP-PN2F0-030D050US930-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.39	9.15	9.45	10.21	11.65	7.96	8.71	9.01	9.78	11.21
	3H	10.02	10.71	11.09	11.77	13.23	9.55	10.23	10.61	11.30	12.75
	4H	10.59	11.24	11.67	12.31	13.77	10.11	10.76	11.19	11.83	13.29
	6H	10.97	11.57	12.06	12.64	14.12	10.49	11.08	11.57	12.16	13.63
	8H	11.07	11.63	12.16	12.72	14.19	10.58	11.15	11.67	12.24	13.71
	12H	11.10	11.64	12.20	12.73	14.22	10.61	11.15	11.71	12.23	13.73
4H	2H	8.83	9.48	9.92	10.55	12.01	8.48	9.13	9.57	10.20	11.66
	3H	10.66	11.20	11.76	12.30	13.78	10.26	10.80	11.36	11.90	13.38
	4H	11.36	11.85	12.46	12.94	14.44	10.94	11.44	12.04	12.53	14.03
	6H	11.85	12.27	12.95	13.38	14.88	11.43	11.85	12.53	12.97	14.46
	8H	11.99	12.38	13.09	13.49	14.99	11.56	11.96	12.67	13.06	14.57
	12H	12.04	12.40	13.17	13.52	15.03	11.61	11.97	12.73	13.09	14.60
8H	4H	11.54	11.93	12.64	13.04	14.54	11.17	11.56	12.27	12.67	14.17
	6H	12.14	12.47	13.27	13.61	15.11	11.77	12.09	12.89	13.24	14.74
	8H	12.34	12.63	13.48	13.76	15.28	11.96	12.25	13.10	13.38	14.90
	12H	12.46	12.71	13.59	13.83	15.39	12.06	12.31	13.20	13.44	15.00
12H	4H	11.51	11.87	12.64	12.99	14.50	11.15	11.51	12.28	12.63	14.14
	6H	12.16	12.45	13.30	13.58	15.10	11.80	12.09	12.93	13.21	14.74
	8H	12.38	12.64	13.52	13.76	15.32	12.01	12.27	13.15	13.39	14.95

END OF REPORT