

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P916533

Luminaire Tested: DFN2DIP-PN2F0-040D030US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P916533
REPORT IS A COMBINATION OF REPORTS P900995 AND P897905
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-040D030US930-FLLONL
Description: 2 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5650.0 lumens
Efficiency: N/A
Efficacy: 97.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 58.1
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P916533

CATALOG NUMBER: DFN2DIP-PN2F0-040D030US930-FLLONL

Luminous Intensity Polar Plot

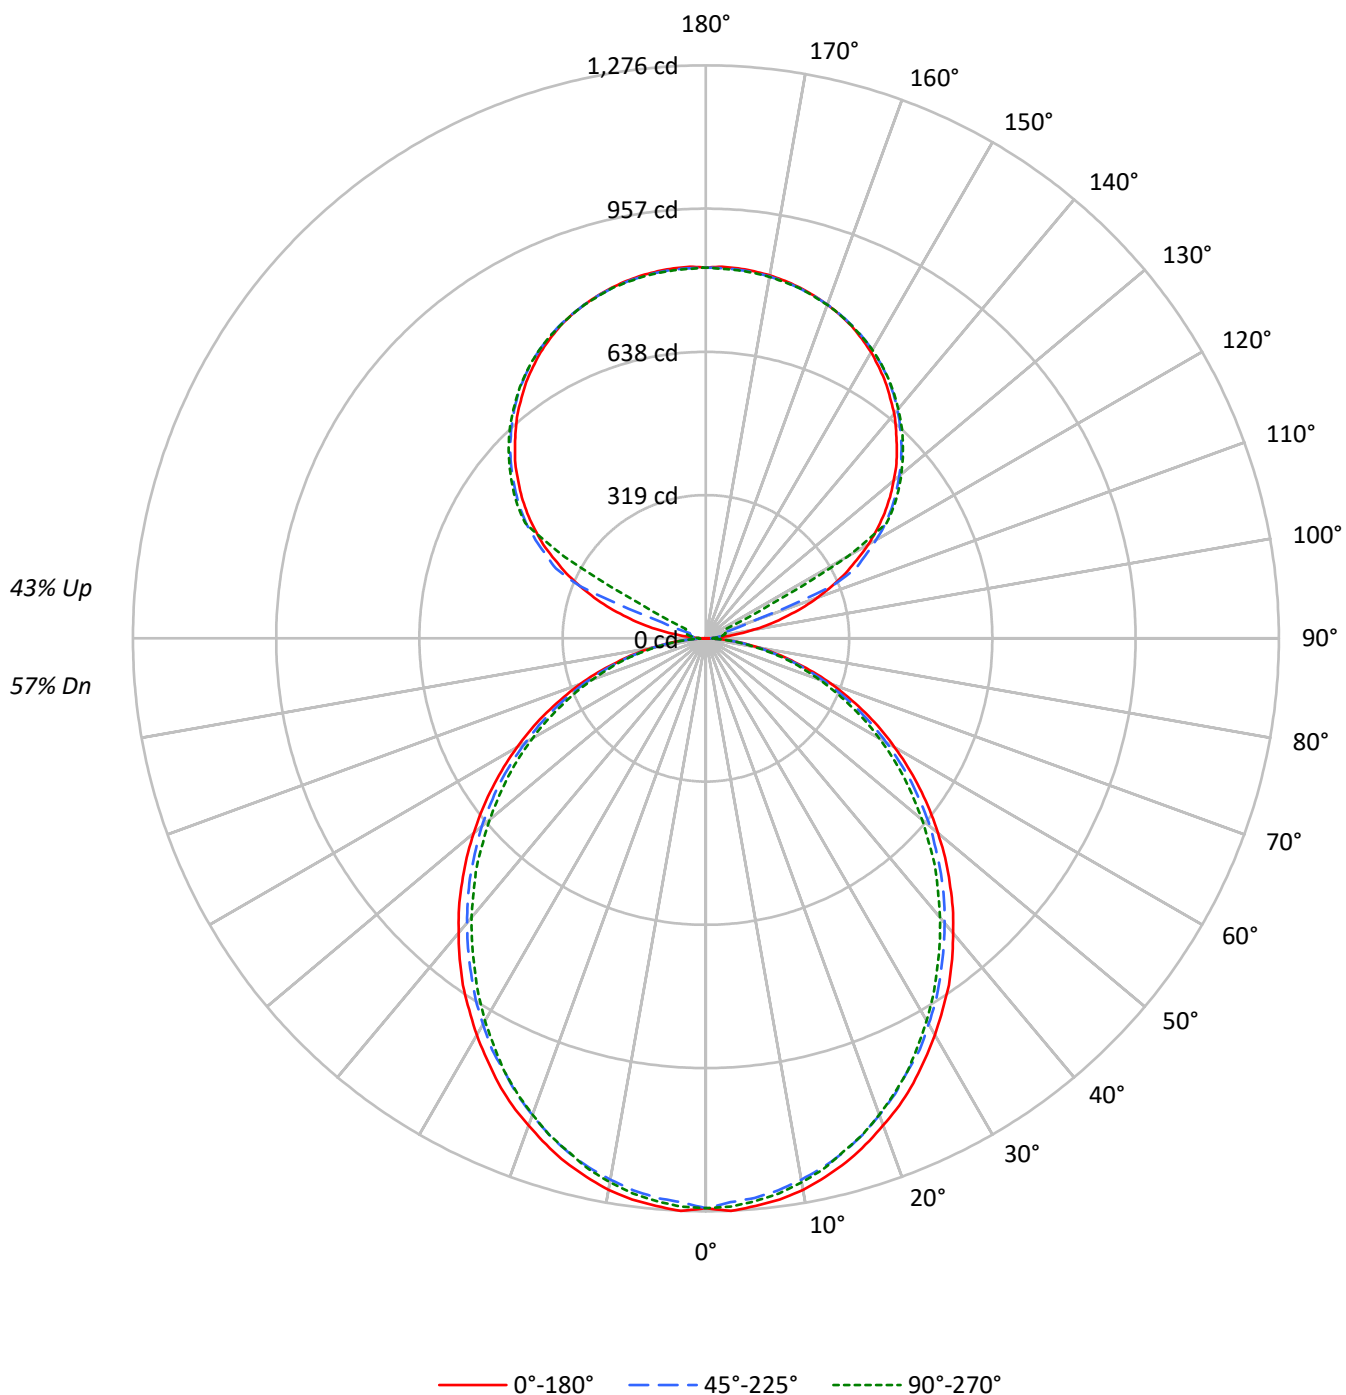

TEST NUMBER: P916533

CATALOG NUMBER: DFN2DIP-PN2F0-040D030US930-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	63	63	63
1	99	95	91	88	92	89	85	82	77	74	72	66	64	62	55	54	53
2	91	83	77	72	84	77	72	67	67	63	59	58	55	52	49	47	45
3	83	73	66	60	77	68	62	56	59	54	50	51	47	44	43	40	38
4	76	65	57	50	70	61	53	48	53	47	43	45	41	38	39	35	33
5	69	58	49	43	64	54	47	41	47	41	37	41	36	33	35	31	29
6	64	52	44	38	59	49	41	36	43	37	32	37	32	29	32	28	25
7	59	47	39	33	55	44	37	31	39	33	28	34	29	25	29	25	22
8	55	43	35	29	51	40	33	28	35	29	25	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	32	27	23	28	24	20	25	21	18
10	48	36	28	24	45	34	27	22	30	24	20	26	22	18	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2748	2748	2748
5°	2748	2704	2724
10°	2722	2662	2683
15°	2677	2612	2622
20°	2619	2545	2559
25°	2560	2467	2487
30°	2488	2393	2396
35°	2420	2308	2301
40°	2336	2221	2209
45°	2252	2133	2115
50°	2161	2041	2007
55°	2065	1935	1907
60°	1955	1810	1792
65°	1836	1679	1656
70°	1683	1520	1510
75°	1475	1329	1368
80°	1220	1085	1111
85°	828	686	695

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2252 cd/sqm

TEST NUMBER: P916533

CATALOG NUMBER: DFN2DIP-PN2F0-040D030US930-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	119.4	2.1
10°-20°	336.0	5.9
20°-30°	493.8	8.7
30°-40°	573.6	10.2
40°-50°	572.9	10.1
50°-60°	499.5	8.8
60°-70°	369.3	6.5
70°-80°	208.9	3.7
80°-90°	56.6	1.0
90°-100°	27.2	0.5
100°-110°	101.5	1.8
110°-120°	269.1	4.8
120°-130°	446.3	7.9
130°-140°	474.1	8.4
140°-150°	440.6	7.8
150°-160°	354.3	6.3
160°-170°	228.3	4.0
170°-180°	78.6	1.4
0°-30°	949.3	16.8
0°-40°	1522.9	27.0
0°-60°	2595.3	45.9
0°-90°	3230.0	57.2
90°-120°	397.8	7.0
90°-150°	1758.9	31.1
90°-180°	2420.0	42.8
0°-180°	5650.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1269	1269	1269	1269	1269	
5°	1269	1264	1251	1260	1258	120
15°	1208	1201	1185	1190	1184	340
25°	1093	1084	1063	1065	1063	503
35°	943	931	912	904	898	589
45°	768	759	741	727	722	592
55°	581	574	559	544	538	519
65°	392	384	372	361	355	387
75°	205	203	196	189	192	219
85°	50	49	48	44	43	56
90°	1	7	12	15	16	5
95°	39	19	23	26	26	46
105°	182	200	36	43	45	194
115°	343	354	368	92	49	338
125°	486	493	505	509	511	433
135°	601	610	616	622	621	464
145°	697	696	707	711	708	436
155°	768	762	769	773	768	354
165°	809	805	807	811	807	228
175°	827	823	824	828	822	79
180°	826	826	826	826	826	

TEST NUMBER: P916533

CATALOG NUMBER: DFN2DIP-PN2F0-040D030US930-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1268.9	1268.9	1268.9	1268.9	1268.9
2.5°	1276.3	1270.2	1256.8	1268.9	1266.6
5°	1268.9	1264.1	1250.7	1260.4	1258.1
7.5°	1260.4	1253.1	1239.7	1249.5	1247.1
10°	1247.1	1238.5	1223.9	1233.6	1230.0
12.5°	1228.7	1221.4	1206.8	1212.9	1210.4
15°	1207.9	1200.7	1184.8	1189.7	1183.6
17.5°	1182.3	1175.1	1159.2	1165.2	1159.2
20°	1154.2	1147.0	1129.9	1133.5	1128.8
22.5°	1126.3	1115.2	1099.3	1099.3	1096.9
25°	1093.2	1083.5	1062.8	1065.2	1062.8
27.5°	1056.6	1048.1	1032.3	1028.7	1022.6
30°	1020.1	1010.3	992.1	988.4	983.5
32.5°	981.0	973.8	954.2	946.9	941.9
35°	943.2	931.1	911.5	904.2	898.1
37.5°	900.5	889.5	869.9	861.4	855.3
40°	856.6	846.8	827.2	816.4	811.5
42.5°	813.9	804.0	784.6	772.3	765.1
45°	767.5	759.0	740.6	727.3	722.4
47.5°	722.4	713.8	694.3	680.9	673.6
50°	674.7	668.6	651.6	634.5	628.4
52.5°	628.4	619.9	604.1	590.6	582.0
55°	580.9	573.5	558.9	544.2	538.2
57.5°	533.2	527.2	511.2	496.6	491.7
60°	485.6	480.8	463.7	450.3	446.6
62.5°	439.3	430.7	418.6	406.3	401.5
65°	391.8	384.3	372.2	361.2	355.1
67.5°	342.9	336.7	325.9	317.3	312.4
70°	297.7	292.9	281.8	273.3	268.5
72.5°	251.4	246.5	240.4	231.9	228.2
75°	205.0	202.6	196.4	189.1	191.6
77.5°	163.5	158.6	156.1	152.5	148.9
80°	122.1	120.7	118.3	114.7	112.3
82.5°	83.0	83.0	81.9	76.9	76.9
85°	50.0	48.8	47.6	43.9	42.7
87.5°	22.0	19.6	17.1	13.5	12.1
90°	0.6	7.2	11.9	15.0	16.1
92.5°	15.0	12.6	14.3	15.6	16.1
95°	38.8	19.1	23.2	26.3	25.7
97.5°	69.9	21.0	30.4	32.3	32.9
100°	105.7	23.9	34.1	38.8	40.0
102.5°	145.1	144.0	35.2	41.7	43.6
105°	181.6	199.5	36.4	43.0	45.4
107.5°	224.0	238.9	37.7	44.2	46.6
110°	264.6	277.1	104.5	44.8	47.2

TEST NUMBER: P916533

CATALOG NUMBER: DFN2DIP-PN2F0-040D030US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	302.9	313.6	303.5	46.0	47.8
115°	343.4	353.6	368.5	92.0	49.0
117.5°	378.7	390.6	400.8	315.4	158.9
120°	418.1	427.1	437.8	445.0	364.4
122.5°	451.5	461.1	473.1	476.6	477.3
125°	485.6	493.3	504.8	508.9	510.7
127.5°	516.7	525.0	534.0	540.0	540.5
130°	545.9	555.5	562.1	568.6	568.1
132.5°	575.8	583.6	590.1	595.5	594.9
135°	600.9	610.5	615.8	621.8	620.6
137.5°	627.1	634.3	640.3	646.3	644.5
140°	652.8	657.6	664.1	669.5	666.6
142.5°	674.4	678.6	686.3	691.0	688.1
145°	697.1	696.4	706.6	710.8	707.8
147.5°	716.7	714.9	725.1	728.1	725.7
150°	735.9	731.7	741.3	744.8	741.8
152.5°	751.9	747.2	756.2	759.8	755.6
155°	767.5	762.2	769.3	772.9	768.2
157.5°	780.1	775.3	780.7	784.9	780.1
160°	790.8	787.3	790.8	794.4	790.2
162.5°	800.4	796.8	799.8	804.0	798.6
165°	808.7	805.2	807.0	811.1	807.0
167.5°	815.3	811.7	813.5	817.7	812.4
170°	820.7	817.1	818.3	822.5	817.1
172.5°	824.3	820.7	821.9	826.1	820.7
175°	827.2	823.0	824.3	828.4	822.5
177.5°	828.4	824.3	824.9	829.1	823.7
180°	825.5	825.5	825.5	825.5	825.5

TEST NUMBER: P916533

CATALOG NUMBER: DFN2DIP-PN2F0-040D030US930-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.31	12.23	12.20	13.15	14.31	10.87	11.80	11.76	12.71	13.88
	3H	12.95	13.78	13.86	14.71	15.90	12.47	13.30	13.37	14.23	15.42
	4H	13.53	14.32	14.45	15.24	16.44	13.05	13.83	13.97	14.76	15.96
	6H	13.92	14.64	14.85	15.58	16.79	13.43	14.16	14.36	15.09	16.30
	8H	14.01	14.71	14.95	15.66	16.87	13.53	14.22	14.47	15.17	16.38
	12H	14.06	14.72	15.00	15.66	16.90	13.56	14.22	14.51	15.17	16.41
4H	2H	11.76	12.55	12.69	13.48	14.68	11.41	12.20	12.34	13.13	14.33
	3H	13.61	14.27	14.55	15.23	16.44	13.21	13.87	14.15	14.83	16.04
	4H	14.31	14.91	15.26	15.87	17.11	13.90	14.50	14.85	15.45	16.69
	6H	14.81	15.33	15.77	16.31	17.55	14.39	14.91	15.35	15.89	17.13
	8H	14.95	15.44	15.92	16.41	17.66	14.53	15.02	15.49	15.99	17.24
	12H	15.02	15.46	16.00	16.45	17.70	14.59	15.03	15.57	16.01	17.27
8H	4H	14.50	14.99	15.47	15.96	17.21	14.14	14.62	15.10	15.59	16.84
	6H	15.11	15.52	16.10	16.53	17.78	14.74	15.14	15.73	16.15	17.41
	8H	15.32	15.68	16.32	16.68	17.95	14.94	15.30	15.94	16.30	17.57
	12H	15.44	15.76	16.44	16.75	18.07	15.05	15.36	16.05	16.35	17.67
12H	4H	14.49	14.93	15.47	15.92	17.17	14.13	14.57	15.11	15.56	16.81
	6H	15.14	15.49	16.14	16.50	17.76	14.78	15.13	15.77	16.13	17.40
	8H	15.37	15.68	16.37	16.68	17.99	15.00	15.31	16.00	16.31	17.62

END OF REPORT