

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919227

Luminaire Tested: DFN2DIP-PN2F0-020D040US935-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919227
REPORT IS A COMBINATION OF REPORTS P901002 AND P897905
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-020D040US935-RLLONL
Description: 2 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4873.2 lumens
Efficiency: N/A
Efficacy: 103.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 47.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919227

CATALOG NUMBER: DFN2DIP-PN2F0-020D040US935-RLLONL

Luminous Intensity Polar Plot

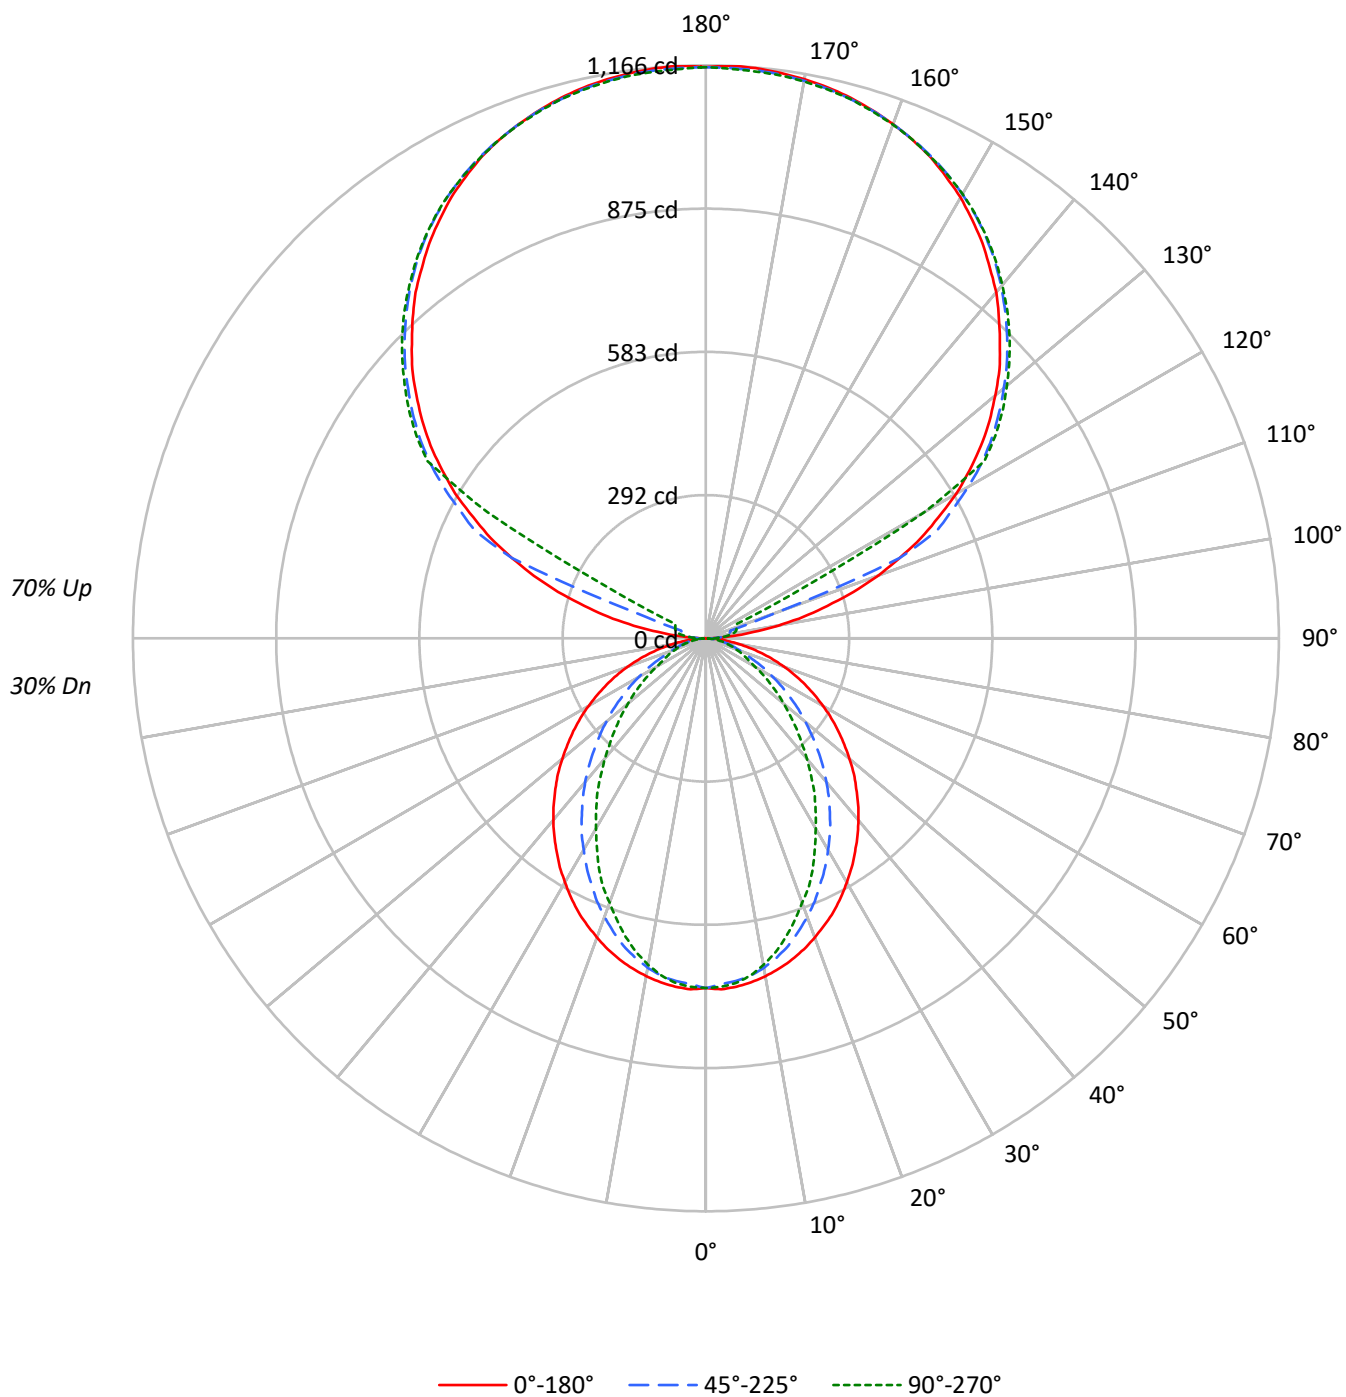

TEST NUMBER: P919227

CATALOG NUMBER: DFN2DIP-PN2F0-020D040US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	102	102	102	102	92	92	92	92	72	72	72	54	54	54	38	38	38
1	94	90	86	83	84	81	77	75	64	62	60	48	47	46	34	33	32
2	85	78	73	68	76	71	66	62	56	53	50	43	40	39	30	29	28
3	78	69	62	57	70	62	57	52	50	46	42	38	35	33	27	25	24
4	71	61	54	48	64	55	49	44	44	40	36	34	31	28	24	22	21
5	66	55	47	41	59	49	43	38	40	35	31	30	27	25	22	20	18
6	60	49	41	36	54	44	38	33	36	31	27	28	24	22	20	18	16
7	56	44	37	31	50	40	34	29	32	28	24	25	22	19	18	16	15
8	52	40	33	28	46	36	30	25	29	25	21	23	20	17	17	15	13
9	48	37	29	25	43	33	27	23	27	22	19	21	18	15	16	13	12
10	45	33	27	22	40	30	24	20	25	20	17	20	16	14	14	12	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1541	1541	1541
5°	1541	1514	1524
10°	1524	1481	1473
15°	1500	1428	1394
20°	1470	1358	1298
25°	1439	1280	1205
30°	1398	1200	1089
35°	1358	1114	986
40°	1317	1025	869
45°	1270	928	764
50°	1221	830	661
55°	1170	725	561
60°	1110	616	460
65°	1041	506	412
70°	958	402	369
75°	852	348	331
80°	702	283	280
85°	457	176	199

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1270 cd/sqm

TEST NUMBER: P919227

CATALOG NUMBER: DFN2DIP-PN2F0-020D040US935-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	66.7	1.4
10°-20°	183.1	3.8
20°-30°	257.1	5.3
30°-40°	280.2	5.8
40°-50°	257.6	5.3
50°-60°	202.3	4.2
60°-70°	131.7	2.7
70°-80°	67.8	1.4
80°-90°	19.3	0.4
90°-100°	38.3	0.8
100°-110°	142.9	2.9
110°-120°	378.9	7.8
120°-130°	628.5	12.9
130°-140°	667.6	13.7
140°-150°	620.4	12.7
150°-160°	498.8	10.2
160°-170°	321.4	6.6
170°-180°	110.6	2.3
0°-30°	506.9	10.4
0°-40°	787.1	16.2
0°-60°	1247.0	25.6
0°-90°	1465.8	30.1
90°-120°	560.1	11.5
90°-150°	2476.6	50.8
90°-180°	3407.0	69.9
0°-180°	4873.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	712	712	712	712	712	
5°	712	708	700	706	704	67
15°	677	670	648	636	629	191
25°	614	594	551	525	515	283
35°	529	497	440	399	385	331
45°	433	390	322	276	261	334
55°	329	279	209	171	158	294
65°	222	170	112	90	88	220
75°	118	73	52	47	46	125
85°	28	14	12	12	12	32
90°	1	10	17	21	23	5
95°	55	27	33	37	36	65
105°	256	281	51	60	64	273
115°	484	498	519	130	69	476
125°	684	695	711	717	719	610
135°	846	860	867	876	874	654
145°	982	981	995	1001	997	614
155°	1081	1073	1083	1088	1082	498
165°	1139	1134	1136	1142	1136	322
175°	1165	1159	1161	1166	1158	111
180°	1162	1162	1162	1162	1162	

TEST NUMBER: P919227

CATALOG NUMBER: DFN2DIP-PN2F0-020D040US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	711.7	711.7	711.7	711.7	711.7
2.5°	714.9	711.7	704.6	711.1	709.8
5°	711.7	708.5	700.1	705.9	704.0
7.5°	705.9	702.1	693.0	695.6	692.3
10°	698.2	693.6	680.8	678.8	675.0
12.5°	688.5	682.7	665.3	661.5	654.4
15°	676.9	669.8	647.9	635.7	629.3
17.5°	663.4	653.1	626.0	611.8	601.6
20°	647.9	635.0	602.9	586.8	572.6
22.5°	631.2	616.4	579.0	557.2	547.5
25°	614.5	593.8	551.3	525.0	515.2
27.5°	594.5	572.6	525.6	495.2	480.4
30°	573.3	548.7	497.2	464.4	446.9
32.5°	552.6	523.0	470.2	431.5	415.4
35°	529.4	496.6	440.0	399.3	385.1
37.5°	506.9	471.4	411.6	367.1	351.0
40°	483.0	444.4	381.9	336.2	319.4
42.5°	458.6	417.4	352.3	304.6	288.6
45°	432.8	389.6	322.1	276.3	260.8
47.5°	408.4	362.7	293.1	247.3	233.2
50°	381.3	335.6	264.8	220.2	206.8
52.5°	354.8	306.5	237.6	195.2	183.0
55°	329.1	278.9	209.3	170.7	158.4
57.5°	302.7	251.2	184.3	148.2	137.8
60°	275.7	224.1	157.8	125.0	114.7
62.5°	249.3	197.8	135.3	104.4	99.2
65°	222.2	170.0	112.1	90.2	88.3
67.5°	196.5	144.2	90.2	79.2	77.3
70°	169.4	119.2	74.6	68.3	65.7
72.5°	143.6	95.9	62.4	57.3	56.1
75°	118.5	73.4	51.5	47.0	46.4
77.5°	93.4	52.2	40.6	38.0	36.7
80°	70.2	37.4	30.9	28.3	28.3
82.5°	48.9	25.1	21.3	20.0	20.0
85°	27.6	14.1	12.2	12.2	12.2
87.5°	10.3	5.2	5.2	4.5	4.5
90°	0.8	10.1	16.8	21.1	22.6
92.5°	21.1	17.7	20.1	21.9	22.6
95°	54.6	26.9	32.7	37.0	36.2
97.5°	98.4	29.4	42.9	45.5	46.2
100°	148.9	33.7	48.0	54.6	56.3
102.5°	204.3	202.8	49.6	58.8	61.4
105°	255.6	280.9	51.3	60.5	63.9
107.5°	315.4	336.4	53.0	62.3	65.6
110°	372.6	390.2	147.2	63.1	66.4

TEST NUMBER: P919227

CATALOG NUMBER: DFN2DIP-PN2F0-020D040US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	426.5	441.5	427.2	64.7	67.3
115°	483.5	497.8	518.9	129.5	69.1
117.5°	533.2	550.0	564.4	444.0	223.7
120°	588.8	601.3	616.5	626.6	513.1
122.5°	635.8	649.3	666.2	671.1	672.0
125°	683.7	694.7	710.7	716.6	719.1
127.5°	727.5	739.3	751.9	760.3	761.1
130°	768.7	782.2	791.3	800.6	799.9
132.5°	810.7	821.7	830.9	838.5	837.8
135°	846.1	859.6	867.1	875.5	873.9
137.5°	883.0	893.1	901.6	910.0	907.5
140°	919.2	926.0	935.2	942.8	938.6
142.5°	949.6	955.4	966.4	973.0	968.9
145°	981.5	980.7	994.9	1000.8	996.6
147.5°	1009.2	1006.7	1021.0	1025.2	1021.9
150°	1036.1	1030.3	1043.8	1048.8	1044.6
152.5°	1058.9	1052.1	1064.7	1069.8	1063.9
155°	1080.7	1073.2	1083.3	1088.3	1081.6
157.5°	1098.4	1091.7	1099.3	1105.2	1098.4
160°	1113.5	1108.4	1113.5	1118.5	1112.7
162.5°	1127.0	1122.0	1126.2	1132.0	1124.5
165°	1138.8	1133.8	1136.3	1142.1	1136.3
167.5°	1148.1	1142.9	1145.6	1151.4	1143.8
170°	1155.6	1150.6	1152.2	1158.1	1150.6
172.5°	1160.6	1155.6	1157.4	1163.2	1155.6
175°	1164.8	1158.9	1160.6	1166.5	1158.1
177.5°	1166.5	1160.6	1161.5	1167.4	1159.9
180°	1162.3	1162.3	1162.3	1162.3	1162.3

TEST NUMBER: P919227

CATALOG NUMBER: DFN2DIP-PN2F0-020D040US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.31	7.00	7.43	8.11	9.64	2.28	2.97	3.40	4.08	5.61
	3H	7.96	8.58	9.08	9.69	11.24	3.44	4.06	4.57	5.18	6.72
	4H	8.55	9.13	9.68	10.25	11.80	3.87	4.46	5.01	5.58	7.13
	6H	8.95	9.48	10.09	10.60	12.17	4.17	4.71	5.32	5.83	7.40
	8H	9.06	9.57	10.20	10.70	12.26	4.25	4.76	5.40	5.90	7.46
	12H	9.11	9.59	10.26	10.72	12.30	4.28	4.77	5.43	5.90	7.48
4H	2H	6.31	6.89	7.45	8.01	9.56	2.85	3.43	3.99	4.55	6.11
	3H	8.10	8.59	9.25	9.73	11.30	4.17	4.65	5.31	5.80	7.36
	4H	8.77	9.22	9.92	10.35	11.94	4.69	5.14	5.84	6.27	7.86
	6H	9.26	9.64	10.42	10.80	12.37	5.09	5.47	6.24	6.62	8.20
	8H	9.42	9.78	10.58	10.93	12.52	5.20	5.56	6.36	6.71	8.30
	12H	9.50	9.82	10.67	10.98	12.58	5.25	5.58	6.42	6.73	8.33
8H	4H	8.73	9.08	9.88	10.23	11.82	4.95	5.31	6.11	6.45	8.05
	6H	9.27	9.56	10.44	10.75	12.34	5.44	5.74	6.62	6.92	8.51
	8H	9.47	9.72	10.65	10.89	12.50	5.62	5.88	6.80	7.04	8.65
	12H	9.58	9.81	10.77	10.97	12.62	5.72	5.94	6.90	7.11	8.75
12H	4H	8.67	8.99	9.84	10.15	11.75	4.95	5.27	6.12	6.43	8.03
	6H	9.24	9.50	10.42	10.66	12.27	5.48	5.74	6.66	6.91	8.52
	8H	9.44	9.66	10.62	10.83	12.47	5.67	5.90	6.86	7.06	8.71

END OF REPORT