

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919264

Luminaire Tested: DFN2DIP-PN2F0-040D040US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919264
REPORT IS A COMBINATION OF REPORTS P899485 AND P896349
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-040D040US935-FLLFLL
Description: 2 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6457.5 lumens
Efficiency: N/A
Efficacy: 92.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 70.2
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919264

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US935-FLLFLL

Luminous Intensity Polar Plot

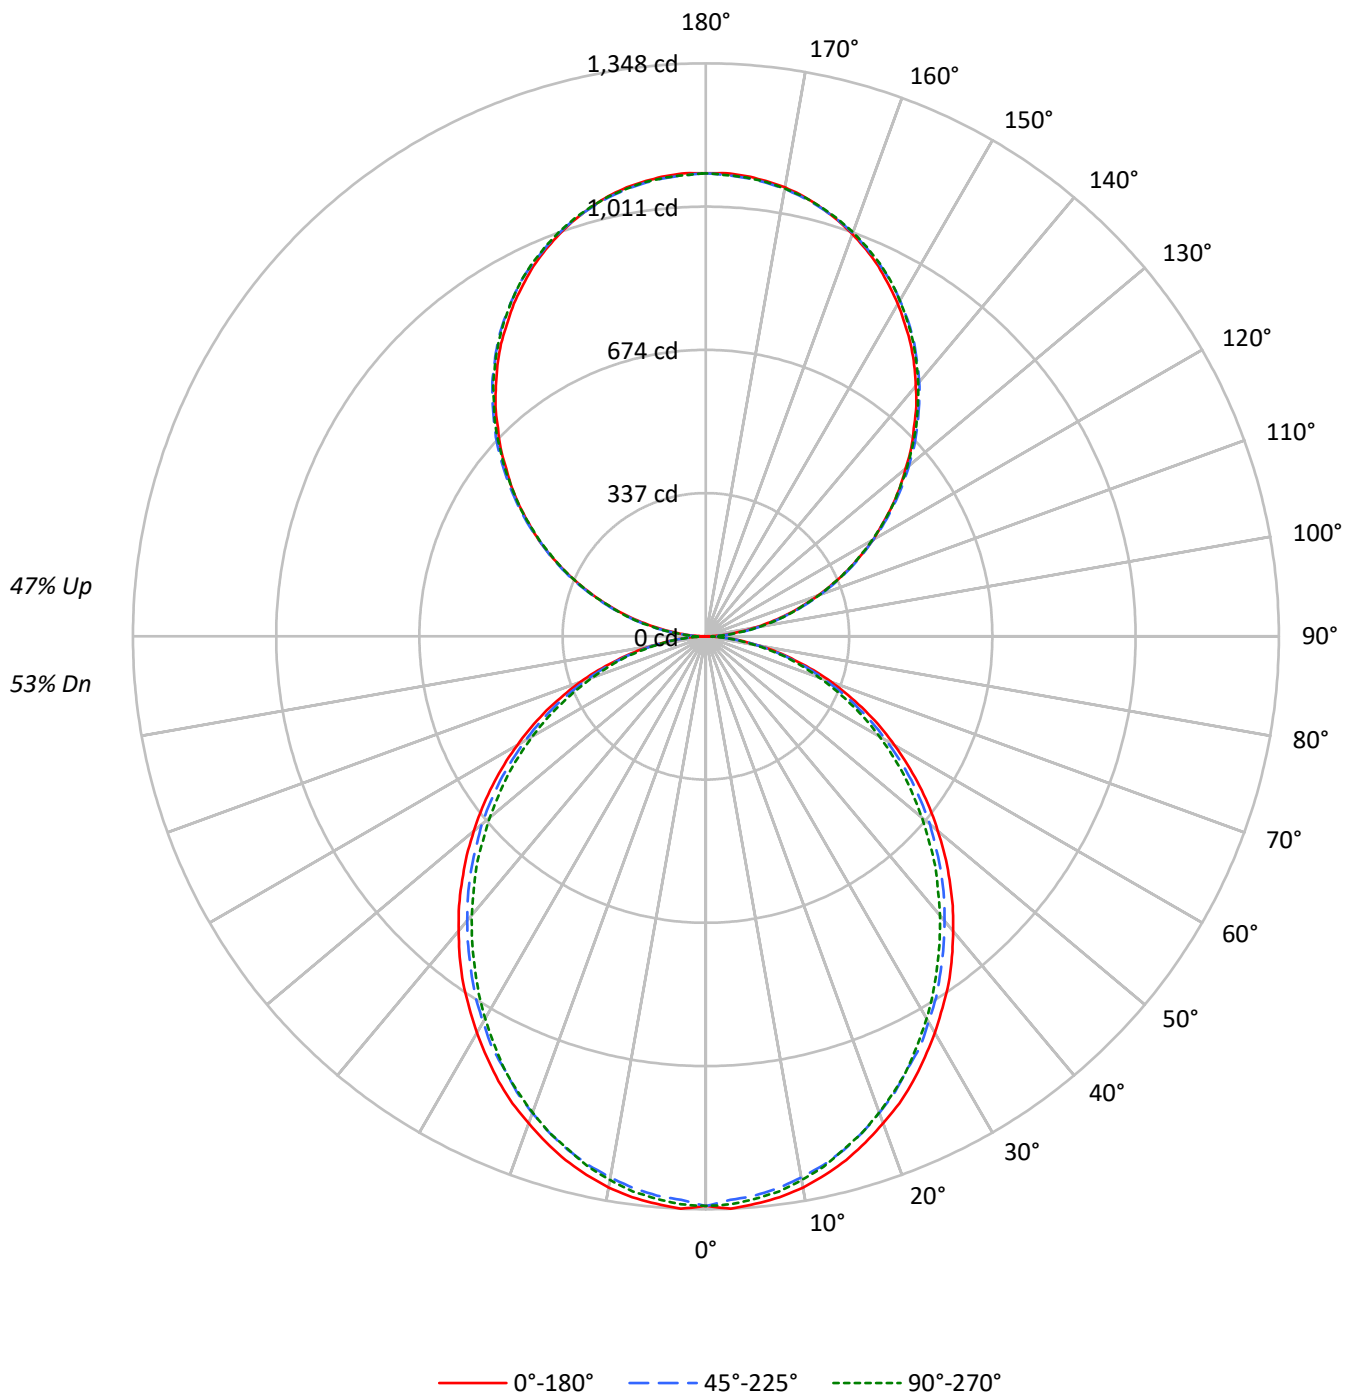

TEST NUMBER: P919264

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US935-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85		71	71	71		59
1	98	94	90	87	91	87	84	81	74	72	70		63	61	59		52
2	90	82	76	71	83	76	71	66	65	61	58		55	52	50		46
3	82	72	65	59	75	67	61	55	58	53	49		49	45	42		41
4	75	64	56	50	69	60	52	47	51	46	41		43	39	36		36
5	69	57	49	43	63	53	46	40	46	40	36		39	35	31		33
6	63	51	43	37	58	48	40	35	41	36	31		35	31	27		30
7	59	46	38	33	54	43	36	31	37	32	28		32	28	24		27
8	54	42	34	29	50	39	32	27	34	29	24		29	25	22		25
9	51	38	31	26	47	36	29	24	31	26	22		27	23	19		23
10	47	35	28	23	44	33	26	22	29	23	20		25	21	18		21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2902	2902	2902
5°	2902	2856	2877
10°	2874	2811	2834
15°	2827	2759	2769
20°	2765	2688	2702
25°	2704	2605	2626
30°	2628	2528	2530
35°	2555	2437	2429
40°	2467	2345	2333
45°	2379	2253	2234
50°	2282	2156	2120
55°	2180	2043	2014
60°	2065	1911	1893
65°	1938	1773	1750
70°	1777	1605	1594
75°	1557	1403	1445
80°	1288	1146	1173
85°	875	724	735

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2379 cd/sqm

TEST NUMBER: P919264

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	126.1	2.0
10°-20°	354.9	5.5
20°-30°	521.5	8.1
30°-40°	605.7	9.4
40°-50°	605.0	9.4
50°-60°	527.5	8.2
60°-70°	389.9	6.0
70°-80°	220.6	3.4
80°-90°	61.3	0.9
90°-100°	67.4	1.0
100°-110°	214.2	3.3
110°-120°	366.5	5.7
120°-130°	482.0	7.5
130°-140°	541.0	8.4
140°-150°	530.5	8.2
150°-160°	445.0	6.9
160°-170°	295.1	4.6
170°-180°	103.2	1.6
0°-30°	1002.5	15.5
0°-40°	1608.3	24.9
0°-60°	2740.7	42.4
0°-90°	3412.6	52.8
90°-120°	648.0	10.0
90°-150°	2201.5	34.1
90°-180°	3045.0	47.2
0°-180°	6457.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1340	1340	1340	1340	1340	
5°	1340	1335	1321	1331	1329	127
15°	1276	1268	1251	1256	1250	359
25°	1154	1144	1122	1125	1122	531
35°	996	983	963	955	948	622
45°	810	802	782	768	763	626
55°	614	606	590	575	568	548
65°	414	406	393	381	375	409
75°	216	214	207	200	202	231
85°	53	52	50	46	45	59
90°	1	12	32	30	31	6
95°	48	57	59	59	57	53
105°	198	200	202	204	204	209
115°	368	373	371	370	368	364
125°	535	543	540	538	537	478
135°	692	702	704	703	700	535
145°	840	846	852	853	849	525
155°	960	963	966	971	968	442
165°	1045	1044	1044	1050	1046	295
175°	1087	1085	1083	1089	1084	103
180°	1089	1089	1089	1089	1089	

TEST NUMBER: P919264

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1340.1	1340.1	1340.1	1340.1	1340.1
2.5°	1347.9	1341.4	1327.2	1340.1	1337.6
5°	1340.1	1335.0	1320.8	1331.0	1328.6
7.5°	1331.0	1323.4	1309.1	1319.6	1317.0
10°	1317.0	1307.9	1292.5	1302.8	1298.9
12.5°	1297.5	1289.9	1274.4	1280.9	1278.2
15°	1275.7	1268.0	1251.2	1256.4	1250.0
17.5°	1248.6	1241.0	1224.2	1230.5	1224.2
20°	1218.9	1211.3	1193.3	1197.0	1192.1
22.5°	1189.4	1177.8	1161.0	1161.0	1158.4
25°	1154.5	1144.3	1122.4	1124.9	1122.4
27.5°	1115.9	1106.8	1090.2	1086.3	1079.9
30°	1077.3	1066.9	1047.7	1043.8	1038.6
32.5°	1036.0	1028.4	1007.7	1000.0	994.7
35°	996.1	983.3	962.6	954.8	948.4
37.5°	951.0	939.3	918.7	909.7	903.3
40°	904.7	894.2	873.6	862.1	857.0
42.5°	859.5	849.1	828.6	815.6	808.0
45°	810.5	801.6	782.1	768.1	762.8
47.5°	762.8	753.8	733.2	719.0	711.4
50°	712.6	706.1	688.1	670.0	663.6
52.5°	663.6	654.6	637.9	623.7	614.7
55°	613.5	605.6	590.2	574.7	568.3
57.5°	563.1	556.7	539.8	524.4	519.3
60°	512.8	507.7	489.7	475.5	471.7
62.5°	463.9	454.9	442.0	429.1	424.0
65°	413.7	405.9	393.0	381.4	375.1
67.5°	362.1	355.6	344.1	335.1	329.9
70°	314.4	309.3	297.6	288.6	283.5
72.5°	265.5	260.3	253.9	244.9	241.0
75°	216.5	214.0	207.4	199.8	202.3
77.5°	172.6	167.5	164.9	161.0	157.2
80°	128.9	127.5	124.9	121.1	118.6
82.5°	87.6	87.6	86.4	81.2	81.2
85°	52.8	51.6	50.3	46.3	45.1
87.5°	23.2	20.7	18.1	14.2	12.8
90°	0.9	11.8	32.2	30.2	31.2
92.5°	20.3	27.6	28.6	29.5	29.5
95°	48.0	57.2	58.8	58.8	57.2
97.5°	79.8	88.3	92.0	92.0	92.0
100°	116.6	124.2	126.7	126.7	125.8
102.5°	155.3	160.9	164.5	165.5	164.5
105°	197.7	200.3	202.2	203.9	203.9
107.5°	239.7	243.7	243.7	244.3	239.7
110°	280.4	285.7	285.7	285.7	283.1

TEST NUMBER: P919264

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	324.4	330.0	329.0	326.4	324.4
115°	367.7	373.1	371.3	370.4	367.7
117.5°	410.8	418.0	413.5	410.8	408.2
120°	454.2	461.3	454.2	454.2	451.2
122.5°	493.5	502.7	498.2	495.5	493.5
125°	534.9	543.1	540.5	537.5	536.6
127.5°	575.3	585.5	581.9	577.9	575.3
130°	613.0	624.9	623.3	621.3	617.7
132.5°	655.4	664.6	665.3	660.6	658.1
135°	691.9	702.1	704.0	703.0	700.4
137.5°	732.6	740.8	742.4	741.7	737.9
140°	768.4	776.6	781.2	781.2	777.6
142.5°	805.2	813.4	816.0	817.0	813.4
145°	840.0	846.5	851.8	852.8	849.2
147.5°	871.2	879.3	883.3	884.9	881.3
150°	903.4	909.0	912.6	915.5	912.6
152.5°	931.9	937.5	942.1	945.7	942.1
155°	960.4	963.1	966.0	970.7	967.7
157.5°	985.2	987.0	988.7	995.3	990.7
160°	1007.1	1009.1	1010.0	1015.6	1011.7
162.5°	1027.4	1027.4	1028.5	1034.7	1030.1
165°	1044.9	1043.9	1043.9	1050.4	1045.9
167.5°	1060.7	1057.6	1057.6	1064.3	1059.6
170°	1072.5	1069.8	1068.8	1075.4	1069.8
172.5°	1080.6	1078.1	1077.0	1083.7	1078.1
175°	1087.3	1084.6	1082.6	1089.2	1083.7
177.5°	1090.9	1088.2	1086.2	1091.8	1086.2
180°	1089.2	1089.2	1089.2	1089.2	1089.2

TEST NUMBER: P919264

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.12	12.00	12.05	12.95	14.18	10.68	11.57	11.61	12.52	13.75
	3H	12.76	13.55	13.70	14.51	15.77	12.28	13.07	13.22	14.03	15.29
	4H	13.33	14.09	14.29	15.05	16.31	12.85	13.60	13.81	14.57	15.83
	6H	13.72	14.41	14.69	15.38	16.66	13.23	13.93	14.20	14.90	16.17
	8H	13.82	14.48	14.79	15.46	16.74	13.33	13.99	14.31	14.98	16.25
	12H	13.86	14.49	14.84	15.47	16.76	13.36	13.99	14.35	14.97	16.27
4H	2H	11.57	12.32	12.53	13.29	14.55	11.22	11.97	12.18	12.94	14.20
	3H	13.41	14.04	14.39	15.04	16.31	13.01	13.64	13.99	14.64	15.91
	4H	14.11	14.69	15.10	15.68	16.98	13.70	14.27	14.68	15.26	16.56
	6H	14.61	15.11	15.61	16.12	17.41	14.19	14.69	15.19	15.70	17.00
	8H	14.75	15.21	15.75	16.22	17.53	14.33	14.79	15.32	15.79	17.11
	12H	14.82	15.23	15.83	16.25	17.57	14.38	14.80	15.40	15.82	17.14
8H	4H	14.30	14.76	15.30	15.77	17.08	13.93	14.40	14.93	15.40	16.71
	6H	14.91	15.29	15.93	16.34	17.65	14.54	14.92	15.56	15.96	17.27
	8H	15.12	15.45	16.15	16.49	17.82	14.74	15.07	15.77	16.11	17.43
	12H	15.24	15.53	16.27	16.56	17.93	14.84	15.14	15.87	16.16	17.54
12H	4H	14.29	14.70	15.30	15.72	17.04	13.92	14.34	14.94	15.36	16.68
	6H	14.93	15.27	15.96	16.30	17.63	14.57	14.91	15.60	15.94	17.27
	8H	15.16	15.46	16.19	16.49	17.86	14.79	15.09	15.83	16.12	17.49