

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919267

Luminaire Tested: DFN2DIP-PN2F0-040D040US935-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919267
REPORT IS A COMBINATION OF REPORTS P901006 AND P897905
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-040D040US935-RLLONL
Description: 2 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6336.9 lumens
Efficiency: N/A
Efficacy: 90.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 70.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919267

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US935-RLLONL

Luminous Intensity Polar Plot

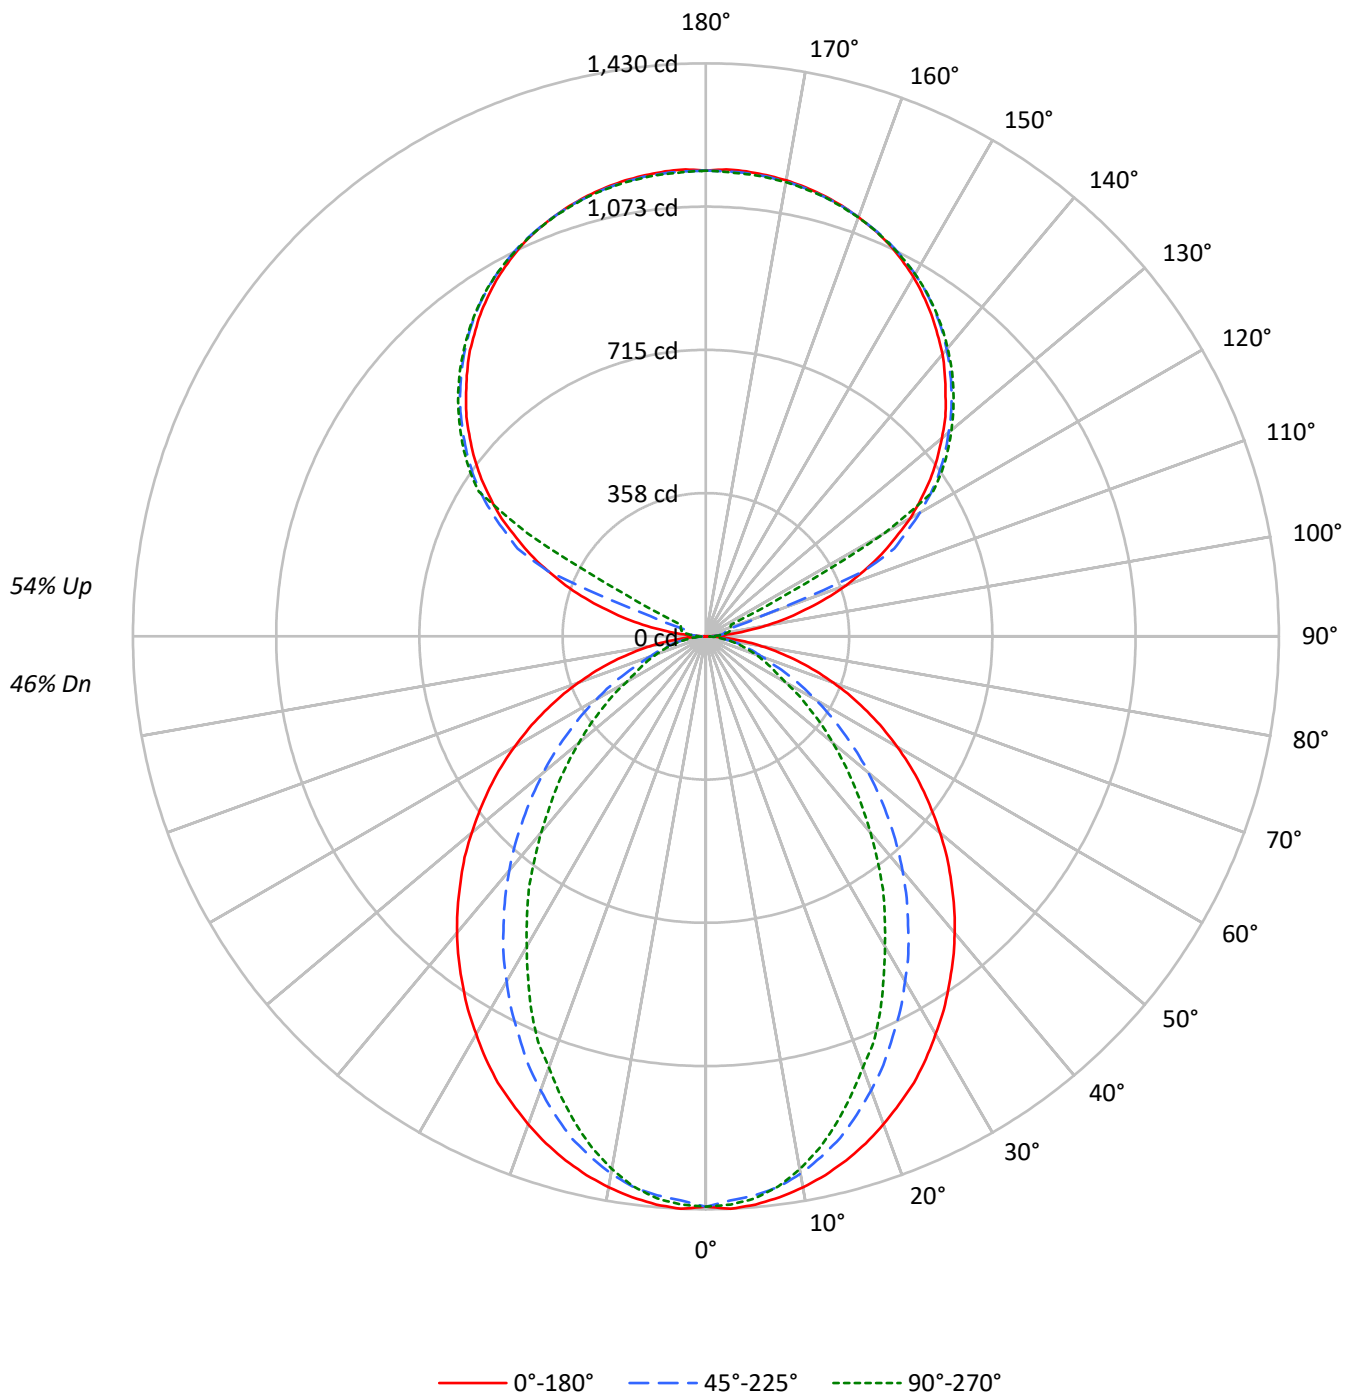

TEST NUMBER: P919267

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3083	3083	3083
5°	3083	3027	3049
10°	3048	2961	2945
15°	3000	2857	2788
20°	2940	2716	2596
25°	2878	2559	2411
30°	2797	2399	2178
35°	2717	2228	1973
40°	2635	2051	1739
45°	2540	1855	1528
50°	2442	1658	1321
55°	2339	1449	1123
60°	2220	1232	920
65°	2082	1011	823
70°	1915	806	738
75°	1704	698	663
80°	1402	566	561
85°	918	353	399

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2540 cd/sqm

TEST NUMBER: P919267

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US935-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	133.4	2.1
10°-20°	366.2	5.8
20°-30°	514.2	8.1
30°-40°	560.5	8.8
40°-50°	515.1	8.1
50°-60°	404.5	6.4
60°-70°	263.3	4.2
70°-80°	135.6	2.1
80°-90°	36.6	0.6
90°-100°	38.3	0.6
100°-110°	142.9	2.3
110°-120°	378.9	6.0
120°-130°	628.5	9.9
130°-140°	667.6	10.5
140°-150°	620.4	9.8
150°-160°	498.8	7.9
160°-170°	321.4	5.1
170°-180°	110.6	1.7
0°-30°	1013.8	16.0
0°-40°	1574.2	24.8
0°-60°	2493.9	39.4
0°-90°	2929.4	46.2
90°-120°	560.1	8.8
90°-150°	2476.6	39.1
90°-180°	3407.0	53.8
0°-180°	6336.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1423	1423	1423	1423	1423	
5°	1423	1417	1400	1412	1408	135
15°	1354	1340	1296	1271	1259	382
25°	1229	1188	1103	1050	1030	565
35°	1059	993	880	799	770	663
45°	866	779	644	553	522	668
55°	658	558	419	341	317	588
65°	444	340	224	180	176	441
75°	237	147	103	94	93	251
85°	55	28	24	24	24	64
90°	1	10	17	21	23	6
95°	55	27	33	37	36	65
105°	256	281	51	60	64	273
115°	484	498	519	130	69	476
125°	684	695	711	717	719	610
135°	846	860	867	876	874	654
145°	982	981	995	1001	997	614
155°	1081	1073	1083	1088	1082	498
165°	1139	1134	1136	1142	1136	322
175°	1165	1159	1161	1166	1158	111
180°	1162	1162	1162	1162	1162	

TEST NUMBER: P919267

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1423.4	1423.4	1423.4	1423.4	1423.4
2.5°	1429.9	1423.4	1409.2	1422.2	1419.5
5°	1423.4	1416.9	1400.2	1411.8	1408.0
7.5°	1411.8	1404.1	1386.1	1391.1	1384.7
10°	1396.4	1387.3	1361.6	1357.6	1350.0
12.5°	1377.1	1365.5	1330.6	1322.9	1308.7
15°	1353.8	1339.6	1295.9	1271.4	1258.6
17.5°	1326.8	1306.1	1252.0	1223.7	1203.1
20°	1295.9	1270.1	1205.7	1173.5	1145.1
22.5°	1262.4	1232.8	1158.0	1114.2	1095.0
25°	1228.9	1187.7	1102.6	1049.9	1030.4
27.5°	1189.0	1145.1	1051.1	990.6	960.9
30°	1146.5	1097.4	994.4	928.8	894.0
32.5°	1105.3	1045.9	940.4	863.1	830.8
35°	1058.9	993.2	879.9	798.7	770.2
37.5°	1013.8	942.9	823.1	734.2	702.1
40°	966.1	888.9	763.9	672.4	638.9
42.5°	917.1	834.7	704.6	609.2	577.1
45°	865.6	779.3	644.1	552.6	521.7
47.5°	816.7	725.3	586.2	494.6	466.3
50°	762.6	671.1	529.4	440.5	413.5
52.5°	709.7	613.1	475.4	390.3	365.8
55°	658.2	557.8	418.6	341.4	316.9
57.5°	605.5	502.4	368.4	296.3	275.7
60°	551.3	448.2	315.6	249.9	229.4
62.5°	498.6	395.5	270.4	208.7	198.5
65°	444.4	340.0	224.1	180.4	176.4
67.5°	393.0	288.5	180.4	158.4	154.5
70°	338.8	238.3	149.4	136.6	131.3
72.5°	287.3	191.9	124.9	114.7	112.1
75°	236.9	146.8	103.1	94.0	92.8
77.5°	186.8	104.3	81.2	76.0	73.4
80°	140.3	74.7	61.7	56.7	56.7
82.5°	97.9	50.3	42.5	39.9	39.9
85°	55.4	28.3	24.5	24.5	24.5
87.5°	20.7	10.2	10.2	9.0	9.0
90°	0.8	10.1	16.8	21.1	22.6
92.5°	21.1	17.7	20.1	21.9	22.6
95°	54.6	26.9	32.7	37.0	36.2
97.5°	98.4	29.4	42.9	45.5	46.2
100°	148.9	33.7	48.0	54.6	56.3
102.5°	204.3	202.8	49.6	58.8	61.4
105°	255.6	280.9	51.3	60.5	63.9
107.5°	315.4	336.4	53.0	62.3	65.6
110°	372.6	390.2	147.2	63.1	66.4

TEST NUMBER: P919267

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	426.5	441.5	427.2	64.7	67.3
115°	483.5	497.8	518.9	129.5	69.1
117.5°	533.2	550.0	564.4	444.0	223.7
120°	588.8	601.3	616.5	626.6	513.1
122.5°	635.8	649.3	666.2	671.1	672.0
125°	683.7	694.7	710.7	716.6	719.1
127.5°	727.5	739.3	751.9	760.3	761.1
130°	768.7	782.2	791.3	800.6	799.9
132.5°	810.7	821.7	830.9	838.5	837.8
135°	846.1	859.6	867.1	875.5	873.9
137.5°	883.0	893.1	901.6	910.0	907.5
140°	919.2	926.0	935.2	942.8	938.6
142.5°	949.6	955.4	966.4	973.0	968.9
145°	981.5	980.7	994.9	1000.8	996.6
147.5°	1009.2	1006.7	1021.0	1025.2	1021.9
150°	1036.1	1030.3	1043.8	1048.8	1044.6
152.5°	1058.9	1052.1	1064.7	1069.8	1063.9
155°	1080.7	1073.2	1083.3	1088.3	1081.6
157.5°	1098.4	1091.7	1099.3	1105.2	1098.4
160°	1113.5	1108.4	1113.5	1118.5	1112.7
162.5°	1127.0	1122.0	1126.2	1132.0	1124.5
165°	1138.8	1133.8	1136.3	1142.1	1136.3
167.5°	1148.1	1142.9	1145.6	1151.4	1143.8
170°	1155.6	1150.6	1152.2	1158.1	1150.6
172.5°	1160.6	1155.6	1157.4	1163.2	1155.6
175°	1164.8	1158.9	1160.6	1166.5	1158.1
177.5°	1166.5	1160.6	1161.5	1167.4	1159.9
180°	1162.3	1162.3	1162.3	1162.3	1162.3

TEST NUMBER: P919267

CATALOG NUMBER: DFN2DIP-PN2F0-040D040US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.58	11.38	11.57	12.38	13.71	6.55	7.35	7.54	8.35	9.68
	3H	12.23	12.95	13.24	13.96	15.31	7.72	8.43	8.72	9.44	10.79
	4H	12.83	13.50	13.85	14.52	15.87	8.15	8.83	9.17	9.84	11.20
	6H	13.23	13.85	14.26	14.87	16.24	8.46	9.08	9.49	10.10	11.47
	8H	13.35	13.94	14.38	14.97	16.34	8.54	9.13	9.57	10.17	11.53
	12H	13.40	13.96	14.44	14.99	16.38	8.57	9.14	9.61	10.17	11.55
4H	2H	10.59	11.27	11.61	12.28	13.64	7.13	7.80	8.15	8.82	10.17
	3H	12.39	12.96	13.43	14.00	15.37	8.46	9.02	9.49	10.06	11.43
	4H	13.07	13.58	14.11	14.62	16.01	8.99	9.50	10.03	10.54	11.93
	6H	13.56	14.00	14.61	15.06	16.45	9.39	9.83	10.44	10.89	12.27
	8H	13.72	14.14	14.78	15.19	16.59	9.51	9.92	10.56	10.97	12.37
	12H	13.81	14.18	14.88	15.24	16.65	9.56	9.93	10.63	11.00	12.40
8H	4H	13.03	13.44	14.08	14.49	15.89	9.25	9.67	10.30	10.72	12.12
	6H	13.57	13.91	14.65	15.00	16.40	9.75	10.09	10.82	11.18	12.58
	8H	13.77	14.07	14.86	15.15	16.57	9.93	10.22	11.01	11.30	12.72
	12H	13.90	14.16	14.98	15.23	16.69	10.03	10.29	11.11	11.36	12.82
12H	4H	12.98	13.35	14.05	14.42	15.82	9.25	9.63	10.32	10.69	12.10
	6H	13.54	13.84	14.63	14.92	16.34	9.79	10.09	10.87	11.17	12.59
	8H	13.75	14.01	14.83	15.08	16.54	9.98	10.25	11.07	11.32	12.78

END OF REPORT