

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919302

Luminaire Tested: DFN2DIP-PN2F0-060D030US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919302
REPORT IS A COMBINATION OF REPORTS P899480 AND P896349
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-060D030US935-RLLFLL
Description: 2 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6677.0 lumens
Efficiency: N/A
Efficacy: 80.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 83.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919302

CATALOG NUMBER: DFN2DIP-PN2F0-060D030US935-RLLFLL

Luminous Intensity Polar Plot

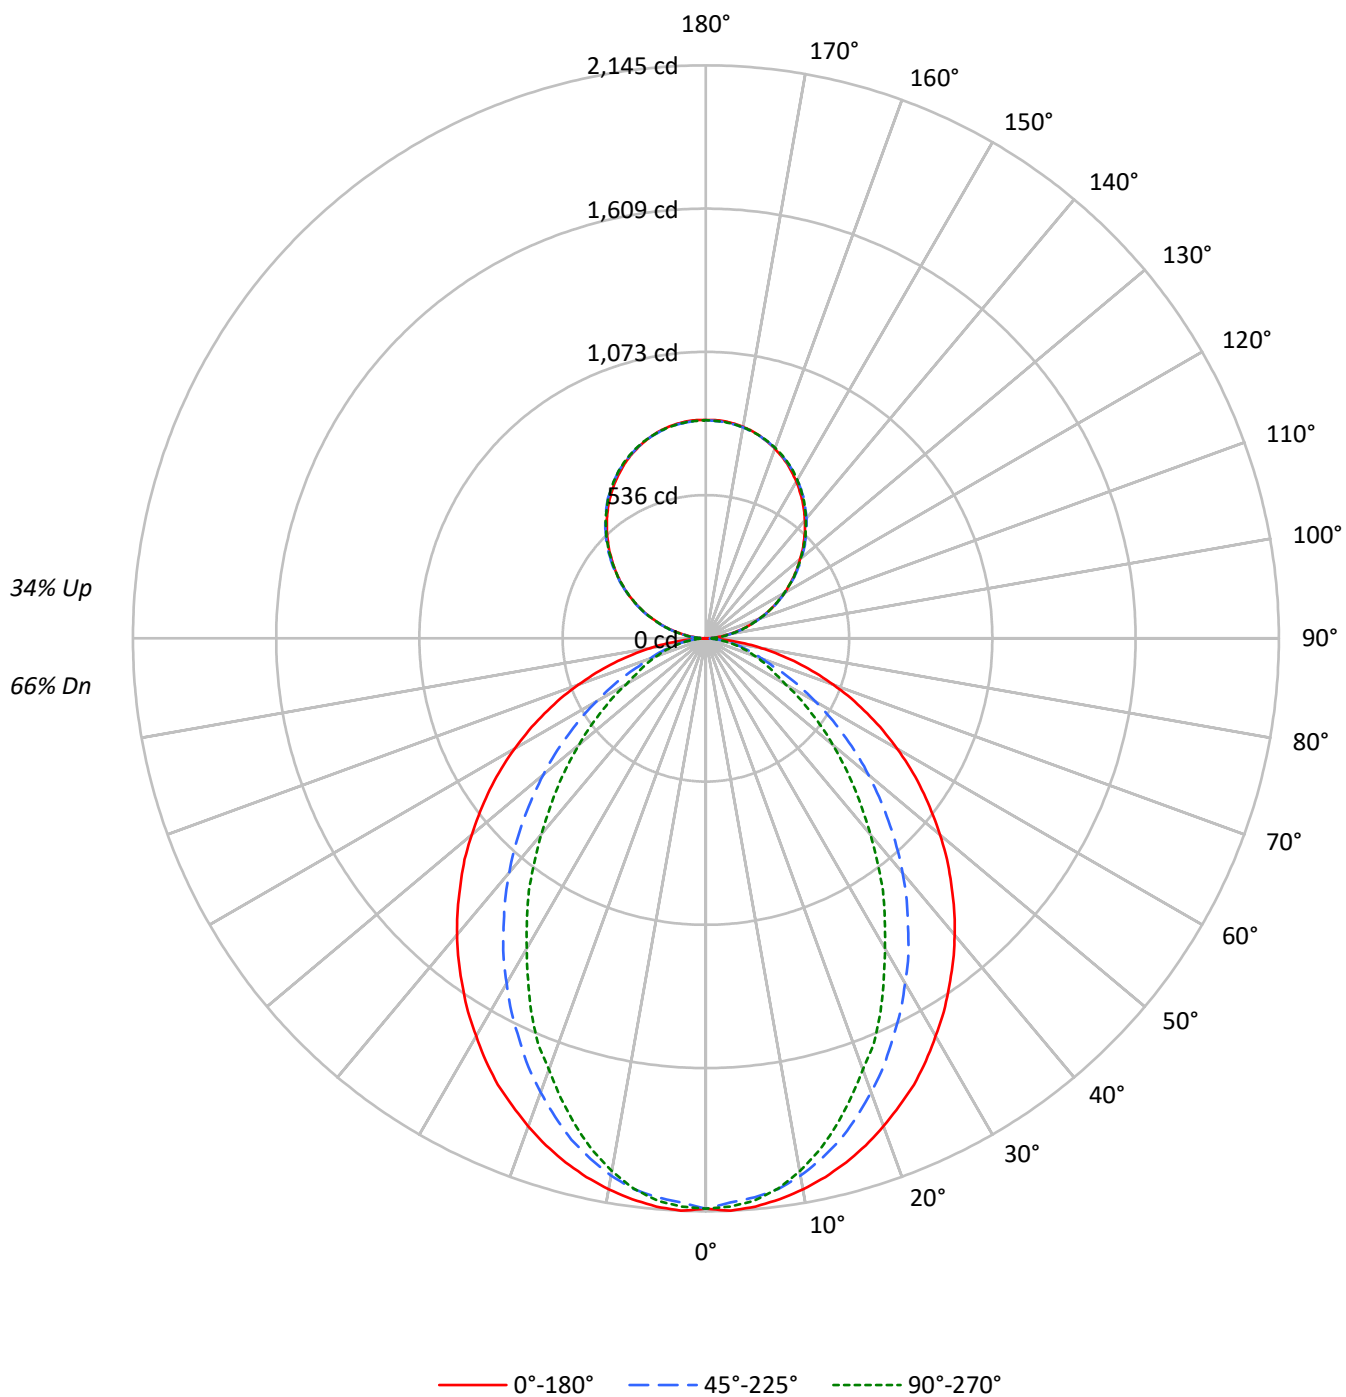

TEST NUMBER: P919302

CATALOG NUMBER: DFN2DIP-PN2F0-060D030US935-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92	81	81	81	71	71	71
1	102	98	94	91	96	92	89	86	82	79	77	72	70	69	63	62	61
2	93	86	80	75	88	81	76	72	72	68	65	64	61	58	57	54	52
3	86	76	69	63	80	72	66	61	65	59	55	57	53	50	51	48	45
4	79	68	60	54	74	65	58	52	58	52	48	52	47	44	46	42	40
5	73	61	53	47	68	58	51	45	52	46	42	47	42	38	42	38	35
6	67	55	47	41	63	52	45	40	47	41	37	42	38	34	38	34	31
7	62	50	42	37	59	48	40	35	43	37	33	39	34	30	35	31	28
8	58	46	38	33	55	44	37	32	40	34	29	36	31	27	32	28	25
9	54	42	35	29	51	40	33	29	36	31	27	33	28	25	30	26	23
10	51	39	31	27	48	37	30	26	34	28	24	31	26	23	28	24	21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4624	4624	4624
5°	4624	4541	4573
10°	4571	4442	4418
15°	4501	4286	4181
20°	4410	4074	3894
25°	4317	3839	3616
30°	4195	3599	3267
35°	4075	3341	2960
40°	3952	3076	2609
45°	3811	2783	2291
50°	3663	2488	1981
55°	3509	2174	1685
60°	3330	1848	1380
65°	3124	1517	1235
70°	2873	1208	1108
75°	2557	1045	994
80°	2104	849	842
85°	1375	529	598

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3811 cd/sqm

TEST NUMBER: P919302

CATALOG NUMBER: DFN2DIP-PN2F0-060D030US935-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	200.1	3.0
10°-20°	549.3	8.2
20°-30°	771.2	11.6
30°-40°	840.7	12.6
40°-50°	772.7	11.6
50°-60°	606.8	9.1
60°-70°	395.0	5.9
70°-80°	203.3	3.0
80°-90°	54.2	0.8
90°-100°	50.6	0.8
100°-110°	160.6	2.4
110°-120°	274.9	4.1
120°-130°	361.5	5.4
130°-140°	405.7	6.1
140°-150°	397.9	6.0
150°-160°	333.8	5.0
160°-170°	221.3	3.3
170°-180°	77.4	1.2
0°-30°	1520.7	22.8
0°-40°	2361.4	35.4
0°-60°	3740.9	56.0
0°-90°	4393.4	65.8
90°-120°	486.0	7.3
90°-150°	1651.1	24.7
90°-180°	2284.0	34.2
0°-180°	6677.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2135	2135	2135	2135	2135	
5°	2135	2126	2100	2118	2112	202
15°	2031	2009	1944	1907	1888	572
25°	1843	1782	1654	1575	1546	848
35°	1588	1490	1320	1198	1155	994
45°	1298	1169	966	829	782	1003
55°	987	837	628	512	475	882
65°	667	510	336	271	265	661
75°	356	220	154	141	139	376
85°	83	42	37	37	37	95
90°	1	9	24	23	23	7
95°	36	43	44	44	43	40
105°	148	150	152	153	153	156
115°	276	280	278	278	276	273
125°	401	407	405	403	402	358
135°	519	526	528	527	525	401
145°	630	635	639	640	637	394
155°	720	722	724	728	726	332
165°	784	783	783	788	784	221
175°	816	814	812	817	813	77
180°	817	817	817	817	817	

TEST NUMBER: P919302

CATALOG NUMBER: DFN2DIP-PN2F0-060D030US935-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2135.1	2135.1	2135.1	2135.1	2135.1
2.5°	2144.7	2135.1	2113.7	2133.2	2129.3
5°	2135.1	2125.5	2100.2	2117.7	2111.9
7.5°	2117.7	2106.2	2079.1	2086.7	2077.1
10°	2094.5	2080.9	2042.5	2036.5	2025.0
12.5°	2065.6	2048.1	1995.9	1984.4	1963.1
15°	2030.7	2009.4	1943.8	1907.1	1887.8
17.5°	1990.2	1959.2	1878.0	1835.6	1804.7
20°	1943.8	1905.0	1808.5	1760.3	1717.7
22.5°	1893.6	1849.1	1737.0	1671.4	1642.4
25°	1843.4	1781.5	1654.0	1574.9	1545.7
27.5°	1783.6	1717.7	1576.7	1485.8	1441.4
30°	1719.8	1646.1	1491.6	1393.2	1340.9
32.5°	1657.9	1568.9	1410.7	1294.6	1246.2
35°	1588.4	1489.8	1319.8	1198.0	1155.4
37.5°	1520.7	1414.3	1234.8	1101.3	1053.1
40°	1449.1	1333.3	1145.7	1008.6	958.4
42.5°	1375.8	1252.1	1057.0	913.9	865.7
45°	1298.5	1168.9	966.2	828.8	782.5
47.5°	1225.1	1088.0	879.3	741.9	699.5
50°	1143.9	1006.8	794.2	660.7	620.3
52.5°	1064.5	919.6	713.0	585.5	548.8
55°	987.3	836.6	627.9	512.1	475.4
57.5°	908.2	753.5	552.7	444.4	413.5
60°	827.0	672.4	473.4	375.0	344.0
62.5°	747.9	593.3	405.7	313.1	297.6
65°	666.7	510.1	336.2	270.6	264.7
67.5°	589.4	432.7	270.6	237.6	231.9
70°	508.2	357.5	224.0	204.8	197.0
72.5°	430.9	287.8	187.4	172.0	168.1
75°	355.5	220.2	154.5	141.0	139.2
77.5°	280.3	156.4	121.7	114.0	110.1
80°	210.5	112.1	92.6	85.1	85.1
82.5°	146.8	75.4	63.7	59.8	59.8
85°	83.0	42.4	36.7	36.7	36.7
87.5°	31.0	15.4	15.4	13.5	13.5
90°	0.8	8.9	24.1	22.6	23.4
92.5°	15.2	20.7	21.4	22.1	22.1
95°	36.0	42.9	44.1	44.1	42.9
97.5°	59.8	66.2	69.0	69.0	69.0
100°	87.4	93.1	95.1	95.1	94.4
102.5°	116.5	120.7	123.4	124.2	123.4
105°	148.3	150.2	151.7	152.9	152.9
107.5°	179.8	182.7	182.7	183.2	179.8
110°	210.3	214.3	214.3	214.3	212.3



TEST NUMBER: P919302

CATALOG NUMBER: DFN2DIP-PN2F0-060D030US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	243.3	247.5	246.8	244.8	243.3
115°	275.9	279.7	278.5	277.8	275.9
117.5°	308.1	313.5	310.0	308.1	306.1
120°	340.6	346.0	340.6	340.6	338.4
122.5°	370.1	377.0	373.6	371.6	370.1
125°	401.2	407.3	405.4	403.1	402.4
127.5°	431.4	439.1	436.4	433.4	431.4
130°	459.8	468.6	467.4	466.0	463.2
132.5°	491.5	498.4	498.9	495.5	493.5
135°	518.9	526.5	528.0	527.3	525.3
137.5°	549.4	555.6	556.8	556.4	553.4
140°	576.3	582.5	585.9	585.9	583.2
142.5°	603.9	610.0	612.0	612.8	610.0
145°	630.0	634.9	638.9	639.5	636.9
147.5°	653.4	659.5	662.5	663.7	661.0
150°	677.5	681.7	684.4	686.6	684.4
152.5°	699.0	703.1	706.5	709.3	706.5
155°	720.4	722.3	724.5	728.0	725.8
157.5°	738.8	740.3	741.6	746.5	743.0
160°	755.4	756.8	757.6	761.7	758.8
162.5°	770.6	770.6	771.4	776.0	772.6
165°	783.7	782.9	782.9	787.8	784.4
167.5°	795.5	793.2	793.2	798.1	794.7
170°	804.3	802.4	801.7	806.6	802.4
172.5°	810.5	808.6	807.8	812.7	808.6
175°	815.5	813.5	812.0	816.9	812.7
177.5°	818.1	816.1	814.7	818.9	814.7
180°	816.9	816.9	816.9	816.9	816.9

TEST NUMBER: P919302

CATALOG NUMBER: DFN2DIP-PN2F0-060D030US935-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.71	14.69	14.53	15.52	16.55	9.68	10.66	10.49	11.49	12.52
	3H	15.38	16.25	16.21	17.10	18.15	10.86	11.74	11.69	12.58	13.64
	4H	15.98	16.81	16.83	17.66	18.72	11.31	12.13	12.15	12.98	14.05
	6H	16.39	17.15	17.25	18.01	19.09	11.62	12.38	12.48	13.24	14.32
	8H	16.52	17.24	17.38	18.11	19.20	11.71	12.43	12.57	13.31	14.39
	12H	16.57	17.26	17.44	18.13	19.24	11.75	12.44	12.62	13.31	14.41
4H	2H	13.74	14.57	14.59	15.42	16.49	10.28	11.11	11.13	11.96	13.02
	3H	15.56	16.25	16.42	17.13	18.21	11.62	12.31	12.49	13.19	14.28
	4H	16.24	16.87	17.12	17.75	18.86	12.16	12.79	13.04	13.67	14.78
	6H	16.75	17.28	17.64	18.19	19.30	12.57	13.11	13.46	14.01	15.13
	8H	16.91	17.42	17.81	18.31	19.44	12.69	13.20	13.59	14.10	15.22
	12H	17.00	17.46	17.92	18.37	19.51	12.76	13.21	13.67	14.13	15.26
8H	4H	16.22	16.72	17.11	17.62	18.75	12.44	12.94	13.33	13.84	14.97
	6H	16.77	17.18	17.69	18.12	19.25	12.94	13.36	13.86	14.30	15.42
	8H	16.97	17.34	17.90	18.27	19.41	13.12	13.49	14.05	14.42	15.57
	12H	17.10	17.42	18.03	18.35	19.55	13.23	13.56	14.16	14.48	15.68
12H	4H	16.18	16.63	17.09	17.55	18.68	12.45	12.90	13.36	13.82	14.95
	6H	16.74	17.11	17.67	18.04	19.19	12.99	13.35	13.92	14.29	15.43
	8H	16.95	17.28	17.88	18.20	19.40	13.19	13.51	14.12	14.44	15.63

END OF REPORT