

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919312

Luminaire Tested: DFN2DIP-PN2F0-060D060US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919312
REPORT IS A COMBINATION OF REPORTS P899509 AND P896349
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-060D060US935-FLLFLL
Description: 2 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9686.2 lumens
Efficiency: N/A
Efficacy: 82.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 117.3
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919312

CATALOG NUMBER: DFN2DIP-PN2F0-060D060US935-FLLFLL

Luminous Intensity Polar Plot

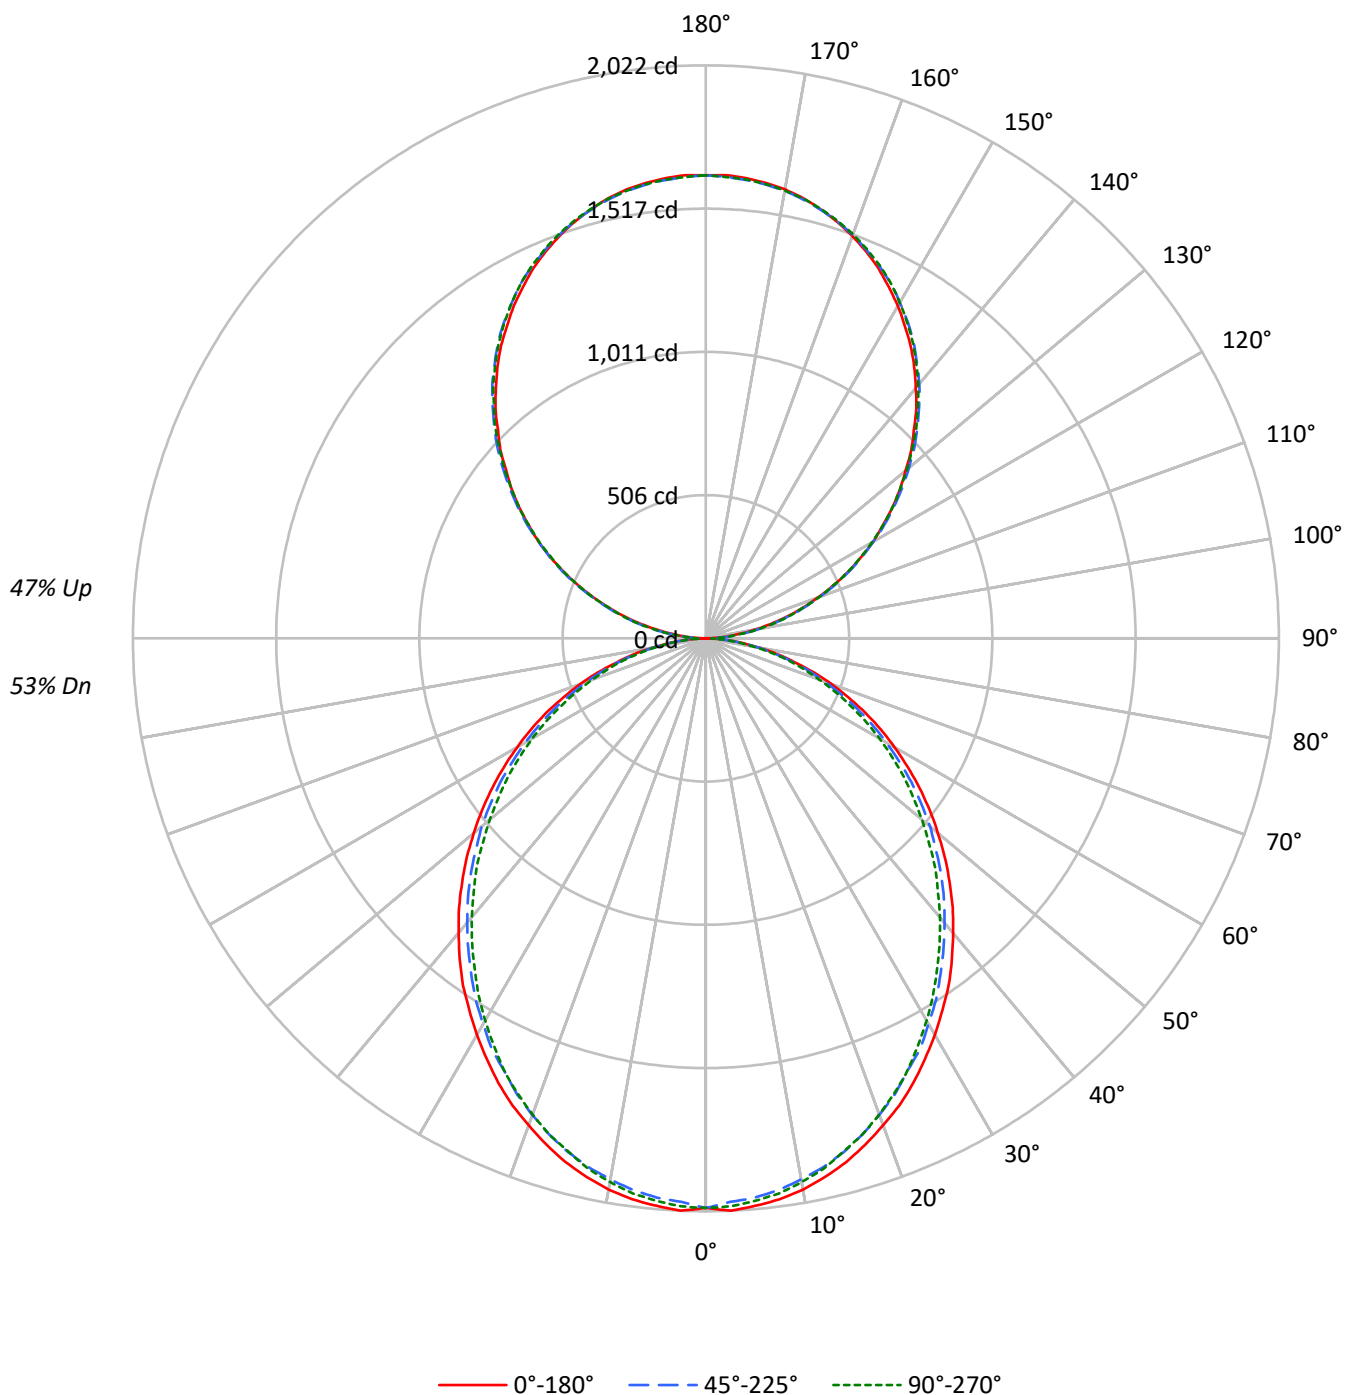

TEST NUMBER: P919312

CATALOG NUMBER: DFN2DIP-PN2F0-060D060US935-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4354	4354	4354
5°	4354	4284	4315
10°	4311	4217	4251
15°	4241	4138	4153
20°	4148	4032	4053
25°	4056	3908	3939
30°	3942	3791	3795
35°	3833	3655	3644
40°	3701	3518	3499
45°	3568	3379	3351
50°	3423	3233	3180
55°	3270	3065	3021
60°	3097	2867	2839
65°	2907	2660	2624
70°	2667	2407	2391
75°	2335	2105	2168
80°	1933	1719	1759
85°	1310	1086	1103

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3568 cd/sqm

TEST NUMBER: P919312

CATALOG NUMBER: DFN2DIP-PN2F0-060D060US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	189.2	2.0
10°-20°	532.3	5.5
20°-30°	782.3	8.1
30°-40°	908.6	9.4
40°-50°	907.5	9.4
50°-60°	791.3	8.2
60°-70°	584.9	6.0
70°-80°	330.9	3.4
80°-90°	92.0	0.9
90°-100°	101.1	1.0
100°-110°	321.2	3.3
110°-120°	549.7	5.7
120°-130°	723.0	7.5
130°-140°	811.5	8.4
140°-150°	795.8	8.2
150°-160°	667.5	6.9
160°-170°	442.7	4.6
170°-180°	154.7	1.6
0°-30°	1503.8	15.5
0°-40°	2412.4	24.9
0°-60°	4111.1	42.4
0°-90°	5119.0	52.8
90°-120°	972.0	10.0
90°-150°	3302.3	34.1
90°-180°	4567.0	47.1
0°-180°	9686.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2010	2010	2010	2010	2010	
5°	2010	2002	1981	1997	1993	191
15°	1914	1902	1877	1885	1875	539
25°	1732	1716	1684	1687	1684	797
35°	1494	1475	1444	1432	1422	933
45°	1216	1202	1173	1152	1144	938
55°	920	908	885	862	852	823
65°	620	609	590	572	562	614
75°	325	321	311	300	304	347
85°	79	77	75	70	68	88
90°	2	18	48	45	47	9
95°	72	86	88	88	86	80
105°	296	300	303	306	306	313
115°	552	560	557	556	552	546
125°	802	815	811	806	805	717
135°	1038	1053	1056	1055	1051	802
145°	1260	1270	1278	1279	1274	787
155°	1441	1445	1449	1456	1452	663
165°	1567	1566	1566	1576	1569	442
175°	1631	1627	1624	1634	1625	155
180°	1634	1634	1634	1634	1634	

TEST NUMBER: P919312

CATALOG NUMBER: DFN2DIP-PN2F0-060D060US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2010.1	2010.1	2010.1	2010.1	2010.1
2.5°	2021.8	2012.2	1990.8	2010.1	2006.4
5°	2010.1	2002.5	1981.2	1996.6	1992.9
7.5°	1996.6	1985.1	1963.8	1979.3	1975.5
10°	1975.5	1962.0	1938.7	1954.1	1948.4
12.5°	1946.4	1934.8	1911.7	1921.3	1917.4
15°	1913.5	1902.0	1876.8	1884.6	1875.0
17.5°	1872.9	1861.5	1836.3	1845.8	1836.3
20°	1828.4	1817.0	1789.8	1795.6	1788.0
22.5°	1784.2	1766.7	1741.5	1741.5	1737.6
25°	1731.8	1716.5	1683.6	1687.3	1683.6
27.5°	1673.8	1660.3	1635.2	1629.5	1619.9
30°	1616.0	1600.3	1571.5	1565.7	1557.9
32.5°	1554.0	1542.6	1511.6	1499.9	1492.1
35°	1494.2	1474.9	1443.9	1432.2	1422.5
37.5°	1426.5	1409.0	1378.1	1364.5	1354.9
40°	1356.9	1341.3	1310.4	1293.2	1285.4
42.5°	1289.3	1273.7	1242.9	1223.5	1211.9
45°	1215.9	1202.3	1173.2	1152.1	1144.3
47.5°	1144.3	1130.7	1099.8	1078.5	1066.9
50°	1068.8	1059.2	1032.2	1005.0	995.4
52.5°	995.4	981.9	956.8	935.6	922.0
55°	920.1	908.4	885.3	862.1	852.5
57.5°	844.7	835.1	809.9	786.7	778.9
60°	769.2	761.6	734.6	713.3	707.5
62.5°	695.8	682.3	663.0	643.7	635.9
65°	620.5	608.9	589.6	572.1	562.5
67.5°	543.2	533.4	516.2	502.7	494.8
70°	471.7	463.9	446.4	432.9	425.3
72.5°	398.2	390.5	380.8	367.3	361.5
75°	324.6	321.0	311.1	299.6	303.5
77.5°	259.0	251.2	247.3	241.6	235.8
80°	193.4	191.3	187.4	181.7	177.8
82.5°	131.5	131.5	129.6	121.8	121.8
85°	79.1	77.3	75.4	69.5	67.7
87.5°	34.9	31.0	27.0	21.4	19.3
90°	1.5	17.7	48.3	45.3	46.8
92.5°	30.6	41.4	42.9	44.3	44.3
95°	71.9	85.7	88.2	88.2	85.7
97.5°	119.7	132.5	137.9	137.9	137.9
100°	174.9	186.1	190.1	190.1	188.6
102.5°	233.0	241.3	246.8	248.2	246.8
105°	296.5	300.5	303.4	305.9	305.9
107.5°	359.6	365.5	365.5	366.4	359.6
110°	420.7	428.5	428.5	428.5	424.6



TEST NUMBER: P919312

CATALOG NUMBER: DFN2DIP-PN2F0-060D060US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	486.6	495.0	493.5	489.6	486.6
115°	551.6	559.6	557.1	555.6	551.6
117.5°	616.2	627.1	620.1	616.2	612.3
120°	681.2	692.1	681.2	681.2	676.7
122.5°	740.3	754.1	747.2	743.3	740.3
125°	802.4	814.7	810.7	806.3	804.9
127.5°	863.0	878.2	872.8	866.9	863.0
130°	919.6	937.4	934.9	931.9	926.5
132.5°	983.2	996.9	997.9	991.0	987.0
135°	1037.8	1053.1	1056.0	1054.6	1050.6
137.5°	1098.9	1111.2	1113.7	1112.7	1106.8
140°	1152.6	1164.9	1171.8	1171.8	1166.4
142.5°	1207.7	1220.0	1224.0	1225.5	1220.0
145°	1260.0	1269.8	1277.7	1279.2	1273.8
147.5°	1306.7	1319.0	1325.0	1327.4	1322.0
150°	1355.0	1363.4	1368.8	1373.2	1368.8
152.5°	1397.8	1406.3	1413.2	1418.6	1413.2
155°	1440.7	1444.7	1449.1	1456.0	1451.6
157.5°	1477.6	1480.7	1483.1	1493.0	1486.1
160°	1510.7	1513.6	1515.1	1523.4	1517.6
162.5°	1541.2	1541.2	1542.6	1552.0	1545.1
165°	1567.3	1565.8	1565.8	1575.7	1568.8
167.5°	1591.0	1586.6	1586.6	1596.4	1589.5
170°	1608.7	1604.7	1603.3	1613.1	1604.7
172.5°	1621.0	1617.0	1615.6	1625.4	1617.0
175°	1630.8	1626.9	1623.9	1633.8	1625.4
177.5°	1636.2	1632.4	1629.4	1637.7	1629.4
180°	1633.8	1633.8	1633.8	1633.8	1633.8

TEST NUMBER: P919312

CATALOG NUMBER: DFN2DIP-PN2F0-060D060US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.52	13.41	13.46	14.36	15.59	12.09	12.98	13.02	13.92	15.15
	3H	14.17	14.96	15.11	15.92	17.18	13.69	14.48	14.63	15.44	16.70
	4H	14.74	15.50	15.70	16.46	17.72	14.26	15.01	15.22	15.98	17.24
	6H	15.13	15.82	16.10	16.79	18.07	14.64	15.34	15.61	16.30	17.58
	8H	15.23	15.89	16.20	16.87	18.14	14.74	15.40	15.71	16.39	17.66
	12H	15.27	15.90	16.25	16.88	18.17	14.77	15.40	15.76	16.38	17.68
4H	2H	12.98	13.73	13.94	14.70	15.96	12.63	13.38	13.59	14.35	15.61
	3H	14.82	15.45	15.80	16.45	17.72	14.42	15.05	15.40	16.05	17.32
	4H	15.52	16.10	16.51	17.08	18.38	15.11	15.68	16.09	16.67	17.97
	6H	16.02	16.52	17.01	17.53	18.82	15.60	16.10	16.59	17.11	18.40
	8H	16.16	16.62	17.16	17.63	18.94	15.74	16.20	16.73	17.20	18.52
	12H	16.23	16.64	17.24	17.66	18.98	15.79	16.21	16.81	17.23	18.55
8H	4H	15.71	16.17	16.71	17.18	18.49	15.34	15.80	16.34	16.81	18.12
	6H	16.32	16.70	17.34	17.75	19.06	15.94	16.33	16.97	17.37	18.68
	8H	16.53	16.86	17.55	17.89	19.22	16.14	16.48	17.17	17.51	18.84
	12H	16.64	16.94	17.68	17.97	19.34	16.25	16.55	17.28	17.57	18.95
12H	4H	15.69	16.11	16.71	17.13	18.45	15.33	15.75	16.35	16.77	18.09
	6H	16.34	16.68	17.37	17.71	19.04	15.98	16.32	17.01	17.35	18.68
	8H	16.57	16.87	17.60	17.89	19.27	16.20	16.50	17.23	17.53	18.90