

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924679

Luminaire Tested: DFN2DIP-PN2F0-020D030US950-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924679
REPORT IS A COMBINATION OF REPORTS P900992 AND P897905
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-020D030US950-RLLONL
Description: 2 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4455.2 lumens
Efficiency: N/A
Efficacy: 126.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 35.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924679

CATALOG NUMBER: DFN2DIP-PN2F0-020D030US950-RLLONL

Luminous Intensity Polar Plot

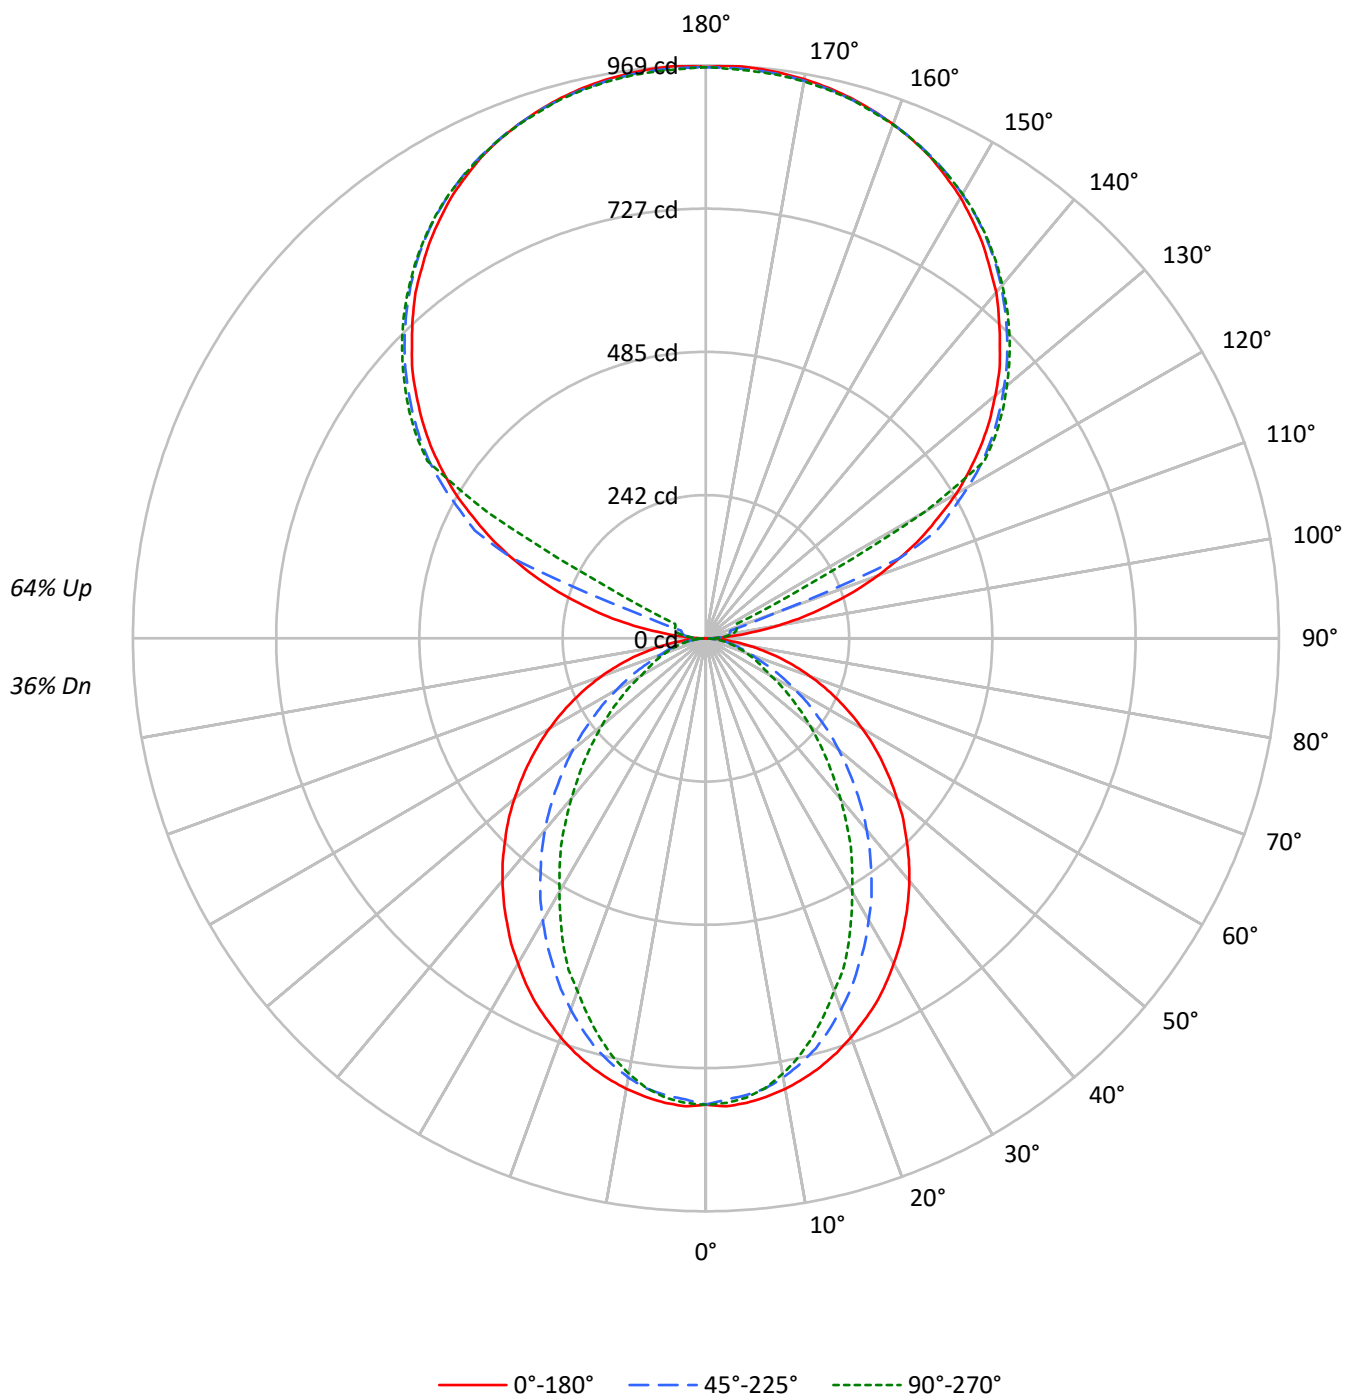

TEST NUMBER: P924679

CATALOG NUMBER: DFN2DIP-PN2F0-020D030US950-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	44	44	44
1	95	91	87	84	86	83	80	77	67	65	63	52	51	50	39	38	38
2	87	80	74	69	78	73	68	63	59	56	53	46	44	42	35	33	32
3	79	70	63	58	72	64	58	53	52	48	45	41	38	36	31	29	28
4	73	63	55	49	66	57	51	46	47	42	38	37	34	31	28	26	24
5	67	56	48	42	60	51	44	39	42	37	33	33	30	27	25	23	21
6	62	50	42	37	56	46	39	34	38	33	29	30	27	24	23	21	19
7	57	45	38	32	52	41	35	30	34	29	26	28	24	21	21	19	17
8	53	41	34	29	48	38	31	27	31	26	23	25	22	19	20	17	15
9	49	37	30	25	45	34	28	24	29	24	20	23	20	17	18	16	14
10	46	34	27	23	42	32	25	21	26	22	18	22	18	15	17	14	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1708	1708	1708
5°	1708	1677	1689
10°	1688	1641	1632
15°	1662	1583	1545
20°	1629	1505	1438
25°	1595	1418	1336
30°	1549	1329	1206
35°	1505	1234	1093
40°	1460	1136	963
45°	1407	1028	846
50°	1353	919	732
55°	1296	803	622
60°	1230	683	510
65°	1154	560	456
70°	1061	446	409
75°	945	386	367
80°	777	314	311
85°	507	194	220

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1407 cd/sqm

TEST NUMBER: P924679

CATALOG NUMBER: DFN2DIP-PN2F0-020D030US950-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	73.9	1.7
10°-20°	202.9	4.6
20°-30°	284.8	6.4
30°-40°	310.5	7.0
40°-50°	285.4	6.4
50°-60°	224.1	5.0
60°-70°	145.9	3.3
70°-80°	75.1	1.7
80°-90°	20.9	0.5
90°-100°	31.9	0.7
100°-110°	118.7	2.7
110°-120°	314.9	7.1
120°-130°	522.3	11.7
130°-140°	554.8	12.5
140°-150°	515.6	11.6
150°-160°	414.5	9.3
160°-170°	267.1	6.0
170°-180°	91.9	2.1
0°-30°	561.6	12.6
0°-40°	872.1	19.6
0°-60°	1381.7	31.0
0°-90°	1623.5	36.4
90°-120°	465.5	10.4
90°-150°	2058.1	46.2
90°-180°	2832.0	63.6
0°-180°	4455.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	789	789	789	789	789	
5°	789	785	776	782	780	75
15°	750	742	718	704	697	211
25°	681	658	611	582	571	313
35°	587	550	488	442	427	367
45°	480	432	357	306	289	370
55°	365	309	232	189	176	326
65°	246	188	124	100	98	244
75°	131	81	57	52	51	139
85°	31	16	14	14	14	35
90°	1	8	14	18	19	4
95°	45	22	27	31	30	54
105°	212	233	43	50	53	227
115°	402	414	431	108	57	396
125°	568	577	591	596	598	507
135°	703	714	721	728	726	543
145°	816	815	827	832	828	510
155°	898	892	900	904	899	414
165°	946	942	944	949	944	267
175°	968	963	964	969	962	92
180°	966	966	966	966	966	

TEST NUMBER: P924679

CATALOG NUMBER: DFN2DIP-PN2F0-020D030US950-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	788.6	788.6	788.6	788.6	788.6
2.5°	792.1	788.6	780.7	787.9	786.5
5°	788.6	785.0	775.7	782.2	780.0
7.5°	782.2	777.9	767.9	770.7	767.1
10°	773.6	768.5	754.3	752.1	747.9
12.5°	762.9	756.4	737.2	733.0	725.0
15°	750.0	742.1	717.9	704.3	697.3
17.5°	735.1	723.6	693.7	677.9	666.6
20°	717.9	703.6	668.0	650.2	634.4
22.5°	699.4	683.0	641.6	617.3	606.6
25°	680.9	658.0	610.8	581.7	570.9
27.5°	658.7	634.4	582.3	548.7	532.3
30°	635.2	608.0	550.9	514.6	495.2
32.5°	612.3	579.5	521.0	478.1	460.3
35°	586.6	550.3	487.5	442.5	426.7
37.5°	561.6	522.3	456.0	406.8	388.9
40°	535.2	492.5	423.2	372.5	353.9
42.5°	508.1	462.5	390.4	337.5	319.8
45°	479.6	431.7	356.9	306.1	289.0
47.5°	452.5	401.8	324.7	274.0	258.3
50°	422.5	371.9	293.4	244.0	229.2
52.5°	393.1	339.6	263.3	216.3	202.7
55°	364.6	309.0	231.9	189.2	175.5
57.5°	335.4	278.3	204.2	164.2	152.7
60°	305.5	248.3	174.9	138.5	127.1
62.5°	276.2	219.1	149.9	115.6	109.9
65°	246.2	188.4	124.2	100.0	97.8
67.5°	217.7	159.8	100.0	87.8	85.7
70°	187.7	132.0	82.7	75.7	72.8
72.5°	159.1	106.3	69.2	63.5	62.1
75°	131.3	81.3	57.0	52.1	51.4
77.5°	103.5	57.8	44.9	42.1	40.6
80°	77.8	41.4	34.2	31.4	31.4
82.5°	54.2	27.9	23.6	22.1	22.1
85°	30.6	15.6	13.5	13.5	13.5
87.5°	11.4	5.7	5.7	5.0	5.0
90°	0.7	8.4	13.9	17.6	18.8
92.5°	17.6	14.7	16.8	18.2	18.8
95°	45.4	22.3	27.2	30.8	30.1
97.5°	81.8	24.5	35.6	37.8	38.4
100°	123.7	28.0	39.9	45.4	46.8
102.5°	169.8	168.5	41.2	48.8	51.0
105°	212.5	233.4	42.6	50.3	53.1
107.5°	262.1	279.5	44.1	51.7	54.6
110°	309.7	324.3	122.3	52.5	55.2

TEST NUMBER: P924679

CATALOG NUMBER: DFN2DIP-PN2F0-020D030US950-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	354.4	366.9	355.1	53.8	55.9
115°	401.8	413.7	431.2	107.6	57.3
117.5°	443.1	457.1	469.0	369.0	185.9
120°	489.2	499.7	512.3	520.7	426.3
122.5°	528.3	539.6	553.6	557.7	558.5
125°	568.2	577.3	590.6	595.5	597.6
127.5°	604.5	614.3	624.9	631.8	632.5
130°	638.8	650.1	657.7	665.3	664.7
132.5°	673.7	682.9	690.5	696.8	696.1
135°	703.1	714.4	720.6	727.6	726.2
137.5°	733.8	742.2	749.3	756.2	754.1
140°	763.9	769.5	777.1	783.4	780.0
142.5°	789.1	794.0	803.1	808.6	805.2
145°	815.7	814.9	826.8	831.7	828.2
147.5°	838.7	836.6	848.5	851.9	849.2
150°	861.1	856.2	867.4	871.5	868.0
152.5°	879.9	874.3	884.8	889.0	884.2
155°	898.1	891.9	900.2	904.4	898.9
157.5°	912.8	907.3	913.6	918.4	912.8
160°	925.4	921.2	925.4	929.6	924.6
162.5°	936.5	932.3	935.9	940.7	934.4
165°	946.3	942.2	944.3	949.1	944.3
167.5°	954.0	949.8	951.9	956.9	950.6
170°	960.3	956.1	957.5	962.4	956.1
172.5°	964.5	960.3	961.7	966.6	960.3
175°	967.9	963.1	964.5	969.4	962.4
177.5°	969.4	964.5	965.3	970.1	963.8
180°	965.9	965.9	965.9	965.9	965.9

TEST NUMBER: P924679

CATALOG NUMBER: DFN2DIP-PN2F0-020D030US950-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.47	8.21	8.55	9.27	10.73	3.44	4.18	4.52	5.24	6.70
	3H	9.12	9.78	10.20	10.85	12.33	4.61	5.26	5.69	6.34	7.81
	4H	9.71	10.33	10.81	11.41	12.89	5.04	5.66	6.13	6.74	8.22
	6H	10.11	10.68	11.21	11.77	13.26	5.34	5.91	6.44	6.99	8.49
	8H	10.23	10.77	11.33	11.87	13.35	5.42	5.96	6.53	7.06	8.55
	12H	10.28	10.79	11.39	11.88	13.39	5.45	5.97	6.56	7.06	8.57
4H	2H	7.48	8.10	8.57	9.17	10.65	4.02	4.64	5.12	5.71	7.19
	3H	9.27	9.79	10.38	10.89	12.39	5.34	5.85	6.44	6.96	8.45
	4H	9.95	10.42	11.05	11.51	13.03	5.87	6.34	6.98	7.44	8.95
	6H	10.44	10.84	11.55	11.96	13.46	6.26	6.67	7.38	7.79	9.29
	8H	10.60	10.98	11.71	12.09	13.61	6.38	6.76	7.50	7.87	9.39
	12H	10.68	11.02	11.81	12.14	13.67	6.43	6.77	7.56	7.89	9.42
8H	4H	9.90	10.28	11.02	11.39	12.91	6.13	6.51	7.24	7.62	9.14
	6H	10.44	10.75	11.58	11.91	13.42	6.62	6.93	7.76	8.08	9.60
	8H	10.64	10.92	11.79	12.05	13.59	6.80	7.07	7.94	8.20	9.74
	12H	10.76	11.00	11.91	12.13	13.71	6.90	7.14	8.04	8.27	9.84
12H	4H	9.85	10.19	10.98	11.31	12.84	6.12	6.47	7.26	7.59	9.12
	6H	10.42	10.69	11.56	11.82	13.36	6.66	6.93	7.81	8.07	9.61
	8H	10.62	10.86	11.76	11.99	13.56	6.85	7.09	8.00	8.22	9.80

END OF REPORT