

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924753

Luminaire Tested: DFN2DIP-PN2F0-060D020US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924753
REPORT IS A COMBINATION OF REPORTS P900989 AND P897905
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-060D020US950-FLLONL
Description: 2 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7555.7 lumens
Efficiency: N/A
Efficacy: 93.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 80.6
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924753

CATALOG NUMBER: DFN2DIP-PN2F0-060D020US950-FLLONL

Luminous Intensity Polar Plot

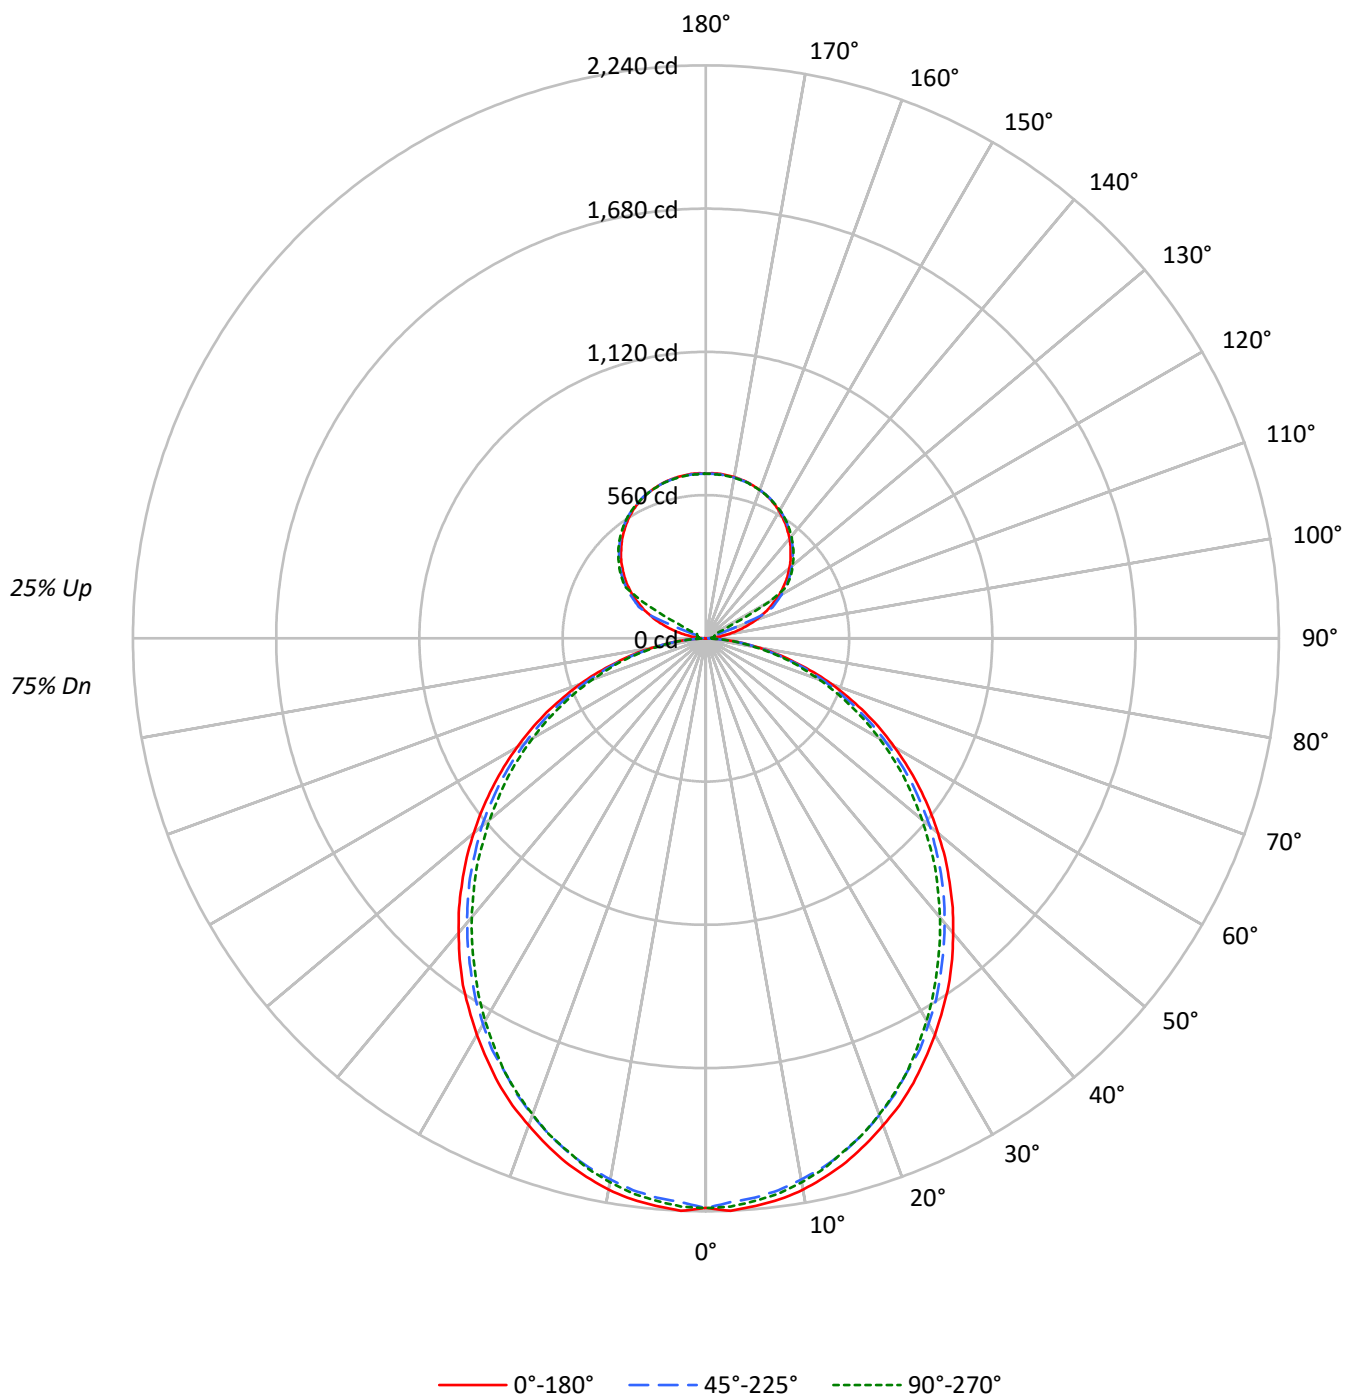

TEST NUMBER: P924753

CATALOG NUMBER: DFN2DIP-PN2F0-060D020US950-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	113	113	113	113	108	108	108	108	97	97	97	88	88	88	79	79	79
1	103	99	95	91	98	94	91	87	85	83	80	77	75	73	70	68	67
2	94	86	80	75	89	82	77	72	75	70	66	68	64	61	62	59	56
3	86	76	68	62	81	73	66	60	66	61	56	60	56	52	55	51	48
4	79	67	59	53	75	64	57	51	59	53	48	54	49	45	49	45	41
5	72	60	52	46	69	58	50	44	53	46	41	48	43	39	44	40	36
6	67	54	46	40	63	52	44	39	48	41	36	44	38	34	40	35	32
7	62	49	41	35	59	47	39	34	43	37	32	40	34	30	37	32	28
8	58	45	37	31	55	43	36	30	40	33	29	37	31	27	34	29	25
9	54	41	33	28	51	39	32	27	37	30	26	34	28	24	31	26	23
10	50	38	30	25	48	36	29	25	34	28	23	31	26	22	29	24	21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4824	4824	4824
5°	4824	4746	4781
10°	4777	4672	4710
15°	4699	4585	4602
20°	4596	4468	4491
25°	4494	4330	4365
30°	4368	4201	4205
35°	4247	4050	4038
40°	4100	3898	3877
45°	3954	3744	3713
50°	3793	3583	3523
55°	3623	3396	3347
60°	3432	3177	3145
65°	3221	2947	2907
70°	2954	2667	2650
75°	2588	2332	2402
80°	2142	1905	1949
85°	1453	1204	1222

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3954 cd/sqm

TEST NUMBER: P924753

CATALOG NUMBER: DFN2DIP-PN2F0-060D020US950-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	209.6	2.8
10°-20°	589.8	7.8
20°-30°	866.8	11.5
30°-40°	1006.7	13.3
40°-50°	1005.5	13.3
50°-60°	876.7	11.6
60°-70°	648.1	8.6
70°-80°	366.7	4.9
80°-90°	97.9	1.3
90°-100°	21.2	0.3
100°-110°	79.1	1.0
110°-120°	209.9	2.8
120°-130°	348.2	4.6
130°-140°	369.8	4.9
140°-150°	343.7	4.5
150°-160°	276.4	3.7
160°-170°	178.1	2.4
170°-180°	61.3	0.8
0°-30°	1666.2	22.1
0°-40°	2673.0	35.4
0°-60°	4555.2	60.3
0°-90°	5667.9	75.0
90°-120°	310.3	4.1
90°-150°	1372.0	18.2
90°-180°	1888.0	25.0
0°-180°	7555.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2227	2227	2227	2227	2227	
5°	2227	2219	2195	2212	2208	211
15°	2120	2108	2080	2088	2078	597
25°	1919	1902	1866	1870	1866	883
35°	1656	1634	1600	1587	1576	1034
45°	1347	1332	1300	1276	1268	1040
55°	1020	1007	981	955	945	912
65°	688	675	653	634	623	680
75°	360	356	345	332	336	384
85°	88	86	84	77	75	98
90°	0	6	9	12	13	7
95°	30	15	18	20	20	36
105°	142	156	28	34	35	151
115°	268	276	288	72	38	264
125°	379	385	394	397	398	338
135°	469	476	480	485	484	362
145°	544	543	551	554	552	340
155°	599	594	600	603	599	276
165°	631	628	629	633	629	178
175°	645	642	643	646	642	61
180°	644	644	644	644	644	

TEST NUMBER: P924753

CATALOG NUMBER: DFN2DIP-PN2F0-060D020US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2227.2	2227.2	2227.2	2227.2	2227.2
2.5°	2240.2	2229.5	2205.8	2227.2	2223.1
5°	2227.2	2218.8	2195.2	2212.2	2208.1
7.5°	2212.2	2199.5	2175.9	2193.2	2188.9
10°	2188.9	2173.9	2148.1	2165.2	2158.8
12.5°	2156.6	2143.8	2118.2	2128.9	2124.6
15°	2120.2	2107.5	2079.5	2088.2	2077.5
17.5°	2075.2	2062.5	2034.6	2045.2	2034.6
20°	2025.9	2013.2	1983.2	1989.6	1981.2
22.5°	1976.9	1957.5	1929.6	1929.6	1925.3
25°	1918.9	1901.9	1865.5	1869.6	1865.5
27.5°	1854.6	1839.6	1811.8	1805.5	1794.9
30°	1790.6	1773.2	1741.2	1734.8	1726.2
32.5°	1721.9	1709.2	1674.8	1661.9	1653.3
35°	1655.6	1634.2	1599.9	1586.9	1576.2
37.5°	1580.6	1561.2	1527.0	1511.9	1501.2
40°	1503.5	1486.2	1452.0	1432.9	1424.2
42.5°	1428.5	1411.3	1377.2	1355.6	1342.9
45°	1347.2	1332.2	1299.9	1276.5	1267.9
47.5°	1267.9	1252.9	1218.6	1195.0	1182.2
50°	1184.3	1173.6	1143.7	1113.6	1102.9
52.5°	1102.9	1087.9	1060.2	1036.6	1021.6
55°	1019.5	1006.6	980.9	955.2	944.6
57.5°	936.0	925.3	897.3	871.7	863.0
60°	852.3	843.9	814.0	790.3	783.9
62.5°	770.9	755.9	734.6	713.2	704.6
65°	687.5	674.7	653.3	633.9	623.2
67.5°	601.9	591.0	571.9	556.9	548.3
70°	522.6	514.0	494.6	479.7	471.3
72.5°	441.2	432.6	422.0	407.0	400.6
75°	359.7	355.7	344.7	332.0	336.3
77.5°	287.0	278.4	274.0	267.7	261.3
80°	214.3	212.0	207.7	201.3	197.0
82.5°	145.7	145.7	143.6	135.0	135.0
85°	87.7	85.7	83.6	77.0	75.0
87.5°	38.6	34.3	30.0	23.7	21.4
90°	0.5	5.6	9.3	11.6	12.6
92.5°	11.6	9.8	11.2	12.1	12.6
95°	30.2	14.9	18.1	20.5	20.0
97.5°	54.5	16.3	23.8	25.2	25.7
100°	82.5	18.6	26.5	30.2	31.2
102.5°	113.2	112.3	27.5	32.6	34.1
105°	141.7	155.6	28.4	33.5	35.4
107.5°	174.8	186.3	29.4	34.4	36.3
110°	206.4	216.2	81.6	35.0	36.8



TEST NUMBER: P924753

CATALOG NUMBER: DFN2DIP-PN2F0-060D020US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	236.2	244.6	236.7	35.9	37.3
115°	267.9	275.8	287.5	71.7	38.3
117.5°	295.4	304.7	312.6	246.0	123.9
120°	326.2	333.1	341.5	347.2	284.2
122.5°	352.2	359.7	369.0	371.8	372.3
125°	378.8	384.8	393.7	397.0	398.4
127.5°	403.1	409.6	416.6	421.2	421.7
130°	425.9	433.3	438.5	443.6	443.1
132.5°	449.1	455.2	460.3	464.5	464.1
135°	468.8	476.2	480.3	485.1	484.2
137.5°	489.2	494.8	499.5	504.2	502.8
140°	509.2	513.1	518.1	522.3	520.0
142.5°	526.0	529.4	535.4	539.1	536.7
145°	543.8	543.3	551.2	554.5	552.2
147.5°	559.1	557.7	565.6	567.9	566.1
150°	574.0	570.8	578.2	581.0	578.7
152.5°	586.6	582.9	589.9	592.7	589.4
155°	598.7	594.5	600.2	602.9	599.2
157.5°	608.6	604.8	609.0	612.3	608.6
160°	617.0	614.1	617.0	619.7	616.5
162.5°	624.3	621.5	623.9	627.2	623.0
165°	630.9	628.1	629.4	632.8	629.4
167.5°	636.0	633.2	634.6	637.9	633.6
170°	640.2	637.4	638.3	641.6	637.4
172.5°	643.0	640.2	641.2	644.4	640.2
175°	645.3	642.0	643.0	646.2	641.6
177.5°	646.2	643.0	643.5	646.7	642.5
180°	643.9	643.9	643.9	643.9	643.9

TEST NUMBER: P924753

CATALOG NUMBER: DFN2DIP-PN2F0-060D020US950-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.67	15.81	15.38	16.54	17.40	14.23	15.37	14.94	16.10	16.97
	3H	16.33	17.36	17.05	18.09	18.99	15.85	16.88	16.57	17.61	18.51
	4H	16.92	17.89	17.66	18.63	19.54	16.43	17.40	17.18	18.15	19.06
	6H	17.32	18.21	18.07	18.97	19.89	16.83	17.72	17.58	18.48	19.40
	8H	17.42	18.27	18.18	19.05	19.97	16.93	17.79	17.70	18.56	19.49
	12H	17.47	18.28	18.24	19.05	20.01	16.98	17.79	17.75	18.56	19.51
4H	2H	15.15	16.12	15.90	16.87	17.78	14.80	15.77	15.55	16.52	17.43
	3H	17.02	17.83	17.78	18.61	19.54	16.62	17.43	17.38	18.21	19.14
	4H	17.73	18.47	18.50	19.25	20.20	17.32	18.05	18.09	18.84	19.79
	6H	18.24	18.88	19.03	19.69	20.65	17.82	18.46	18.61	19.27	20.23
	8H	18.39	18.98	19.18	19.79	20.76	17.96	18.56	18.76	19.37	20.34
	12H	18.47	19.00	19.28	19.83	20.81	18.03	18.57	18.85	19.40	20.37
8H	4H	17.94	18.53	18.73	19.34	20.31	17.57	18.17	18.36	18.97	19.94
	6H	18.56	19.05	19.38	19.90	20.87	18.18	18.68	19.01	19.52	20.50
	8H	18.77	19.21	19.60	20.05	21.04	18.39	18.83	19.22	19.67	20.66
	12H	18.90	19.29	19.73	20.12	21.17	18.50	18.89	19.34	19.72	20.77
12H	4H	17.94	18.47	18.75	19.30	20.28	17.57	18.11	18.39	18.94	19.92
	6H	18.58	19.02	19.42	19.87	20.86	18.22	18.66	19.06	19.51	20.50
	8H	18.82	19.21	19.66	20.05	21.09	18.45	18.84	19.29	19.68	20.72