

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924754

Luminaire Tested: DFN2DIP-PN2F0-060D020US950-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924754
REPORT IS A COMBINATION OF REPORTS P899470 AND P896349
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-060D020US950-RLLFLL
Description: 2 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6554.0 lumens
Efficiency: N/A
Efficacy: 81.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 80.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924754

CATALOG NUMBER: DFN2DIP-PN2F0-060D020US950-RLLFLL

Luminous Intensity Polar Plot

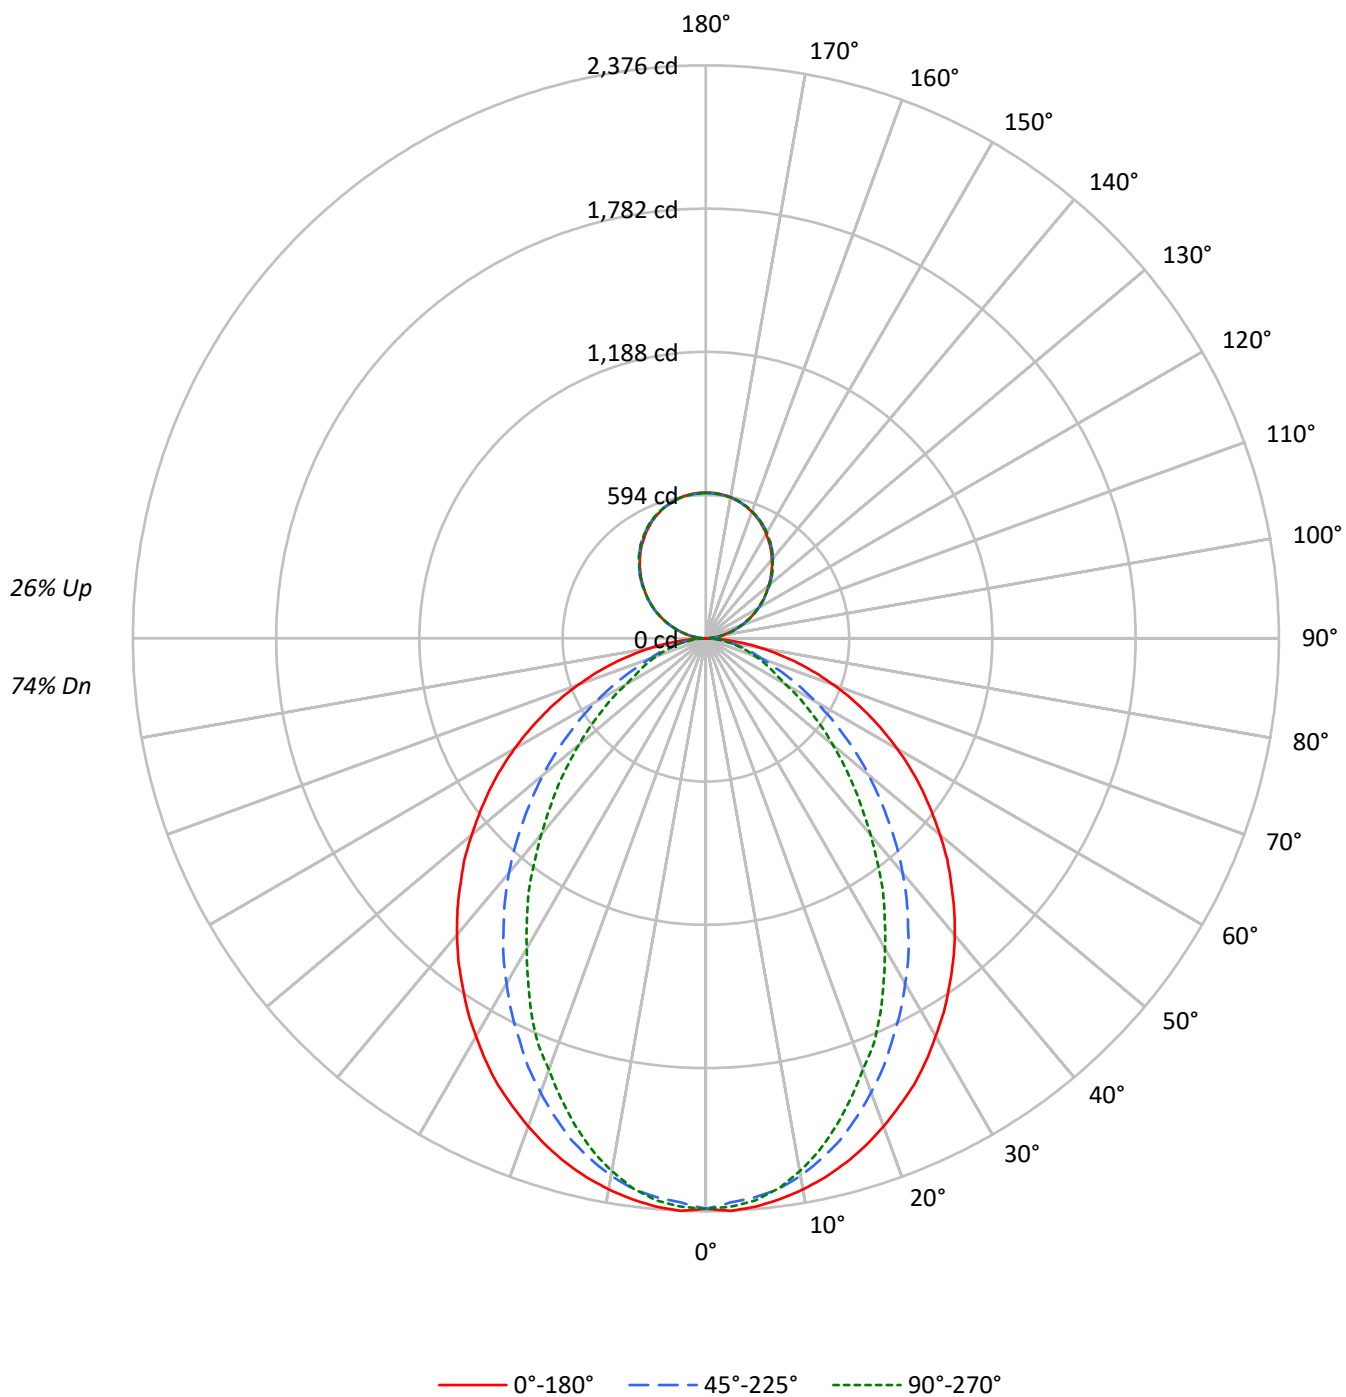

TEST NUMBER: P924754

CATALOG NUMBER: DFN2DIP-PN2F0-060D020US950-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	113	113	113	113	107	107	107	107	97	97	97	87	87	87	78	78	78
1	104	100	96	93	99	95	92	89	86	84	81	78	76	74	70	69	68
2	95	88	82	77	90	84	79	74	76	72	68	69	66	63	63	60	58
3	87	78	71	65	83	75	68	63	68	63	58	62	58	54	56	53	50
4	80	70	62	56	76	67	60	54	61	55	51	56	51	47	51	47	44
5	74	63	54	48	70	60	53	47	55	49	44	51	45	42	46	42	39
6	69	57	48	43	65	54	47	41	50	44	39	46	41	37	42	38	35
7	64	51	43	38	61	49	42	37	46	39	35	42	37	33	39	34	31
8	59	47	39	34	57	45	38	33	42	36	31	39	34	30	36	31	28
9	56	43	36	31	53	42	35	30	39	33	28	36	31	27	33	29	26
10	52	40	33	28	50	39	32	27	36	30	26	33	28	25	31	27	23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5124	5124	5124
5°	5124	5032	5067
10°	5065	4922	4895
15°	4987	4749	4633
20°	4886	4514	4314
25°	4784	4254	4007
30°	4648	3987	3620
35°	4515	3702	3279
40°	4379	3408	2891
45°	4222	3084	2539
50°	4059	2757	2196
55°	3888	2409	1866
60°	3690	2047	1529
65°	3461	1680	1368
70°	3183	1338	1227
75°	2834	1158	1102
80°	2331	942	933
85°	1524	585	661

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4222 cd/sqm

TEST NUMBER: P924754

CATALOG NUMBER: DFN2DIP-PN2F0-060D020US950-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.7	3.4
10°-20°	608.7	9.3
20°-30°	854.5	13.0
30°-40°	931.5	14.2
40°-50°	856.2	13.1
50°-60°	672.4	10.3
60°-70°	437.7	6.7
70°-80°	225.3	3.4
80°-90°	59.2	0.9
90°-100°	37.3	0.6
100°-110°	118.7	1.8
110°-120°	203.0	3.1
120°-130°	267.0	4.1
130°-140°	299.7	4.6
140°-150°	293.9	4.5
150°-160°	246.5	3.8
160°-170°	163.5	2.5
170°-180°	57.1	0.9
0°-30°	1684.9	25.7
0°-40°	2616.4	39.9
0°-60°	4144.9	63.2
0°-90°	4867.1	74.3
90°-120°	359.0	5.5
90°-150°	1219.7	18.6
90°-180°	1687.0	25.7
0°-180°	6554.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2366	2366	2366	2366	2366	
5°	2366	2355	2327	2346	2340	224
15°	2250	2226	2154	2113	2092	634
25°	2042	1974	1833	1745	1713	939
35°	1760	1651	1462	1327	1280	1102
45°	1439	1295	1071	918	867	1111
55°	1094	927	696	567	527	978
65°	739	565	372	300	293	732
75°	394	244	171	156	154	417
85°	92	47	41	41	41	106
90°	1	7	18	17	17	6
95°	26	32	32	32	32	30
105°	110	111	112	113	113	116
115°	204	207	206	205	204	202
125°	296	301	300	298	297	265
135°	383	389	390	390	388	296
145°	465	469	472	472	470	291
155°	532	534	535	538	536	245
165°	579	578	578	582	580	163
175°	602	601	600	603	600	57
180°	603	603	603	603	603	

TEST NUMBER: P924754

CATALOG NUMBER: DFN2DIP-PN2F0-060D020US950-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2365.7	2365.7	2365.7	2365.7	2365.7
2.5°	2376.4	2365.7	2342.1	2363.6	2359.3
5°	2365.7	2355.0	2327.1	2346.5	2340.1
7.5°	2346.5	2333.7	2303.7	2312.1	2301.4
10°	2320.7	2305.7	2263.1	2256.5	2243.7
12.5°	2288.7	2269.4	2211.5	2198.8	2175.1
15°	2250.1	2226.4	2153.8	2113.1	2091.7
17.5°	2205.2	2170.8	2080.9	2033.8	1999.6
20°	2153.8	2110.8	2003.9	1950.5	1903.2
22.5°	2098.1	2048.8	1924.6	1851.9	1819.9
25°	2042.5	1973.9	1832.6	1745.0	1712.7
27.5°	1976.2	1903.2	1747.0	1646.3	1597.1
30°	1905.5	1824.0	1652.7	1543.7	1485.8
32.5°	1836.9	1738.4	1563.0	1434.4	1380.8
35°	1759.9	1650.7	1462.4	1327.4	1280.2
37.5°	1685.0	1567.0	1368.1	1220.3	1166.8
40°	1605.7	1477.4	1269.5	1117.5	1061.9
42.5°	1524.4	1387.4	1171.1	1012.6	959.2
45°	1438.7	1295.2	1070.6	918.3	867.0
47.5°	1357.4	1205.5	974.2	822.1	775.0
50°	1267.5	1115.5	880.0	732.1	687.4
52.5°	1179.5	1019.0	790.0	648.7	608.1
55°	1094.0	927.0	695.8	567.4	526.7
57.5°	1006.3	834.9	612.4	492.5	458.1
60°	916.3	745.1	524.5	415.5	381.1
62.5°	828.6	657.4	449.5	346.9	329.8
65°	738.7	565.1	372.5	299.8	293.3
67.5°	653.0	479.5	299.8	263.3	256.9
70°	563.1	396.1	248.2	227.0	218.3
72.5°	477.5	318.9	207.6	190.6	186.2
75°	393.9	243.9	171.2	156.3	154.3
77.5°	310.5	173.3	134.9	126.3	122.0
80°	233.3	124.2	102.7	94.3	94.3
82.5°	162.7	83.6	70.6	66.3	66.3
85°	92.0	47.0	40.6	40.6	40.6
87.5°	34.3	17.1	17.1	15.0	15.0
90°	0.6	6.6	17.8	16.7	17.3
92.5°	11.3	15.3	15.8	16.4	16.4
95°	26.5	31.7	32.5	32.5	31.7
97.5°	44.2	48.9	50.9	50.9	50.9
100°	64.6	68.8	70.2	70.2	69.6
102.5°	86.1	89.1	91.1	91.7	91.1
105°	109.5	111.0	112.1	113.0	113.0
107.5°	132.8	135.0	135.0	135.4	132.8
110°	155.4	158.3	158.3	158.3	156.8

TEST NUMBER: P924754

CATALOG NUMBER: DFN2DIP-PN2F0-060D020US950-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	179.7	182.8	182.3	180.8	179.7
115°	203.8	206.6	205.8	205.2	203.8
117.5°	227.6	231.6	229.1	227.6	226.1
120°	251.6	255.6	251.6	251.6	249.9
122.5°	273.4	278.5	276.0	274.6	273.4
125°	296.3	300.9	299.5	297.8	297.3
127.5°	318.7	324.4	322.4	320.2	318.7
130°	339.6	346.2	345.3	344.2	342.2
132.5°	363.1	368.2	368.5	366.0	364.5
135°	383.3	388.9	390.0	389.5	388.0
137.5°	405.8	410.4	411.4	411.0	408.8
140°	425.7	430.3	432.8	432.8	430.8
142.5°	446.1	450.6	452.1	452.6	450.6
145°	465.4	469.0	471.9	472.4	470.4
147.5°	482.6	487.2	489.4	490.3	488.3
150°	500.5	503.5	505.5	507.1	505.5
152.5°	516.3	519.4	521.9	523.9	521.9
155°	532.1	533.6	535.2	537.8	536.1
157.5°	545.8	546.8	547.8	551.4	548.8
160°	558.0	559.0	559.6	562.7	560.5
162.5°	569.3	569.3	569.7	573.3	570.7
165°	578.9	578.3	578.3	581.9	579.5
167.5°	587.6	585.9	585.9	589.6	587.1
170°	594.2	592.7	592.1	595.8	592.7
172.5°	598.7	597.2	596.7	600.4	597.2
175°	602.4	600.9	599.8	603.4	600.4
177.5°	604.4	602.9	601.8	604.8	601.8
180°	603.4	603.4	603.4	603.4	603.4

TEST NUMBER: P924754

CATALOG NUMBER: DFN2DIP-PN2F0-060D020US950-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.73	15.80	15.45	16.54	17.42	10.70	11.77	11.42	12.51	13.39
	3H	16.40	17.37	17.14	18.12	19.03	11.89	12.85	12.62	13.60	14.51
	4H	17.01	17.92	17.76	18.67	19.60	12.34	13.24	13.09	14.00	14.93
	6H	17.43	18.26	18.19	19.03	19.97	12.65	13.49	13.42	14.26	15.20
	8H	17.55	18.35	18.33	19.13	20.07	12.74	13.54	13.52	14.33	15.27
	12H	17.61	18.37	18.40	19.15	20.12	12.79	13.55	13.57	14.33	15.29
4H	2H	14.77	15.68	15.53	16.44	17.36	11.31	12.22	12.07	12.98	13.90
	3H	16.60	17.35	17.37	18.15	19.09	12.66	13.42	13.43	14.21	15.15
	4H	17.28	17.97	18.07	18.76	19.73	13.21	13.89	13.99	14.68	15.65
	6H	17.79	18.38	18.60	19.20	20.18	13.62	14.21	14.42	15.03	16.01
	8H	17.96	18.51	18.77	19.33	20.32	13.74	14.29	14.55	15.11	16.10
	12H	18.06	18.55	18.88	19.39	20.38	13.81	14.30	14.64	15.14	16.13
8H	4H	17.27	17.82	18.07	18.63	19.62	13.49	14.04	14.30	14.86	15.85
	6H	17.82	18.27	18.65	19.13	20.12	14.00	14.45	14.83	15.31	16.30
	8H	18.02	18.43	18.87	19.28	20.29	14.17	14.58	15.02	15.43	16.44
	12H	18.16	18.51	19.01	19.36	20.42	14.29	14.65	15.14	15.49	16.55
12H	4H	17.23	17.72	18.06	18.56	19.55	13.50	14.00	14.33	14.84	15.83
	6H	17.79	18.20	18.64	19.05	20.06	14.04	14.44	14.89	15.30	16.31
	8H	18.01	18.37	18.86	19.21	20.27	14.25	14.60	15.09	15.45	16.51

END OF REPORT