

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924766

Luminaire Tested: DFN2DIP-PN2F0-060D050US950-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924766
REPORT IS A COMBINATION OF REPORTS P899500 AND P896349
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-060D050US950-RLLFLL
Description: 2 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9086.9 lumens
Efficiency: N/A
Efficacy: 85.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 105.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924766

CATALOG NUMBER: DFN2DIP-PN2F0-060D050US950-RLLFLL

Luminous Intensity Polar Plot

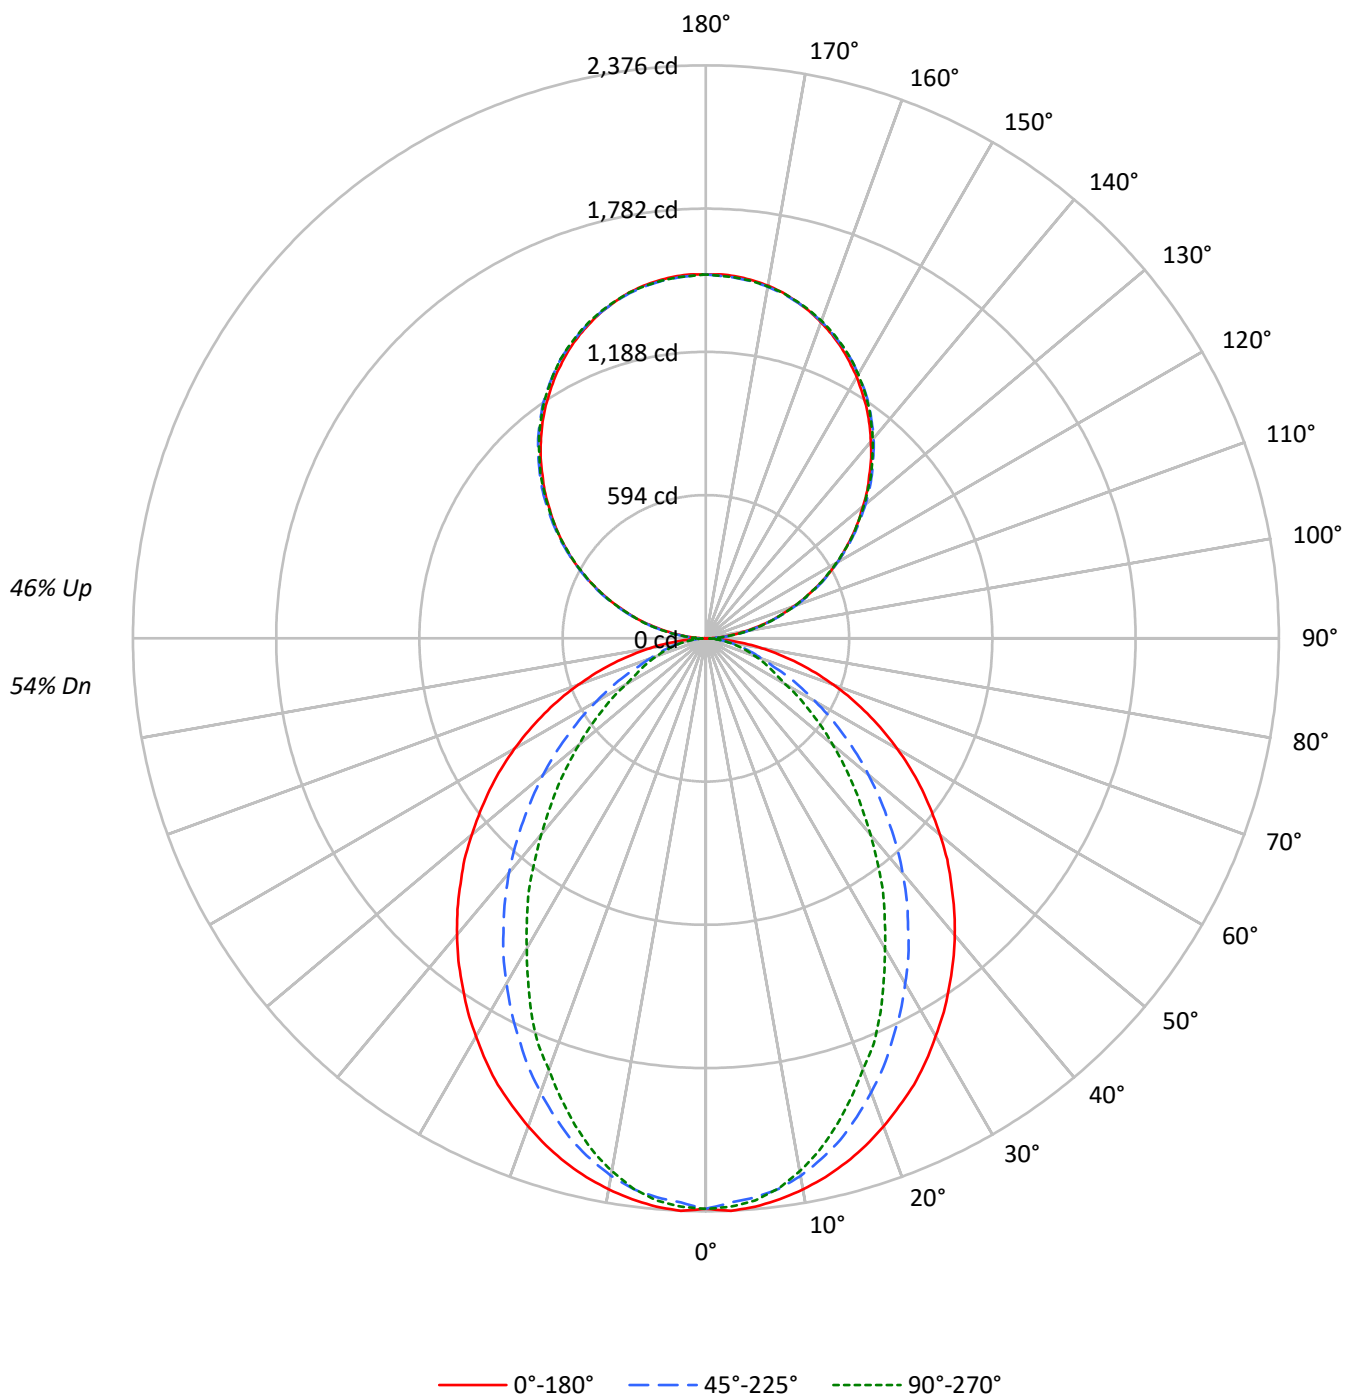

TEST NUMBER: P924766

CATALOG NUMBER: DFN2DIP-PN2F0-060D050US950-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	72	72	72	59	59	59
1	99	95	91	88	92	88	85	82	76	73	71	64	62	61	53	52	51
2	91	84	78	73	84	78	73	68	67	63	60	57	54	52	48	46	44
3	83	74	67	61	77	69	63	58	59	55	51	51	47	44	43	40	38
4	76	66	58	52	71	61	55	49	53	48	44	46	42	38	38	36	33
5	70	59	51	45	65	55	48	43	48	42	38	41	37	34	35	32	29
6	65	53	45	39	60	50	43	37	43	38	34	37	33	30	32	29	26
7	60	48	40	35	56	45	38	33	39	34	30	34	30	27	29	26	23
8	56	44	36	31	52	41	34	30	36	31	27	31	27	24	27	24	21
9	52	40	33	28	48	38	31	27	33	28	24	29	25	22	25	22	19
10	49	37	30	25	45	35	28	24	31	25	22	27	23	20	23	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5124	5124	5124
5°	5124	5032	5067
10°	5065	4922	4895
15°	4987	4749	4633
20°	4886	4514	4314
25°	4784	4254	4007
30°	4648	3987	3620
35°	4515	3702	3279
40°	4379	3408	2891
45°	4222	3084	2539
50°	4059	2757	2196
55°	3888	2409	1866
60°	3690	2047	1529
65°	3461	1680	1368
70°	3183	1338	1227
75°	2834	1158	1102
80°	2331	942	933
85°	1524	585	661

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4222 cd/sqm

TEST NUMBER: P924766

CATALOG NUMBER: DFN2DIP-PN2F0-060D050US950-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.7	2.4
10°-20°	608.7	6.7
20°-30°	854.5	9.4
30°-40°	931.5	10.3
40°-50°	856.2	9.4
50°-60°	672.4	7.4
60°-70°	437.7	4.8
70°-80°	225.3	2.5
80°-90°	61.8	0.7
90°-100°	93.4	1.0
100°-110°	296.6	3.3
110°-120°	507.6	5.6
120°-130°	667.5	7.3
130°-140°	749.3	8.2
140°-150°	734.8	8.1
150°-160°	616.4	6.8
160°-170°	408.8	4.5
170°-180°	142.9	1.6
0°-30°	1684.9	18.5
0°-40°	2616.4	28.8
0°-60°	4144.9	45.6
0°-90°	4869.7	53.6
90°-120°	897.5	9.9
90°-150°	3049.2	33.6
90°-180°	4217.0	46.4
0°-180°	9086.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2366	2366	2366	2366	2366	
5°	2366	2355	2327	2346	2340	224
15°	2250	2226	2154	2113	2092	634
25°	2042	1974	1833	1745	1713	939
35°	1760	1651	1462	1327	1280	1102
45°	1439	1295	1071	918	867	1111
55°	1094	927	696	567	527	978
65°	739	565	372	300	293	732
75°	394	244	171	156	154	417
85°	92	47	41	41	41	106
90°	1	16	45	42	43	9
95°	66	79	81	81	79	74
105°	274	277	280	282	282	289
115°	509	517	514	513	509	504
125°	741	752	749	744	743	662
135°	958	972	975	974	970	741
145°	1163	1172	1180	1181	1176	727
155°	1330	1334	1338	1344	1340	612
165°	1447	1446	1446	1455	1449	408
175°	1506	1502	1500	1509	1501	143
180°	1509	1509	1509	1509	1509	

TEST NUMBER: P924766

CATALOG NUMBER: DFN2DIP-PN2F0-060D050US950-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2365.7	2365.7	2365.7	2365.7	2365.7
2.5°	2376.4	2365.7	2342.1	2363.6	2359.3
5°	2365.7	2355.0	2327.1	2346.5	2340.1
7.5°	2346.5	2333.7	2303.7	2312.1	2301.4
10°	2320.7	2305.7	2263.1	2256.5	2243.7
12.5°	2288.7	2269.4	2211.5	2198.8	2175.1
15°	2250.1	2226.4	2153.8	2113.1	2091.7
17.5°	2205.2	2170.8	2080.9	2033.8	1999.6
20°	2153.8	2110.8	2003.9	1950.5	1903.2
22.5°	2098.1	2048.8	1924.6	1851.9	1819.9
25°	2042.5	1973.9	1832.6	1745.0	1712.7
27.5°	1976.2	1903.2	1747.0	1646.3	1597.1
30°	1905.5	1824.0	1652.7	1543.7	1485.8
32.5°	1836.9	1738.4	1563.0	1434.4	1380.8
35°	1759.9	1650.7	1462.4	1327.4	1280.2
37.5°	1685.0	1567.0	1368.1	1220.3	1166.8
40°	1605.7	1477.4	1269.5	1117.5	1061.9
42.5°	1524.4	1387.4	1171.1	1012.6	959.2
45°	1438.7	1295.2	1070.6	918.3	867.0
47.5°	1357.4	1205.5	974.2	822.1	775.0
50°	1267.5	1115.5	880.0	732.1	687.4
52.5°	1179.5	1019.0	790.0	648.7	608.1
55°	1094.0	927.0	695.8	567.4	526.7
57.5°	1006.3	834.9	612.4	492.5	458.1
60°	916.3	745.1	524.5	415.5	381.1
62.5°	828.6	657.4	449.5	346.9	329.8
65°	738.7	565.1	372.5	299.8	293.3
67.5°	653.0	479.5	299.8	263.3	256.9
70°	563.1	396.1	248.2	227.0	218.3
72.5°	477.5	318.9	207.6	190.6	186.2
75°	393.9	243.9	171.2	156.3	154.3
77.5°	310.5	173.3	134.9	126.3	122.0
80°	233.3	124.2	102.7	94.3	94.3
82.5°	162.7	83.6	70.6	66.3	66.3
85°	92.0	47.0	40.6	40.6	40.6
87.5°	34.3	17.1	17.1	15.0	15.0
90°	1.3	16.4	44.6	41.9	43.2
92.5°	28.2	38.2	39.6	40.9	40.9
95°	66.4	79.2	81.4	81.4	79.2
97.5°	110.5	122.3	127.4	127.4	127.4
100°	161.4	171.9	175.5	175.5	174.2
102.5°	215.1	222.9	227.8	229.2	227.8
105°	273.8	277.4	280.2	282.4	282.4
107.5°	332.0	337.4	337.4	338.4	332.0
110°	388.4	395.7	395.7	395.7	392.0

TEST NUMBER: P924766

CATALOG NUMBER: DFN2DIP-PN2F0-060D050US950-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	449.3	457.1	455.7	452.1	449.3
115°	509.3	516.7	514.4	513.1	509.3
117.5°	569.0	579.0	572.6	569.0	565.3
120°	629.0	639.0	629.0	629.0	624.9
122.5°	683.5	696.3	689.9	686.3	683.5
125°	740.9	752.2	748.6	744.5	743.2
127.5°	796.8	810.9	805.9	800.4	796.8
130°	849.2	865.5	863.2	860.5	855.5
132.5°	907.8	920.5	921.5	915.1	911.5
135°	958.3	972.3	975.1	973.7	970.1
137.5°	1014.7	1026.0	1028.3	1027.4	1021.9
140°	1064.2	1075.6	1081.9	1081.9	1077.0
142.5°	1115.1	1126.6	1130.2	1131.5	1126.6
145°	1163.4	1172.5	1179.7	1181.1	1176.1
147.5°	1206.6	1218.0	1223.4	1225.7	1220.6
150°	1251.2	1258.9	1263.9	1268.0	1263.9
152.5°	1290.8	1298.5	1304.8	1309.8	1304.8
155°	1330.3	1333.9	1338.0	1344.4	1340.3
157.5°	1364.4	1367.1	1369.4	1378.5	1372.1
160°	1394.8	1397.6	1398.9	1406.7	1401.2
162.5°	1423.1	1423.1	1424.4	1433.1	1426.7
165°	1447.2	1445.8	1445.8	1454.9	1448.6
167.5°	1469.0	1464.9	1464.9	1474.0	1467.6
170°	1485.4	1481.8	1480.4	1489.5	1481.8
172.5°	1496.7	1493.1	1491.8	1500.8	1493.1
175°	1505.9	1502.2	1499.5	1508.6	1500.8
177.5°	1510.8	1507.2	1504.5	1512.2	1504.5
180°	1508.6	1508.6	1508.6	1508.6	1508.6

TEST NUMBER: P924766

CATALOG NUMBER: DFN2DIP-PN2F0-060D050US950-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.03	13.90	13.97	14.84	16.06	9.00	9.86	9.94	10.81	12.03
	3H	14.69	15.46	15.64	16.42	17.66	10.18	10.95	11.12	11.90	13.15
	4H	15.29	16.02	16.25	16.98	18.23	10.62	11.34	11.58	12.30	13.56
	6H	15.70	16.37	16.67	17.33	18.60	10.93	11.59	11.90	12.56	13.83
	8H	15.82	16.45	16.79	17.43	18.70	11.01	11.65	11.99	12.63	13.89
	12H	15.87	16.48	16.85	17.45	18.74	11.05	11.65	12.03	12.63	13.91
4H	2H	13.05	13.78	14.02	14.74	15.99	9.59	10.32	10.56	11.28	12.53
	3H	14.86	15.47	15.83	16.45	17.72	10.92	11.53	11.90	12.52	13.79
	4H	15.54	16.09	16.52	17.07	18.37	11.46	12.01	12.44	12.99	14.29
	6H	16.04	16.51	17.03	17.52	18.81	11.86	12.34	12.86	13.34	14.63
	8H	16.20	16.64	17.20	17.64	18.95	11.98	12.42	12.98	13.42	14.73
	12H	16.29	16.68	17.30	17.70	19.01	12.04	12.44	13.05	13.45	14.76
8H	4H	15.50	15.95	16.50	16.95	18.25	11.73	12.17	12.73	13.17	14.48
	6H	16.05	16.41	17.07	17.46	18.76	12.23	12.59	13.25	13.63	14.94
	8H	16.25	16.57	17.28	17.60	18.92	12.40	12.73	13.43	13.75	15.08
	12H	16.38	16.66	17.41	17.68	19.05	12.51	12.79	13.54	13.82	15.18
12H	4H	15.46	15.86	16.47	16.87	18.18	11.73	12.13	12.75	13.15	14.46
	6H	16.02	16.35	17.05	17.37	18.70	12.27	12.59	13.30	13.62	14.94
	8H	16.23	16.51	17.26	17.54	18.90	12.47	12.75	13.50	13.77	15.14

END OF REPORT