

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903021

Luminaire Tested: DFN2DIP-PN3F0-050D070US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903021
REPORT IS A COMBINATION OF REPORTS P901091 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-050D070US830-FLLONL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11197.4 lumens
Efficiency: N/A
Efficacy: 112.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 99.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903021

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US830-FLLONL

Luminous Intensity Polar Plot

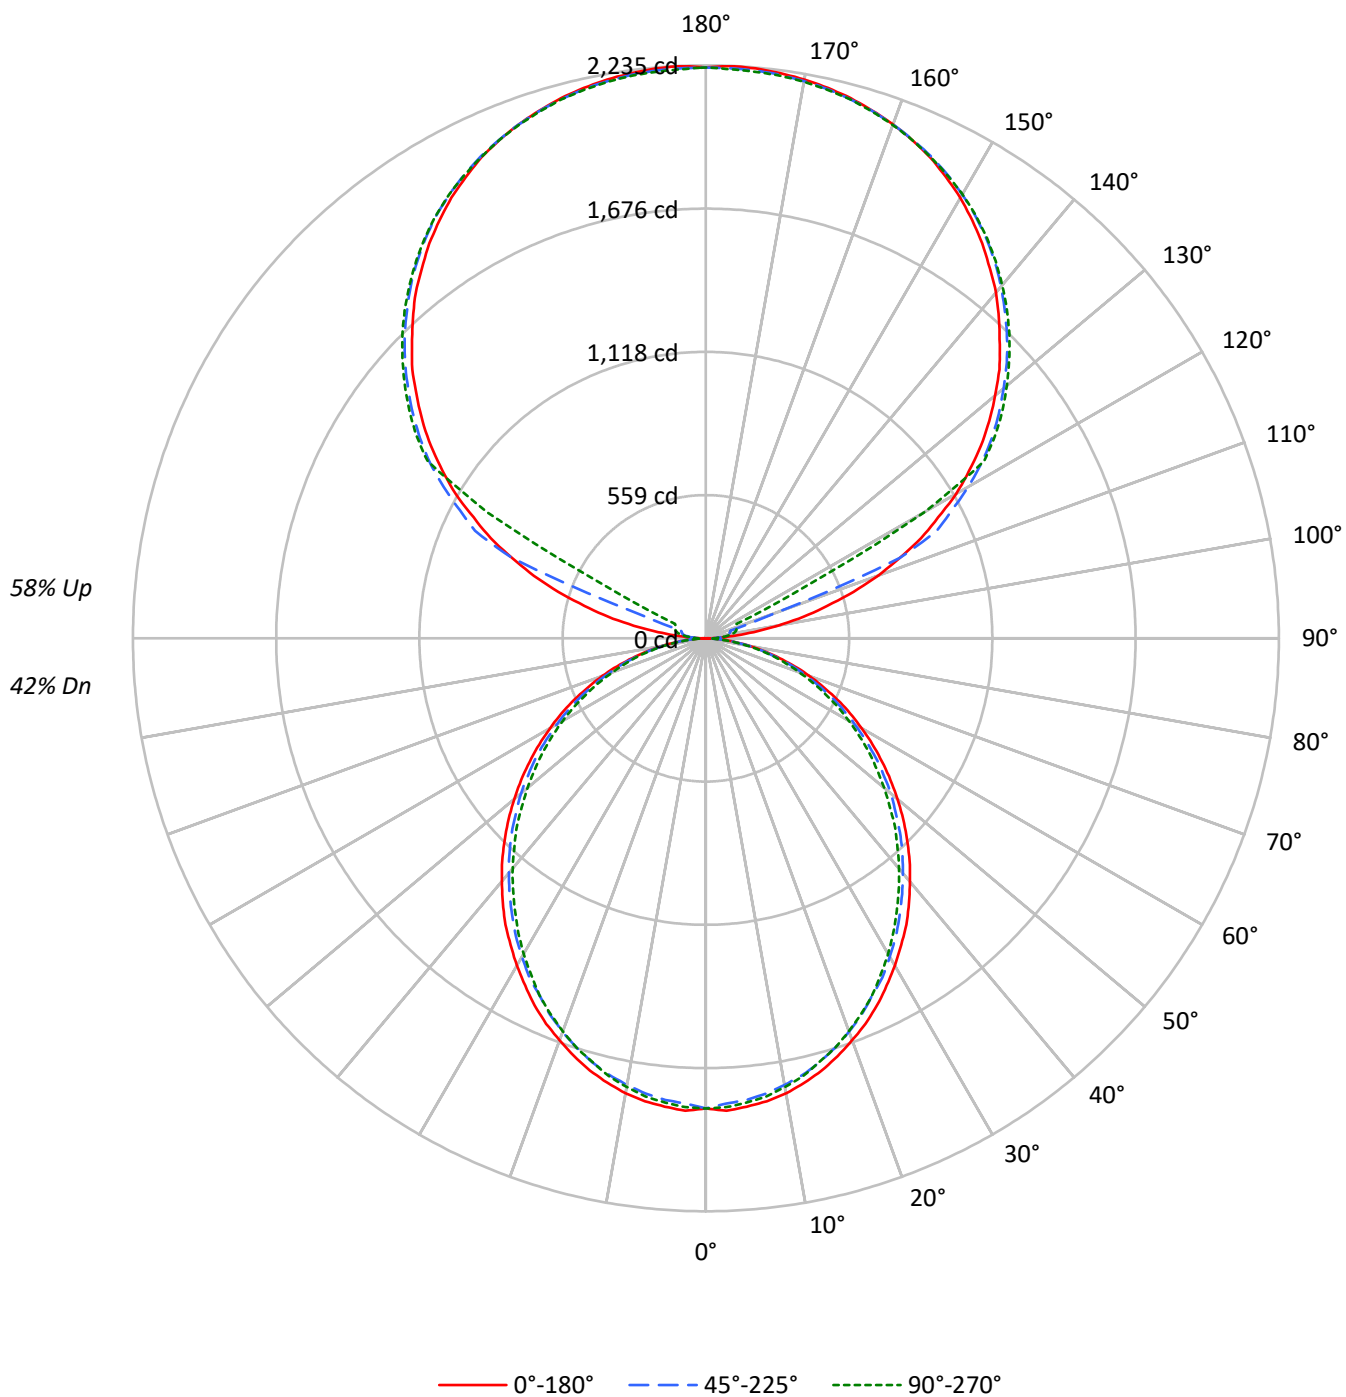

TEST NUMBER: P903021

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US830-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	63	63	63	49	49	49
1	96	92	88	84	87	84	80	78	69	67	65	55	54	52	43	42	41
2	87	80	74	69	79	73	68	64	60	57	53	49	46	44	38	36	34
3	80	70	63	57	72	64	58	53	53	49	45	43	40	37	33	31	29
4	73	62	54	48	66	57	50	45	47	42	38	38	35	32	30	27	25
5	67	55	47	41	61	51	44	39	42	37	33	34	30	27	27	24	22
6	62	50	42	36	56	46	39	33	38	33	29	31	27	24	24	22	19
7	57	45	37	31	52	41	34	29	34	29	25	28	24	21	22	19	17
8	53	41	33	28	48	37	31	26	31	26	22	26	22	19	20	18	15
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	26	21	18	22	18	15	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2144	2144	2144
5°	2146	2112	2127
10°	2127	2082	2097
15°	2095	2046	2051
20°	2051	1997	2005
25°	2008	1939	1950
30°	1954	1884	1882
35°	1902	1820	1809
40°	1839	1756	1740
45°	1777	1691	1669
50°	1708	1622	1587
55°	1636	1543	1512
60°	1554	1450	1426
65°	1465	1352	1323
70°	1351	1234	1213
75°	1194	1092	1111
80°	1004	910	916
85°	708	602	597

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1777 cd/sqm

TEST NUMBER: P903021

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US830-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	172.6	1.5
10°-20°	485.6	4.3
20°-30°	713.7	6.4
30°-40°	828.9	7.4
40°-50°	827.8	7.4
50°-60°	721.8	6.4
60°-70°	533.6	4.8
70°-80°	301.9	2.7
80°-90°	83.6	0.7
90°-100°	73.4	0.7
100°-110°	273.7	2.4
110°-120°	725.9	6.5
120°-130°	1204.0	10.8
130°-140°	1278.9	11.4
140°-150°	1188.6	10.6
150°-160°	955.6	8.5
160°-170°	615.8	5.5
170°-180°	211.9	1.9
0°-30°	1371.9	12.3
0°-40°	2200.7	19.7
0°-60°	3750.4	33.5
0°-90°	4669.5	41.7
90°-120°	1073.0	9.6
90°-150°	4744.6	42.4
90°-180°	6528.0	58.3
0°-180°	11197.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1834	1834	1834	1834	1834	
5°	1834	1827	1807	1821	1818	174
15°	1746	1735	1712	1719	1710	492
25°	1580	1566	1536	1539	1536	727
35°	1363	1346	1317	1307	1298	851
45°	1109	1097	1070	1051	1044	856
55°	839	829	808	786	778	750
65°	566	555	538	522	513	560
75°	296	293	284	273	277	316
85°	72	70	69	63	62	81
90°	2	19	32	40	44	10
95°	105	52	63	71	69	124
105°	490	538	98	116	122	523
115°	926	954	994	248	132	912
125°	1310	1331	1362	1373	1378	1168
135°	1621	1647	1661	1677	1674	1252
145°	1880	1879	1906	1917	1909	1176
155°	2070	2056	2075	2085	2072	954
165°	2182	2172	2177	2188	2177	616
175°	2232	2220	2224	2235	2219	212
180°	2227	2227	2227	2227	2227	

TEST NUMBER: P903021

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1833.7	1833.7	1833.7	1833.7	1833.7
2.5°	1844.4	1835.6	1816.2	1833.7	1830.4
5°	1833.7	1826.8	1807.3	1821.4	1818.1
7.5°	1821.4	1810.9	1791.5	1805.7	1802.1
10°	1802.1	1789.8	1768.7	1782.6	1777.4
12.5°	1775.6	1765.1	1744.0	1752.8	1749.2
15°	1745.6	1735.1	1712.1	1719.3	1710.4
17.5°	1708.5	1698.1	1675.1	1683.9	1675.1
20°	1668.0	1657.6	1632.9	1638.0	1631.2
22.5°	1627.6	1611.7	1588.7	1588.7	1585.1
25°	1579.9	1565.8	1535.9	1539.3	1535.9
27.5°	1526.9	1514.6	1491.8	1486.5	1477.7
30°	1474.1	1460.0	1433.6	1428.3	1421.3
32.5°	1417.7	1407.2	1378.9	1368.3	1361.2
35°	1363.0	1345.5	1317.2	1306.6	1297.8
37.5°	1301.3	1285.4	1257.2	1244.8	1236.0
40°	1237.9	1223.7	1195.4	1179.7	1172.6
42.5°	1176.2	1162.0	1133.9	1116.1	1105.6
45°	1109.2	1096.8	1070.3	1051.0	1043.9
47.5°	1043.9	1031.5	1003.3	983.8	973.4
50°	975.1	966.3	941.6	916.9	908.0
52.5°	908.0	895.7	872.9	853.5	841.1
55°	839.4	828.8	807.6	786.5	777.7
57.5°	770.5	761.8	738.8	717.7	710.5
60°	701.7	694.8	670.1	650.6	645.5
62.5°	634.8	622.5	604.8	587.2	580.1
65°	566.1	555.4	537.8	522.0	513.1
67.5°	495.6	486.6	470.9	458.5	451.4
70°	430.3	423.2	407.3	394.9	388.0
72.5°	363.4	356.2	347.4	335.1	329.8
75°	296.1	292.8	283.8	273.3	276.9
77.5°	236.3	229.1	225.6	220.4	215.2
80°	176.4	174.6	171.0	165.8	162.2
82.5°	119.9	119.9	118.2	111.1	111.1
85°	72.2	70.5	68.8	63.4	61.7
87.5°	31.8	28.3	24.7	19.4	17.6
90°	1.5	19.3	32.1	40.3	43.5
92.5°	40.3	33.8	38.6	41.9	43.5
95°	104.6	51.5	62.8	71.0	69.3
97.5°	188.4	56.5	82.1	87.1	88.6
100°	285.3	64.5	91.8	104.6	107.9
102.5°	391.4	388.4	95.1	112.7	117.6
105°	489.8	538.2	98.3	115.9	122.4
107.5°	604.2	644.4	101.6	119.2	125.7
110°	713.9	747.5	282.0	120.9	127.2

TEST NUMBER: P903021

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	817.0	845.8	818.5	123.9	128.9
115°	926.4	953.8	994.1	248.2	132.2
117.5°	1021.5	1053.7	1081.2	850.6	428.6
120°	1127.8	1152.0	1181.1	1200.4	982.9
122.5°	1218.0	1243.8	1276.2	1285.7	1287.4
125°	1309.9	1330.9	1361.5	1372.8	1377.5
127.5°	1393.6	1416.2	1440.5	1456.6	1458.1
130°	1472.6	1498.5	1516.1	1533.9	1532.4
132.5°	1553.2	1574.2	1591.9	1606.4	1604.9
135°	1620.9	1646.7	1661.1	1677.3	1674.1
137.5°	1691.7	1711.1	1727.3	1743.4	1738.6
140°	1761.0	1774.0	1791.6	1806.1	1798.1
142.5°	1819.1	1830.4	1851.2	1864.1	1856.1
145°	1880.4	1878.7	1906.0	1917.3	1909.3
147.5°	1933.3	1928.6	1956.0	1964.0	1957.7
150°	1985.0	1973.8	1999.6	2009.1	2001.1
152.5°	2028.4	2015.6	2039.8	2049.5	2038.2
155°	2070.4	2056.0	2075.3	2084.9	2072.1
157.5°	2104.2	2091.4	2105.9	2117.2	2104.2
160°	2133.4	2123.5	2133.4	2142.9	2131.6
162.5°	2159.0	2149.4	2157.4	2168.7	2154.2
165°	2181.5	2172.0	2176.7	2188.0	2176.7
167.5°	2199.3	2189.5	2194.5	2205.8	2191.3
170°	2213.8	2204.1	2207.3	2218.7	2204.1
172.5°	2223.5	2213.8	2217.1	2228.4	2213.8
175°	2231.5	2220.2	2223.5	2234.7	2218.7
177.5°	2234.7	2223.5	2225.2	2236.5	2221.9
180°	2226.7	2226.7	2226.7	2226.7	2226.7

TEST NUMBER: P903021

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US830-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.06	9.85	10.09	10.89	12.27	8.62	9.42	9.65	10.45	11.83
	3H	10.71	11.42	11.75	12.46	13.87	10.23	10.94	11.27	11.98	13.39
	4H	11.29	11.97	12.34	13.01	14.42	10.81	11.48	11.86	12.52	13.94
	6H	11.68	12.30	12.74	13.35	14.78	11.19	11.81	12.25	12.86	14.29
	8H	11.78	12.37	12.85	13.44	14.86	11.29	11.88	12.36	12.95	14.37
	12H	11.83	12.39	12.90	13.45	14.89	11.33	11.89	12.40	12.95	14.39
4H	2H	9.51	10.18	10.57	11.23	12.64	9.16	9.83	10.22	10.88	12.29
	3H	11.36	11.93	12.43	13.00	14.42	10.96	11.52	12.03	12.60	14.02
	4H	12.07	12.59	13.14	13.65	15.10	11.66	12.17	12.72	13.23	14.68
	6H	12.58	13.02	13.65	14.11	15.55	12.15	12.60	13.23	13.68	15.12
	8H	12.72	13.13	13.80	14.21	15.67	12.30	12.71	13.37	13.79	15.24
	12H	12.79	13.16	13.88	14.25	15.72	12.35	12.72	13.45	13.82	15.28
8H	4H	12.26	12.67	13.34	13.75	15.21	11.89	12.30	12.97	13.38	14.84
	6H	12.88	13.22	13.98	14.34	15.79	12.50	12.85	13.60	13.97	15.42
	8H	13.09	13.39	14.20	14.50	15.97	12.71	13.01	13.82	14.11	15.59
	12H	13.22	13.48	14.33	14.58	16.09	12.82	13.08	13.93	14.18	15.69
12H	4H	12.24	12.61	13.34	13.71	15.17	11.88	12.25	12.97	13.34	14.81
	6H	12.91	13.21	14.01	14.31	15.78	12.54	12.84	13.65	13.95	15.42
	8H	13.14	13.40	14.25	14.50	16.01	12.77	13.03	13.88	14.13	15.64

END OF REPORT