

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903065

Luminaire Tested: DFN2DIP-PN3F0-070D040US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903065
REPORT IS A COMBINATION OF REPORTS P901053 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-070D040US830-FLLONL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10264.3 lumens
Efficiency: N/A
Efficacy: 103.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 99.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903065

CATALOG NUMBER: DFN2DIP-PN3F0-070D040US830-FLLONL

Luminous Intensity Polar Plot

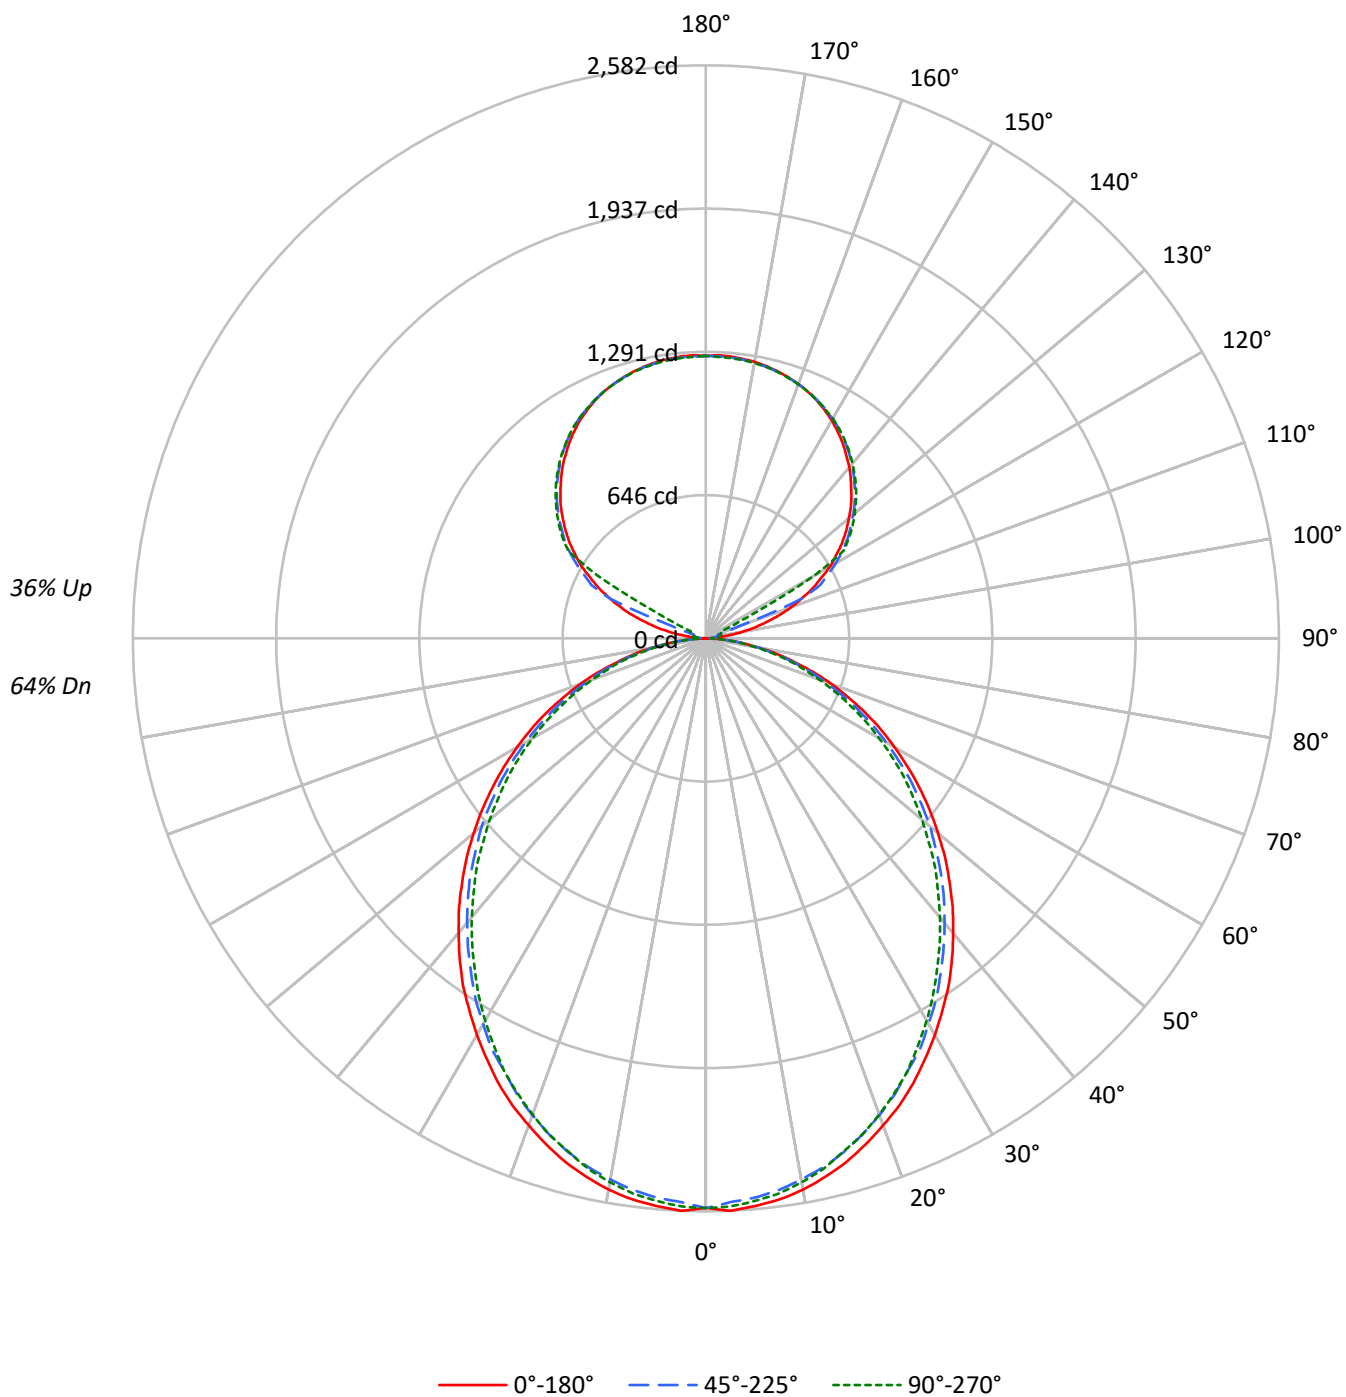

TEST NUMBER: P903065

CATALOG NUMBER: DFN2DIP-PN3F0-070D040US830-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	104	104	104	104	91	91	91	79	79	79	69	69	69
1	101	96	92	89	94	91	87	84	80	77	75	70	68	66	61	59	58
2	92	84	78	73	86	79	74	69	70	66	62	61	58	55	53	51	49
3	84	74	67	61	78	70	63	58	62	57	52	54	50	47	47	44	42
4	77	66	58	51	72	62	55	49	55	49	45	48	44	40	42	39	36
5	71	59	50	44	66	55	48	42	49	43	39	44	39	35	38	34	31
6	65	53	44	38	61	50	42	37	44	38	34	39	34	31	35	31	28
7	60	48	39	34	56	45	38	32	40	34	30	36	31	27	32	28	25
8	56	43	35	30	52	41	34	29	37	31	27	33	28	24	29	25	22
9	52	40	32	27	49	38	31	26	34	28	24	30	25	22	27	23	20
10	49	36	29	24	46	35	28	23	31	26	22	28	23	20	25	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3001	3001	3001
5°	3004	2957	2978
10°	2978	2915	2936
15°	2932	2865	2872
20°	2871	2796	2806
25°	2811	2715	2730
30°	2735	2638	2634
35°	2663	2548	2533
40°	2575	2458	2436
45°	2487	2367	2337
50°	2391	2271	2222
55°	2290	2161	2117
60°	2176	2030	1996
65°	2051	1894	1853
70°	1892	1727	1699
75°	1672	1529	1555
80°	1406	1275	1283
85°	992	843	836

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2487 cd/sqm

TEST NUMBER: P903065

CATALOG NUMBER: DFN2DIP-PN3F0-070D040US830-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	241.6	2.4
10°-20°	679.9	6.6
20°-30°	999.1	9.7
30°-40°	1160.4	11.3
40°-50°	1159.0	11.3
50°-60°	1010.6	9.8
60°-70°	747.1	7.3
70°-80°	422.7	4.1
80°-90°	113.8	1.1
90°-100°	41.9	0.4
100°-110°	156.4	1.5
110°-120°	414.8	4.0
120°-130°	688.0	6.7
130°-140°	730.8	7.1
140°-150°	679.2	6.6
150°-160°	546.1	5.3
160°-170°	351.9	3.4
170°-180°	121.1	1.2
0°-30°	1920.6	18.7
0°-40°	3081.0	30.0
0°-60°	5250.6	51.2
0°-90°	6534.1	63.7
90°-120°	613.2	6.0
90°-150°	2711.2	26.4
90°-180°	3730.0	36.3
0°-180°	10264.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2567	2567	2567	2567	2567	
5°	2567	2558	2530	2550	2545	244
15°	2444	2429	2397	2407	2395	688
25°	2212	2192	2150	2155	2150	1018
35°	1908	1884	1844	1829	1817	1192
45°	1553	1536	1498	1471	1461	1198
55°	1175	1160	1131	1101	1089	1051
65°	793	778	753	731	718	784
75°	415	410	397	383	388	443
85°	101	99	96	89	86	113
90°	1	11	18	23	25	9
95°	60	29	36	40	40	71
105°	280	308	56	66	70	299
115°	529	545	568	142	76	521
125°	748	760	778	784	787	668
135°	926	941	949	958	957	715
145°	1074	1074	1089	1096	1091	672
155°	1183	1175	1186	1191	1184	545
165°	1247	1241	1244	1250	1244	352
175°	1275	1269	1270	1277	1268	121
180°	1272	1272	1272	1272	1272	

TEST NUMBER: P903065

CATALOG NUMBER: DFN2DIP-PN3F0-070D040US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2567.2	2567.2	2567.2	2567.2	2567.2
2.5°	2582.2	2569.8	2542.6	2567.2	2562.5
5°	2567.2	2557.6	2530.3	2550.0	2545.2
7.5°	2550.0	2535.3	2508.0	2528.0	2523.0
10°	2523.0	2505.7	2476.1	2495.8	2488.4
12.5°	2485.8	2471.2	2441.6	2453.8	2448.8
15°	2443.9	2429.2	2397.0	2407.0	2394.6
17.5°	2392.0	2377.4	2345.1	2357.5	2345.1
20°	2335.1	2320.5	2285.9	2293.3	2283.6
22.5°	2278.6	2256.4	2224.1	2224.1	2219.1
25°	2211.9	2192.2	2150.3	2155.0	2150.3
27.5°	2137.7	2120.4	2088.5	2081.1	2068.8
30°	2063.9	2043.9	2007.0	1999.7	1989.7
32.5°	1984.7	1970.1	1930.5	1915.6	1905.6
35°	1908.3	1883.7	1844.1	1829.2	1816.8
37.5°	1821.8	1799.6	1760.0	1742.8	1730.4
40°	1733.1	1713.2	1673.6	1651.6	1641.6
42.5°	1646.6	1626.7	1587.4	1562.5	1547.8
45°	1552.8	1535.6	1498.4	1471.4	1461.4
47.5°	1461.4	1444.2	1404.6	1377.3	1362.7
50°	1365.1	1352.7	1318.1	1283.6	1271.3
52.5°	1271.3	1254.1	1222.1	1194.9	1177.5
55°	1175.2	1160.3	1130.7	1101.1	1088.7
57.5°	1078.8	1066.5	1034.3	1004.7	994.8
60°	982.4	972.7	938.2	911.0	903.6
62.5°	888.6	871.4	846.8	822.2	812.2
65°	792.6	777.6	753.0	730.8	718.4
67.5°	693.8	681.3	659.2	642.0	632.0
70°	602.4	592.5	570.1	552.9	543.2
72.5°	508.6	498.7	486.4	469.1	461.8
75°	414.6	409.9	397.3	382.7	387.7
77.5°	330.8	320.8	315.8	308.5	301.2
80°	246.9	244.4	239.4	232.1	227.1
82.5°	167.9	167.9	165.5	155.6	155.6
85°	101.1	98.8	96.4	88.8	86.4
87.5°	44.5	39.6	34.6	27.2	24.6
90°	0.8	11.0	18.4	23.1	24.8
92.5°	23.1	19.3	22.1	23.9	24.8
95°	59.8	29.4	35.8	40.5	39.6
97.5°	107.7	32.2	46.9	49.8	50.6
100°	163.0	36.9	52.5	59.8	61.6
102.5°	223.7	222.0	54.3	64.4	67.2
105°	279.8	307.6	56.2	66.3	69.9
107.5°	345.3	368.3	58.1	68.1	71.8
110°	407.9	427.2	161.2	69.1	72.7

TEST NUMBER: P903065

CATALOG NUMBER: DFN2DIP-PN3F0-070D040US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	466.8	483.3	467.7	70.9	73.7
115°	529.3	545.0	568.1	141.8	75.6
117.5°	583.7	602.1	617.8	486.1	244.9
120°	644.5	658.3	674.9	686.0	561.7
122.5°	696.0	710.8	729.2	734.7	735.7
125°	748.5	760.5	778.0	784.5	787.2
127.5°	796.4	809.3	823.1	832.4	833.2
130°	841.5	856.3	866.3	876.5	875.6
132.5°	887.5	899.6	909.6	917.9	917.1
135°	926.2	941.0	949.2	958.5	956.7
137.5°	966.7	977.7	987.0	996.2	993.4
140°	1006.3	1013.7	1023.8	1032.1	1027.5
142.5°	1039.5	1045.9	1057.9	1065.2	1060.6
145°	1074.5	1073.6	1089.1	1095.6	1091.0
147.5°	1104.8	1102.0	1117.7	1122.3	1118.7
150°	1134.3	1127.8	1142.6	1148.1	1143.5
152.5°	1159.1	1151.8	1165.5	1171.1	1164.7
155°	1183.1	1174.9	1185.9	1191.4	1184.0
157.5°	1202.4	1195.0	1203.4	1209.8	1202.4
160°	1219.0	1213.4	1219.0	1224.5	1218.0
162.5°	1233.7	1228.2	1232.8	1239.3	1231.0
165°	1246.6	1241.1	1243.9	1250.3	1243.9
167.5°	1256.8	1251.1	1254.1	1260.5	1252.2
170°	1265.1	1259.5	1261.3	1267.8	1259.5
172.5°	1270.5	1265.1	1267.0	1273.4	1265.1
175°	1275.1	1268.7	1270.5	1277.0	1267.8
177.5°	1277.0	1270.5	1271.5	1278.0	1269.7
180°	1272.4	1272.4	1272.4	1272.4	1272.4

TEST NUMBER: P903065

CATALOG NUMBER: DFN2DIP-PN3F0-070D040US830-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.22	13.22	13.05	14.08	15.14	11.79	12.78	12.62	13.64	14.70
	3H	13.89	14.79	14.73	15.65	16.74	13.41	14.30	14.25	15.17	16.25
	4H	14.48	15.33	15.34	16.20	17.30	13.99	14.84	14.85	15.71	16.81
	6H	14.88	15.66	15.75	16.54	17.65	14.39	15.17	15.26	16.05	17.16
	8H	14.99	15.73	15.87	16.63	17.74	14.50	15.24	15.38	16.14	17.25
	12H	15.04	15.75	15.92	16.64	17.77	14.54	15.25	15.43	16.14	17.28
4H	2H	12.70	13.55	13.56	14.42	15.51	12.35	13.20	13.21	14.06	15.16
	3H	14.57	15.28	15.45	16.18	17.29	14.17	14.88	15.04	15.78	16.89
	4H	15.28	15.93	16.17	16.83	17.97	14.87	15.51	15.76	16.41	17.55
	6H	15.80	16.36	16.70	17.28	18.42	15.38	15.94	16.28	16.86	18.00
	8H	15.95	16.47	16.86	17.39	18.55	15.53	16.05	16.43	16.96	18.12
	12H	16.03	16.50	16.95	17.43	18.60	15.59	16.06	16.52	17.00	18.16
8H	4H	15.49	16.01	16.39	16.93	18.08	15.12	15.64	16.02	16.56	17.71
	6H	16.12	16.55	17.05	17.51	18.66	15.74	16.17	16.68	17.13	18.29
	8H	16.34	16.72	17.28	17.67	18.84	15.95	16.33	16.90	17.28	18.46
	12H	16.47	16.81	17.41	17.75	18.97	16.07	16.41	17.02	17.35	18.57
12H	4H	15.48	15.95	16.40	16.88	18.05	15.12	15.59	16.04	16.52	17.69
	6H	16.15	16.53	17.09	17.48	18.65	15.78	16.17	16.73	17.12	18.29
	8H	16.39	16.73	17.34	17.67	18.89	16.02	16.36	16.97	17.30	18.52