

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903125

Luminaire Tested: DFN2DIP-PN3F0-090D050US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903125
REPORT IS A COMBINATION OF REPORTS P901071 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-090D050US830-FLLONL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13063.7 lumens
Efficiency: N/A
Efficacy: 100.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 130.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9954
Total Harmonic Distortion (THDi): 0.076
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903125

CATALOG NUMBER: DFN2DIP-PN3F0-090D050US830-FLLONL

Luminous Intensity Polar Plot

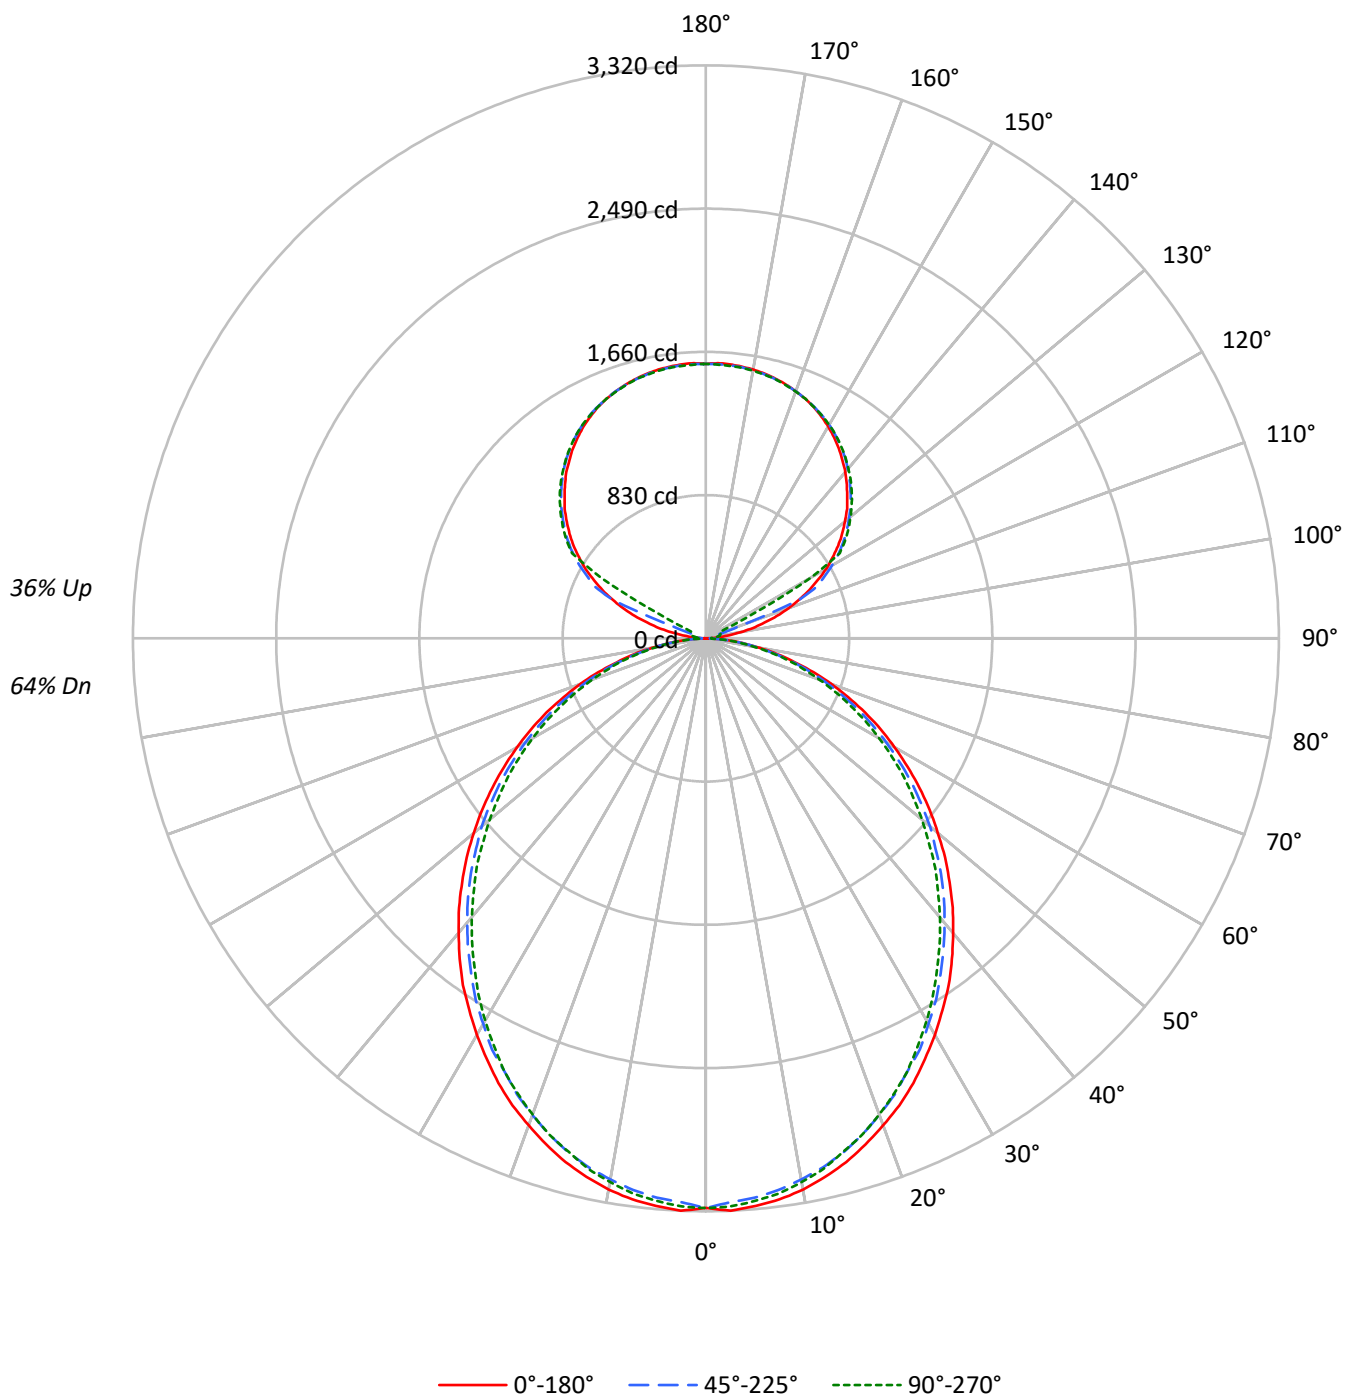

TEST NUMBER: P903125

CATALOG NUMBER: DFN2DIP-PN3F0-090D050US830-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	111	111	111	111	104	104	104	104	91	91	91		80	80	80		69
1	101	97	93	89	95	91	87	84	80	78	75		70	68	67		61
2	92	84	78	73	86	79	74	69	70	66	62		62	59	56		54
3	84	74	67	61	79	70	63	58	62	57	52		55	51	47		48
4	77	66	58	51	72	62	55	49	55	49	45		49	44	40		43
5	71	59	50	44	66	55	48	42	49	43	39		44	39	35		39
6	65	53	44	38	61	50	42	37	45	38	34		40	35	31		35
7	60	48	40	34	57	45	38	33	41	34	30		36	31	27		32
8	56	43	35	30	53	41	34	29	37	31	27		33	28	24		29
9	52	40	32	27	49	38	31	26	34	28	24		30	26	22		27
10	49	37	29	24	46	35	28	23	31	26	22		28	23	20		25

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3858	3858	3858
5°	3862	3802	3829
10°	3829	3748	3775
15°	3770	3684	3693
20°	3692	3595	3608
25°	3614	3490	3511
30°	3517	3392	3387
35°	3424	3277	3257
40°	3311	3160	3132
45°	3198	3043	3005
50°	3074	2920	2858
55°	2944	2778	2722
60°	2797	2609	2566
65°	2637	2434	2382
70°	2432	2221	2184
75°	2150	1966	1999
80°	1808	1638	1650
85°	1275	1084	1075

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3198 cd/sqm

TEST NUMBER: P903125

CATALOG NUMBER: DFN2DIP-PN3F0-090D050US830-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	310.7	2.4
10°-20°	874.1	6.7
20°-30°	1284.6	9.8
30°-40°	1492.0	11.4
40°-50°	1490.1	11.4
50°-60°	1299.3	9.9
60°-70°	960.5	7.4
70°-80°	543.4	4.2
80°-90°	146.2	1.1
90°-100°	52.5	0.4
100°-110°	195.5	1.5
110°-120°	518.5	4.0
120°-130°	860.0	6.6
130°-140°	913.5	7.0
140°-150°	849.0	6.5
150°-160°	682.6	5.2
160°-170°	439.8	3.4
170°-180°	151.4	1.2
0°-30°	2469.3	18.9
0°-40°	3961.3	30.3
0°-60°	6750.7	51.7
0°-90°	8400.9	64.3
90°-120°	766.5	5.9
90°-150°	3389.0	25.9
90°-180°	4663.0	35.7
0°-180°	13063.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3301	3301	3301	3301	3301	
5°	3301	3288	3253	3278	3272	313
15°	3142	3123	3082	3095	3079	885
25°	2844	2818	2765	2771	2765	1309
35°	2454	2422	2371	2352	2336	1532
45°	1996	1974	1926	1892	1879	1541
55°	1511	1492	1454	1416	1400	1351
65°	1019	1000	968	940	924	1007
75°	533	527	511	492	498	569
85°	130	127	124	114	111	145
90°	1	14	23	29	31	12
95°	75	37	45	51	50	89
105°	350	384	70	83	88	374
115°	662	681	710	177	94	651
125°	936	951	972	980	984	834
135°	1158	1176	1186	1198	1196	894
145°	1343	1342	1361	1370	1364	840
155°	1479	1469	1482	1489	1480	681
165°	1558	1551	1555	1563	1555	440
175°	1594	1586	1588	1596	1585	152
180°	1590	1590	1590	1590	1590	

TEST NUMBER: P903125

CATALOG NUMBER: DFN2DIP-PN3F0-090D050US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3300.7	3300.7	3300.7	3300.7	3300.7
2.5°	3319.9	3304.1	3269.1	3300.7	3294.7
5°	3300.7	3288.2	3253.3	3278.5	3272.4
7.5°	3278.5	3259.7	3224.6	3250.3	3243.9
10°	3243.9	3221.6	3183.5	3208.8	3199.4
12.5°	3196.0	3177.1	3139.1	3154.9	3148.6
15°	3142.2	3123.3	3081.8	3094.6	3078.8
17.5°	3075.4	3056.6	3015.2	3031.0	3015.2
20°	3002.4	2983.5	2939.0	2948.5	2936.0
22.5°	2929.6	2901.1	2859.6	2859.6	2853.2
25°	2843.7	2818.5	2764.7	2770.7	2764.7
27.5°	2748.5	2726.2	2685.2	2675.8	2659.9
30°	2653.5	2627.9	2580.4	2571.0	2558.2
32.5°	2551.8	2533.0	2482.1	2463.0	2450.1
35°	2453.5	2421.9	2371.0	2351.8	2336.0
37.5°	2342.4	2313.8	2262.9	2240.7	2224.9
40°	2228.2	2202.6	2151.7	2123.5	2110.7
42.5°	2117.0	2091.5	2041.0	2009.0	1990.2
45°	1996.5	1974.3	1926.5	1891.8	1879.1
47.5°	1879.1	1856.8	1805.9	1770.9	1752.1
50°	1755.1	1739.3	1694.8	1650.4	1634.6
52.5°	1634.6	1612.3	1571.2	1536.2	1514.0
55°	1511.0	1491.8	1453.7	1415.7	1399.9
57.5°	1387.0	1371.2	1329.8	1291.8	1278.9
60°	1263.1	1250.7	1206.2	1171.2	1161.8
62.5°	1142.5	1120.3	1088.6	1057.1	1044.2
65°	1019.0	999.8	968.1	939.5	923.7
67.5°	892.0	875.9	847.5	825.4	812.6
70°	774.5	761.7	733.1	710.9	698.4
72.5°	653.9	641.1	625.3	603.1	593.7
75°	533.1	527.0	510.9	492.0	498.4
77.5°	425.3	412.6	406.1	396.7	387.3
80°	317.5	314.1	307.7	298.3	292.0
82.5°	215.8	215.8	212.8	200.0	200.0
85°	130.0	127.0	123.9	114.1	111.1
87.5°	57.2	50.8	44.5	35.1	31.7
90°	1.1	13.8	23.0	28.8	31.0
92.5°	28.8	24.2	27.6	30.0	31.0
95°	74.7	36.8	44.9	50.7	49.5
97.5°	134.6	40.3	58.6	62.2	63.2
100°	203.8	46.1	65.6	74.7	77.1
102.5°	279.7	277.4	68.0	80.5	84.1
105°	349.9	384.5	70.2	82.8	87.5
107.5°	431.6	460.2	72.6	85.1	89.8
110°	509.9	534.0	201.4	86.3	90.9

TEST NUMBER: P903125

CATALOG NUMBER: DFN2DIP-PN3F0-090D050US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	583.5	604.2	584.7	88.6	92.1
115°	661.8	681.3	710.1	177.3	94.4
117.5°	729.6	752.6	772.3	607.6	306.1
120°	805.6	822.8	843.6	857.4	702.0
122.5°	870.0	888.4	911.5	918.4	919.6
125°	935.6	950.6	972.5	980.5	984.0
127.5°	995.4	1011.5	1029.0	1040.4	1041.5
130°	1051.9	1070.4	1082.9	1095.6	1094.6
132.5°	1109.5	1124.5	1137.0	1147.5	1146.3
135°	1157.8	1176.3	1186.5	1198.2	1195.8
137.5°	1208.3	1222.2	1233.8	1245.3	1241.9
140°	1257.8	1267.2	1279.7	1290.1	1284.4
142.5°	1299.4	1307.5	1322.4	1331.5	1325.8
145°	1343.1	1341.9	1361.4	1369.5	1363.8
147.5°	1381.0	1377.5	1397.1	1402.9	1398.4
150°	1417.9	1409.9	1428.2	1435.1	1429.4
152.5°	1448.9	1439.7	1457.0	1464.0	1455.9
155°	1478.8	1468.6	1482.3	1489.2	1480.1
157.5°	1503.0	1493.8	1504.2	1512.3	1503.0
160°	1523.8	1516.8	1523.8	1530.6	1522.6
162.5°	1542.1	1535.3	1541.0	1549.1	1538.7
165°	1558.2	1551.4	1554.8	1562.8	1554.8
167.5°	1570.9	1564.0	1567.5	1575.6	1565.2
170°	1581.3	1574.3	1576.7	1584.7	1574.3
172.5°	1588.2	1581.3	1583.7	1591.7	1581.3
175°	1593.9	1585.8	1588.2	1596.2	1584.7
177.5°	1596.2	1588.2	1589.4	1597.4	1587.1
180°	1590.4	1590.4	1590.4	1590.4	1590.4

TEST NUMBER: P903125

CATALOG NUMBER: DFN2DIP-PN3F0-090D050US830-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.15	14.16	13.97	15.00	16.05	12.71	13.72	13.53	14.56	15.61
	3H	14.81	15.72	15.65	16.57	17.65	14.33	15.24	15.17	16.09	17.17
	4H	15.40	16.26	16.26	17.12	18.21	14.92	15.77	15.77	16.64	17.73
	6H	15.81	16.59	16.67	17.47	18.57	15.32	16.11	16.18	16.98	18.08
	8H	15.91	16.66	16.79	17.55	18.66	15.42	16.17	16.30	17.06	18.17
	12H	15.96	16.68	16.84	17.56	18.69	15.47	16.18	16.35	17.06	18.19
4H	2H	13.62	14.48	14.48	15.34	16.43	13.27	14.13	14.13	14.99	16.08
	3H	15.50	16.21	16.37	17.10	18.21	15.09	15.81	15.96	16.70	17.81
	4H	16.21	16.86	17.09	17.75	18.88	15.80	16.45	16.68	17.34	18.47
	6H	16.73	17.29	17.63	18.21	19.34	16.31	16.87	17.20	17.78	18.92
	8H	16.88	17.40	17.78	18.31	19.46	16.45	16.98	17.35	17.89	19.04
	12H	16.96	17.43	17.88	18.36	19.51	16.52	16.99	17.44	17.92	19.07
8H	4H	16.42	16.94	17.32	17.85	19.00	16.05	16.57	16.95	17.48	18.63
	6H	17.05	17.48	17.97	18.43	19.58	16.67	17.11	17.60	18.06	19.20
	8H	17.26	17.65	18.20	18.59	19.76	16.88	17.27	17.82	18.21	19.37
	12H	17.40	17.74	18.34	18.67	19.89	17.00	17.34	17.94	18.27	19.49
12H	4H	16.41	16.88	17.33	17.81	18.96	16.05	16.52	16.96	17.45	18.60
	6H	17.07	17.46	18.01	18.40	19.57	16.71	17.10	17.65	18.04	19.20
	8H	17.32	17.66	18.26	18.59	19.81	16.95	17.29	17.89	18.22	19.44