

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903135

Luminaire Tested: DFN2DIP-PN3F0-090D070US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903135
REPORT IS A COMBINATION OF REPORTS P901100 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-090D070US830-RLLONL
Description: 3 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13742.3 lumens
Efficiency: N/A
Efficacy: 93.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 147.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9954
Total Harmonic Distortion (THDi): 0.076
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903135

CATALOG NUMBER: DFN2DIP-PN3F0-090D070US830-RLLONL

Luminous Intensity Polar Plot

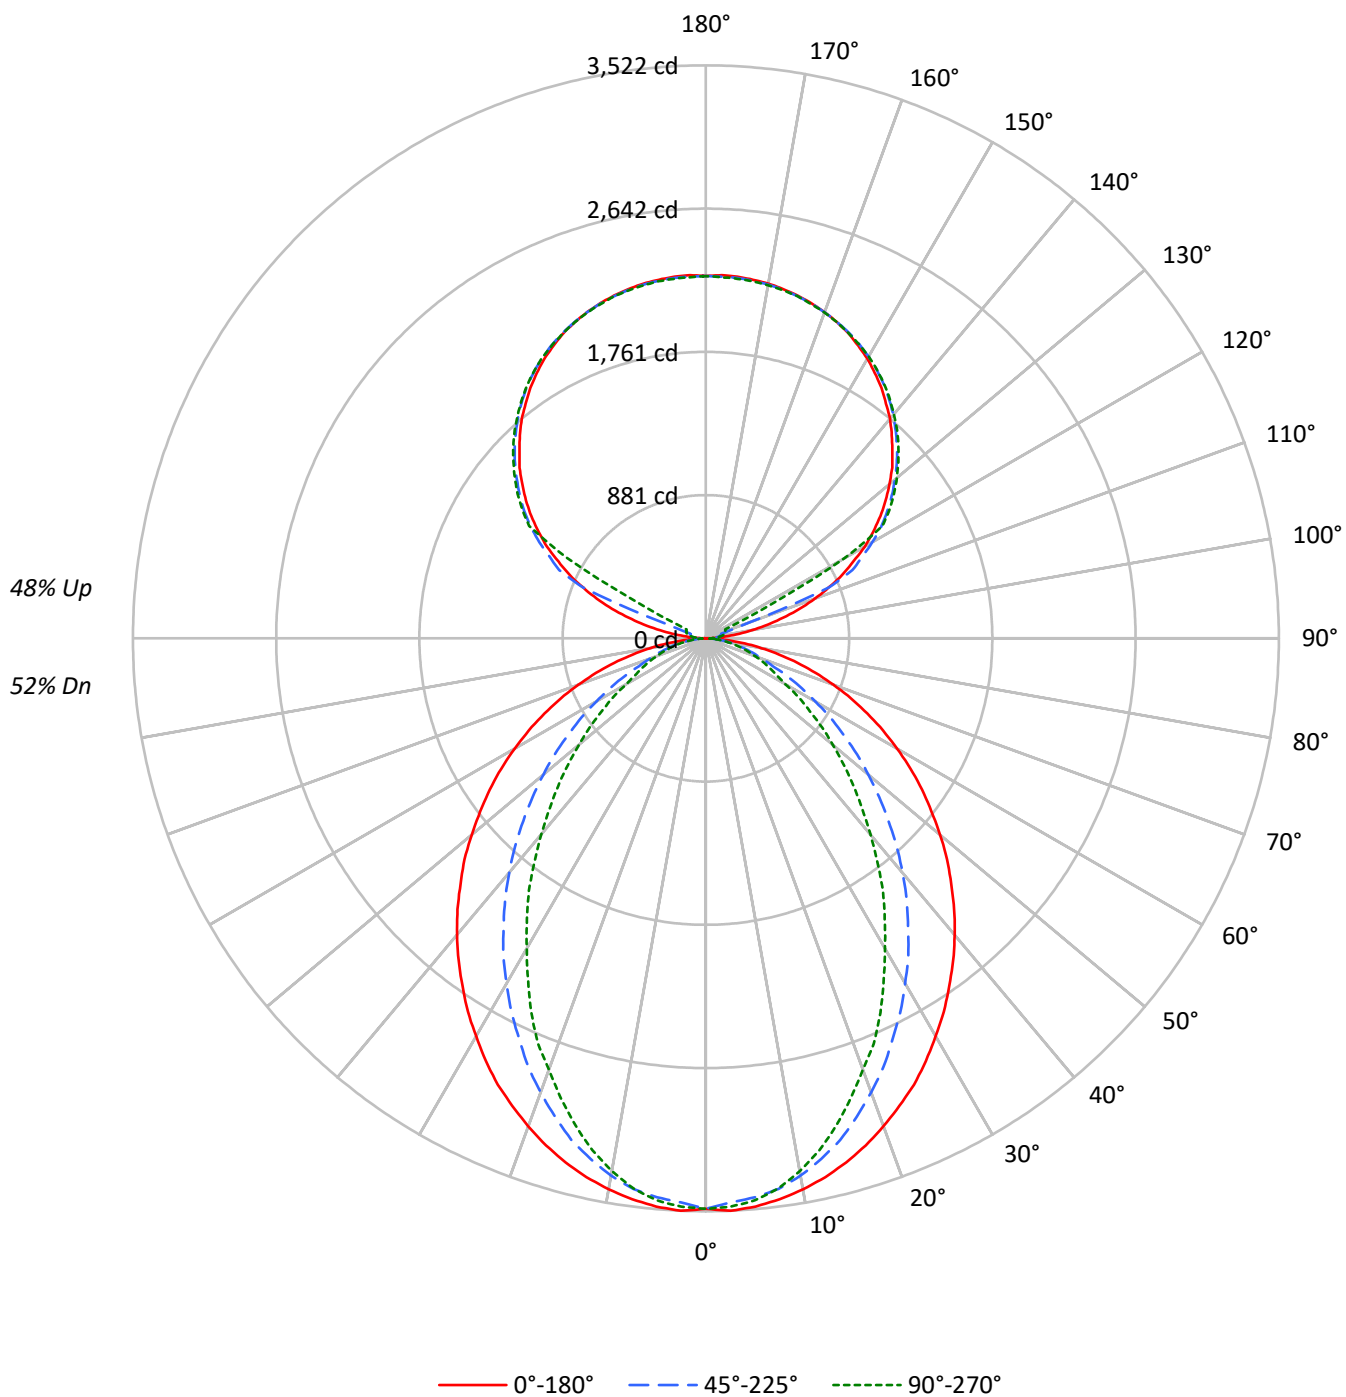

TEST NUMBER: P903135

CATALOG NUMBER: DFN2DIP-PN3F0-090D070US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	58	58	58
1	99	95	91	88	91	88	85	82	75	73	71	63	62	60	52	51	50
2	90	83	77	72	84	77	72	68	66	63	59	56	53	51	47	45	43
3	83	74	67	61	76	69	62	57	59	54	50	50	47	44	42	39	37
4	76	66	58	52	70	61	54	49	53	48	43	45	41	38	38	35	33
5	70	59	51	45	65	55	48	43	47	42	38	41	36	33	34	31	29
6	65	53	45	39	60	49	42	37	43	37	33	37	33	29	31	28	26
7	60	48	40	35	55	45	38	33	39	34	30	34	29	26	29	25	23
8	56	44	36	31	52	41	34	29	36	30	26	31	27	24	26	23	21
9	52	40	33	28	48	38	31	26	33	28	24	29	24	21	25	21	19
10	49	37	30	25	45	35	28	24	30	25	22	27	22	19	23	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4098	4098	4098
5°	4103	4031	4057
10°	4059	3949	3924
15°	4001	3815	3718
20°	3925	3633	3466
25°	3847	3429	3223
30°	3742	3219	2915
35°	3640	2995	2645
40°	3536	2763	2335
45°	3415	2506	2055
50°	3290	2247	1781
55°	3159	1970	1518
60°	3007	1682	1248
65°	2833	1388	1121
70°	2621	1115	1012
75°	2354	976	917
80°	1968	810	789
85°	1337	527	582

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3415 cd/sqm

TEST NUMBER: P903135

CATALOG NUMBER: DFN2DIP-PN3F0-090D070US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	328.6	2.4
10°-20°	902.0	6.6
20°-30°	1266.4	9.2
30°-40°	1380.5	10.0
40°-50°	1268.8	9.2
50°-60°	996.5	7.3
60°-70°	648.6	4.7
70°-80°	333.9	2.4
80°-90°	89.1	0.6
90°-100°	73.4	0.5
100°-110°	273.7	2.0
110°-120°	725.9	5.3
120°-130°	1204.0	8.8
130°-140°	1278.9	9.3
140°-150°	1188.6	8.6
150°-160°	955.6	7.0
160°-170°	615.8	4.5
170°-180°	211.9	1.5
0°-30°	2497.0	18.2
0°-40°	3877.5	28.2
0°-60°	6142.8	44.7
0°-90°	7214.4	52.5
90°-120°	1073.0	7.8
90°-150°	4744.6	34.5
90°-180°	6528.0	47.5
0°-180°	13742.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3506	3506	3506	3506	3506	
5°	3506	3490	3449	3477	3468	332
15°	3335	3300	3192	3132	3100	940
25°	3027	2925	2716	2586	2538	1392
35°	2608	2446	2167	1967	1897	1632
45°	2132	1920	1586	1361	1285	1647
55°	1621	1374	1031	841	781	1449
65°	1095	838	552	444	435	1085
75°	584	362	254	232	229	617
85°	136	70	60	60	60	156
90°	2	19	32	40	44	13
95°	105	52	63	71	69	124
105°	490	538	98	116	122	523
115°	926	954	994	248	132	912
125°	1310	1331	1362	1373	1378	1168
135°	1621	1647	1661	1677	1674	1252
145°	1880	1879	1906	1917	1909	1176
155°	2070	2056	2075	2085	2072	954
165°	2182	2172	2177	2188	2177	616
175°	2232	2220	2224	2235	2219	212
180°	2227	2227	2227	2227	2227	

TEST NUMBER: P903135

CATALOG NUMBER: DFN2DIP-PN3F0-090D070US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3506.0	3506.0	3506.0	3506.0	3506.0
2.5°	3521.8	3506.0	3470.9	3503.0	3496.5
5°	3506.0	3490.1	3448.8	3477.3	3467.9
7.5°	3477.3	3458.5	3414.1	3426.5	3410.7
10°	3439.3	3417.1	3353.8	3344.0	3325.2
12.5°	3391.8	3363.3	3277.4	3258.6	3223.5
15°	3334.6	3299.7	3191.9	3131.6	3100.0
17.5°	3268.0	3217.2	3083.8	3014.2	2963.4
20°	3191.9	3128.3	2969.7	2890.6	2820.6
22.5°	3109.4	3036.4	2852.2	2744.5	2697.1
25°	3027.0	2925.3	2715.9	2586.0	2538.2
27.5°	2928.7	2820.6	2589.0	2439.9	2366.8
30°	2824.0	2703.1	2449.3	2287.7	2201.9
32.5°	2722.3	2576.2	2316.3	2125.8	2046.4
35°	2608.2	2446.3	2167.2	1967.3	1897.2
37.5°	2497.1	2322.4	2027.5	1808.4	1729.3
40°	2379.6	2189.4	1881.4	1656.2	1573.8
42.5°	2259.1	2056.2	1735.6	1500.7	1421.5
45°	2132.2	1919.5	1586.5	1360.9	1284.9
47.5°	2011.7	1786.5	1443.8	1218.2	1148.6
50°	1878.4	1653.1	1304.1	1085.0	1018.6
52.5°	1748.1	1510.1	1170.8	961.4	901.2
55°	1621.2	1373.8	1031.0	840.9	780.6
57.5°	1491.3	1237.5	907.6	729.8	679.0
60°	1357.9	1104.1	777.3	615.7	564.9
62.5°	1228.0	974.2	666.2	514.1	488.8
65°	1094.7	837.5	552.0	444.3	434.6
67.5°	967.8	710.6	444.3	390.1	380.7
70°	834.5	587.1	368.0	336.3	323.5
72.5°	707.6	472.6	307.6	282.4	276.1
75°	583.7	361.6	253.8	231.6	228.6
77.5°	460.1	256.8	199.9	187.2	180.8
80°	345.7	184.2	152.1	139.7	139.7
82.5°	241.0	123.9	104.7	98.3	98.3
85°	136.3	69.7	60.2	60.2	60.2
87.5°	50.8	25.3	25.3	22.2	22.2
90°	1.5	19.3	32.1	40.3	43.5
92.5°	40.3	33.8	38.6	41.9	43.5
95°	104.6	51.5	62.8	71.0	69.3
97.5°	188.4	56.5	82.1	87.1	88.6
100°	285.3	64.5	91.8	104.6	107.9
102.5°	391.4	388.4	95.1	112.7	117.6
105°	489.8	538.2	98.3	115.9	122.4
107.5°	604.2	644.4	101.6	119.2	125.7
110°	713.9	747.5	282.0	120.9	127.2

TEST NUMBER: P903135

CATALOG NUMBER: DFN2DIP-PN3F0-090D070US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	817.0	845.8	818.5	123.9	128.9
115°	926.4	953.8	994.1	248.2	132.2
117.5°	1021.5	1053.7	1081.2	850.6	428.6
120°	1127.8	1152.0	1181.1	1200.4	982.9
122.5°	1218.0	1243.8	1276.2	1285.7	1287.4
125°	1309.9	1330.9	1361.5	1372.8	1377.5
127.5°	1393.6	1416.2	1440.5	1456.6	1458.1
130°	1472.6	1498.5	1516.1	1533.9	1532.4
132.5°	1553.2	1574.2	1591.9	1606.4	1604.9
135°	1620.9	1646.7	1661.1	1677.3	1674.1
137.5°	1691.7	1711.1	1727.3	1743.4	1738.6
140°	1761.0	1774.0	1791.6	1806.1	1798.1
142.5°	1819.1	1830.4	1851.2	1864.1	1856.1
145°	1880.4	1878.7	1906.0	1917.3	1909.3
147.5°	1933.3	1928.6	1956.0	1964.0	1957.7
150°	1985.0	1973.8	1999.6	2009.1	2001.1
152.5°	2028.4	2015.6	2039.8	2049.5	2038.2
155°	2070.4	2056.0	2075.3	2084.9	2072.1
157.5°	2104.2	2091.4	2105.9	2117.2	2104.2
160°	2133.4	2123.5	2133.4	2142.9	2131.6
162.5°	2159.0	2149.4	2157.4	2168.7	2154.2
165°	2181.5	2172.0	2176.7	2188.0	2176.7
167.5°	2199.3	2189.5	2194.5	2205.8	2191.3
170°	2213.8	2204.1	2207.3	2218.7	2204.1
172.5°	2223.5	2213.8	2217.1	2228.4	2213.8
175°	2231.5	2220.2	2223.5	2234.7	2218.7
177.5°	2234.7	2223.5	2225.2	2236.5	2221.9
180°	2226.7	2226.7	2226.7	2226.7	2226.7

TEST NUMBER: P903135

CATALOG NUMBER: DFN2DIP-PN3F0-090D070US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.24	13.09	13.18	14.05	15.28	8.21	9.06	9.15	10.01	11.25
	3H	13.91	14.67	14.87	15.64	16.90	9.39	10.15	10.34	11.11	12.38
	4H	14.52	15.24	15.49	16.21	17.48	9.84	10.56	10.81	11.52	12.79
	6H	14.94	15.60	15.92	16.57	17.85	10.15	10.82	11.13	11.79	13.07
	8H	15.06	15.69	16.05	16.68	17.96	10.24	10.87	11.23	11.86	13.14
	12H	15.12	15.72	16.11	16.70	18.01	10.28	10.88	11.27	11.87	13.17
4H	2H	12.26	12.98	13.23	13.95	15.22	8.80	9.52	9.77	10.49	11.76
	3H	14.08	14.68	15.07	15.68	16.96	10.15	10.74	11.13	11.74	13.02
	4H	14.77	15.32	15.76	16.31	17.62	10.69	11.23	11.68	12.23	13.53
	6H	15.28	15.75	16.29	16.76	18.07	11.10	11.57	12.11	12.59	13.89
	8H	15.45	15.89	16.46	16.90	18.22	11.23	11.67	12.23	12.67	13.99
	12H	15.55	15.94	16.57	16.96	18.29	11.29	11.69	12.31	12.71	14.03
8H	4H	14.74	15.18	15.74	16.18	17.50	10.97	11.41	11.97	12.41	13.73
	6H	15.30	15.66	16.33	16.71	18.03	11.48	11.84	12.51	12.89	14.21
	8H	15.51	15.83	16.55	16.87	18.20	11.67	11.98	12.70	13.02	14.36
	12H	15.65	15.93	16.69	16.96	18.34	11.78	12.06	12.82	13.09	14.47
12H	4H	14.69	15.09	15.71	16.11	17.43	10.97	11.37	12.00	12.39	13.72
	6H	15.27	15.59	16.31	16.63	17.97	11.53	11.84	12.56	12.88	14.22
	8H	15.49	15.77	16.53	16.80	18.18	11.73	12.01	12.77	13.04	14.42

END OF REPORT