

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P905709

Luminaire Tested: DFN2DIP-PN3F0-040D040US835-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P905709
REPORT IS A COMBINATION OF REPORTS P901047 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-040D040US835-FLLONL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7920.0 lumens
Efficiency: N/A
Efficacy: 122.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 64.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P905709

CATALOG NUMBER: DFN2DIP-PN3F0-040D040US835-FLLONL

Luminous Intensity Polar Plot

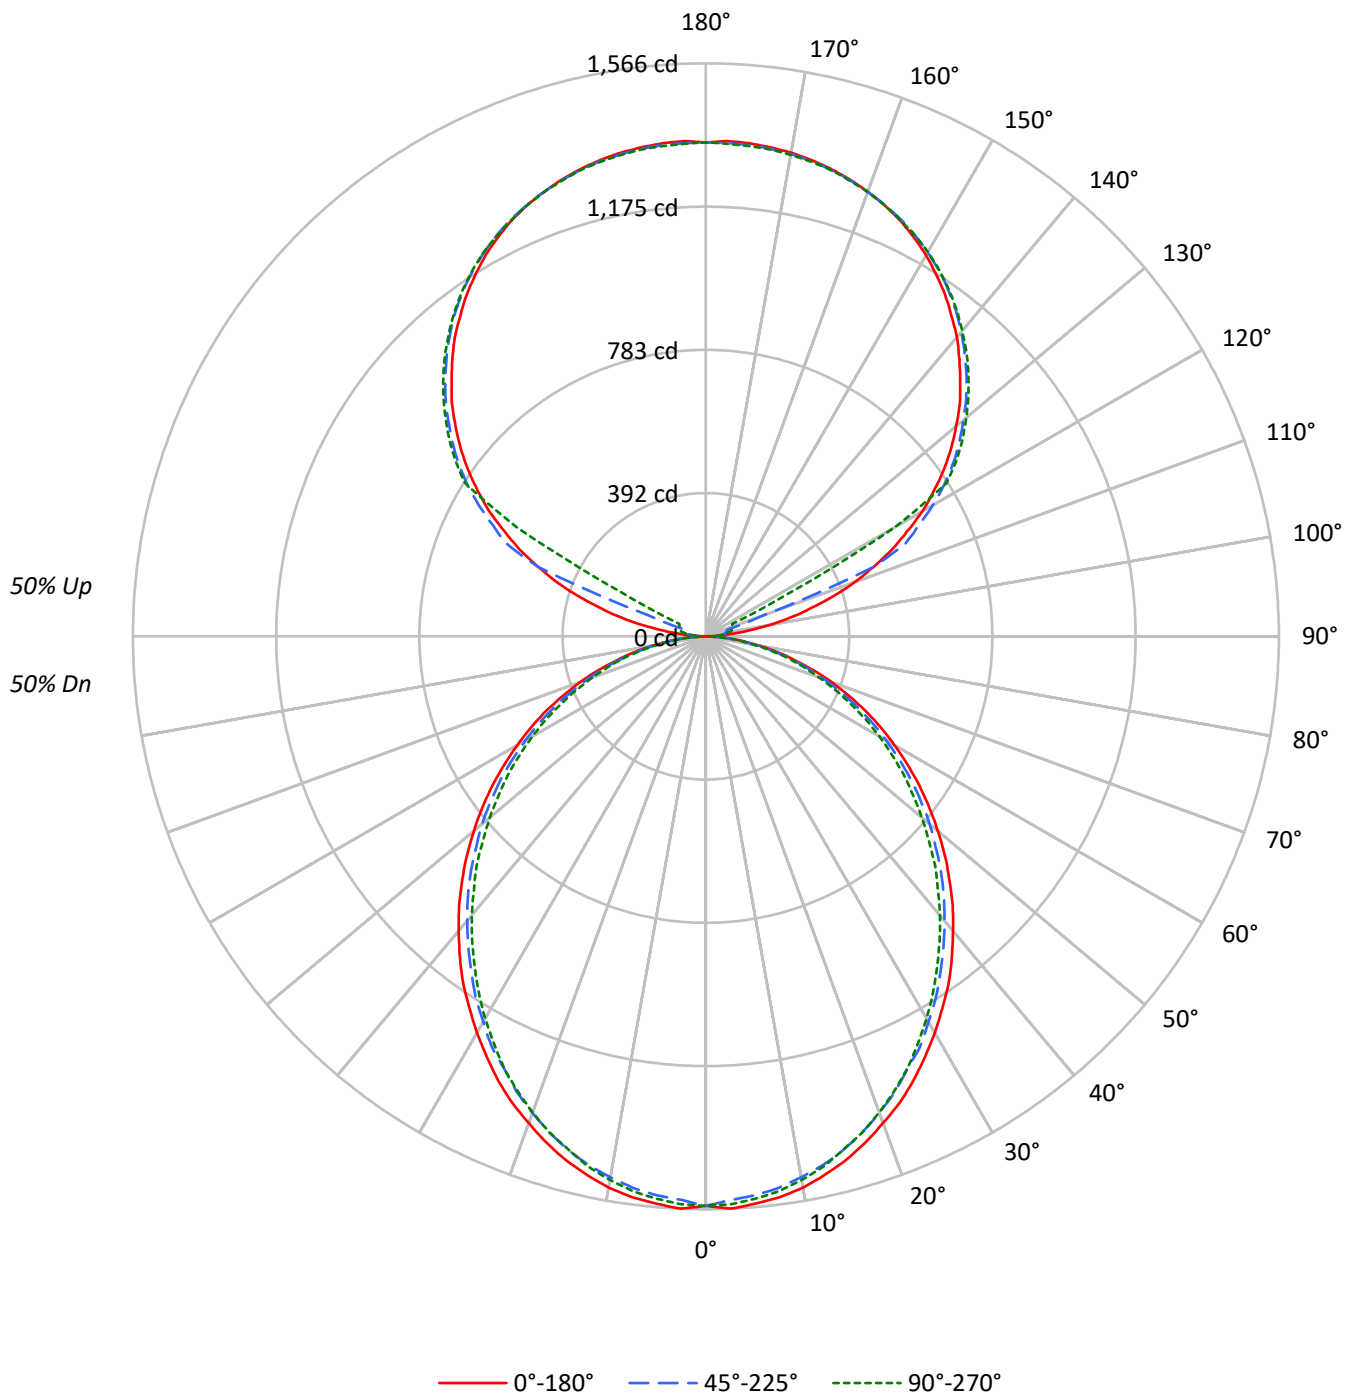

TEST NUMBER: P905709

CATALOG NUMBER: DFN2DIP-PN3F0-040D040US835-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1819	1819	1819
5°	1821	1793	1805
10°	1805	1767	1780
15°	1778	1737	1741
20°	1741	1695	1701
25°	1704	1646	1655
30°	1658	1599	1597
35°	1615	1545	1536
40°	1561	1490	1477
45°	1508	1435	1417
50°	1450	1377	1347
55°	1388	1310	1283
60°	1319	1230	1210
65°	1243	1148	1123
70°	1147	1047	1030
75°	1014	927	943
80°	852	773	778
85°	601	511	507

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1508 cd/sqm

TEST NUMBER: P905709

CATALOG NUMBER: DFN2DIP-PN3F0-040D040US835-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	146.5	1.8
10°-20°	412.2	5.2
20°-30°	605.7	7.6
30°-40°	703.5	8.9
40°-50°	702.6	8.9
50°-60°	612.7	7.7
60°-70°	452.9	5.7
70°-80°	256.2	3.2
80°-90°	70.0	0.9
90°-100°	44.5	0.6
100°-110°	165.9	2.1
110°-120°	440.1	5.6
120°-130°	729.9	9.2
130°-140°	775.4	9.8
140°-150°	720.6	9.1
150°-160°	579.4	7.3
160°-170°	373.3	4.7
170°-180°	128.5	1.6
0°-30°	1164.4	14.7
0°-40°	1867.9	23.6
0°-60°	3183.2	40.2
0°-90°	3962.4	50.0
90°-120°	650.5	8.2
90°-150°	2876.4	36.3
90°-180°	3958.0	50.0
0°-180°	7920.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1556	1556	1556	1556	1556	
5°	1556	1550	1534	1546	1543	148
15°	1482	1473	1453	1459	1452	417
25°	1341	1329	1304	1306	1304	617
35°	1157	1142	1118	1109	1102	722
45°	941	931	908	892	886	727
55°	712	703	686	668	660	637
65°	480	471	456	443	436	475
75°	251	248	241	232	235	268
85°	61	60	58	54	52	68
90°	1	12	20	24	26	7
95°	63	31	38	43	42	75
105°	297	326	60	70	74	317
115°	562	578	603	150	80	553
125°	794	807	825	832	835	708
135°	983	998	1007	1017	1015	759
145°	1140	1139	1156	1162	1158	713
155°	1255	1246	1258	1264	1256	578
165°	1323	1317	1320	1326	1320	374
175°	1353	1346	1348	1355	1345	129
180°	1350	1350	1350	1350	1350	

TEST NUMBER: P905709

CATALOG NUMBER: DFN2DIP-PN3F0-040D040US835-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1556.4	1556.4	1556.4	1556.4	1556.4
2.5°	1565.5	1558.0	1541.5	1556.4	1553.6
5°	1556.4	1550.5	1534.0	1545.9	1543.1
7.5°	1545.9	1537.0	1520.5	1532.6	1529.6
10°	1529.6	1519.1	1501.2	1513.1	1508.6
12.5°	1507.0	1498.1	1480.2	1487.7	1484.6
15°	1481.6	1472.7	1453.2	1459.2	1451.8
17.5°	1450.2	1441.3	1421.8	1429.2	1421.8
20°	1415.7	1406.8	1385.9	1390.3	1384.5
22.5°	1381.4	1367.9	1348.4	1348.4	1345.4
25°	1340.9	1329.0	1303.6	1306.5	1303.6
27.5°	1296.0	1285.5	1266.2	1261.7	1254.3
30°	1251.2	1239.2	1216.8	1212.3	1206.3
32.5°	1203.3	1194.4	1170.4	1161.4	1155.3
35°	1156.9	1142.0	1118.0	1109.0	1101.5
37.5°	1104.5	1091.0	1067.0	1056.6	1049.1
40°	1050.7	1038.6	1014.6	1001.3	995.3
42.5°	998.3	986.2	962.4	947.3	938.4
45°	941.4	931.0	908.4	892.1	886.0
47.5°	886.0	875.5	851.6	835.1	826.2
50°	827.6	820.1	799.2	778.2	770.7
52.5°	770.7	760.3	740.9	724.4	713.9
55°	712.5	703.4	685.5	667.5	660.1
57.5°	654.0	646.6	627.0	609.1	603.1
60°	595.6	589.7	568.8	552.3	547.8
62.5°	538.8	528.3	513.4	498.4	492.4
65°	480.5	471.4	456.5	443.0	435.6
67.5°	420.6	413.0	399.7	389.2	383.2
70°	365.2	359.2	345.7	335.2	329.3
72.5°	308.4	302.3	294.9	284.4	279.9
75°	251.4	248.5	240.9	232.0	235.0
77.5°	200.5	194.5	191.5	187.0	182.6
80°	149.7	148.1	145.1	140.7	137.7
82.5°	101.8	101.8	100.4	94.3	94.3
85°	61.3	59.9	58.4	53.8	52.4
87.5°	27.0	24.0	21.0	16.5	14.9
90°	0.9	11.7	19.5	24.5	26.3
92.5°	24.5	20.5	23.4	25.4	26.3
95°	63.4	31.2	38.0	43.0	42.0
97.5°	114.3	34.2	49.8	52.8	53.7
100°	172.9	39.1	55.7	63.4	65.4
102.5°	237.3	235.5	57.6	68.3	71.3
105°	296.9	326.3	59.6	70.3	74.2
107.5°	366.3	390.7	61.6	72.3	76.2
110°	432.8	453.2	171.0	73.3	77.1

TEST NUMBER: P905709

CATALOG NUMBER: DFN2DIP-PN3F0-040D040US835-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	495.3	512.8	496.2	75.2	78.2
115°	561.6	578.2	602.7	150.4	80.2
117.5°	619.3	638.8	655.5	515.7	259.8
120°	683.8	698.4	716.0	727.8	595.9
122.5°	738.4	754.1	773.7	779.5	780.5
125°	794.1	806.9	825.4	832.3	835.2
127.5°	844.9	858.6	873.3	883.1	884.0
130°	892.8	908.5	919.1	929.9	929.0
132.5°	941.6	954.4	965.1	973.9	973.0
135°	982.7	998.4	1007.1	1016.9	1015.0
137.5°	1025.6	1037.3	1047.2	1056.9	1054.0
140°	1067.6	1075.5	1086.2	1095.0	1090.1
142.5°	1102.9	1109.7	1122.4	1130.1	1125.3
145°	1140.0	1139.0	1155.5	1162.4	1157.5
147.5°	1172.1	1169.2	1185.8	1190.7	1186.9
150°	1203.4	1196.6	1212.3	1218.1	1213.2
152.5°	1229.8	1222.0	1236.6	1242.5	1235.7
155°	1255.2	1246.5	1258.2	1264.0	1256.2
157.5°	1275.7	1267.9	1276.8	1283.6	1275.7
160°	1293.3	1287.4	1293.3	1299.1	1292.3
162.5°	1308.9	1303.1	1308.0	1314.8	1306.0
165°	1322.6	1316.8	1319.7	1326.5	1319.7
167.5°	1333.4	1327.4	1330.5	1337.3	1328.5
170°	1342.2	1336.3	1338.2	1345.1	1336.3
172.5°	1348.0	1342.2	1344.2	1351.0	1342.2
175°	1352.8	1346.0	1348.0	1354.8	1345.1
177.5°	1354.8	1348.0	1349.0	1355.9	1347.1
180°	1350.0	1350.0	1350.0	1350.0	1350.0

TEST NUMBER: P905709

CATALOG NUMBER: DFN2DIP-PN3F0-040D040US835-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.32	10.18	10.27	11.15	12.42	8.88	9.74	9.83	10.71	11.98
	3H	10.97	11.74	11.94	12.72	14.02	10.49	11.26	11.46	12.24	13.53
	4H	11.55	12.29	12.54	13.27	14.57	11.07	11.80	12.05	12.79	14.09
	6H	11.95	12.62	12.94	13.61	14.93	11.46	12.13	12.45	13.12	14.44
	8H	12.05	12.69	13.05	13.70	15.01	11.56	12.20	12.56	13.21	14.52
	12H	12.10	12.71	13.10	13.71	15.04	11.60	12.21	12.60	13.21	14.55
4H	2H	9.77	10.50	10.76	11.49	12.79	9.42	10.15	10.41	11.14	12.44
	3H	11.63	12.24	12.63	13.26	14.57	11.23	11.84	12.23	12.86	14.17
	4H	12.34	12.90	13.35	13.91	15.25	11.93	12.48	12.93	13.49	14.83
	6H	12.85	13.33	13.87	14.36	15.70	12.43	12.91	13.44	13.94	15.28
	8H	13.00	13.45	14.02	14.47	15.82	12.57	13.02	13.59	14.04	15.39
	12H	13.07	13.47	14.10	14.51	15.87	12.63	13.04	13.67	14.08	15.43
8H	4H	12.53	12.98	13.55	14.01	15.36	12.16	12.61	13.18	13.64	14.99
	6H	13.16	13.53	14.20	14.59	15.94	12.78	13.15	13.82	14.22	15.57
	8H	13.37	13.70	14.42	14.75	16.12	12.99	13.32	14.04	14.37	15.74
	12H	13.50	13.79	14.56	14.84	16.25	13.10	13.39	14.16	14.44	15.85
12H	4H	12.52	12.92	13.56	13.96	15.32	12.16	12.56	13.19	13.60	14.96
	6H	13.19	13.51	14.24	14.56	15.93	12.82	13.15	13.87	14.20	15.57
	8H	13.42	13.71	14.48	14.76	16.17	13.05	13.34	14.11	14.39	15.80

END OF REPORT