

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P905736

Luminaire Tested: DFN2DIP-PN3F0-050D040US835-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P905736
REPORT IS A COMBINATION OF REPORTS P899529 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-050D040US835-FLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8490.0 lumens
Efficiency: N/A
Efficacy: 113.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 75
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P905736

CATALOG NUMBER: DFN2DIP-PN3F0-050D040US835-FLLFLL

Luminous Intensity Polar Plot

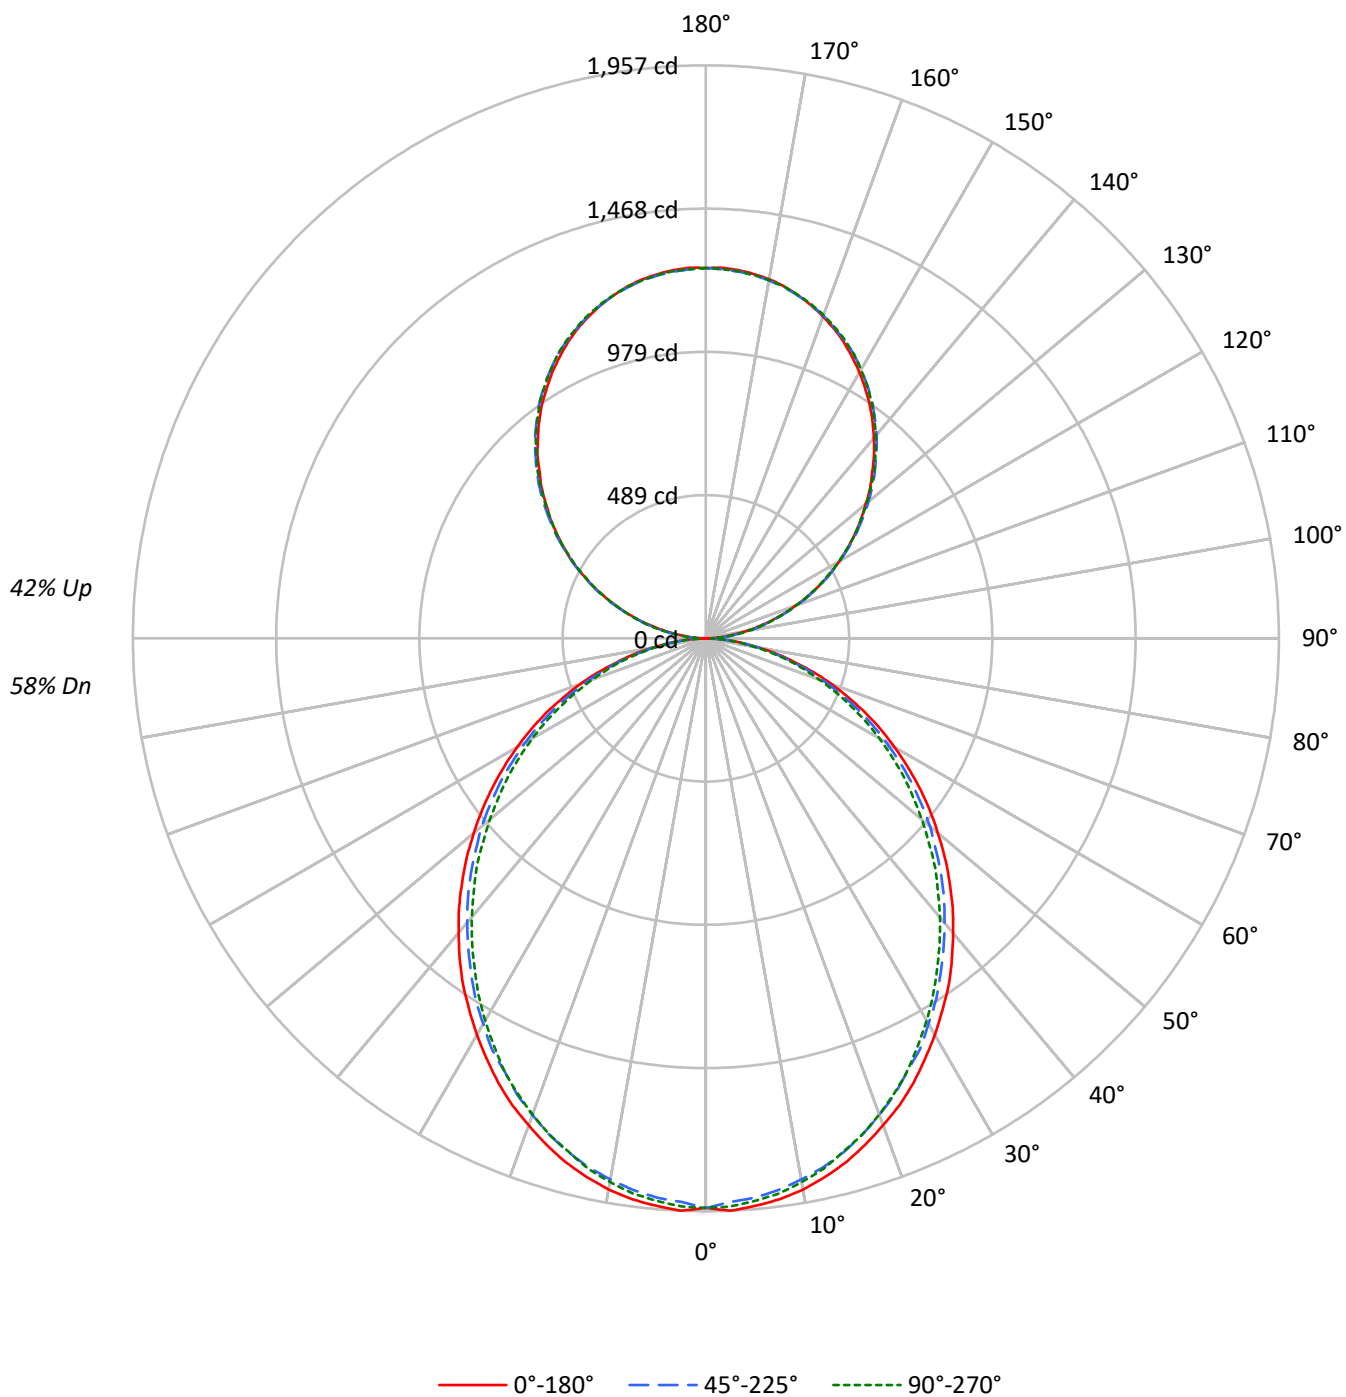

TEST NUMBER: P905736

CATALOG NUMBER: DFN2DIP-PN3F0-050D040US835-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	75	75	75	64	64	64
1	100	95	91	88	93	89	86	82	77	75	72	66	65	63	56	55	54
2	91	83	77	72	84	78	72	68	68	64	60	58	55	52	50	47	45
3	83	73	66	60	77	69	62	57	60	55	50	52	48	44	44	41	39
4	76	65	57	51	70	61	54	48	53	47	43	46	42	38	39	36	33
5	70	58	50	43	65	54	47	41	48	42	37	41	37	33	35	32	29
6	64	52	44	38	60	49	41	36	43	37	32	37	33	29	32	29	26
7	59	47	39	33	55	44	37	32	39	33	29	34	29	26	29	26	23
8	55	43	35	29	51	40	33	28	36	30	26	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	33	27	23	29	24	21	25	21	18
10	48	36	28	24	45	34	27	23	30	25	21	27	22	19	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2274	2274	2274
5°	2277	2241	2257
10°	2257	2209	2225
15°	2222	2171	2176
20°	2176	2119	2127
25°	2130	2057	2069
30°	2073	1999	1996
35°	2018	1931	1920
40°	1952	1863	1846
45°	1885	1794	1771
50°	1812	1721	1684
55°	1735	1637	1604
60°	1649	1538	1513
65°	1554	1435	1404
70°	1434	1309	1288
75°	1267	1158	1178
80°	1066	966	972
85°	751	639	634

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1885 cd/sqm

TEST NUMBER: P905736

CATALOG NUMBER: DFN2DIP-PN3F0-050D040US835-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	183.1	2.2
10°-20°	515.2	6.1
20°-30°	757.2	8.9
30°-40°	879.4	10.4
40°-50°	878.3	10.3
50°-60°	765.8	9.0
60°-70°	566.1	6.7
70°-80°	320.3	3.8
80°-90°	88.1	1.0
90°-100°	78.3	0.9
100°-110°	248.7	2.9
110°-120°	425.6	5.0
120°-130°	559.8	6.6
130°-140°	628.3	7.4
140°-150°	616.2	7.3
150°-160°	516.9	6.1
160°-170°	342.8	4.0
170°-180°	119.8	1.4
0°-30°	1455.5	17.1
0°-40°	2334.9	27.5
0°-60°	3979.0	46.9
0°-90°	4953.6	58.3
90°-120°	752.7	8.9
90°-150°	2556.9	30.1
90°-180°	3536.0	41.6
0°-180°	8490.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1946	1946	1946	1946	1946	
5°	1946	1938	1918	1932	1929	185
15°	1852	1841	1816	1824	1815	522
25°	1676	1661	1630	1633	1630	771
35°	1446	1428	1398	1386	1377	903
45°	1177	1164	1136	1115	1108	908
55°	891	879	857	834	825	796
65°	601	589	571	554	544	594
75°	314	311	301	290	294	335
85°	77	75	73	67	66	85
90°	1	14	37	35	36	8
95°	56	66	68	68	66	62
105°	230	233	235	237	237	242
115°	427	433	431	430	427	422
125°	621	631	628	624	623	555
135°	804	815	818	816	814	621
145°	976	983	989	990	986	610
155°	1116	1119	1122	1127	1124	513
165°	1214	1212	1212	1220	1215	342
175°	1263	1260	1257	1265	1259	120
180°	1265	1265	1265	1265	1265	

TEST NUMBER: P905736

CATALOG NUMBER: DFN2DIP-PN3F0-050D040US835-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1945.5	1945.5	1945.5	1945.5	1945.5
2.5°	1956.8	1947.5	1926.9	1945.5	1942.0
5°	1945.5	1938.2	1917.5	1932.4	1928.9
7.5°	1932.4	1921.3	1900.7	1915.8	1912.0
10°	1912.0	1898.9	1876.5	1891.3	1885.8
12.5°	1883.8	1872.7	1850.3	1859.6	1855.8
15°	1852.0	1840.9	1816.5	1824.1	1814.7
17.5°	1812.7	1801.6	1777.2	1786.5	1777.2
20°	1769.7	1758.6	1732.4	1737.9	1730.6
22.5°	1726.8	1709.9	1685.5	1685.5	1681.7
25°	1676.2	1661.3	1629.5	1633.1	1629.5
27.5°	1620.0	1606.9	1582.7	1577.1	1567.8
30°	1564.0	1549.0	1521.0	1515.4	1507.9
32.5°	1504.1	1493.0	1463.0	1451.7	1444.2
35°	1446.1	1427.5	1397.5	1386.2	1376.9
37.5°	1380.6	1363.8	1333.8	1320.7	1311.4
40°	1313.4	1298.3	1268.3	1251.6	1244.1
42.5°	1247.9	1232.8	1203.0	1184.1	1173.0
45°	1176.8	1163.7	1135.5	1115.1	1107.5
47.5°	1107.5	1094.4	1064.5	1043.8	1032.7
50°	1034.5	1025.2	999.0	972.8	963.4
52.5°	963.4	950.3	926.1	905.5	892.4
55°	890.6	879.3	856.8	834.4	825.1
57.5°	817.5	808.2	783.8	761.4	753.8
60°	744.5	737.2	711.0	690.3	684.8
62.5°	673.5	660.4	641.7	623.0	615.5
65°	600.6	589.3	570.6	553.8	544.4
67.5°	525.8	516.3	499.6	486.5	478.9
70°	456.5	449.0	432.1	419.0	411.7
72.5°	385.5	377.9	368.6	355.5	349.9
75°	314.2	310.6	301.1	290.0	293.8
77.5°	250.7	243.1	239.4	233.8	228.3
80°	187.2	185.2	181.4	175.9	172.1
82.5°	127.2	127.2	125.4	117.9	117.9
85°	76.6	74.8	73.0	67.3	65.5
87.5°	33.7	30.0	26.2	20.6	18.7
90°	1.1	13.7	37.4	35.1	36.2
92.5°	23.6	32.0	33.2	34.3	34.3
95°	55.7	66.4	68.3	68.3	66.4
97.5°	92.7	102.6	106.8	106.8	106.8
100°	135.4	144.2	147.2	147.2	146.1
102.5°	180.4	186.9	191.1	192.2	191.1
105°	229.6	232.6	234.9	236.8	236.8
107.5°	278.4	283.0	283.0	283.7	278.4
110°	325.7	331.8	331.8	331.8	328.8

TEST NUMBER: P905736

CATALOG NUMBER: DFN2DIP-PN3F0-050D040US835-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	376.8	383.3	382.1	379.1	376.8
115°	427.1	433.3	431.3	430.2	427.1
117.5°	477.1	485.5	480.2	477.1	474.1
120°	527.5	535.8	527.5	527.5	524.0
122.5°	573.2	583.9	578.6	575.5	573.2
125°	621.3	630.8	627.8	624.3	623.2
127.5°	668.2	680.0	675.8	671.2	668.2
130°	712.0	725.8	723.9	721.6	717.4
132.5°	761.2	771.9	772.7	767.3	764.3
135°	803.6	815.4	817.7	816.5	813.5
137.5°	850.9	860.4	862.3	861.5	857.0
140°	892.4	902.0	907.3	907.3	903.1
142.5°	935.2	944.7	947.7	948.9	944.7
145°	975.6	983.2	989.3	990.5	986.3
147.5°	1011.8	1021.3	1025.9	1027.8	1023.6
150°	1049.2	1055.7	1059.9	1063.3	1059.9
152.5°	1082.4	1088.8	1094.2	1098.4	1094.2
155°	1115.5	1118.6	1122.0	1127.4	1123.9
157.5°	1144.2	1146.4	1148.3	1156.0	1150.6
160°	1169.7	1172.0	1173.1	1179.6	1175.0
162.5°	1193.3	1193.3	1194.5	1201.7	1196.4
165°	1213.6	1212.4	1212.4	1220.0	1214.7
167.5°	1231.9	1228.4	1228.4	1236.1	1230.7
170°	1245.6	1242.5	1241.4	1249.0	1242.5
172.5°	1255.1	1252.1	1250.9	1258.6	1252.1
175°	1262.8	1259.7	1257.4	1265.0	1258.6
177.5°	1267.0	1263.9	1261.6	1268.1	1261.6
180°	1265.0	1265.0	1265.0	1265.0	1265.0

TEST NUMBER: P905736

CATALOG NUMBER: DFN2DIP-PN3F0-050D040US835-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.82	11.76	11.70	12.67	13.81	10.38	11.33	11.27	12.23	13.38
	3H	12.48	13.33	13.38	14.24	15.41	12.00	12.85	12.90	13.76	14.93
	4H	13.07	13.87	13.98	14.79	15.97	12.59	13.39	13.50	14.30	15.48
	6H	13.47	14.21	14.39	15.13	16.33	12.98	13.72	13.90	14.64	15.84
	8H	13.58	14.28	14.50	15.22	16.41	13.08	13.79	14.01	14.73	15.92
	12H	13.62	14.29	14.56	15.23	16.45	13.13	13.80	14.06	14.73	15.95
4H	2H	11.29	12.09	12.21	13.01	14.19	10.94	11.74	11.85	12.66	13.84
	3H	13.16	13.82	14.08	14.77	15.97	12.76	13.42	13.68	14.37	15.57
	4H	13.87	14.48	14.81	15.42	16.64	13.45	14.06	14.39	15.01	16.23
	6H	14.38	14.91	15.33	15.88	17.10	13.96	14.49	14.91	15.45	16.68
	8H	14.53	15.02	15.48	15.98	17.22	14.11	14.60	15.06	15.56	16.79
	12H	14.61	15.05	15.58	16.03	17.27	14.17	14.61	15.14	15.59	16.83
8H	4H	14.07	14.56	15.02	15.52	16.76	13.70	14.19	14.65	15.15	16.39
	6H	14.70	15.10	15.67	16.11	17.34	14.32	14.73	15.30	15.73	16.96
	8H	14.91	15.27	15.90	16.26	17.52	14.53	14.89	15.52	15.88	17.13
	12H	15.04	15.36	16.03	16.35	17.65	14.64	14.96	15.63	15.95	17.25
12H	4H	14.06	14.50	15.03	15.48	16.72	13.70	14.14	14.67	15.12	16.36
	6H	14.72	15.08	15.71	16.08	17.33	14.36	14.72	15.35	15.71	16.96
	8H	14.97	15.28	15.96	16.27	17.57	14.59	14.91	15.58	15.90	17.20

END OF REPORT