

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P905745

Luminaire Tested: DFN2DIP-PN3F0-050D060US835-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P905745
REPORT IS A COMBINATION OF REPORTS P901077 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-050D060US835-FLLONL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 10890.0 lumens
Efficiency: N/A
Efficacy: 119.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 91
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P905745
CATALOG NUMBER: DFN2DIP-PN3F0-050D060US835-FLLONL

Luminous Intensity Polar Plot

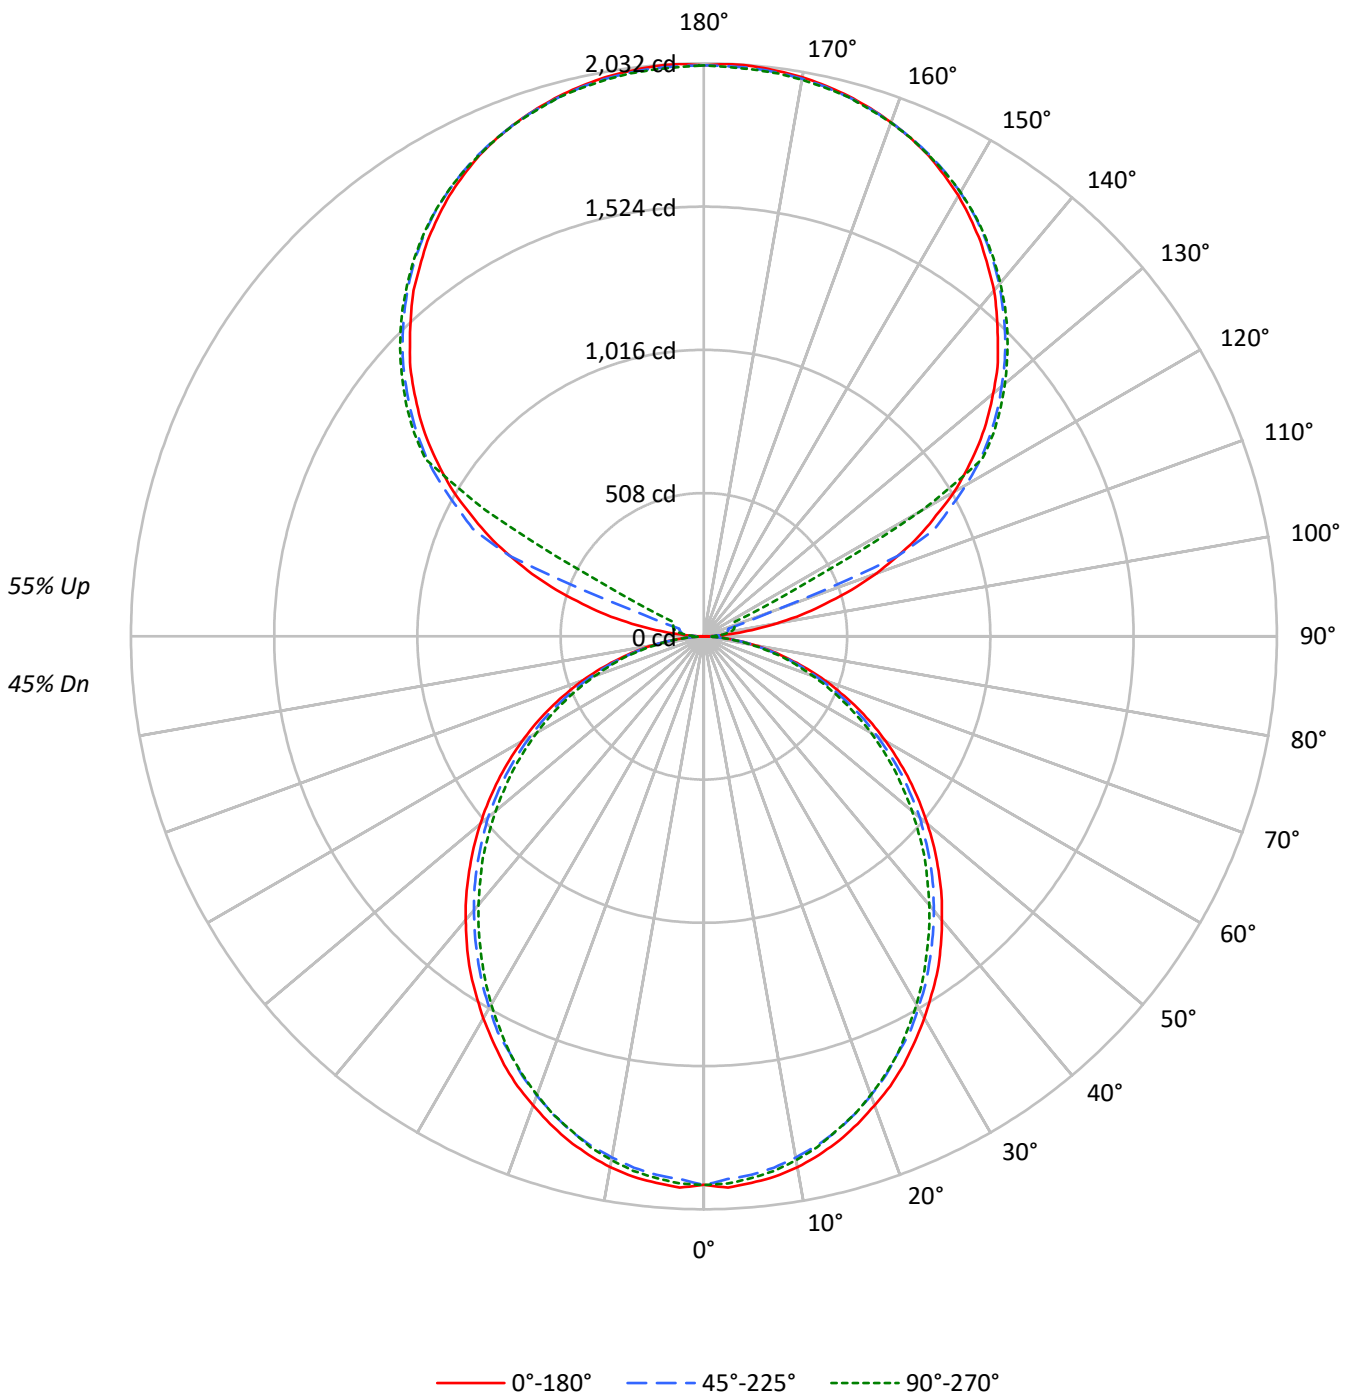



TEST NUMBER: P905745
 CATALOG NUMBER: DFN2DIP-PN3F0-050D060US835-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52	45	45	45	45
1	97	92	89	85	89	85	82	79	71	68	66	58	56	55	46	45	44	38	38	38	38
2	88	81	75	70	81	74	69	65	62	58	55	51	48	46	40	39	37	32	32	32	32
3	80	71	64	58	73	65	59	54	55	50	46	45	42	39	36	33	31	27	27	27	27
4	74	63	55	49	67	58	51	46	49	43	39	40	36	33	32	29	27	23	23	23	23
5	67	56	48	42	62	52	45	39	43	38	34	36	32	29	29	26	24	20	20	20	20
6	62	50	42	36	57	46	39	34	39	34	30	32	28	25	26	23	21	18	18	18	18
7	57	45	37	32	53	42	35	30	35	30	26	30	25	22	24	21	18	16	16	16	16
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	17	14	14	14	14
9	50	37	30	25	45	35	28	24	30	24	21	25	21	18	20	17	15	13	13	13	13
10	46	34	27	22	42	32	25	21	27	22	19	23	19	16	19	16	14	12	12	12	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2274	2274	2274
5°	2277	2241	2257
10°	2257	2209	2225
15°	2222	2171	2176
20°	2176	2119	2127
25°	2130	2057	2069
30°	2073	1999	1996
35°	2018	1931	1920
40°	1952	1863	1846
45°	1885	1794	1771
50°	1812	1721	1684
55°	1735	1637	1604
60°	1649	1538	1513
65°	1554	1435	1404
70°	1434	1309	1288
75°	1267	1158	1178
80°	1066	966	972
85°	751	639	634

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 1885 cd/sqm



TEST NUMBER: P905745

CATALOG NUMBER: DFN2DIP-PN3F0-050D060US835-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	183.1	1.7
10°-20°	515.2	4.7
20°-30°	757.2	7.0
30°-40°	879.4	8.1
40°-50°	878.3	8.1
50°-60°	765.8	7.0
60°-70°	566.1	5.2
70°-80°	320.3	2.9
80°-90°	88.1	0.8
90°-100°	66.8	0.6
100°-110°	248.9	2.3
110°-120°	660.2	6.1
120°-130°	1094.9	10.1
130°-140°	1163.0	10.7
140°-150°	1080.9	9.9
150°-160°	869.0	8.0
160°-170°	560.0	5.1
170°-180°	192.7	1.8
0°-30°	1455.5	13.4
0°-40°	2334.9	21.4
0°-60°	3979.0	36.5
0°-90°	4953.6	45.5
90°-120°	975.8	9.0
90°-150°	4314.7	39.6
90°-180°	5936.0	54.5
0°-180°	10890.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1946	1946	1946	1946	1946	
5°	1946	1938	1918	1932	1929	185
15°	1852	1841	1816	1824	1815	522
25°	1676	1661	1630	1633	1630	771
35°	1446	1428	1398	1386	1377	903
45°	1177	1164	1136	1115	1108	908
55°	891	879	857	834	825	796
65°	601	589	571	554	544	594
75°	314	311	301	290	294	335
85°	77	75	73	67	66	85
90°	1	18	29	37	40	10
95°	95	47	57	65	63	113
105°	445	489	89	105	111	476
115°	842	867	904	226	120	829
125°	1191	1210	1238	1248	1253	1062
135°	1474	1498	1511	1525	1522	1139
145°	1710	1708	1733	1744	1736	1069
155°	1883	1870	1887	1896	1884	868
165°	1984	1975	1980	1990	1980	560
175°	2029	2019	2022	2032	2018	193
180°	2025	2025	2025	2025	2025	



TEST NUMBER: P905745

CATALOG NUMBER: DFN2DIP-PN3F0-050D060US835-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1945.5	1945.5	1945.5	1945.5	1945.5
2.5°	1956.8	1947.5	1926.9	1945.5	1942.0
5°	1945.5	1938.2	1917.5	1932.4	1928.9
7.5°	1932.4	1921.3	1900.7	1915.8	1912.0
10°	1912.0	1898.9	1876.5	1891.3	1885.8
12.5°	1883.8	1872.7	1850.3	1859.6	1855.8
15°	1852.0	1840.9	1816.5	1824.1	1814.7
17.5°	1812.7	1801.6	1777.2	1786.5	1777.2
20°	1769.7	1758.6	1732.4	1737.9	1730.6
22.5°	1726.8	1709.9	1685.5	1685.5	1681.7
25°	1676.2	1661.3	1629.5	1633.1	1629.5
27.5°	1620.0	1606.9	1582.7	1577.1	1567.8
30°	1564.0	1549.0	1521.0	1515.4	1507.9
32.5°	1504.1	1493.0	1463.0	1451.7	1444.2
35°	1446.1	1427.5	1397.5	1386.2	1376.9
37.5°	1380.6	1363.8	1333.8	1320.7	1311.4
40°	1313.4	1298.3	1268.3	1251.6	1244.1
42.5°	1247.9	1232.8	1203.0	1184.1	1173.0
45°	1176.8	1163.7	1135.5	1115.1	1107.5
47.5°	1107.5	1094.4	1064.5	1043.8	1032.7
50°	1034.5	1025.2	999.0	972.8	963.4
52.5°	963.4	950.3	926.1	905.5	892.4
55°	890.6	879.3	856.8	834.4	825.1
57.5°	817.5	808.2	783.8	761.4	753.8
60°	744.5	737.2	711.0	690.3	684.8
62.5°	673.5	660.4	641.7	623.0	615.5
65°	600.6	589.3	570.6	553.8	544.4
67.5°	525.8	516.3	499.6	486.5	478.9
70°	456.5	449.0	432.1	419.0	411.7
72.5°	385.5	377.9	368.6	355.5	349.9
75°	314.2	310.6	301.1	290.0	293.8
77.5°	250.7	243.1	239.4	233.8	228.3
80°	187.2	185.2	181.4	175.9	172.1
82.5°	127.2	127.2	125.4	117.9	117.9
85°	76.6	74.8	73.0	67.3	65.5
87.5°	33.7	30.0	26.2	20.6	18.7
90°	1.4	17.6	29.2	36.7	39.5
92.5°	36.7	30.8	35.1	38.1	39.5
95°	95.2	46.8	57.1	64.6	63.0
97.5°	171.4	51.3	74.6	79.2	80.6
100°	259.4	58.6	83.5	95.2	98.1
102.5°	356.0	353.2	86.5	102.5	107.0
105°	445.4	489.4	89.4	105.4	111.4
107.5°	549.5	586.0	92.4	108.4	114.3
110°	649.2	679.8	256.5	110.0	115.7



TEST NUMBER: P905745

CATALOG NUMBER: DFN2DIP-PN3F0-050D060US835-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	742.9	769.2	744.3	112.7	117.3
115°	842.5	867.4	904.1	225.7	120.2
117.5°	928.9	958.2	983.2	773.6	389.7
120°	1025.7	1047.6	1074.1	1091.6	893.8
122.5°	1107.6	1131.1	1160.5	1169.2	1170.8
125°	1191.2	1210.3	1238.1	1248.4	1252.7
127.5°	1267.4	1287.9	1310.0	1324.6	1326.0
130°	1339.2	1362.7	1378.7	1394.9	1393.5
132.5°	1412.5	1431.6	1447.6	1460.8	1459.4
135°	1474.1	1497.6	1510.6	1525.4	1522.4
137.5°	1538.4	1556.0	1570.8	1585.4	1581.1
140°	1601.4	1613.3	1629.3	1642.5	1635.2
142.5°	1654.3	1664.6	1683.6	1695.2	1687.9
145°	1710.0	1708.4	1733.3	1743.6	1736.3
147.5°	1758.2	1753.8	1778.7	1786.0	1780.3
150°	1805.2	1794.9	1818.4	1827.1	1819.8
152.5°	1844.7	1833.0	1854.9	1863.8	1853.5
155°	1882.8	1869.7	1887.3	1896.0	1884.3
157.5°	1913.6	1901.9	1915.1	1925.4	1913.6
160°	1940.0	1931.1	1940.0	1948.7	1938.5
162.5°	1963.3	1954.6	1961.9	1972.2	1959.0
165°	1983.9	1975.2	1979.5	1989.8	1979.5
167.5°	2000.0	1991.2	1995.7	2006.0	1992.7
170°	2013.3	2004.4	2007.4	2017.6	2004.4
172.5°	2022.0	2013.3	2016.2	2026.5	2013.3
175°	2029.3	2019.0	2022.0	2032.2	2017.6
177.5°	2032.2	2022.0	2023.5	2033.8	2020.6
180°	2024.9	2024.9	2024.9	2024.9	2024.9



TEST NUMBER: P905745
 CATALOG NUMBER: DFN2DIP-PN3F0-050D060US835-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.66	10.48	10.65	11.48	12.82	9.22	10.04	10.21	11.05	12.38
	3H	11.31	12.04	12.31	13.06	14.41	10.82	11.56	11.83	12.58	13.93
	4H	11.89	12.59	12.91	13.61	14.97	11.40	12.10	12.42	13.12	14.48
	6H	12.28	12.93	13.31	13.95	15.32	11.79	12.44	12.82	13.46	14.83
	8H	12.38	13.00	13.42	14.04	15.41	11.89	12.51	12.93	13.54	14.92
	12H	12.43	13.01	13.47	14.04	15.44	11.93	12.51	12.97	13.55	14.94
4H	2H	10.11	10.81	11.13	11.83	13.19	9.76	10.46	10.78	11.47	12.84
	3H	11.96	12.55	13.00	13.59	14.97	11.56	12.14	12.60	13.19	14.57
	4H	12.67	13.21	13.71	14.24	15.64	12.26	12.79	13.30	13.83	15.23
	6H	13.18	13.64	14.23	14.70	16.09	12.76	13.22	13.81	14.28	15.67
	8H	13.32	13.75	14.38	14.81	16.22	12.90	13.33	13.95	14.38	15.79
	12H	13.39	13.78	14.46	14.85	16.26	12.96	13.34	14.02	14.41	15.83
8H	4H	12.86	13.29	13.91	14.34	15.75	12.49	12.92	13.54	13.97	15.38
	6H	13.48	13.84	14.56	14.93	16.34	13.11	13.46	14.18	14.56	15.97
	8H	13.70	14.01	14.78	15.09	16.52	13.32	13.63	14.40	14.71	16.13
	12H	13.82	14.10	14.91	15.17	16.64	13.43	13.70	14.51	14.77	16.24
12H	4H	12.84	13.23	13.91	14.30	15.72	12.48	12.87	13.55	13.94	15.35
	6H	13.51	13.82	14.59	14.90	16.33	13.15	13.46	14.23	14.54	15.97
	8H	13.75	14.02	14.83	15.10	16.56	13.38	13.65	14.46	14.72	16.19