

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P905780

Luminaire Tested: DFN2DIP-PN3F0-060D080US835-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P905780
REPORT IS A COMBINATION OF REPORTS P899587 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-060D080US835-FLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 13020.0 lumens
Efficiency: N/A
Efficacy: 110.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 118.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P905780
CATALOG NUMBER: DFN2DIP-PN3F0-060D080US835-FLLFLL

Luminous Intensity Polar Plot

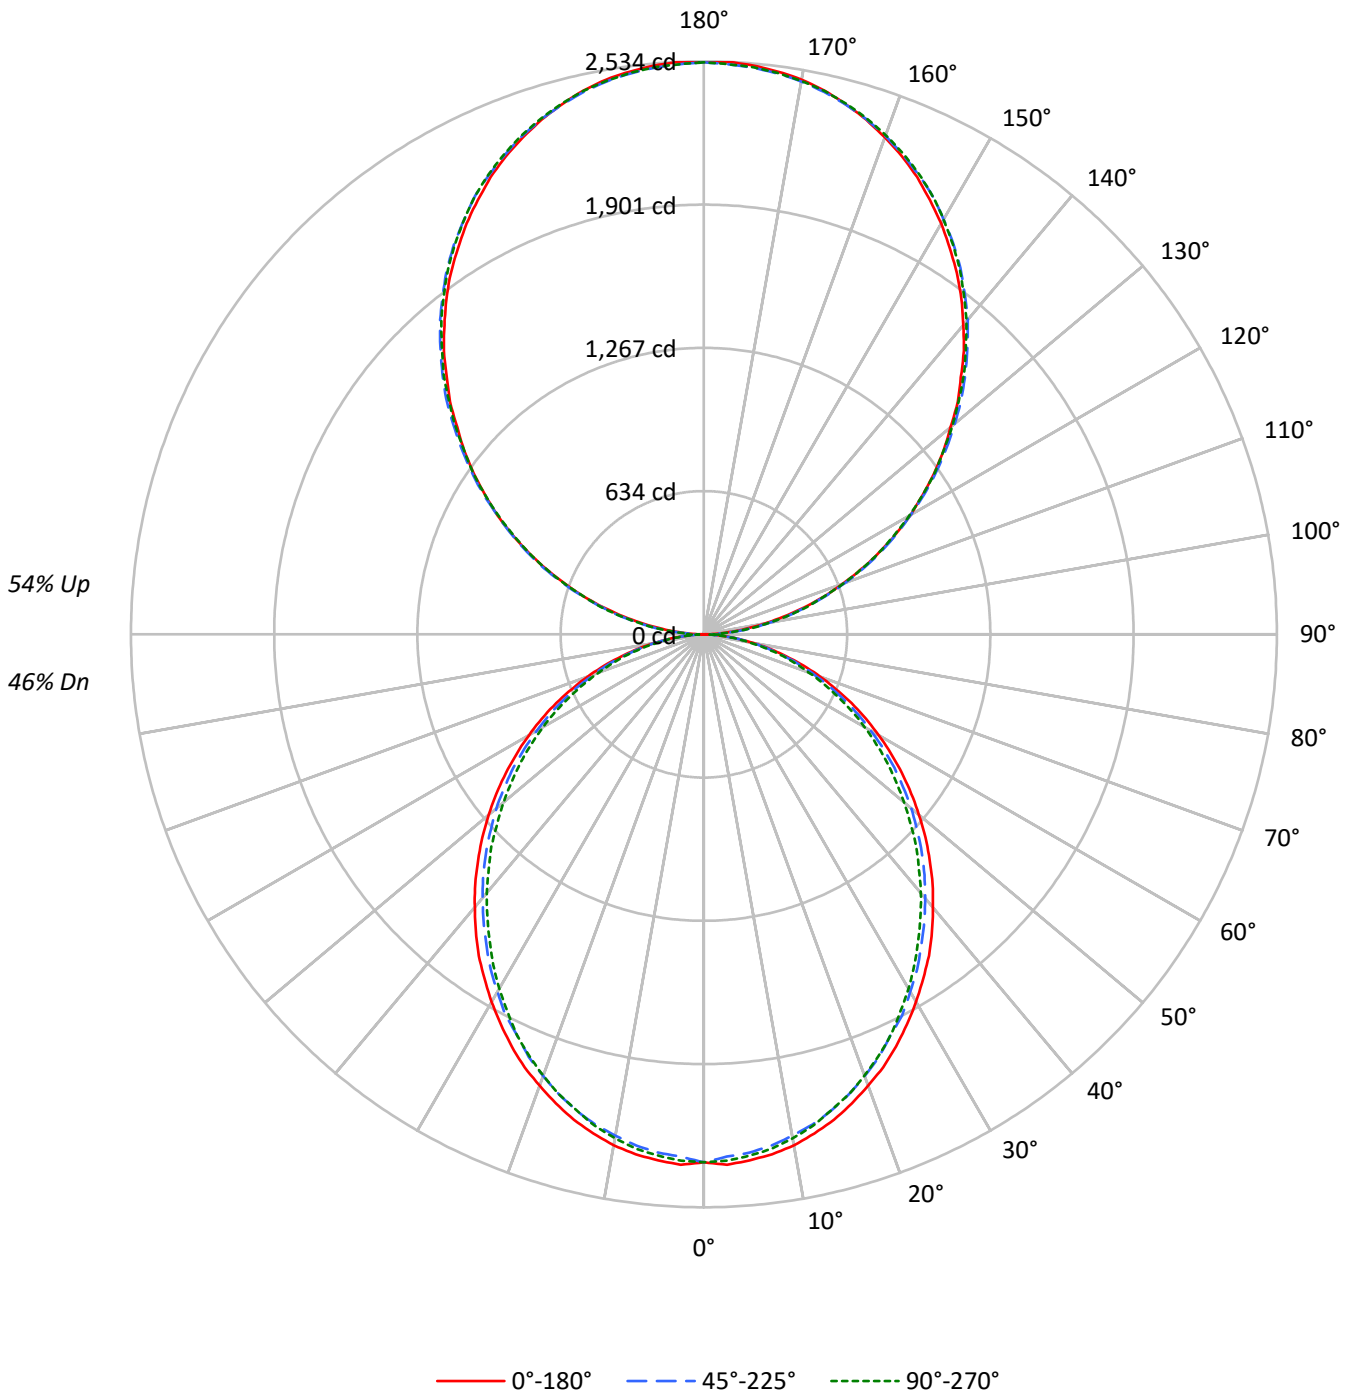



TEST NUMBER: P905780

CATALOG NUMBER: DFN2DIP-PN3F0-060D080US835-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52	46	46	46	46
1	97	93	89	85	89	85	82	79	71	69	66	58	56	55	46	45	44	38	38	38	38
2	88	81	75	70	81	74	69	65	62	58	55	51	48	46	41	39	37	32	32	32	32
3	80	71	64	58	73	65	59	54	55	50	46	45	42	39	36	34	32	27	27	27	27
4	74	63	55	49	67	58	51	46	49	43	39	40	36	33	32	29	27	23	23	23	23
5	67	56	48	42	62	52	45	39	44	38	34	36	32	29	29	26	24	20	20	20	20
6	62	50	42	36	57	46	39	34	39	34	30	33	28	25	26	23	21	18	18	18	18
7	57	45	37	32	53	42	35	30	36	30	26	30	25	22	24	21	19	16	16	16	16
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	17	14	14	14	14
9	50	37	30	25	45	35	28	24	30	24	21	25	21	18	20	17	15	13	13	13	13
10	46	34	27	22	42	32	25	21	27	22	19	23	19	16	19	16	14	12	12	12	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2729	2729	2729
5°	2732	2689	2708
10°	2708	2651	2670
15°	2667	2605	2612
20°	2611	2543	2552
25°	2556	2468	2483
30°	2487	2399	2396
35°	2422	2318	2303
40°	2342	2235	2215
45°	2262	2152	2125
50°	2174	2065	2021
55°	2082	1965	1925
60°	1979	1846	1815
65°	1865	1722	1685
70°	1720	1571	1545
75°	1520	1390	1414
80°	1279	1159	1167
85°	901	766	760

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°
 Vertical Angle: 90°
 Luminance: 2508 cd/sqm



TEST NUMBER: P905780

CATALOG NUMBER: DFN2DIP-PN3F0-060D080US835-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	219.7	1.7
10°-20°	618.3	4.7
20°-30°	908.6	7.0
30°-40°	1055.3	8.1
40°-50°	1054.0	8.1
50°-60°	919.0	7.1
60°-70°	679.4	5.2
70°-80°	384.4	3.0
80°-90°	108.6	0.8
90°-100°	156.6	1.2
100°-110°	497.5	3.8
110°-120°	851.3	6.5
120°-130°	1119.6	8.6
130°-140°	1256.7	9.7
140°-150°	1232.3	9.5
150°-160°	1033.7	7.9
160°-170°	685.6	5.3
170°-180°	239.6	1.8
0°-30°	1746.6	13.4
0°-40°	2801.8	21.5
0°-60°	4774.8	36.7
0°-90°	5947.2	45.7
90°-120°	1505.3	11.6
90°-150°	5113.9	39.3
90°-180°	7073.0	54.3
0°-180°	13020.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2335	2335	2335	2335	2335	
5°	2335	2326	2301	2319	2315	222
15°	2222	2209	2180	2189	2178	626
25°	2011	1994	1955	1960	1955	926
35°	1735	1713	1677	1663	1652	1084
45°	1412	1396	1363	1338	1329	1090
55°	1069	1055	1028	1001	990	955
65°	721	707	685	664	653	713
75°	377	373	361	348	352	402
85°	92	90	88	81	79	103
90°	2	28	75	70	72	13
95°	111	133	136	136	133	124
105°	459	465	470	474	474	485
115°	854	866	863	860	854	845
125°	1242	1262	1256	1249	1246	1110
135°	1607	1631	1635	1633	1627	1242
145°	1951	1966	1979	1981	1972	1219
155°	2231	2237	2244	2255	2248	1027
165°	2427	2425	2425	2440	2429	685
175°	2526	2519	2515	2530	2517	240
180°	2530	2530	2530	2530	2530	



TEST NUMBER: P905780

CATALOG NUMBER: DFN2DIP-PN3F0-060D080US835-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2334.6	2334.6	2334.6	2334.6	2334.6
2.5°	2348.2	2337.0	2312.2	2334.6	2330.3
5°	2334.6	2325.8	2301.0	2318.9	2314.6
7.5°	2318.9	2305.6	2280.8	2298.9	2294.4
10°	2294.4	2278.7	2251.7	2269.6	2262.9
12.5°	2260.6	2247.2	2220.3	2231.5	2227.0
15°	2222.4	2209.1	2179.8	2188.9	2177.7
17.5°	2175.3	2162.0	2132.7	2143.8	2132.7
20°	2123.6	2110.3	2078.8	2085.5	2076.7
22.5°	2072.2	2051.9	2022.6	2022.6	2018.1
25°	2011.4	1993.6	1955.4	1959.7	1955.4
27.5°	1944.0	1928.3	1899.2	1892.6	1881.4
30°	1876.9	1858.7	1825.2	1818.5	1809.4
32.5°	1804.9	1791.6	1755.6	1742.0	1733.0
35°	1735.4	1713.0	1677.0	1663.4	1652.2
37.5°	1656.8	1636.5	1600.6	1584.8	1573.6
40°	1576.0	1557.9	1522.0	1502.0	1492.9
42.5°	1497.4	1479.3	1443.6	1421.0	1407.6
45°	1412.2	1396.4	1362.6	1338.1	1329.0
47.5°	1329.0	1313.3	1277.4	1252.6	1239.2
50°	1241.4	1230.2	1198.8	1167.3	1156.1
52.5°	1156.1	1140.4	1111.3	1086.6	1070.9
55°	1068.7	1055.1	1028.2	1001.3	990.1
57.5°	981.1	969.9	940.6	913.7	904.6
60°	893.4	884.6	853.2	828.4	821.7
62.5°	808.1	792.4	770.0	747.6	738.6
65°	720.7	707.2	684.8	664.5	653.3
67.5°	630.9	619.5	599.5	583.8	574.7
70°	547.8	538.8	518.5	502.8	494.0
72.5°	462.5	453.5	442.3	426.6	419.9
75°	377.0	372.8	361.3	348.0	352.5
77.5°	300.8	291.8	287.2	280.6	273.9
80°	224.6	222.2	217.7	211.0	206.5
82.5°	152.7	152.7	150.5	141.5	141.5
85°	91.9	89.8	87.6	80.7	78.6
87.5°	40.5	36.0	31.4	24.8	22.4
90°	2.3	27.5	74.8	70.2	72.5
92.5°	47.3	64.1	66.4	68.6	68.6
95°	111.4	132.7	136.5	136.5	132.7
97.5°	185.4	205.2	213.6	213.6	213.6
100°	270.8	288.3	294.4	294.4	292.1
102.5°	360.8	373.8	382.1	384.4	382.1
105°	459.2	465.3	469.9	473.7	473.7
107.5°	556.8	566.0	566.0	567.5	556.8
110°	651.4	663.6	663.6	663.6	657.5



TEST NUMBER: P905780

CATALOG NUMBER: DFN2DIP-PN3F0-060D080US835-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	753.6	766.6	764.3	758.2	753.6
115°	854.3	866.5	862.7	860.4	854.3
117.5°	954.2	971.0	960.3	954.2	948.1
120°	1054.9	1071.7	1054.9	1054.9	1048.0
122.5°	1146.4	1167.8	1157.1	1151.0	1146.4
125°	1242.5	1261.6	1255.5	1248.6	1246.4
127.5°	1336.4	1360.0	1351.6	1342.5	1336.4
130°	1424.1	1451.5	1447.7	1443.2	1434.8
132.5°	1522.5	1543.8	1545.4	1534.7	1528.6
135°	1607.1	1630.8	1635.4	1633.1	1627.0
137.5°	1701.7	1720.8	1724.6	1723.1	1713.9
140°	1784.9	1803.9	1814.6	1814.6	1806.2
142.5°	1870.3	1889.4	1895.5	1897.8	1889.4
145°	1951.2	1966.4	1978.6	1980.9	1972.5
147.5°	2023.6	2042.7	2051.8	2055.7	2047.3
150°	2098.4	2111.3	2119.7	2126.6	2119.7
152.5°	2164.7	2177.7	2188.4	2196.8	2188.4
155°	2231.1	2237.2	2244.1	2254.7	2247.9
157.5°	2288.3	2292.9	2296.7	2311.9	2301.3
160°	2339.4	2344.0	2346.3	2359.2	2350.1
162.5°	2386.7	2386.7	2389.0	2403.5	2392.8
165°	2427.1	2424.8	2424.8	2440.1	2429.4
167.5°	2463.7	2456.9	2456.9	2472.1	2461.4
170°	2491.2	2485.1	2482.8	2498.1	2485.1
172.5°	2510.3	2504.2	2501.9	2517.1	2504.2
175°	2525.5	2519.4	2514.8	2530.1	2517.1
177.5°	2533.9	2527.8	2523.2	2536.2	2523.2
180°	2530.1	2530.1	2530.1	2530.1	2530.1



TEST NUMBER: P905780
 CATALOG NUMBER: DFN2DIP-PN3F0-060D080US835-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.31	11.13	11.30	12.14	13.47	9.87	10.69	10.86	11.70	13.03
	3H	11.96	12.70	12.96	13.71	15.06	11.47	12.21	12.48	13.23	14.58
	4H	12.54	13.24	13.56	14.26	15.62	12.05	12.75	13.07	13.77	15.13
	6H	12.93	13.58	13.96	14.60	15.97	12.44	13.09	13.47	14.11	15.48
	8H	13.03	13.65	14.07	14.69	16.05	12.54	13.16	13.58	14.20	15.56
	12H	13.08	13.66	14.12	14.69	16.09	12.58	13.17	13.62	14.20	15.59
4H	2H	10.76	11.46	11.78	12.48	13.84	10.41	11.11	11.43	12.13	13.49
	3H	12.61	13.20	13.65	14.24	15.62	12.21	12.80	13.24	13.84	15.22
	4H	13.32	13.86	14.36	14.89	16.29	12.91	13.44	13.95	14.48	15.87
	6H	13.83	14.29	14.88	15.35	16.74	13.41	13.87	14.46	14.93	16.32
	8H	13.98	14.41	15.03	15.46	16.87	13.55	13.98	14.60	15.03	16.44
	12H	14.04	14.43	15.11	15.50	16.91	13.61	13.99	14.67	15.06	16.48
8H	4H	13.51	13.94	14.56	15.00	16.40	13.14	13.57	14.19	14.62	16.03
	6H	14.13	14.49	15.21	15.58	16.99	13.76	14.11	14.83	15.21	16.61
	8H	14.35	14.66	15.43	15.74	17.17	13.97	14.28	15.05	15.36	16.78
	12H	14.48	14.75	15.56	15.82	17.29	14.08	14.35	15.16	15.43	16.89
12H	4H	13.49	13.88	14.56	14.95	16.36	13.13	13.52	14.20	14.59	16.00
	6H	14.16	14.47	15.24	15.55	16.98	13.80	14.11	14.88	15.19	16.61
	8H	14.40	14.67	15.48	15.75	17.21	14.03	14.30	15.11	15.38	16.84