

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P905808

Luminaire Tested: DFN2DIP-PN3F0-070D080US835-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P905808
REPORT IS A COMBINATION OF REPORTS P899589 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-070D080US835-FLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14010.0 lumens
Efficiency: N/A
Efficacy: 107.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 130.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P905808

CATALOG NUMBER: DFN2DIP-PN3F0-070D080US835-FLLFLL

Luminous Intensity Polar Plot

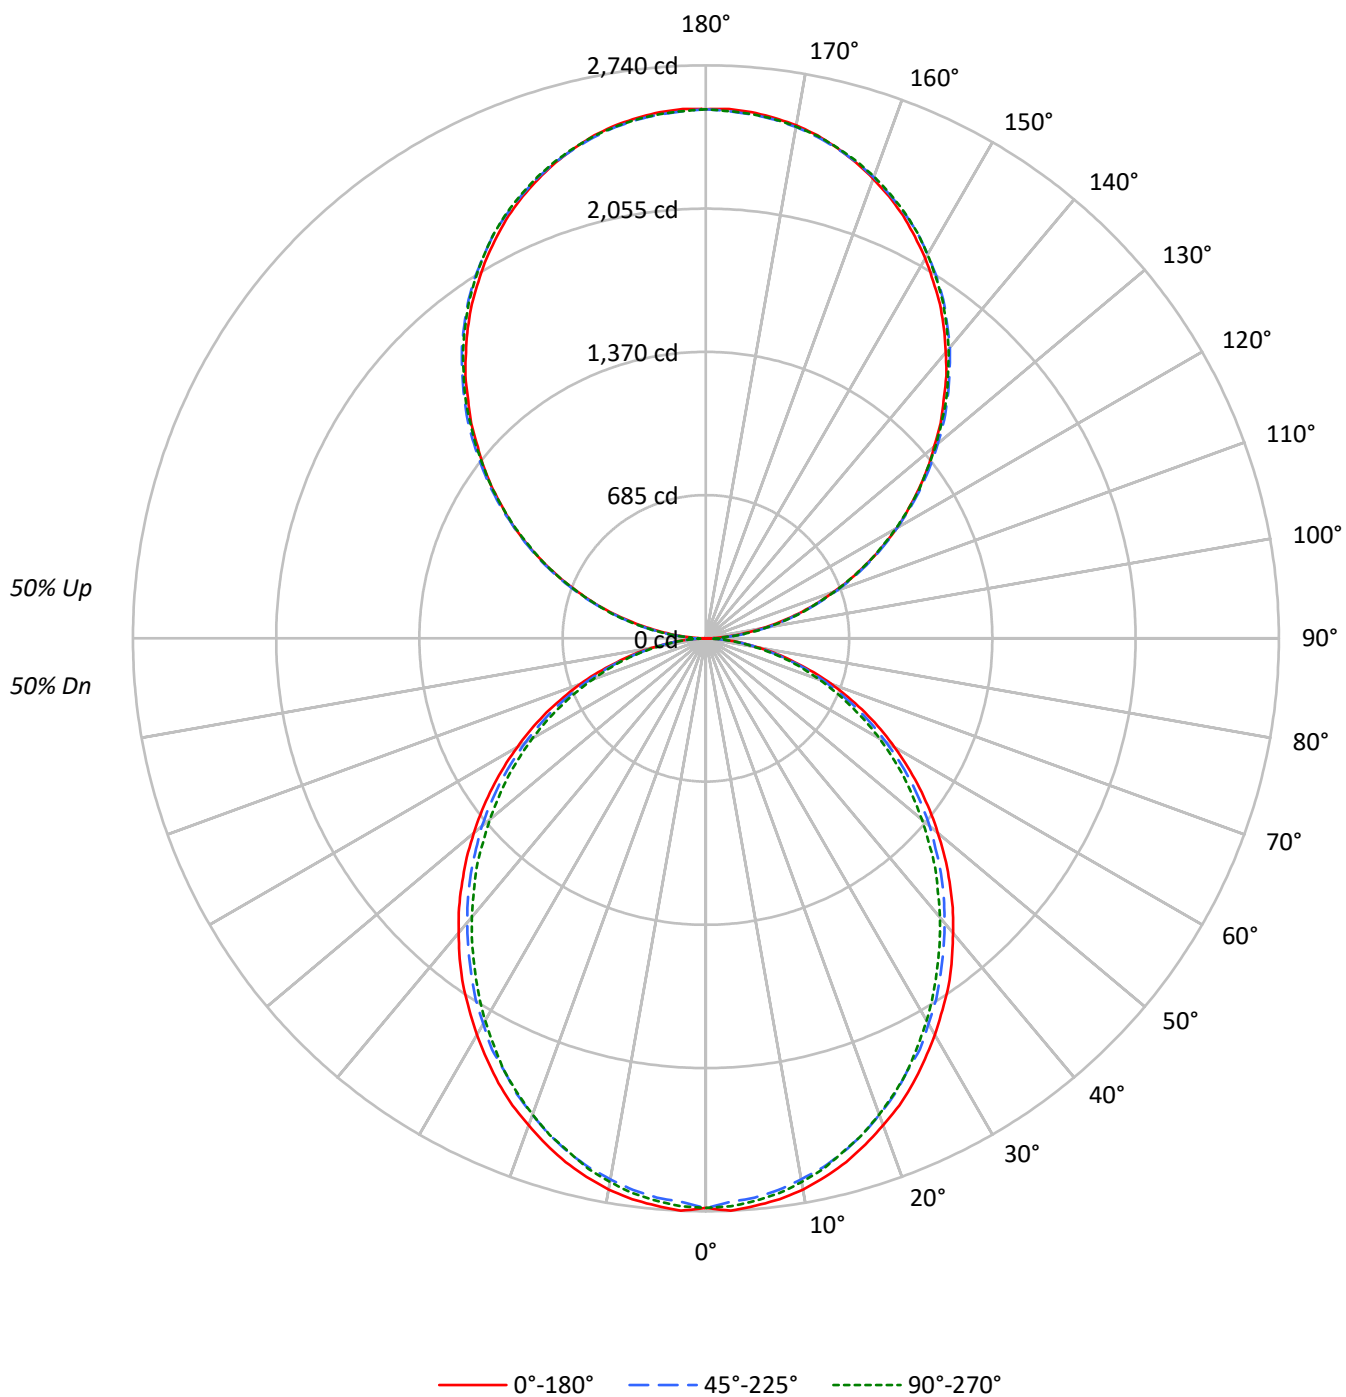

TEST NUMBER: P905808

CATALOG NUMBER: DFN2DIP-PN3F0-070D080US835-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	89	86	90	86	83	80	73	70	68	61	59	57	49	48	47
2	89	82	75	70	82	75	70	66	64	60	56	53	50	48	43	41	40
3	81	72	64	58	74	66	60	55	56	51	47	47	43	40	38	36	34
4	74	63	56	49	68	59	52	46	50	45	40	42	38	35	34	31	29
5	68	57	48	42	63	52	45	40	45	39	35	38	33	30	31	28	25
6	63	51	43	37	58	47	40	35	40	35	30	34	30	26	28	25	22
7	58	46	38	32	53	43	35	30	37	31	27	31	27	23	26	22	20
8	54	42	34	28	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	18	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3184	3184	3184
5°	3187	3137	3159
10°	3159	3093	3115
15°	3111	3040	3047
20°	3046	2967	2977
25°	2982	2880	2897
30°	2902	2799	2795
35°	2826	2704	2687
40°	2732	2608	2585
45°	2639	2511	2479
50°	2537	2409	2358
55°	2430	2292	2246
60°	2308	2153	2117
65°	2176	2009	1966
70°	2007	1833	1802
75°	1774	1622	1650
80°	1492	1352	1361
85°	1053	895	887

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2639 cd/sqm

TEST NUMBER: P905808

CATALOG NUMBER: DFN2DIP-PN3F0-070D080US835-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	256.4	1.8
10°-20°	721.3	5.1
20°-30°	1060.0	7.6
30°-40°	1231.1	8.8
40°-50°	1229.6	8.8
50°-60°	1072.2	7.7
60°-70°	792.6	5.7
70°-80°	448.4	3.2
80°-90°	125.6	0.9
90°-100°	156.6	1.1
100°-110°	497.5	3.6
110°-120°	851.3	6.1
120°-130°	1119.6	8.0
130°-140°	1256.7	9.0
140°-150°	1232.3	8.8
150°-160°	1033.7	7.4
160°-170°	685.6	4.9
170°-180°	239.6	1.7
0°-30°	2037.7	14.5
0°-40°	3268.8	23.3
0°-60°	5570.6	39.8
0°-90°	6937.2	49.5
90°-120°	1505.3	10.7
90°-150°	5113.9	36.5
90°-180°	7073.0	50.5
0°-180°	14010.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2724	2724	2724	2724	2724	
5°	2724	2714	2685	2705	2700	259
15°	2593	2577	2543	2554	2541	730
25°	2347	2326	2281	2286	2281	1080
35°	2025	1998	1956	1941	1928	1264
45°	1648	1629	1590	1561	1550	1271
55°	1247	1231	1200	1168	1155	1115
65°	841	825	799	775	762	831
75°	440	435	422	406	411	470
85°	107	105	102	94	92	120
90°	2	28	75	70	72	14
95°	111	133	136	136	133	124
105°	459	465	470	474	474	485
115°	854	866	863	860	854	845
125°	1242	1262	1256	1249	1246	1110
135°	1607	1631	1635	1633	1627	1242
145°	1951	1966	1979	1981	1972	1219
155°	2231	2237	2244	2255	2248	1027
165°	2427	2425	2425	2440	2429	685
175°	2526	2519	2515	2530	2517	240
180°	2530	2530	2530	2530	2530	

TEST NUMBER: P905808

CATALOG NUMBER: DFN2DIP-PN3F0-070D080US835-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2723.7	2723.7	2723.7	2723.7	2723.7
2.5°	2739.6	2726.5	2697.6	2723.7	2718.7
5°	2723.7	2713.5	2684.6	2705.4	2700.4
7.5°	2705.4	2689.8	2660.9	2682.1	2676.8
10°	2676.8	2658.4	2627.0	2647.9	2640.1
12.5°	2637.3	2621.8	2590.4	2603.4	2598.1
15°	2592.9	2577.3	2543.1	2553.7	2540.6
17.5°	2537.8	2522.3	2488.1	2501.2	2488.1
20°	2477.5	2462.0	2425.3	2433.1	2422.8
22.5°	2417.5	2393.9	2359.7	2359.7	2354.4
25°	2346.7	2325.8	2281.4	2286.4	2281.4
27.5°	2268.0	2249.7	2215.8	2208.0	2194.9
30°	2189.7	2168.5	2129.4	2121.6	2111.0
32.5°	2105.7	2090.2	2048.2	2032.4	2021.8
35°	2024.6	1998.5	1956.5	1940.7	1927.6
37.5°	1932.9	1909.3	1867.3	1849.0	1835.9
40°	1838.7	1817.6	1775.6	1752.3	1741.7
42.5°	1747.0	1725.9	1684.2	1657.8	1642.2
45°	1647.5	1629.2	1589.7	1561.1	1550.5
47.5°	1550.5	1532.2	1490.2	1461.3	1445.8
50°	1448.3	1435.2	1398.5	1361.9	1348.8
52.5°	1348.8	1330.5	1296.6	1267.7	1249.3
55°	1246.8	1231.0	1199.6	1168.2	1155.1
57.5°	1144.6	1131.5	1097.3	1065.9	1055.4
60°	1042.3	1032.0	995.4	966.5	958.7
62.5°	942.8	924.5	898.4	872.3	861.7
65°	840.9	825.0	798.9	775.3	762.2
67.5°	736.1	722.8	699.4	681.1	670.5
70°	639.1	628.6	604.9	586.6	576.3
72.5°	539.6	529.1	516.0	497.7	489.9
75°	439.9	434.9	421.5	406.0	411.3
77.5°	351.0	340.4	335.1	327.3	319.6
80°	262.0	259.3	254.0	246.2	240.9
82.5°	178.1	178.1	175.6	165.1	165.1
85°	107.3	104.8	102.3	94.2	91.7
87.5°	47.2	42.0	36.7	28.9	26.1
90°	2.3	27.5	74.8	70.2	72.5
92.5°	47.3	64.1	66.4	68.6	68.6
95°	111.4	132.7	136.5	136.5	132.7
97.5°	185.4	205.2	213.6	213.6	213.6
100°	270.8	288.3	294.4	294.4	292.1
102.5°	360.8	373.8	382.1	384.4	382.1
105°	459.2	465.3	469.9	473.7	473.7
107.5°	556.8	566.0	566.0	567.5	556.8
110°	651.4	663.6	663.6	663.6	657.5

TEST NUMBER: P905808

CATALOG NUMBER: DFN2DIP-PN3F0-070D080US835-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	753.6	766.6	764.3	758.2	753.6
115°	854.3	866.5	862.7	860.4	854.3
117.5°	954.2	971.0	960.3	954.2	948.1
120°	1054.9	1071.7	1054.9	1054.9	1048.0
122.5°	1146.4	1167.8	1157.1	1151.0	1146.4
125°	1242.5	1261.6	1255.5	1248.6	1246.4
127.5°	1336.4	1360.0	1351.6	1342.5	1336.4
130°	1424.1	1451.5	1447.7	1443.2	1434.8
132.5°	1522.5	1543.8	1545.4	1534.7	1528.6
135°	1607.1	1630.8	1635.4	1633.1	1627.0
137.5°	1701.7	1720.8	1724.6	1723.1	1713.9
140°	1784.9	1803.9	1814.6	1814.6	1806.2
142.5°	1870.3	1889.4	1895.5	1897.8	1889.4
145°	1951.2	1966.4	1978.6	1980.9	1972.5
147.5°	2023.6	2042.7	2051.8	2055.7	2047.3
150°	2098.4	2111.3	2119.7	2126.6	2119.7
152.5°	2164.7	2177.7	2188.4	2196.8	2188.4
155°	2231.1	2237.2	2244.1	2254.7	2247.9
157.5°	2288.3	2292.9	2296.7	2311.9	2301.3
160°	2339.4	2344.0	2346.3	2359.2	2350.1
162.5°	2386.7	2386.7	2389.0	2403.5	2392.8
165°	2427.1	2424.8	2424.8	2440.1	2429.4
167.5°	2463.7	2456.9	2456.9	2472.1	2461.4
170°	2491.2	2485.1	2482.8	2498.1	2485.1
172.5°	2510.3	2504.2	2501.9	2517.1	2504.2
175°	2525.5	2519.4	2514.8	2530.1	2517.1
177.5°	2533.9	2527.8	2523.2	2536.2	2523.2
180°	2530.1	2530.1	2530.1	2530.1	2530.1

TEST NUMBER: P905808

CATALOG NUMBER: DFN2DIP-PN3F0-070D080US835-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.21	12.07	12.17	13.04	14.32	10.77	11.63	11.73	12.60	13.88
	3H	12.86	13.63	13.84	14.62	15.92	12.38	13.15	13.35	14.14	15.44
	4H	13.45	14.18	14.43	15.16	16.47	12.96	13.69	13.95	14.68	15.99
	6H	13.84	14.51	14.84	15.51	16.83	13.35	14.02	14.35	15.02	16.34
	8H	13.95	14.58	14.95	15.59	16.91	13.45	14.09	14.46	15.10	16.42
	12H	13.99	14.60	15.00	15.60	16.95	13.49	14.10	14.50	15.11	16.45
4H	2H	11.67	12.40	12.66	13.38	14.69	11.32	12.04	12.31	13.03	14.34
	3H	13.53	14.13	14.53	15.15	16.47	13.12	13.73	14.13	14.75	16.07
	4H	14.24	14.79	15.24	15.80	17.15	13.82	14.37	14.83	15.39	16.73
	6H	14.74	15.22	15.76	16.26	17.60	14.32	14.80	15.34	15.83	17.18
	8H	14.89	15.34	15.91	16.37	17.72	14.46	14.91	15.49	15.94	17.30
	12H	14.96	15.36	16.00	16.41	17.77	14.52	14.93	15.56	15.97	17.33
8H	4H	14.43	14.87	15.45	15.90	17.26	14.06	14.50	15.08	15.53	16.89
	6H	15.05	15.42	16.10	16.49	17.85	14.68	15.05	15.72	16.11	17.47
	8H	15.27	15.59	16.32	16.65	18.02	14.88	15.21	15.94	16.26	17.64
	12H	15.39	15.68	16.45	16.73	18.15	14.99	15.28	16.05	16.33	17.75
12H	4H	14.41	14.82	15.45	15.86	17.22	14.05	14.45	15.09	15.50	16.86
	6H	15.08	15.40	16.13	16.46	17.83	14.71	15.04	15.77	16.10	17.47
	8H	15.32	15.60	16.37	16.65	18.07	14.94	15.23	16.00	16.28	17.70