

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P905820

Luminaire Tested: DFN2DIP-PN3F0-080D040US835-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P905820
REPORT IS A COMBINATION OF REPORTS P899535 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-080D040US835-FLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11460.0 lumens
Efficiency: N/A
Efficacy: 104.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 109.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9967
Total Harmonic Distortion (THDi): 0.063
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P905820

CATALOG NUMBER: DFN2DIP-PN3F0-080D040US835-FLLFLL

Luminous Intensity Polar Plot

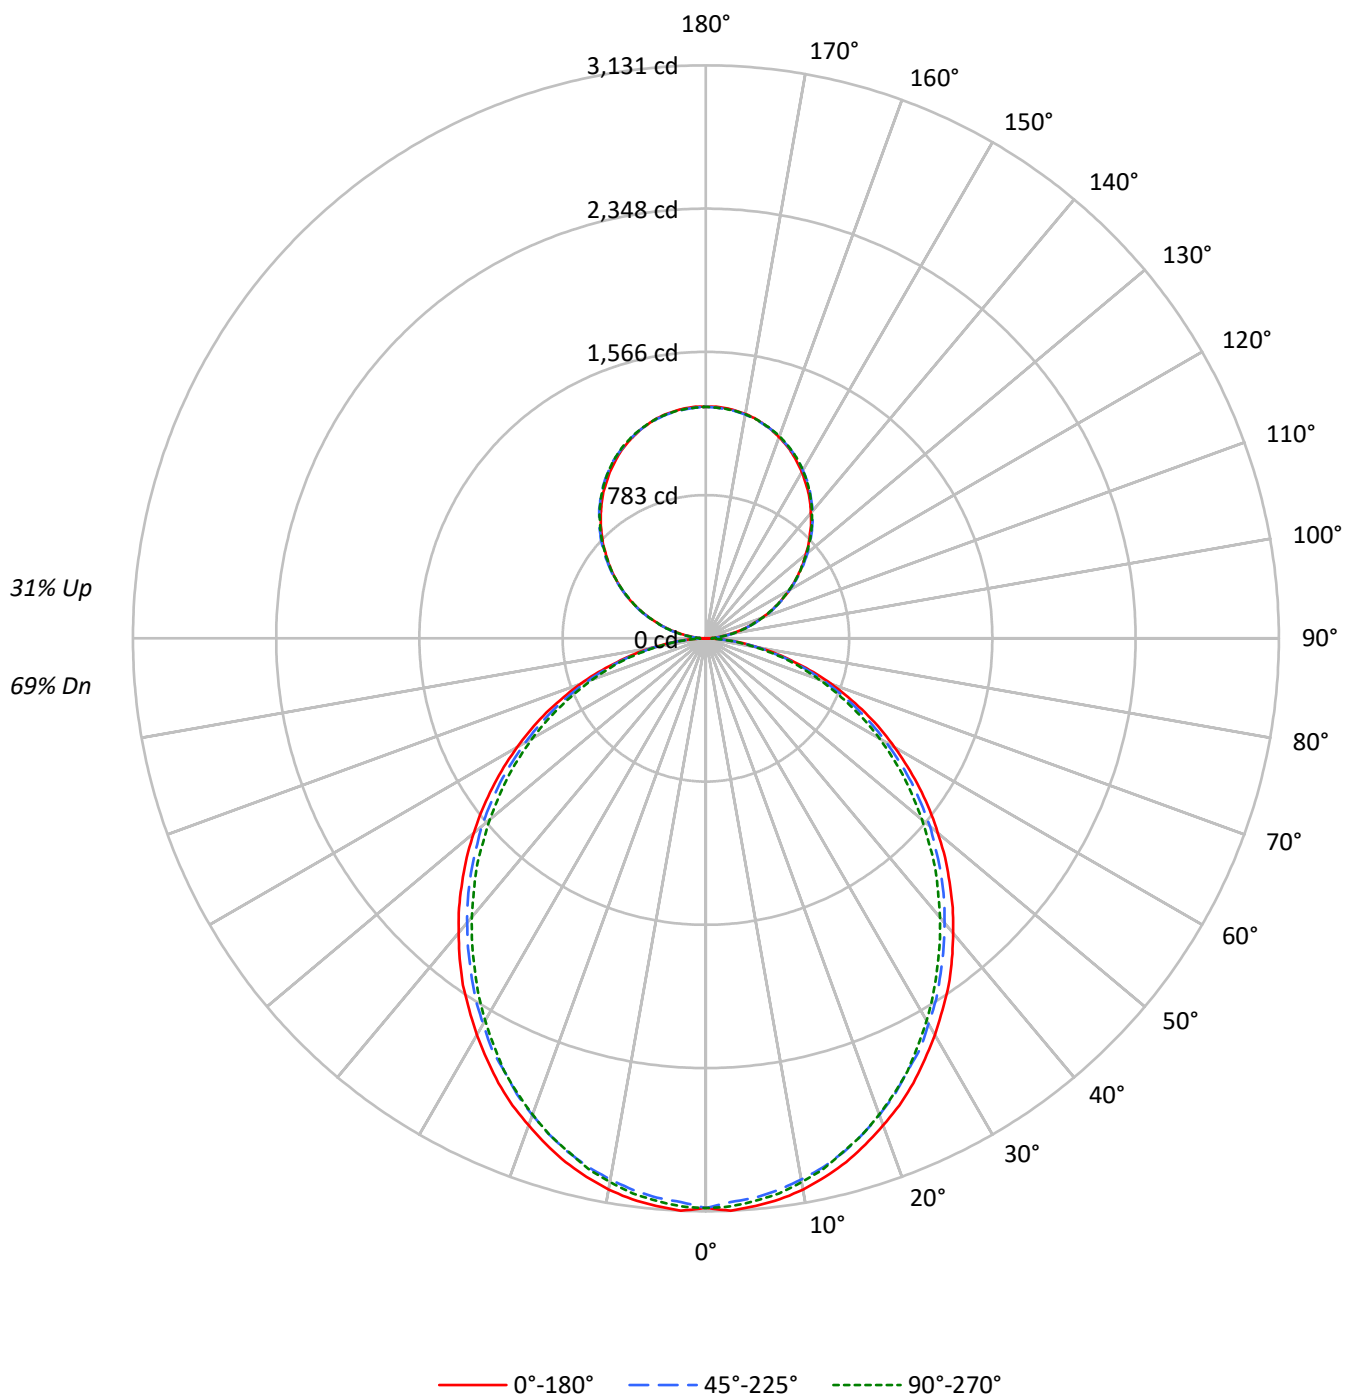

TEST NUMBER: P905820

CATALOG NUMBER: DFN2DIP-PN3F0-080D040US835-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	94	94	94	83	83	83	74	74	74
1	102	98	94	90	96	92	89	86	83	80	77	74	71	70	65	64	62
2	93	85	79	74	88	81	75	70	72	68	64	65	61	58	57	55	52
3	85	75	67	61	80	71	64	59	64	58	54	57	53	49	51	48	45
4	78	67	58	52	73	63	56	50	57	51	46	51	46	42	46	42	39
5	71	59	51	45	67	56	49	43	51	45	40	46	41	37	41	37	34
6	66	53	45	39	62	51	43	38	46	40	35	41	36	32	37	33	30
7	61	48	40	34	58	46	39	33	42	36	31	38	33	29	34	30	26
8	57	44	36	31	54	42	35	30	38	32	28	35	29	26	31	27	24
9	53	40	33	27	50	39	31	26	35	29	25	32	27	23	29	25	21
10	50	37	30	25	47	36	29	24	32	27	22	30	25	21	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3639	3639	3639
5°	3642	3586	3611
10°	3611	3535	3560
15°	3556	3474	3482
20°	3482	3391	3403
25°	3408	3291	3311
30°	3316	3199	3194
35°	3229	3090	3071
40°	3123	2980	2954
45°	3016	2870	2834
50°	2899	2754	2695
55°	2777	2620	2567
60°	2638	2461	2420
65°	2487	2296	2247
70°	2294	2095	2060
75°	2027	1854	1885
80°	1705	1546	1555
85°	1203	1023	1014

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3016 cd/sqm

TEST NUMBER: P905820

CATALOG NUMBER: DFN2DIP-PN3F0-080D040US835-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	293.0	2.6
10°-20°	824.3	7.2
20°-30°	1211.5	10.6
30°-40°	1407.0	12.3
40°-50°	1405.3	12.3
50°-60°	1225.4	10.7
60°-70°	905.8	7.9
70°-80°	512.5	4.5
80°-90°	138.9	1.2
90°-100°	78.3	0.7
100°-110°	248.7	2.2
110°-120°	425.6	3.7
120°-130°	559.8	4.9
130°-140°	628.3	5.5
140°-150°	616.2	5.4
150°-160°	516.9	4.5
160°-170°	342.8	3.0
170°-180°	119.8	1.0
0°-30°	2328.8	20.3
0°-40°	3735.8	32.6
0°-60°	6366.4	55.6
0°-90°	7923.6	69.1
90°-120°	752.7	6.6
90°-150°	2556.9	22.3
90°-180°	3536.0	30.9
0°-180°	11460.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3113	3113	3113	3113	3113	
5°	3113	3101	3068	3092	3086	295
15°	2963	2946	2906	2918	2904	835
25°	2682	2658	2607	2613	2607	1234
35°	2314	2284	2236	2218	2203	1445
45°	1883	1862	1817	1784	1772	1453
55°	1425	1407	1371	1335	1320	1274
65°	961	943	913	886	871	950
75°	503	497	482	464	470	537
85°	123	120	117	108	105	137
90°	1	14	37	35	36	11
95°	56	66	68	68	66	62
105°	230	233	235	237	237	242
115°	427	433	431	430	427	422
125°	621	631	628	624	623	555
135°	804	815	818	816	814	621
145°	976	983	989	990	986	610
155°	1116	1119	1122	1127	1124	513
165°	1214	1212	1212	1220	1215	342
175°	1263	1260	1257	1265	1259	120
180°	1265	1265	1265	1265	1265	

TEST NUMBER: P905820

CATALOG NUMBER: DFN2DIP-PN3F0-080D040US835-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3112.8	3112.8	3112.8	3112.8	3112.8
2.5°	3130.9	3116.0	3083.0	3112.8	3107.1
5°	3112.8	3101.1	3068.1	3091.9	3086.2
7.5°	3091.9	3074.1	3041.1	3065.2	3059.2
10°	3059.2	3038.2	3002.3	3026.1	3017.3
12.5°	3014.1	2996.3	2960.4	2975.3	2969.3
15°	2963.3	2945.5	2906.4	2918.5	2903.6
17.5°	2900.4	2882.6	2843.5	2858.5	2843.5
20°	2831.5	2813.7	2771.8	2780.7	2768.9
22.5°	2762.9	2735.9	2696.8	2696.8	2690.8
25°	2681.9	2658.1	2607.3	2613.0	2607.3
27.5°	2592.0	2571.1	2532.3	2523.4	2508.5
30°	2502.5	2478.3	2433.6	2424.7	2412.6
32.5°	2406.6	2388.8	2340.8	2322.7	2310.7
35°	2313.8	2284.0	2236.0	2217.9	2203.0
37.5°	2209.0	2182.0	2134.1	2113.1	2098.2
40°	2101.4	2077.2	2029.3	2002.6	1990.5
42.5°	1996.6	1972.4	1924.8	1894.6	1876.9
45°	1882.9	1861.9	1816.8	1784.1	1772.1
47.5°	1772.1	1751.1	1703.1	1670.1	1652.3
50°	1655.2	1640.3	1598.3	1556.4	1541.5
52.5°	1541.5	1520.5	1481.8	1448.8	1427.8
55°	1424.9	1406.8	1371.0	1335.1	1320.1
57.5°	1308.1	1293.2	1254.1	1218.2	1206.1
60°	1191.2	1179.5	1137.5	1104.5	1095.6
62.5°	1077.5	1056.6	1026.7	996.9	984.8
65°	961.0	942.9	913.0	886.0	871.1
67.5°	841.2	826.0	799.3	778.4	766.3
70°	730.4	718.3	691.4	670.4	658.6
72.5°	616.7	604.7	589.7	568.8	559.9
75°	502.7	497.0	481.8	464.0	470.0
77.5°	401.1	389.0	383.0	374.1	365.2
80°	299.5	296.3	290.3	281.4	275.3
82.5°	203.6	203.6	200.7	188.6	188.6
85°	122.6	119.7	116.9	107.7	104.8
87.5°	54.0	48.0	41.9	33.0	29.9
90°	1.1	13.7	37.4	35.1	36.2
92.5°	23.6	32.0	33.2	34.3	34.3
95°	55.7	66.4	68.3	68.3	66.4
97.5°	92.7	102.6	106.8	106.8	106.8
100°	135.4	144.2	147.2	147.2	146.1
102.5°	180.4	186.9	191.1	192.2	191.1
105°	229.6	232.6	234.9	236.8	236.8
107.5°	278.4	283.0	283.0	283.7	278.4
110°	325.7	331.8	331.8	331.8	328.8



TEST NUMBER: P905820

CATALOG NUMBER: DFN2DIP-PN3F0-080D040US835-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	376.8	383.3	382.1	379.1	376.8
115°	427.1	433.3	431.3	430.2	427.1
117.5°	477.1	485.5	480.2	477.1	474.1
120°	527.5	535.8	527.5	527.5	524.0
122.5°	573.2	583.9	578.6	575.5	573.2
125°	621.3	630.8	627.8	624.3	623.2
127.5°	668.2	680.0	675.8	671.2	668.2
130°	712.0	725.8	723.9	721.6	717.4
132.5°	761.2	771.9	772.7	767.3	764.3
135°	803.6	815.4	817.7	816.5	813.5
137.5°	850.9	860.4	862.3	861.5	857.0
140°	892.4	902.0	907.3	907.3	903.1
142.5°	935.2	944.7	947.7	948.9	944.7
145°	975.6	983.2	989.3	990.5	986.3
147.5°	1011.8	1021.3	1025.9	1027.8	1023.6
150°	1049.2	1055.7	1059.9	1063.3	1059.9
152.5°	1082.4	1088.8	1094.2	1098.4	1094.2
155°	1115.5	1118.6	1122.0	1127.4	1123.9
157.5°	1144.2	1146.4	1148.3	1156.0	1150.6
160°	1169.7	1172.0	1173.1	1179.6	1175.0
162.5°	1193.3	1193.3	1194.5	1201.7	1196.4
165°	1213.6	1212.4	1212.4	1220.0	1214.7
167.5°	1231.9	1228.4	1228.4	1236.1	1230.7
170°	1245.6	1242.5	1241.4	1249.0	1242.5
172.5°	1255.1	1252.1	1250.9	1258.6	1252.1
175°	1262.8	1259.7	1257.4	1265.0	1258.6
177.5°	1267.0	1263.9	1261.6	1268.1	1261.6
180°	1265.0	1265.0	1265.0	1265.0	1265.0

TEST NUMBER: P905820

CATALOG NUMBER: DFN2DIP-PN3F0-080D040US835-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.32	14.39	14.10	15.18	16.15	12.88	13.95	13.66	14.74	15.71
	3H	14.99	15.95	15.78	16.75	17.75	14.51	15.47	15.30	16.27	17.27
	4H	15.59	16.49	16.39	17.30	18.31	15.10	16.00	15.90	16.82	17.83
	6H	15.99	16.82	16.81	17.65	18.67	15.50	16.33	16.32	17.16	18.18
	8H	16.10	16.89	16.93	17.73	18.76	15.61	16.40	16.43	17.24	18.27
	12H	16.15	16.91	16.98	17.74	18.79	15.65	16.41	16.49	17.25	18.30
4H	2H	13.81	14.71	14.61	15.52	16.53	13.45	14.36	14.26	15.17	16.18
	3H	15.68	16.44	16.50	17.28	18.31	15.28	16.03	16.10	16.88	17.91
	4H	16.40	17.09	17.23	17.93	18.99	15.98	16.67	16.82	17.52	18.57
	6H	16.92	17.51	17.77	18.39	19.44	16.50	17.09	17.35	17.96	19.02
	8H	17.07	17.63	17.93	18.49	19.56	16.65	17.20	17.50	18.07	19.14
	12H	17.15	17.65	18.03	18.54	19.61	16.71	17.21	17.59	18.10	19.18
8H	4H	16.61	17.16	17.46	18.03	19.10	16.24	16.79	17.09	17.66	18.73
	6H	17.24	17.70	18.12	18.61	19.68	16.87	17.33	17.75	18.23	19.30
	8H	17.46	17.87	18.35	18.77	19.86	17.08	17.48	17.97	18.39	19.47
	12H	17.60	17.96	18.49	18.85	19.99	17.20	17.56	18.09	18.45	19.59
12H	4H	16.60	17.10	17.48	17.99	19.07	16.24	16.74	17.11	17.63	18.70
	6H	17.27	17.68	18.16	18.58	19.67	16.91	17.32	17.80	18.22	19.31
	8H	17.52	17.88	18.41	18.77	19.91	17.15	17.51	18.04	18.40	19.54

END OF REPORT