

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P905832

Luminaire Tested: DFN2DIP-PN3F0-080D070US835-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P905832
REPORT IS A COMBINATION OF REPORTS P899577 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-080D070US835-FLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14115.0 lumens
Efficiency: N/A
Efficacy: 105.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 134.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9967
Total Harmonic Distortion (THDi): 0.063
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P905832

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US835-FLLFLL

Luminous Intensity Polar Plot

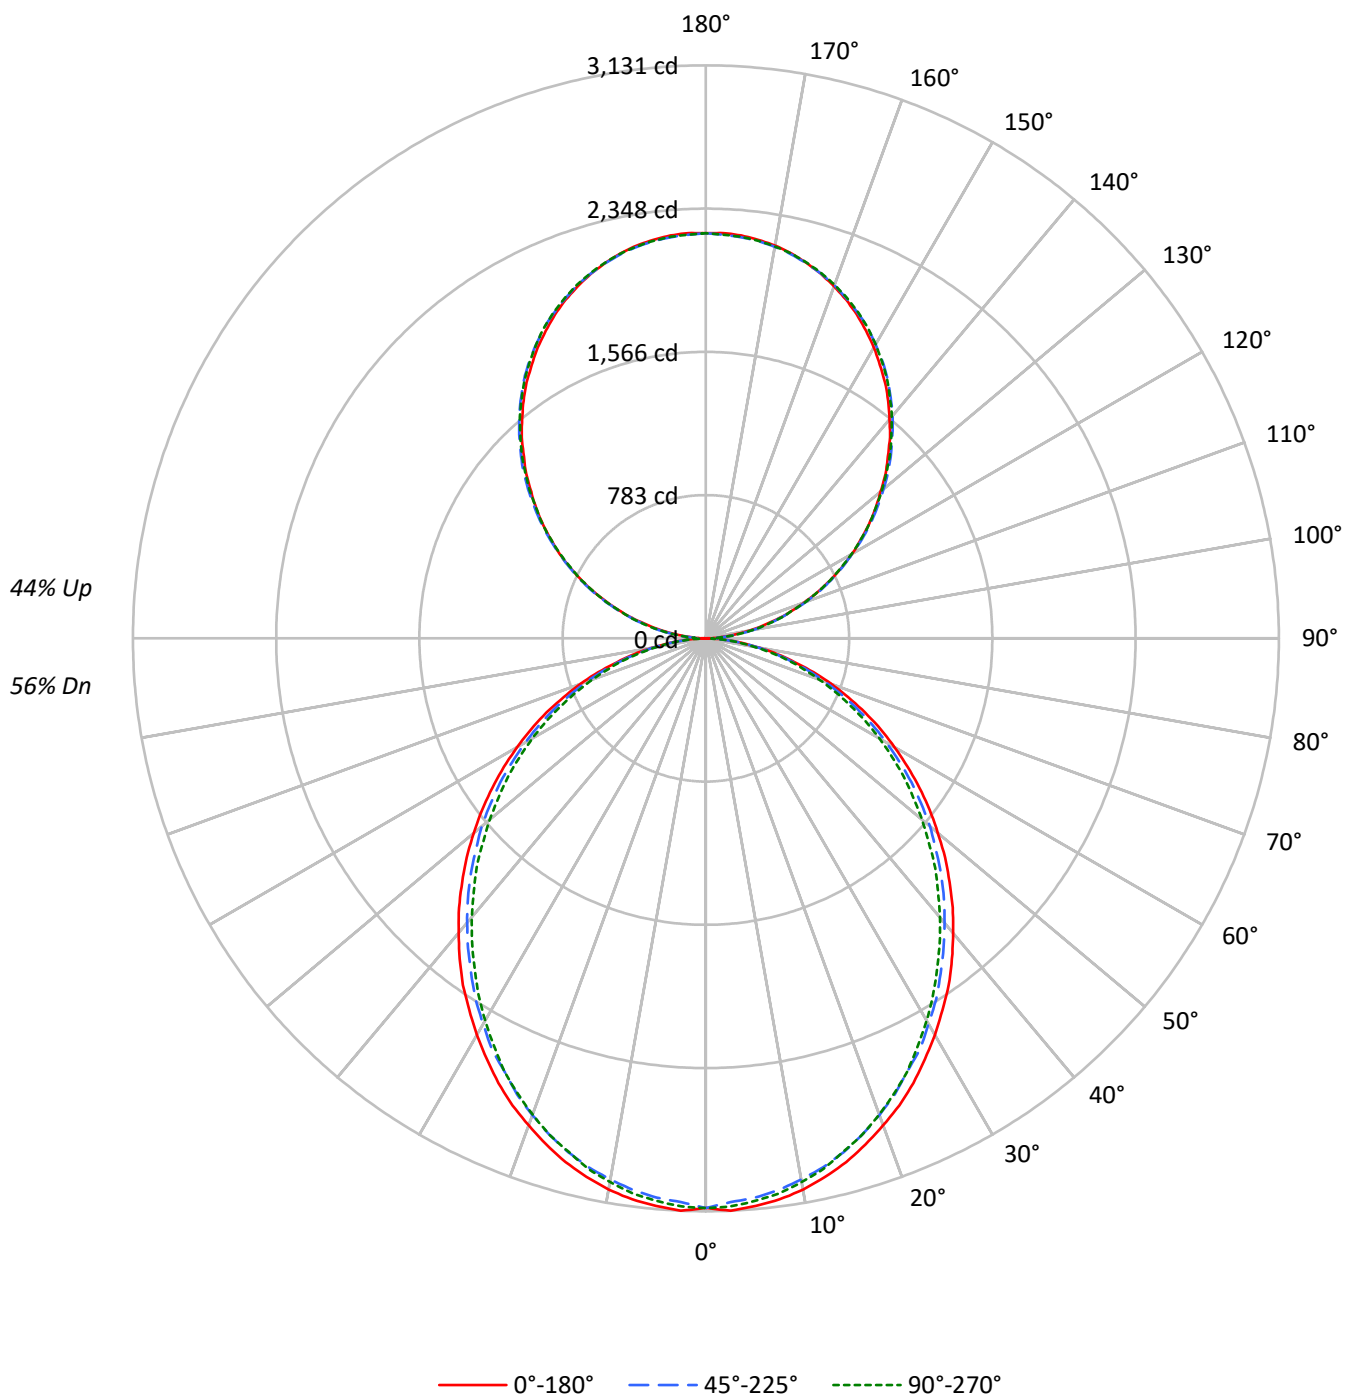

TEST NUMBER: P905832

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US835-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	62	62	62
1	99	95	91	87	92	88	85	82	76	74	71	65	63	61	55	53	52
2	90	83	77	71	84	77	72	67	67	63	59	57	54	51	48	46	44
3	82	73	65	59	76	68	61	56	59	54	50	50	47	43	43	40	37
4	75	64	56	50	70	60	53	48	52	47	42	45	41	37	38	35	32
5	69	57	49	43	64	54	46	41	47	41	37	40	36	32	34	31	28
6	64	52	43	38	59	48	41	36	42	36	32	37	32	28	31	28	25
7	59	47	39	33	55	44	37	31	38	32	28	33	29	25	28	25	22
8	55	42	35	29	51	40	33	28	35	29	25	30	26	22	26	23	20
9	51	39	31	26	47	36	30	25	32	26	23	28	23	20	24	21	18
10	48	36	28	23	44	34	27	22	30	24	20	26	21	18	22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3639	3639	3639
5°	3642	3586	3611
10°	3611	3535	3560
15°	3556	3474	3482
20°	3482	3391	3403
25°	3408	3291	3311
30°	3316	3199	3194
35°	3229	3090	3071
40°	3123	2980	2954
45°	3016	2870	2834
50°	2899	2754	2695
55°	2777	2620	2567
60°	2638	2461	2420
65°	2487	2296	2247
70°	2294	2095	2060
75°	2027	1854	1885
80°	1705	1546	1555
85°	1203	1023	1014

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3016 cd/sqm

TEST NUMBER: P905832

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US835-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	293.0	2.1
10°-20°	824.3	5.8
20°-30°	1211.5	8.6
30°-40°	1407.0	10.0
40°-50°	1405.3	10.0
50°-60°	1225.4	8.7
60°-70°	905.8	6.4
70°-80°	512.5	3.6
80°-90°	141.6	1.0
90°-100°	137.0	1.0
100°-110°	435.3	3.1
110°-120°	744.9	5.3
120°-130°	979.6	6.9
130°-140°	1099.6	7.8
140°-150°	1078.3	7.6
150°-160°	904.5	6.4
160°-170°	599.9	4.2
170°-180°	209.7	1.5
0°-30°	2328.8	16.5
0°-40°	3735.8	26.5
0°-60°	6366.4	45.1
0°-90°	7926.3	56.2
90°-120°	1317.2	9.3
90°-150°	4474.7	31.7
90°-180°	6189.0	43.8
0°-180°	14115.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3113	3113	3113	3113	3113	
5°	3113	3101	3068	3092	3086	295
15°	2963	2946	2906	2918	2904	835
25°	2682	2658	2607	2613	2607	1234
35°	2314	2284	2236	2218	2203	1445
45°	1883	1862	1817	1784	1772	1453
55°	1425	1407	1371	1335	1320	1274
65°	961	943	913	886	871	950
75°	503	497	482	464	470	537
85°	123	120	117	108	105	137
90°	2	24	65	61	63	14
95°	97	116	120	120	116	108
105°	402	407	411	414	414	424
115°	748	758	755	753	748	739
125°	1087	1104	1099	1093	1091	972
135°	1406	1427	1431	1429	1424	1087
145°	1707	1721	1731	1733	1726	1067
155°	1952	1958	1964	1973	1967	899
165°	2124	2122	2122	2135	2126	599
175°	2210	2204	2200	2214	2202	210
180°	2214	2214	2214	2214	2214	

TEST NUMBER: P905832

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US835-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3112.8	3112.8	3112.8	3112.8	3112.8
2.5°	3130.9	3116.0	3083.0	3112.8	3107.1
5°	3112.8	3101.1	3068.1	3091.9	3086.2
7.5°	3091.9	3074.1	3041.1	3065.2	3059.2
10°	3059.2	3038.2	3002.3	3026.1	3017.3
12.5°	3014.1	2996.3	2960.4	2975.3	2969.3
15°	2963.3	2945.5	2906.4	2918.5	2903.6
17.5°	2900.4	2882.6	2843.5	2858.5	2843.5
20°	2831.5	2813.7	2771.8	2780.7	2768.9
22.5°	2762.9	2735.9	2696.8	2696.8	2690.8
25°	2681.9	2658.1	2607.3	2613.0	2607.3
27.5°	2592.0	2571.1	2532.3	2523.4	2508.5
30°	2502.5	2478.3	2433.6	2424.7	2412.6
32.5°	2406.6	2388.8	2340.8	2322.7	2310.7
35°	2313.8	2284.0	2236.0	2217.9	2203.0
37.5°	2209.0	2182.0	2134.1	2113.1	2098.2
40°	2101.4	2077.2	2029.3	2002.6	1990.5
42.5°	1996.6	1972.4	1924.8	1894.6	1876.9
45°	1882.9	1861.9	1816.8	1784.1	1772.1
47.5°	1772.1	1751.1	1703.1	1670.1	1652.3
50°	1655.2	1640.3	1598.3	1556.4	1541.5
52.5°	1541.5	1520.5	1481.8	1448.8	1427.8
55°	1424.9	1406.8	1371.0	1335.1	1320.1
57.5°	1308.1	1293.2	1254.1	1218.2	1206.1
60°	1191.2	1179.5	1137.5	1104.5	1095.6
62.5°	1077.5	1056.6	1026.7	996.9	984.8
65°	961.0	942.9	913.0	886.0	871.1
67.5°	841.2	826.0	799.3	778.4	766.3
70°	730.4	718.3	691.4	670.4	658.6
72.5°	616.7	604.7	589.7	568.8	559.9
75°	502.7	497.0	481.8	464.0	470.0
77.5°	401.1	389.0	383.0	374.1	365.2
80°	299.5	296.3	290.3	281.4	275.3
82.5°	203.6	203.6	200.7	188.6	188.6
85°	122.6	119.7	116.9	107.7	104.8
87.5°	54.0	48.0	41.9	33.0	29.9
90°	2.0	24.0	65.4	61.4	63.4
92.5°	41.4	56.1	58.1	60.1	60.1
95°	97.4	116.1	119.5	119.5	116.1
97.5°	162.2	179.5	186.9	186.9	186.9
100°	236.9	252.3	257.6	257.6	255.6
102.5°	315.7	327.0	334.4	336.4	334.4
105°	401.8	407.1	411.1	414.5	414.5
107.5°	487.2	495.2	495.2	496.6	487.2
110°	570.0	580.7	580.7	580.7	575.3

TEST NUMBER: P905832

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US835-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	659.4	670.8	668.8	663.4	659.4
115°	747.5	758.2	754.9	752.9	747.5
117.5°	834.9	849.6	840.3	834.9	829.6
120°	923.0	937.7	923.0	923.0	917.0
122.5°	1003.1	1021.8	1012.5	1007.1	1003.1
125°	1087.2	1103.9	1098.6	1092.6	1090.6
127.5°	1169.3	1190.0	1182.7	1174.7	1169.3
130°	1246.1	1270.1	1266.8	1262.8	1255.4
132.5°	1332.2	1350.9	1352.2	1342.9	1337.5
135°	1406.3	1426.9	1431.0	1428.9	1423.6
137.5°	1489.0	1505.7	1509.0	1507.7	1499.7
140°	1561.8	1578.5	1587.8	1587.8	1580.5
142.5°	1636.5	1653.2	1658.5	1660.5	1653.2
145°	1707.3	1720.6	1731.3	1733.3	1726.0
147.5°	1770.7	1787.4	1795.4	1798.7	1791.4
150°	1836.1	1847.4	1854.8	1860.8	1854.8
152.5°	1894.1	1905.5	1914.8	1922.2	1914.8
155°	1952.2	1957.5	1963.6	1972.9	1966.9
157.5°	2002.3	2006.3	2009.6	2023.0	2013.6
160°	2047.0	2051.0	2053.0	2064.3	2056.3
162.5°	2088.4	2088.4	2090.4	2103.0	2093.7
165°	2123.7	2121.7	2121.7	2135.1	2125.7
167.5°	2155.8	2149.8	2149.8	2163.1	2153.8
170°	2179.8	2174.5	2172.5	2185.8	2174.5
172.5°	2196.5	2191.1	2189.1	2202.5	2191.1
175°	2209.8	2204.5	2200.5	2213.8	2202.5
177.5°	2217.2	2211.8	2207.8	2219.2	2207.8
180°	2213.8	2213.8	2213.8	2213.8	2213.8

TEST NUMBER: P905832

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US835-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.27	13.19	13.17	14.11	15.29	11.83	12.75	12.73	13.67	14.85
	3H	13.93	14.75	14.84	15.68	16.89	13.45	14.27	14.36	15.20	16.41
	4H	14.51	15.29	15.44	16.23	17.45	14.03	14.81	14.96	15.75	16.96
	6H	14.91	15.63	15.85	16.57	17.80	14.42	15.14	15.36	16.08	17.31
	8H	15.02	15.70	15.96	16.66	17.89	14.53	15.21	15.47	16.17	17.40
	12H	15.06	15.72	16.02	16.67	17.92	14.57	15.22	15.52	16.17	17.42
4H	2H	12.73	13.51	13.67	14.45	15.67	12.38	13.16	13.32	14.10	15.31
	3H	14.60	15.25	15.54	16.22	17.45	14.20	14.85	15.14	15.82	17.04
	4H	15.31	15.91	16.27	16.87	18.12	14.89	15.49	15.85	16.45	17.70
	6H	15.82	16.34	16.79	17.32	18.57	15.40	15.91	16.37	16.90	18.15
	8H	15.97	16.45	16.94	17.43	18.70	15.54	16.02	16.51	17.00	18.27
	12H	16.04	16.48	17.03	17.47	18.74	15.61	16.04	16.60	17.03	18.31
8H	4H	15.51	15.99	16.48	16.97	18.23	15.14	15.62	16.11	16.60	17.86
	6H	16.13	16.53	17.13	17.55	18.82	15.76	16.16	16.75	17.18	18.44
	8H	16.35	16.70	17.35	17.71	18.99	15.97	16.32	16.97	17.33	18.61
	12H	16.48	16.79	17.49	17.79	19.12	16.08	16.39	17.09	17.39	18.72
12H	4H	15.49	15.93	16.48	16.92	18.20	15.13	15.57	16.12	16.56	17.83
	6H	16.16	16.51	17.17	17.52	18.81	15.80	16.15	16.80	17.16	18.44
	8H	16.40	16.71	17.41	17.71	19.04	16.03	16.34	17.04	17.34	18.67