

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P905852

Luminaire Tested: DFN2DIP-PN3F0-090D050US835-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P905852
REPORT IS A COMBINATION OF REPORTS P899551 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-090D050US835-FLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13335.0 lumens
Efficiency: N/A
Efficacy: 102.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 130.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9954
Total Harmonic Distortion (THDi): 0.076
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P905852

CATALOG NUMBER: DFN2DIP-PN3F0-090D050US835-FLLFLL

Luminous Intensity Polar Plot

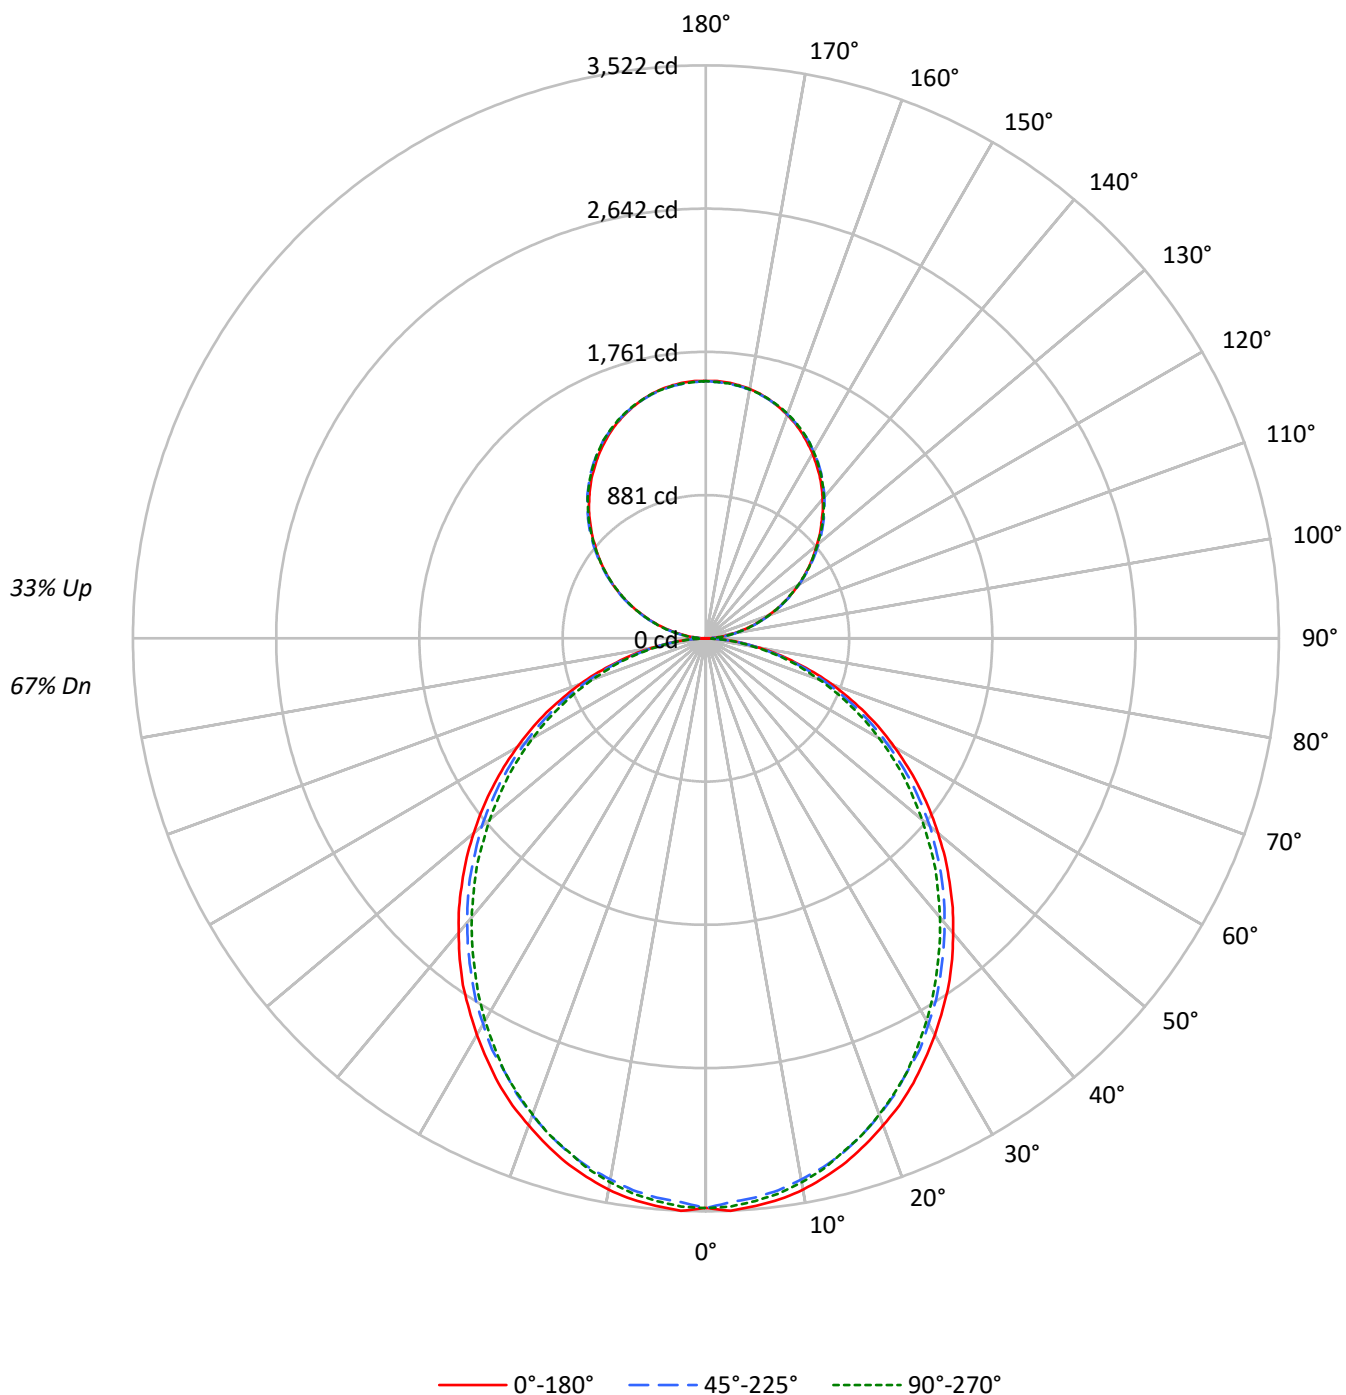

TEST NUMBER: P905852

CATALOG NUMBER: DFN2DIP-PN3F0-090D050US835-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	111	111	111	111	105	105	105	105	93	93	93		82	82	82		72
1	102	97	93	90	96	92	88	85	81	79	76		72	70	68		63
2	93	85	79	73	87	80	75	70	71	67	63		63	60	57		56
3	84	75	67	61	79	71	64	58	63	58	53		56	52	48		49
4	77	66	58	52	73	63	55	50	56	50	45		50	45	41		44
5	71	59	51	45	67	56	48	43	50	44	39		45	40	36		40
6	66	53	45	39	62	50	43	37	45	39	34		41	35	32		36
7	61	48	40	34	57	46	38	33	41	35	30		37	32	28		33
8	56	44	36	30	53	42	34	29	38	32	27		34	29	25		30
9	53	40	32	27	50	38	31	26	35	29	24		31	26	23		28
10	49	37	29	24	46	35	28	24	32	26	22		29	24	20		26

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4094	4094	4094
5°	4098	4034	4062
10°	4062	3977	4005
15°	4000	3908	3918
20°	3917	3814	3828
25°	3834	3703	3725
30°	3731	3599	3594
35°	3633	3476	3455
40°	3513	3353	3323
45°	3393	3228	3188
50°	3262	3098	3032
55°	3124	2947	2888
60°	2968	2768	2722
65°	2798	2583	2528
70°	2581	2357	2317
75°	2281	2085	2121
80°	1918	1738	1750
85°	1353	1151	1141

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3393 cd/sqm

TEST NUMBER: P905852

CATALOG NUMBER: DFN2DIP-PN3F0-090D050US835-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	329.6	2.5
10°-20°	927.4	7.0
20°-30°	1362.9	10.2
30°-40°	1582.9	11.9
40°-50°	1580.9	11.9
50°-60°	1378.5	10.3
60°-70°	1019.0	7.6
70°-80°	576.6	4.3
80°-90°	156.7	1.2
90°-100°	97.8	0.7
100°-110°	310.9	2.3
110°-120°	532.1	4.0
120°-130°	699.7	5.2
130°-140°	785.4	5.9
140°-150°	770.2	5.8
150°-160°	646.1	4.8
160°-170°	428.5	3.2
170°-180°	149.8	1.1
0°-30°	2619.9	19.6
0°-40°	4202.8	31.5
0°-60°	7162.3	53.7
0°-90°	8914.5	66.9
90°-120°	940.8	7.1
90°-150°	3196.2	24.0
90°-180°	4421.0	33.2
0°-180°	13335.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3502	3502	3502	3502	3502	
5°	3502	3489	3452	3478	3472	332
15°	3334	3314	3270	3283	3266	939
25°	3017	2990	2933	2940	2933	1388
35°	2603	2570	2516	2495	2478	1626
45°	2118	2095	2044	2007	1994	1635
55°	1603	1583	1542	1502	1485	1433
65°	1081	1061	1027	997	980	1069
75°	566	559	542	522	529	604
85°	138	135	132	121	118	154
90°	1	17	47	44	45	13
95°	70	83	85	85	83	77
105°	287	291	294	296	296	303
115°	534	542	539	538	534	528
125°	777	788	785	780	779	694
135°	1004	1019	1022	1021	1017	776
145°	1220	1229	1237	1238	1233	762
155°	1394	1398	1402	1409	1405	642
165°	1517	1516	1516	1525	1518	428
175°	1578	1575	1572	1581	1573	150
180°	1581	1581	1581	1581	1581	

TEST NUMBER: P905852

CATALOG NUMBER: DFN2DIP-PN3F0-090D050US835-FLLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3501.9	3501.9	3501.9	3501.9	3501.9
2.5°	3522.3	3505.5	3468.4	3501.9	3495.5
5°	3501.9	3488.7	3451.6	3478.4	3471.9
7.5°	3478.4	3458.4	3421.2	3448.4	3441.6
10°	3441.6	3418.0	3377.6	3404.4	3394.4
12.5°	3390.8	3370.8	3330.5	3347.2	3340.5
15°	3333.7	3313.7	3269.7	3283.3	3266.5
17.5°	3262.9	3242.9	3199.0	3215.8	3199.0
20°	3185.4	3165.4	3118.2	3128.2	3115.0
22.5°	3108.2	3077.9	3033.9	3033.9	3027.1
25°	3017.1	2990.3	2933.2	2939.6	2933.2
27.5°	2916.0	2892.4	2848.9	2838.9	2822.1
30°	2815.3	2788.1	2737.7	2727.7	2714.2
32.5°	2707.4	2687.4	2633.4	2613.1	2599.5
35°	2603.1	2569.5	2515.5	2495.2	2478.4
37.5°	2485.2	2454.8	2400.8	2377.3	2360.5
40°	2364.0	2336.9	2282.9	2252.9	2239.4
42.5°	2246.1	2219.0	2165.4	2131.5	2111.5
45°	2118.2	2094.7	2043.9	2007.1	1993.6
47.5°	1993.6	1970.0	1916.0	1878.9	1858.9
50°	1862.1	1845.3	1798.1	1751.0	1734.2
52.5°	1734.2	1710.6	1667.0	1629.9	1606.3
55°	1603.1	1582.7	1542.3	1502.0	1485.2
57.5°	1471.6	1454.8	1410.9	1370.5	1356.9
60°	1340.1	1326.9	1279.7	1242.6	1232.6
62.5°	1212.2	1188.6	1155.0	1121.5	1107.9
65°	1081.1	1060.7	1027.1	996.8	980.0
67.5°	946.4	929.3	899.2	875.7	862.1
70°	821.7	808.1	777.8	754.2	741.0
72.5°	693.8	680.2	663.4	639.9	629.9
75°	565.6	559.1	542.0	522.0	528.8
77.5°	451.2	437.7	430.9	420.9	410.9
80°	336.9	333.3	326.5	316.5	309.8
82.5°	229.0	229.0	225.8	212.2	212.2
85°	137.9	134.7	131.5	121.1	117.9
87.5°	60.7	53.9	47.2	37.2	33.6
90°	1.4	17.2	46.7	43.9	45.3
92.5°	29.6	40.0	41.5	42.9	42.9
95°	69.6	83.0	85.3	85.3	83.0
97.5°	115.8	128.2	133.5	133.5	133.5
100°	169.2	180.2	184.0	184.0	182.6
102.5°	225.5	233.6	238.8	240.3	238.8
105°	287.0	290.8	293.7	296.0	296.0
107.5°	348.0	353.7	353.7	354.7	348.0
110°	407.1	414.8	414.8	414.8	410.9

TEST NUMBER: P905852

CATALOG NUMBER: DFN2DIP-PN3F0-090D050US835-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	471.0	479.1	477.7	473.9	471.0
115°	533.9	541.6	539.2	537.8	533.9
117.5°	596.4	606.9	600.2	596.4	592.6
120°	659.3	669.8	659.3	659.3	655.0
122.5°	716.5	729.9	723.2	719.4	716.5
125°	776.6	788.5	784.7	780.4	779.0
127.5°	835.2	850.0	844.8	839.0	835.2
130°	890.1	907.2	904.8	902.0	896.7
132.5°	951.6	964.9	965.9	959.2	955.4
135°	1004.5	1019.2	1022.1	1020.7	1016.9
137.5°	1063.6	1075.5	1077.9	1076.9	1071.2
140°	1115.5	1127.5	1134.1	1134.1	1128.9
142.5°	1168.9	1180.9	1184.7	1186.1	1180.9
145°	1219.5	1229.0	1236.6	1238.1	1232.8
147.5°	1264.8	1276.7	1282.4	1284.8	1279.5
150°	1311.5	1319.6	1324.8	1329.1	1324.8
152.5°	1353.0	1361.1	1367.7	1373.0	1367.7
155°	1394.4	1398.2	1402.5	1409.2	1404.9
157.5°	1430.2	1433.0	1435.4	1445.0	1438.3
160°	1462.1	1465.0	1466.4	1474.5	1468.8
162.5°	1491.7	1491.7	1493.1	1502.2	1495.5
165°	1517.0	1515.5	1515.5	1525.1	1518.4
167.5°	1539.8	1535.5	1535.5	1545.1	1538.4
170°	1557.0	1553.2	1551.8	1561.3	1553.2
172.5°	1568.9	1565.1	1563.7	1573.2	1565.1
175°	1578.5	1574.6	1571.8	1581.3	1573.2
177.5°	1583.7	1579.9	1577.0	1585.1	1577.0
180°	1581.3	1581.3	1581.3	1581.3	1581.3

TEST NUMBER: P905852

CATALOG NUMBER: DFN2DIP-PN3F0-090D050US835-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.55	14.59	14.35	15.41	16.42	13.12	14.15	13.91	14.97	15.98
	3H	15.22	16.15	16.03	16.98	18.02	14.74	15.67	15.55	16.50	17.54
	4H	15.81	16.69	16.64	17.53	18.58	15.33	16.21	16.16	17.05	18.09
	6H	16.22	17.03	17.06	17.87	18.94	15.73	16.54	16.57	17.39	18.45
	8H	16.33	17.10	17.17	17.96	19.02	15.84	16.61	16.68	17.47	18.53
	12H	16.38	17.11	17.23	17.97	19.06	15.88	16.62	16.74	17.47	18.56
4H	2H	14.03	14.91	14.87	15.75	16.80	13.68	14.56	14.51	15.40	16.45
	3H	15.91	16.64	16.75	17.51	18.58	15.51	16.24	16.35	17.11	18.18
	4H	16.62	17.29	17.48	18.16	19.25	16.21	16.88	17.07	17.75	18.84
	6H	17.14	17.72	18.02	18.61	19.71	16.72	17.30	17.59	18.19	19.29
	8H	17.29	17.83	18.17	18.72	19.83	16.87	17.41	17.74	18.30	19.40
	12H	17.37	17.86	18.27	18.77	19.88	16.94	17.42	17.83	18.33	19.44
8H	4H	16.83	17.37	17.71	18.26	19.37	16.46	17.00	17.34	17.89	19.00
	6H	17.46	17.91	18.37	18.84	19.95	17.09	17.53	17.99	18.46	19.57
	8H	17.68	18.08	18.59	19.00	20.12	17.30	17.69	18.21	18.62	19.74
	12H	17.82	18.17	18.73	19.08	20.26	17.42	17.77	18.33	18.68	19.86
12H	4H	16.82	17.31	17.72	18.22	19.33	16.46	16.95	17.36	17.86	18.97
	6H	17.49	17.89	18.40	18.81	19.94	17.13	17.53	18.04	18.45	19.57
	8H	17.74	18.09	18.65	19.00	20.18	17.37	17.72	18.28	18.63	19.81

END OF REPORT