

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908425

Luminaire Tested: DFN2DIP-PN3F0-030D080US840-FLLONL

Issue Date: 11/21/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P908425  
REPORT IS A COMBINATION OF REPORTS P901101 AND P897955  
Test Lab: INNOVATION CENTER  
Issue Date: 11/21/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: NEO-RAY  
Catalog Number: DFN2DIP-PN3F0-030D080US840-FLLONL  
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 10997.5 lumens  
Efficiency: N/A  
Efficacy: 128.9 lumens/watt  
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29  
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')  
CIE Type: Semi-Indirect

Input Watts (W): 85.3  
Input Voltage (V):  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: 0.099  
Total Harmonic Distortion (THDi): 0.979  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P908425

CATALOG NUMBER: DFN2DIP-PN3F0-030D080US840-FLLONL

### Luminous Intensity Polar Plot

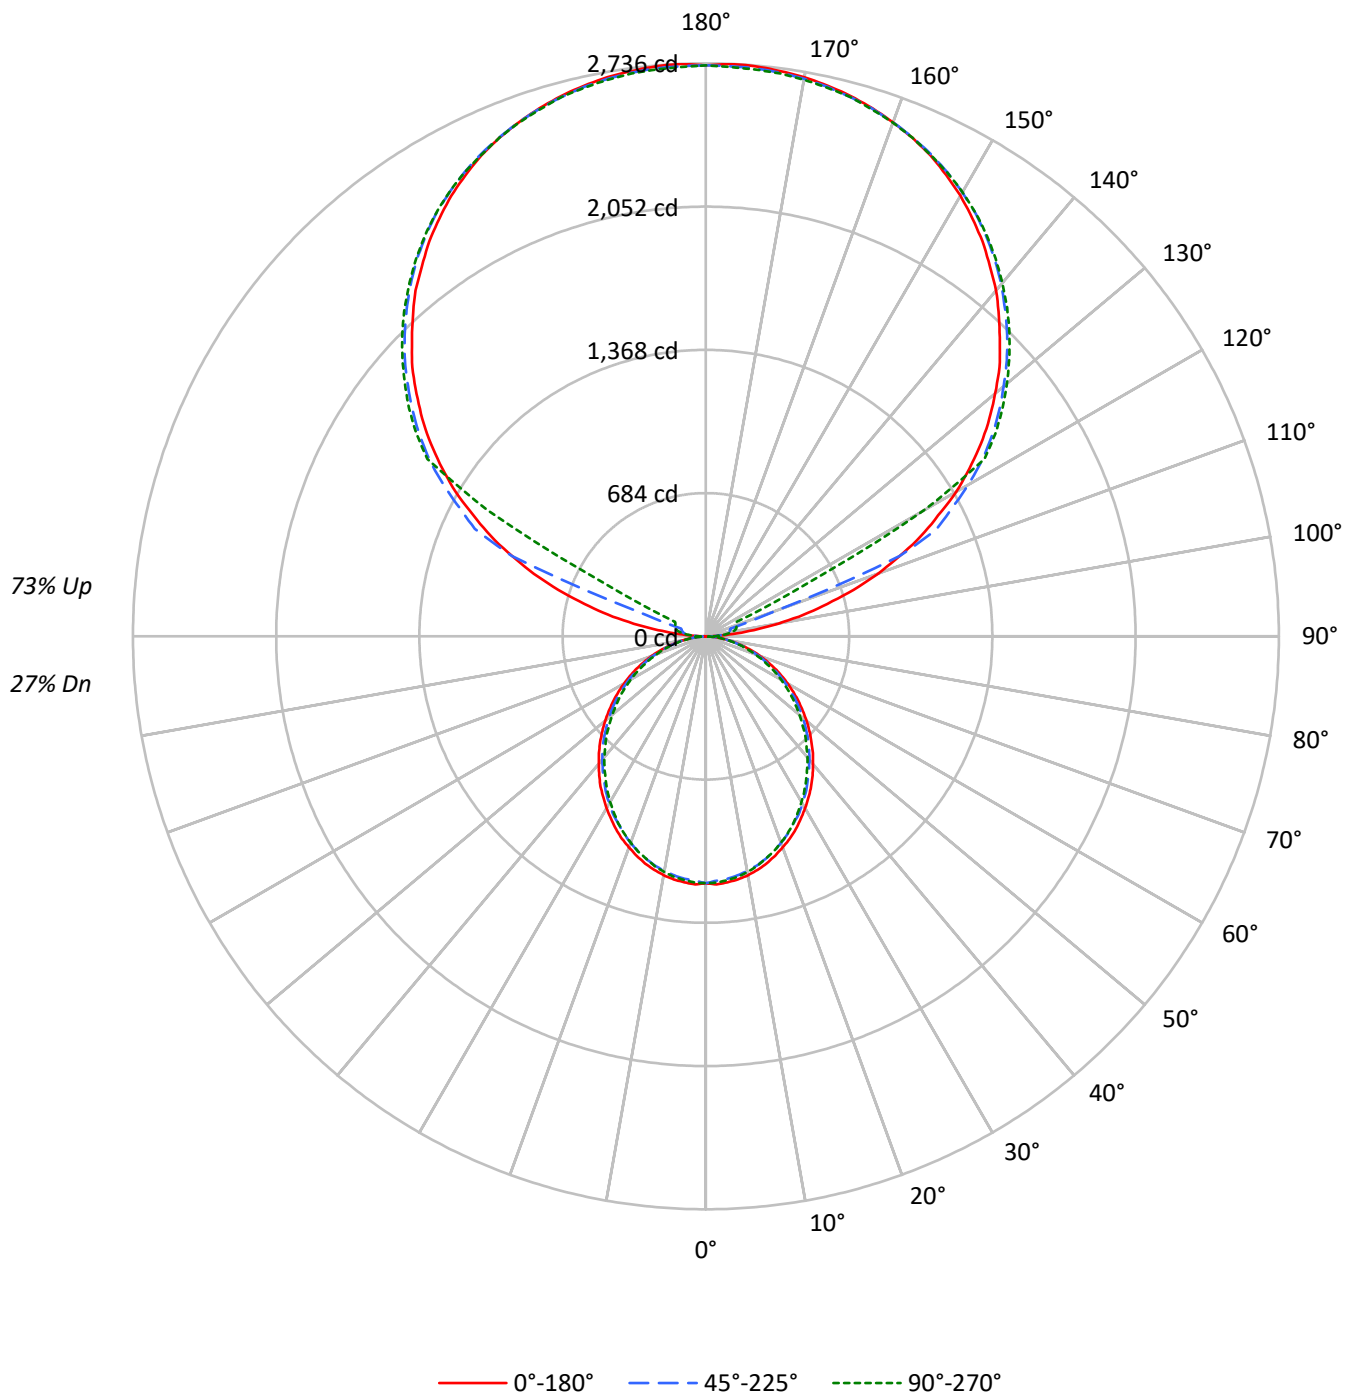

TEST NUMBER: P908425

CATALOG NUMBER: DFN2DIP-PN3F0-030D080US840-FLLONL

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |    |    |    |    |    |    |    |    |    |    |    |    |    |
|-----|-----|-----|-----|-----|----|----|----|----|----|----|----|----|----|----|----|----|----|
| RF  | 20  |     |     |     | 20 |    |    |    | 20 |    |    |    | 20 |    |    |    | 20 |
| RC  | 80  |     |     |     | 70 |    |    |    | 50 |    |    |    | 30 |    |    |    | 10 |
| RW  | 70  | 50  | 30  | 10  | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 |
| RCR |     |     |     |     |    |    |    |    |    |    |    |    |    |    |    |    |    |
| 0   | 102 | 102 | 102 | 102 | 91 | 91 | 91 | 91 | 71 | 71 | 71 | 52 | 52 | 52 | 35 | 35 | 35 |
| 1   | 93  | 89  | 85  | 81  | 83 | 79 | 76 | 73 | 62 | 60 | 58 | 46 | 45 | 43 | 31 | 30 | 30 |
| 2   | 84  | 77  | 71  | 66  | 75 | 69 | 64 | 60 | 54 | 51 | 48 | 40 | 38 | 36 | 27 | 26 | 25 |
| 3   | 77  | 68  | 61  | 55  | 68 | 61 | 55 | 50 | 48 | 44 | 40 | 36 | 33 | 31 | 24 | 23 | 21 |
| 4   | 70  | 60  | 52  | 47  | 63 | 54 | 47 | 42 | 42 | 38 | 34 | 32 | 29 | 26 | 22 | 20 | 18 |
| 5   | 64  | 53  | 45  | 40  | 57 | 48 | 41 | 36 | 38 | 33 | 29 | 28 | 25 | 23 | 19 | 18 | 16 |
| 6   | 59  | 48  | 40  | 34  | 53 | 43 | 36 | 31 | 34 | 29 | 25 | 25 | 22 | 20 | 18 | 16 | 14 |
| 7   | 55  | 43  | 35  | 30  | 49 | 39 | 32 | 27 | 31 | 26 | 22 | 23 | 20 | 17 | 16 | 14 | 12 |
| 8   | 51  | 39  | 31  | 26  | 45 | 35 | 28 | 24 | 28 | 23 | 20 | 21 | 18 | 15 | 15 | 13 | 11 |
| 9   | 47  | 35  | 28  | 23  | 42 | 32 | 26 | 21 | 25 | 21 | 17 | 19 | 16 | 14 | 14 | 12 | 10 |
| 10  | 44  | 32  | 25  | 21  | 39 | 29 | 23 | 19 | 23 | 19 | 16 | 18 | 15 | 12 | 13 | 11 | 9  |

**AVERAGE LUMINANCE (cd/sqm):**

|     | 0°   | 45°  | 90°  |
|-----|------|------|------|
| 0°  | 1378 | 1378 | 1378 |
| 5°  | 1379 | 1358 | 1367 |
| 10° | 1367 | 1339 | 1348 |
| 15° | 1347 | 1316 | 1319 |
| 20° | 1319 | 1284 | 1288 |
| 25° | 1291 | 1246 | 1254 |
| 30° | 1256 | 1211 | 1210 |
| 35° | 1223 | 1170 | 1163 |
| 40° | 1183 | 1129 | 1119 |
| 45° | 1142 | 1087 | 1073 |
| 50° | 1098 | 1043 | 1021 |
| 55° | 1052 | 992  | 972  |
| 60° | 999  | 932  | 917  |
| 65° | 942  | 870  | 851  |
| 70° | 869  | 794  | 780  |
| 75° | 768  | 702  | 714  |
| 80° | 646  | 585  | 589  |
| 85° | 456  | 387  | 384  |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1840 cd/sqm

TEST NUMBER: P908425

CATALOG NUMBER: DFN2DIP-PN3F0-030D080US840-FLLONL

**ZONAL LUMENS:**

| Zone      | Lumens  | % Fixture |
|-----------|---------|-----------|
| 0°-10°    | 111.0   | 1.0       |
| 10°-20°   | 312.2   | 2.8       |
| 20°-30°   | 458.8   | 4.2       |
| 30°-40°   | 532.8   | 4.8       |
| 40°-50°   | 532.2   | 4.8       |
| 50°-60°   | 464.1   | 4.2       |
| 60°-70°   | 343.1   | 3.1       |
| 70°-80°   | 194.1   | 1.8       |
| 80°-90°   | 56.0    | 0.5       |
| 90°-100°  | 89.9    | 0.8       |
| 100°-110° | 335.1   | 3.0       |
| 110°-120° | 888.9   | 8.1       |
| 120°-130° | 1474.3  | 13.4      |
| 130°-140° | 1566.0  | 14.2      |
| 140°-150° | 1455.4  | 13.2      |
| 150°-160° | 1170.1  | 10.6      |
| 160°-170° | 754.0   | 6.9       |
| 170°-180° | 259.5   | 2.4       |
| 0°-30°    | 881.9   | 8.0       |
| 0°-40°    | 1414.7  | 12.9      |
| 0°-60°    | 2411.0  | 21.9      |
| 0°-90°    | 3004.1  | 27.3      |
| 90°-120°  | 1314.0  | 11.9      |
| 90°-150°  | 5809.7  | 52.8      |
| 90°-180°  | 7993.0  | 72.7      |
| 0°-180°   | 10997.5 | 100.0     |

**CANDELA DISTRIBUTION:**

|      | 0°   | 22.5° | 45°  | 67.5° | 90°  | Flux |
|------|------|-------|------|-------|------|------|
| 0°   | 1179 | 1179  | 1179 | 1179  | 1179 |      |
| 5°   | 1179 | 1174  | 1162 | 1171  | 1169 | 112  |
| 15°  | 1122 | 1116  | 1101 | 1105  | 1100 | 316  |
| 25°  | 1016 | 1007  | 987  | 990   | 987  | 467  |
| 35°  | 876  | 865   | 847  | 840   | 834  | 547  |
| 45°  | 713  | 705   | 688  | 676   | 671  | 550  |
| 55°  | 540  | 533   | 519  | 506   | 500  | 482  |
| 65°  | 364  | 357   | 346  | 336   | 330  | 360  |
| 75°  | 190  | 188   | 182  | 176   | 178  | 203  |
| 85°  | 46   | 45    | 44   | 41    | 40   | 52   |
| 90°  | 2    | 24    | 39   | 49    | 53   | 10   |
| 95°  | 128  | 63    | 77   | 87    | 85   | 152  |
| 105° | 600  | 659   | 120  | 142   | 150  | 641  |
| 115° | 1134 | 1168  | 1217 | 304   | 162  | 1117 |
| 125° | 1604 | 1630  | 1667 | 1681  | 1687 | 1430 |
| 135° | 1985 | 2016  | 2034 | 2054  | 2050 | 1533 |
| 145° | 2302 | 2300  | 2334 | 2348  | 2338 | 1440 |
| 155° | 2535 | 2518  | 2541 | 2553  | 2537 | 1168 |
| 165° | 2671 | 2660  | 2665 | 2679  | 2665 | 755  |
| 175° | 2732 | 2719  | 2723 | 2736  | 2717 | 260  |
| 180° | 2726 | 2726  | 2726 | 2726  | 2726 |      |

TEST NUMBER: P908425

CATALOG NUMBER: DFN2DIP-PN3F0-030D080US840-FLLONL

**CANDELA DISTRIBUTION (FULL):**

|        | 0°     | 22.5°  | 45°    | 67.5°  | 90°    |
|--------|--------|--------|--------|--------|--------|
| 0°     | 1178.8 | 1178.8 | 1178.8 | 1178.8 | 1178.8 |
| 2.5°   | 1185.7 | 1180.0 | 1167.5 | 1178.8 | 1176.7 |
| 5°     | 1178.8 | 1174.4 | 1161.9 | 1170.9 | 1168.7 |
| 7.5°   | 1170.9 | 1164.2 | 1151.7 | 1160.8 | 1158.5 |
| 10°    | 1158.5 | 1150.5 | 1137.0 | 1146.0 | 1142.7 |
| 12.5°  | 1141.5 | 1134.7 | 1121.2 | 1126.7 | 1124.5 |
| 15°    | 1122.2 | 1115.5 | 1100.7 | 1105.2 | 1099.5 |
| 17.5°  | 1098.3 | 1091.7 | 1076.8 | 1082.5 | 1076.8 |
| 20°    | 1072.3 | 1065.5 | 1049.7 | 1053.0 | 1048.5 |
| 22.5°  | 1046.3 | 1036.1 | 1021.3 | 1021.3 | 1019.0 |
| 25°    | 1015.6 | 1006.6 | 987.3  | 989.6  | 987.3  |
| 27.5°  | 981.6  | 973.6  | 959.0  | 955.6  | 950.0  |
| 30°    | 947.7  | 938.6  | 921.6  | 918.2  | 913.6  |
| 32.5°  | 911.4  | 904.6  | 886.5  | 879.6  | 875.0  |
| 35°    | 876.3  | 864.9  | 846.8  | 839.9  | 834.2  |
| 37.5°  | 836.6  | 826.4  | 808.2  | 800.2  | 794.6  |
| 40°    | 795.8  | 786.7  | 768.5  | 758.4  | 753.9  |
| 42.5°  | 756.1  | 747.0  | 728.9  | 717.5  | 710.7  |
| 45°    | 713.1  | 705.1  | 688.0  | 675.6  | 671.1  |
| 47.5°  | 671.1  | 663.2  | 645.0  | 632.5  | 625.7  |
| 50°    | 626.8  | 621.2  | 605.3  | 589.5  | 583.8  |
| 52.5°  | 583.8  | 575.8  | 561.2  | 548.7  | 540.7  |
| 55°    | 539.7  | 532.8  | 519.2  | 505.6  | 500.0  |
| 57.5°  | 495.3  | 489.7  | 474.9  | 461.3  | 456.8  |
| 60°    | 451.1  | 446.7  | 430.8  | 418.3  | 415.0  |
| 62.5°  | 408.1  | 400.1  | 388.8  | 377.5  | 372.9  |
| 65°    | 364.0  | 357.1  | 345.8  | 335.6  | 329.9  |
| 67.5°  | 318.6  | 312.9  | 302.7  | 294.8  | 290.2  |
| 70°    | 276.6  | 272.1  | 261.9  | 253.9  | 249.4  |
| 72.5°  | 233.6  | 228.9  | 223.3  | 215.4  | 212.1  |
| 75°    | 190.4  | 188.2  | 182.5  | 175.7  | 178.0  |
| 77.5°  | 151.9  | 147.3  | 145.0  | 141.7  | 138.4  |
| 80°    | 113.4  | 112.2  | 109.9  | 106.5  | 104.3  |
| 82.5°  | 77.1   | 77.1   | 76.0   | 71.4   | 71.4   |
| 85°    | 46.5   | 45.3   | 44.2   | 40.8   | 39.7   |
| 87.5°  | 20.4   | 18.2   | 15.9   | 12.5   | 11.3   |
| 90°    | 1.9    | 23.6   | 39.4   | 49.4   | 53.2   |
| 92.5°  | 49.4   | 41.5   | 47.4   | 51.3   | 53.2   |
| 95°    | 128.2  | 63.0   | 76.9   | 86.9   | 84.8   |
| 97.5°  | 230.8  | 69.1   | 100.5  | 106.6  | 108.5  |
| 100°   | 349.3  | 79.0   | 112.5  | 128.2  | 132.1  |
| 102.5° | 479.4  | 475.5  | 116.4  | 137.9  | 144.1  |
| 105°   | 599.8  | 659.0  | 120.4  | 142.0  | 150.0  |
| 107.5° | 739.8  | 789.0  | 124.4  | 145.9  | 153.9  |
| 110°   | 874.1  | 915.3  | 345.4  | 148.0  | 155.8  |

TEST NUMBER: P908425

CATALOG NUMBER: DFN2DIP-PN3F0-030D080US840-FLLONL

**CANDELA DISTRIBUTION (continued):**

|        | 0°     | 22.5°  | 45°    | 67.5°  | 90°    |
|--------|--------|--------|--------|--------|--------|
| 112.5° | 1000.4 | 1035.7 | 1002.3 | 151.8  | 157.9  |
| 115°   | 1134.4 | 1167.9 | 1217.3 | 303.9  | 161.9  |
| 117.5° | 1250.8 | 1290.2 | 1323.9 | 1041.6 | 524.8  |
| 120°   | 1381.1 | 1410.6 | 1446.2 | 1469.9 | 1203.5 |
| 122.5° | 1491.4 | 1523.1 | 1562.7 | 1574.4 | 1576.5 |
| 125°   | 1603.9 | 1629.6 | 1667.1 | 1680.9 | 1686.8 |
| 127.5° | 1706.5 | 1734.1 | 1763.9 | 1783.5 | 1785.4 |
| 130°   | 1803.2 | 1834.8 | 1856.4 | 1878.2 | 1876.3 |
| 132.5° | 1901.9 | 1927.6 | 1949.2 | 1967.0 | 1965.1 |
| 135°   | 1984.8 | 2016.4 | 2034.0 | 2054.0 | 2049.9 |
| 137.5° | 2071.5 | 2095.2 | 2115.1 | 2134.8 | 2128.9 |
| 140°   | 2156.3 | 2172.2 | 2193.8 | 2211.6 | 2201.7 |
| 142.5° | 2227.6 | 2241.3 | 2266.8 | 2282.6 | 2272.7 |
| 145°   | 2302.5 | 2300.4 | 2333.9 | 2347.7 | 2337.8 |
| 147.5° | 2367.4 | 2361.6 | 2395.0 | 2404.9 | 2397.1 |
| 150°   | 2430.6 | 2416.8 | 2448.4 | 2460.1 | 2450.3 |
| 152.5° | 2483.9 | 2468.1 | 2497.6 | 2509.6 | 2495.8 |
| 155°   | 2535.2 | 2517.6 | 2541.2 | 2552.9 | 2537.3 |
| 157.5° | 2576.6 | 2560.9 | 2578.7 | 2592.5 | 2576.6 |
| 160°   | 2612.2 | 2600.3 | 2612.2 | 2623.9 | 2610.1 |
| 162.5° | 2643.6 | 2631.9 | 2641.7 | 2655.5 | 2637.8 |
| 165°   | 2671.3 | 2659.6 | 2665.4 | 2679.2 | 2665.4 |
| 167.5° | 2693.0 | 2681.1 | 2687.2 | 2701.0 | 2683.2 |
| 170°   | 2710.9 | 2698.9 | 2702.9 | 2716.7 | 2698.9 |
| 172.5° | 2722.6 | 2710.9 | 2714.8 | 2728.7 | 2710.9 |
| 175°   | 2732.4 | 2718.6 | 2722.6 | 2736.3 | 2716.7 |
| 177.5° | 2736.3 | 2722.6 | 2724.6 | 2738.5 | 2720.7 |
| 180°   | 2726.5 | 2726.5 | 2726.5 | 2726.5 | 2726.5 |

TEST NUMBER: P908425

CATALOG NUMBER: DFN2DIP-PN3F0-030D080US840-FLONL

**CIE UGR TABLE:**

| Reflectances:   |      |                  |       |       |       |       |                |      |       |       |       |
|-----------------|------|------------------|-------|-------|-------|-------|----------------|------|-------|-------|-------|
| Ceiling         |      | 0.7              | 0.7   | 0.5   | 0.5   | 0.3   | 0.7            | 0.7  | 0.5   | 0.5   | 0.3   |
| Wall            |      | 0.5              | 0.3   | 0.5   | 0.3   | 0.3   | 0.5            | 0.3  | 0.5   | 0.3   | 0.3   |
| Reference plane |      | 0.2              | 0.2   | 0.2   | 0.2   | 0.2   | 0.2            | 0.2  | 0.2   | 0.2   | 0.2   |
| Room dimensions |      | Viewed crosswise |       |       |       |       | Viewed endwise |      |       |       |       |
| X=2H            | Y=2H | 5.75             | 6.44  | 6.88  | 7.56  | 9.13  | 5.31           | 6.00 | 6.44  | 7.12  | 8.69  |
|                 | 3H   | 7.39             | 8.01  | 8.53  | 9.14  | 10.72 | 6.91           | 7.53 | 8.05  | 8.66  | 10.24 |
|                 | 4H   | 7.97             | 8.56  | 9.12  | 9.69  | 11.27 | 7.48           | 8.07 | 8.63  | 9.20  | 10.78 |
|                 | 6H   | 8.36             | 8.89  | 9.51  | 10.03 | 11.62 | 7.87           | 8.41 | 9.02  | 9.54  | 11.13 |
|                 | 8H   | 8.45             | 8.97  | 9.61  | 10.11 | 11.70 | 7.96           | 8.48 | 9.12  | 9.62  | 11.21 |
|                 | 12H  | 8.49             | 8.98  | 9.66  | 10.12 | 11.73 | 8.00           | 8.48 | 9.16  | 9.62  | 11.23 |
| 4H              | 2H   | 6.19             | 6.77  | 7.34  | 7.91  | 9.49  | 5.84           | 6.42 | 6.99  | 7.55  | 9.14  |
|                 | 3H   | 8.03             | 8.52  | 9.19  | 9.68  | 11.27 | 7.63           | 8.12 | 8.79  | 9.28  | 10.87 |
|                 | 4H   | 8.73             | 9.18  | 9.90  | 10.33 | 11.94 | 8.32           | 8.77 | 9.48  | 9.91  | 11.53 |
|                 | 6H   | 9.23             | 9.62  | 10.40 | 10.79 | 12.39 | 8.81           | 9.20 | 9.98  | 10.36 | 11.97 |
|                 | 8H   | 9.38             | 9.74  | 10.54 | 10.90 | 12.52 | 8.95           | 9.31 | 10.12 | 10.47 | 12.09 |
|                 | 12H  | 9.44             | 9.76  | 10.62 | 10.93 | 12.56 | 9.00           | 9.33 | 10.18 | 10.50 | 12.12 |
| 8H              | 4H   | 8.91             | 9.27  | 10.08 | 10.43 | 12.05 | 8.54           | 8.90 | 9.71  | 10.06 | 11.68 |
|                 | 6H   | 9.53             | 9.83  | 10.72 | 11.03 | 12.65 | 9.15           | 9.45 | 10.34 | 10.65 | 12.27 |
|                 | 8H   | 9.74             | 10.00 | 10.94 | 11.18 | 12.82 | 9.36           | 9.62 | 10.55 | 10.80 | 12.44 |
|                 | 12H  | 9.86             | 10.09 | 11.06 | 11.27 | 12.94 | 9.46           | 9.69 | 10.66 | 10.87 | 12.54 |
| 12H             | 4H   | 8.89             | 9.22  | 10.07 | 10.39 | 12.01 | 8.53           | 8.85 | 9.71  | 10.02 | 11.65 |
|                 | 6H   | 9.56             | 9.81  | 10.75 | 10.99 | 12.63 | 9.19           | 9.45 | 10.38 | 10.63 | 12.27 |
|                 | 8H   | 9.78             | 10.01 | 10.98 | 11.19 | 12.86 | 9.41           | 9.64 | 10.61 | 10.82 | 12.49 |