

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908560

Luminaire Tested: DFN2DIP-PN3F0-080D070US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908560
REPORT IS A COMBINATION OF REPORTS P899577 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-080D070US840-FLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14254.3 lumens
Efficiency: N/A
Efficacy: 106.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 134.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9967
Total Harmonic Distortion (THDi): 0.063
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908560

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US840-FLLFLL

Luminous Intensity Polar Plot

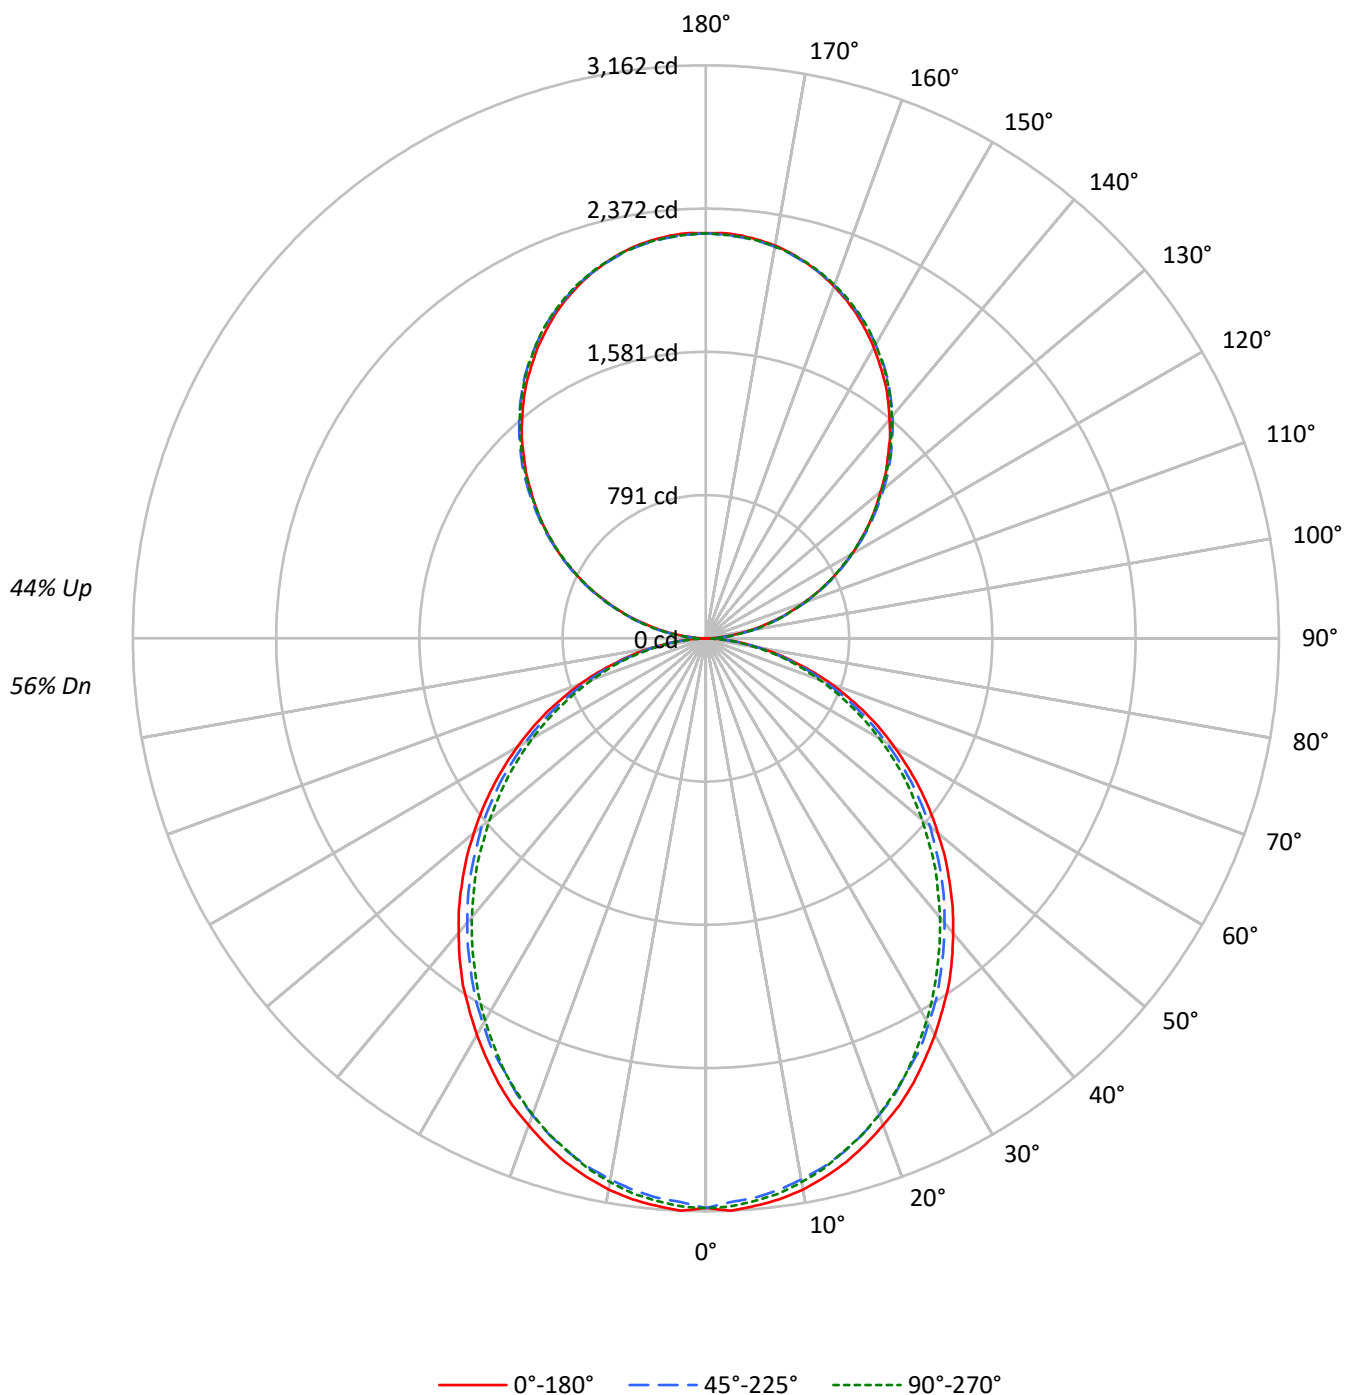

TEST NUMBER: P908560

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US840-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					10
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	109	109	109	109		101	101	101	101		87	87	87		74	74	74		62	62	62
1	99	95	91	87		92	88	85	82		76	74	71		65	63	61		55	53	52
2	90	83	77	71		84	77	72	67		67	63	59		57	54	51		48	46	44
3	82	73	65	59		76	68	61	56		59	54	50		50	47	43		43	40	37
4	75	64	56	50		70	60	53	48		52	47	42		45	41	37		38	35	32
5	69	57	49	43		64	54	46	41		47	41	37		40	36	32		34	31	28
6	64	52	43	38		59	48	41	36		42	36	32		37	32	28		31	28	25
7	59	47	39	33		55	44	37	31		38	32	28		33	29	25		28	25	22
8	55	42	35	29		51	40	33	28		35	29	25		30	26	22		26	23	20
9	51	39	31	26		47	36	30	25		32	26	23		28	23	20		24	21	18
10	48	36	28	23		44	34	27	22		30	24	20		26	21	18		22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3675	3675	3675
5°	3678	3621	3646
10°	3647	3570	3596
15°	3591	3508	3517
20°	3516	3424	3436
25°	3442	3324	3343
30°	3349	3230	3226
35°	3261	3121	3101
40°	3153	3009	2983
45°	3046	2898	2862
50°	2928	2781	2721
55°	2804	2646	2592
60°	2664	2485	2444
65°	2511	2318	2269
70°	2316	2115	2080
75°	2048	1872	1904
80°	1722	1561	1570
85°	1214	1033	1024

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3046 cd/sqm

TEST NUMBER: P908560

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	295.9	2.1
10°-20°	832.5	5.8
20°-30°	1223.4	8.6
30°-40°	1420.9	10.0
40°-50°	1419.1	10.0
50°-60°	1237.5	8.7
60°-70°	914.7	6.4
70°-80°	517.6	3.6
80°-90°	143.0	1.0
90°-100°	138.3	1.0
100°-110°	439.6	3.1
110°-120°	752.2	5.3
120°-130°	989.3	6.9
130°-140°	1110.5	7.8
140°-150°	1088.9	7.6
150°-160°	913.5	6.4
160°-170°	605.8	4.2
170°-180°	211.7	1.5
0°-30°	2351.8	16.5
0°-40°	3772.7	26.5
0°-60°	6429.3	45.1
0°-90°	8004.5	56.2
90°-120°	1330.1	9.3
90°-150°	4518.8	31.7
90°-180°	6250.0	43.8
0°-180°	14254.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3144	3144	3144	3144	3144	
5°	3144	3132	3098	3122	3117	298
15°	2992	2975	2935	2947	2932	843
25°	2708	2684	2633	2639	2633	1246
35°	2337	2306	2258	2240	2225	1459
45°	1902	1880	1835	1802	1790	1467
55°	1439	1421	1384	1348	1333	1287
65°	970	952	922	895	880	959
75°	508	502	487	469	475	542
85°	124	121	118	109	106	138
90°	2	24	66	62	64	14
95°	98	117	121	121	117	109
105°	406	411	415	419	419	428
115°	755	766	762	760	755	747
125°	1098	1115	1109	1103	1101	981
135°	1420	1441	1445	1443	1438	1098
145°	1724	1738	1748	1750	1743	1077
155°	1972	1977	1983	1992	1986	907
165°	2145	2143	2143	2156	2147	605
175°	2232	2226	2222	2236	2224	212
180°	2236	2236	2236	2236	2236	

TEST NUMBER: P908560

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3143.5	3143.5	3143.5	3143.5	3143.5
2.5°	3161.8	3146.7	3113.4	3143.5	3137.8
5°	3143.5	3131.7	3098.4	3122.4	3116.6
7.5°	3122.4	3104.4	3071.1	3095.4	3089.4
10°	3089.4	3068.2	3031.9	3056.0	3047.1
12.5°	3043.8	3025.9	2989.6	3004.7	2998.6
15°	2992.5	2974.6	2935.1	2947.3	2932.2
17.5°	2929.0	2911.0	2871.6	2886.7	2871.6
20°	2859.4	2841.5	2799.1	2808.1	2796.2
22.5°	2790.2	2762.9	2723.4	2723.4	2717.3
25°	2708.4	2684.3	2633.0	2638.8	2633.0
27.5°	2617.6	2596.5	2557.3	2548.3	2533.2
30°	2527.2	2502.7	2457.6	2448.6	2436.4
32.5°	2430.3	2412.4	2363.9	2345.6	2333.5
35°	2336.6	2306.5	2258.1	2239.8	2224.7
37.5°	2230.8	2203.5	2155.2	2133.9	2118.9
40°	2122.1	2097.7	2049.3	2022.4	2010.1
42.5°	2016.3	1991.9	1943.8	1913.3	1895.4
45°	1901.5	1880.3	1834.7	1801.7	1789.6
47.5°	1789.6	1768.4	1719.9	1686.6	1668.6
50°	1671.5	1656.5	1614.1	1571.8	1556.7
52.5°	1556.7	1535.5	1496.4	1463.1	1441.9
55°	1439.0	1420.7	1384.5	1348.3	1333.1
57.5°	1321.0	1306.0	1266.5	1230.2	1218.0
60°	1203.0	1191.1	1148.7	1115.4	1106.4
62.5°	1088.1	1067.0	1036.8	1006.7	994.5
65°	970.5	952.2	922.0	894.7	879.7
67.5°	849.5	834.1	807.2	786.1	773.9
70°	737.6	725.4	698.2	677.0	665.1
72.5°	622.8	610.7	595.5	574.4	565.4
75°	507.7	501.9	486.6	468.6	474.6
77.5°	405.1	392.8	386.8	377.8	368.8
80°	302.5	299.2	293.2	284.2	278.0
82.5°	205.6	205.6	202.7	190.5	190.5
85°	123.8	120.9	118.1	108.8	105.8
87.5°	54.5	48.5	42.3	33.3	30.2
90°	2.0	24.2	66.0	62.0	64.0
92.5°	41.8	56.7	58.7	60.7	60.7
95°	98.4	117.2	120.7	120.7	117.2
97.5°	163.8	181.3	188.7	188.7	188.7
100°	239.2	254.8	260.1	260.1	258.1
102.5°	318.8	330.2	337.7	339.7	337.7
105°	405.8	411.1	415.2	418.6	418.6
107.5°	492.0	500.1	500.1	501.5	492.0
110°	575.6	586.4	586.4	586.4	581.0

TEST NUMBER: P908560

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	665.9	677.4	675.4	669.9	665.9
115°	754.9	765.7	762.3	760.3	754.9
117.5°	843.1	858.0	848.6	843.1	837.8
120°	932.1	947.0	932.1	932.1	926.0
122.5°	1013.0	1031.9	1022.5	1017.0	1013.0
125°	1097.9	1114.8	1109.4	1103.4	1101.4
127.5°	1180.8	1201.7	1194.4	1186.3	1180.8
130°	1258.4	1282.6	1279.3	1275.3	1267.8
132.5°	1345.3	1364.2	1365.5	1356.1	1350.7
135°	1420.2	1441.0	1445.1	1443.0	1437.6
137.5°	1503.7	1520.6	1523.9	1522.6	1514.5
140°	1577.2	1594.1	1603.5	1603.5	1596.1
142.5°	1652.6	1669.5	1674.9	1676.9	1669.5
145°	1724.1	1737.6	1748.4	1750.4	1743.0
147.5°	1788.2	1805.0	1813.1	1816.4	1809.1
150°	1854.2	1865.6	1873.1	1879.2	1873.1
152.5°	1912.8	1924.3	1933.7	1941.2	1933.7
155°	1971.5	1976.8	1983.0	1992.4	1986.3
157.5°	2022.1	2026.1	2029.4	2043.0	2033.5
160°	2067.2	2071.2	2073.3	2084.7	2076.6
162.5°	2109.0	2109.0	2111.0	2123.7	2114.4
165°	2144.7	2142.6	2142.6	2156.2	2146.7
167.5°	2177.1	2171.0	2171.0	2184.4	2175.0
170°	2201.3	2196.0	2193.9	2207.4	2196.0
172.5°	2218.2	2212.7	2210.7	2224.2	2212.7
175°	2231.6	2226.2	2222.2	2235.6	2224.2
177.5°	2239.1	2233.6	2229.6	2241.1	2229.6
180°	2235.6	2235.6	2235.6	2235.6	2235.6

TEST NUMBER: P908560

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.30	13.22	13.21	14.15	15.33	11.86	12.78	12.77	13.71	14.89
	3H	13.96	14.79	14.88	15.72	16.92	13.48	14.30	14.39	15.24	16.44
	4H	14.55	15.33	15.48	16.27	17.48	14.06	14.84	14.99	15.78	16.99
	6H	14.95	15.67	15.89	16.61	17.84	14.46	15.18	15.40	16.12	17.35
	8H	15.05	15.74	16.00	16.70	17.92	14.56	15.25	15.51	16.21	17.43
	12H	15.10	15.75	16.05	16.70	17.96	14.60	15.25	15.56	16.21	17.46
4H	2H	12.77	13.55	13.70	14.49	15.70	12.42	13.20	13.35	14.13	15.35
	3H	14.63	15.28	15.58	16.25	17.48	14.23	14.88	15.18	15.85	17.08
	4H	15.34	15.94	16.30	16.90	18.15	14.93	15.52	15.88	16.48	17.74
	6H	15.86	16.37	16.82	17.36	18.61	15.43	15.95	16.40	16.93	18.19
	8H	16.01	16.48	16.97	17.46	18.73	15.58	16.06	16.55	17.04	18.30
	12H	16.08	16.51	17.07	17.51	18.78	15.64	16.07	16.63	17.07	18.34
8H	4H	15.54	16.02	16.51	17.00	18.27	15.17	15.65	16.14	16.63	17.90
	6H	16.17	16.56	17.16	17.58	18.85	15.79	16.19	16.79	17.21	18.47
	8H	16.38	16.74	17.39	17.74	19.03	16.00	16.35	17.01	17.36	18.64
	12H	16.51	16.82	17.52	17.83	19.16	16.12	16.42	17.12	17.43	18.76
12H	4H	15.53	15.96	16.52	16.96	18.23	15.17	15.60	16.16	16.60	17.87
	6H	16.20	16.55	17.20	17.56	18.84	15.83	16.18	16.84	17.19	18.48
	8H	16.44	16.74	17.44	17.75	19.08	16.07	16.37	17.07	17.38	18.71

END OF REPORT